


SINGLE MII ELEC. WATER HEATER
WITH TOP CONNECTIONS AND RETURN
CIRCULATION THROUGH DRAIN VALVE

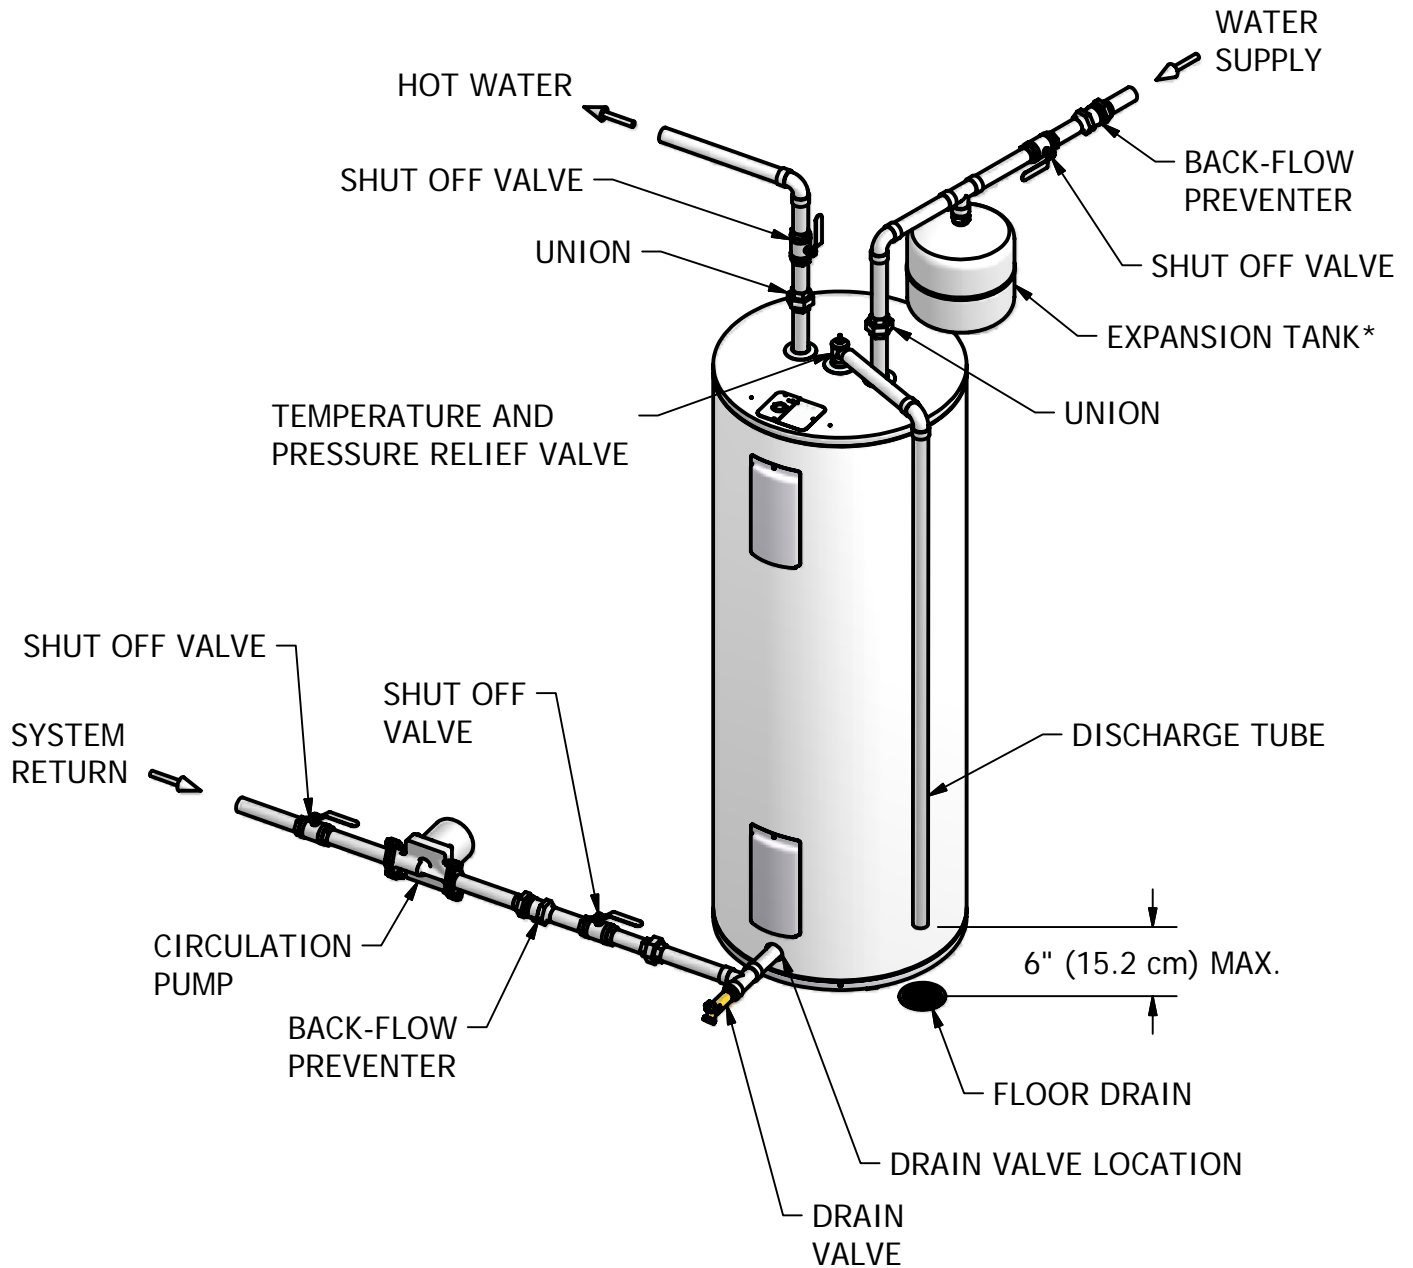

*EXPANSION TANK REQUIRED TO MINIMIZE ANY PRESSURE BUILD UP IF THE WATER SUPPLY PIPING HAS A BACK-FLOW PREVENTER, CHECK VALVE OR WATER METER WITH A CHECK VALVE.