

# Multi 9™ System Catalog

Catalog  
 0860CT0201 R02/14  
**2014**  
 Class 860



**CONTENTS**

Description .....	Page
Introduction .....	7
UL® and CSA® Rated Protection Devices .....	14
IEC 60947-2 Rated Protection Devices .....	24
Ground-Fault Protection Devices .....	35
Accessories .....	44
Additional System Devices .....	64
Dimensions .....	72
Applications .....	84
Time/Current Curves .....	91
Let-Through Curves .....	96
Index of Part Numbers .....	103



## Table of Contents

<b>SECTION 1: INTRODUCTION</b>	7
Multi 9™ Products for Equipment Applications	7
System Flexibility	7
Advantages	8
Conformance to Standards	9
Overview	9
UL 489/CSA C22.2 No.5 Standard—Branch Circuit Protection	9
UL 1077 Standard—Supplementary Protection within the Product	10
Comparing Terminology for UL 489/CSA C22.2 No.5 and 1077 Standards	11
UL 489A Standard—DC Telecommunication Applications	12
UL 486 Standard—Connection Terminals	12
IEC 60947-2 Standard	12
IEC 60898 Standard	12
CSA C22.2 Standard	12
CCC Mark	12
UL 508 Standard—Manual Motor Controllers	12
<b>SECTION 2: UL® AND CSA® RATED PROTECTION DEVICES</b>	14
UL 489/CSA C22.2 No.5 Listed 240 Vac C60 Circuit Breakers (AC)	16
Standard Features	16
Connections	17
Standards	17
Catalog Numbers	18
UL 489/CSA C22.2 No. 5 Listed 480Y/277 Vac C60 Circuit Breakers (AC)	19
Benefits	19
Standard Features	19
Connections	20
Standards	20
Catalog Numbers	20
UL 489/CSA C22.2 No. 5 Listed C60 Circuit Breakers (DC)	21
Overview	21
Catalog Numbers	21
UL 1077 Recognized C60 Supplementary Protectors	22
Standards	22
Standard Features	23
Catalog Numbers	23
<b>SECTION 3: IEC 60947-2 RATED PROTECTION DEVICES</b>	24
DPN-N Phase + Neutral Circuit Breakers	25
Time/Current Curves	25
Accessories	25
Standards	25
Catalog Numbers	26
IEC Rated C60 Miniature Circuit Breakers	27
Standard Features	27
Catalog Numbers	28
Catalog Numbers	29
Catalog Numbers	30
C60L Instantaneous Circuit Breakers (Icb) (Curve MA)	31
Coordination of C60L-MA Circuit Breaker, Thermal Relay and Contactor	31
IEC Rated C120H Circuit Breakers	33
Standard Features	33

Accessories .....	34
Standards .....	34
Catalog Numbers .....	34
<b>SECTION 4: GROUND-FAULT PROTECTION DEVICES .....</b>	<b>35</b>
Selection Table .....	35
UL 1053 Listed GFP Ground Fault Protectors .....	36
Standards .....	36
Catalog Numbers .....	37
IEC Rated ID Residual Current Switches .....	38
Standards .....	39
Catalog Numbers .....	39
IEC Rated C60 Vigi™ Modules for Ground-fault Protection .....	40
Accessories .....	41
Standards .....	41
Catalog Numbers .....	41
IEC Rated C120 Vigi Residual Current Circuit Breakers .....	42
Standards .....	42
Catalog Numbers .....	42
DPN-N Vigi Residual Current Circuit Breaker .....	43
Function .....	43
Catalog Numbers .....	43
Standards .....	43
<b>SECTION 5: ACCESSORIES .....</b>	<b>44</b>
Technical Data .....	45
Breaking Capacity .....	45
Endurance .....	45
Dimensions .....	45
Weight .....	46
Electrical Auxiliaries .....	46
MN Undervoltage Release .....	47
MN Time-delayed Undervoltage Release .....	47
MX + OF Shunt Trip and Auxiliary Switch .....	48
OF Auxiliary Switch .....	48
OFS Auxiliary Switch and Adapter (for GFP and ID RCD) .....	48
SD Alarm Switch .....	49
Comb Bus Bars .....	50
UL Recognized C60 Comb Bus Bars .....	50
Tooth Caps for UL Recognized Comb Bus Bars .....	50
Connection Comb Bus Bars for C60 UL 1077 Circuit Breakers .....	51
Connection Comb Bus Bars for C60 UL489 Circuit Breakers .....	52
IEC Rated C60 Comb Bus Bars .....	53
End Caps for IEC Rated C60 Comb Bus Bars .....	54
Connector for IEC Rated Comb Bus Bars .....	54
Tooth Caps for IEC Rated Comb Bus Bars .....	54
Device Shielding .....	54
DIN Rail Spacer .....	54
Terminal Screw Shields .....	55
Terminal Covers .....	55
Ring Lug Terminal Kit .....	55
Identification System .....	56
Snap-on Marking Symbols .....	56
Operation Devices .....	57
Rotary Handles .....	57
Padlock Attachments .....	57
Mounting Accessories .....	59
Plug-in Base .....	59

Front Mounting Bracket (Kit) .....	59
DIN Rail Mounting Clips .....	60
UL/CSA Recognized Mounting Base for Multi 9 C60 Circuit Breakers .....	60
US Mounting Base Accessories .....	61
Wire Lug Kit .....	61
MSC IEC Mounting Base .....	62
Multi-Pole Front Mounting Kit .....	63
Pole Filler .....	63
<b>SECTION 6: ADDITIONAL SYSTEM DEVICES .....</b>	<b>64</b>
CM Selector Switches .....	64
I Current Isolating Switch .....	66
Status, Display and Control Accessories .....	67
V Signal Lamp .....	67
BP Push Buttons .....	68
CH Hour Counter .....	69
CI Impulse Counter .....	69
Kaedra™ Weatherproof DIN Type Enclosures .....	70
Applications .....	70
Standard Features .....	70
Construction .....	70
Installation .....	70
Accessories .....	71
<b>SECTION 7: DIMENSIONS .....</b>	<b>72</b>
UL 489/CSA C22.2 No. 5 Listed C60 Circuit Breakers .....	72
UL 1077 Supplementary Protectors .....	73
IEC Rated Circuit Breakers .....	73
UL and IEC Rated Ground-Fault Products .....	74
Accessory Dimensions .....	75
Kaedra Weatherproof Mini-Enclosure Dimensions .....	81
Kaedra Weatherproof Enclosures .....	82
<b>SECTION 8: APPLICATIONS .....</b>	<b>84</b>
Degree of Protection (IP) .....	84
Vibration .....	85
Mechanical Shock (IK) .....	85
Protection of 400 Hz Circuits .....	85
Temperature Rating .....	86
Typical IEC Grounding Systems .....	89
Codification of the Grounding Systems .....	89
The TT Grounded Neutral System .....	89
The IT Grounding System .....	90
The TN-S Grounding System .....	90
<b>SECTION 9: TIME/CURRENT CURVES .....</b>	<b>91</b>
UL 489/CSA C22.2 No. 5 & UL 489A Listed C60 Miniature Circuit Breakers .....	91
UL 1077 Recognized Supplementary Protectors .....	92
IEC60947-2 Rated D PN-N Circuit Breakers .....	93
Alternative Current 50/60 Hz .....	94
Motor Curve .....	95
<b>SECTION 10: LET-THROUGH CURVES .....</b>	<b>96</b>
UL Listed C60 Miniature Circuit Breakers and UL Recognized C60 Supplementary Protectors .....	96

# Multi 9™ System Catalog

Limitation curves ..... 100

**INDEX OF PART NUMBERS ..... 103**

## Section 1—Introduction

### Multi 9™ Products for Equipment Applications

Multi 9 modular system of miniature circuit breakers and supplementary protectors, accessories, and peripherals provides protection of equipment or especially sensitive circuits within the equipment. Installation labor and space are both minimized by the modular architecture of the Multi 9 system, whether a single protective device or multiple devices with their accessories are being used.

Schneider Electric offers an extensive line of UL 489/CSA C22.2 No.5 Circuit Breakers and UL 1077 Supplementary Protectors. In addition, a variety of IEC certified Circuit Breakers and Accessories are available for an original equipment manufacturer (OEM) whose products are destined for export beyond North America. To an OEM, this means that one family of electrical protection products can be used regardless of equipment destination.

The Standards include:


- UL 489 Standard for Circuit Breakers
- UL 489A Standard for DC Communication Applications
- UL 1077 Standard for Supplementary Protectors
- UL 1053 Ground Fault Sensing and Relaying Equipment
- IEC 60947-2 Low-voltage switchgear and controlgear - Part 2: Circuit-breakers
- CSA C22.2 No. 5 Standard for Circuit Breakers
- CSA C22.2 No. 235 Supplementary Protectors
- CCC Pending
- C60 Miniature Circuit Breakers are RoHS Compliant

Potential applications include semi-conductor machines, communication equipment, process control panels, computers, medical equipment, electronic controls, transformers, power supplies, and other electrical equipment.

### System Flexibility

The Multi 9 System includes an extensive line of field-installable accessories. Plug-on electrical auxiliaries include shunt trip, undervoltage release, auxiliary switch, and alarm switch. Other protection devices include residual current devices, dc circuit breakers, and switches. Control and display devices include signal lamps, push buttons, and motor operators. There are also mechanical accessories for locking, operating, shielding, mounting, etc. The following diagram shows many of the Multi 9 system accessories.

**Figure 1: Functional Diagram of Multi 9 System**

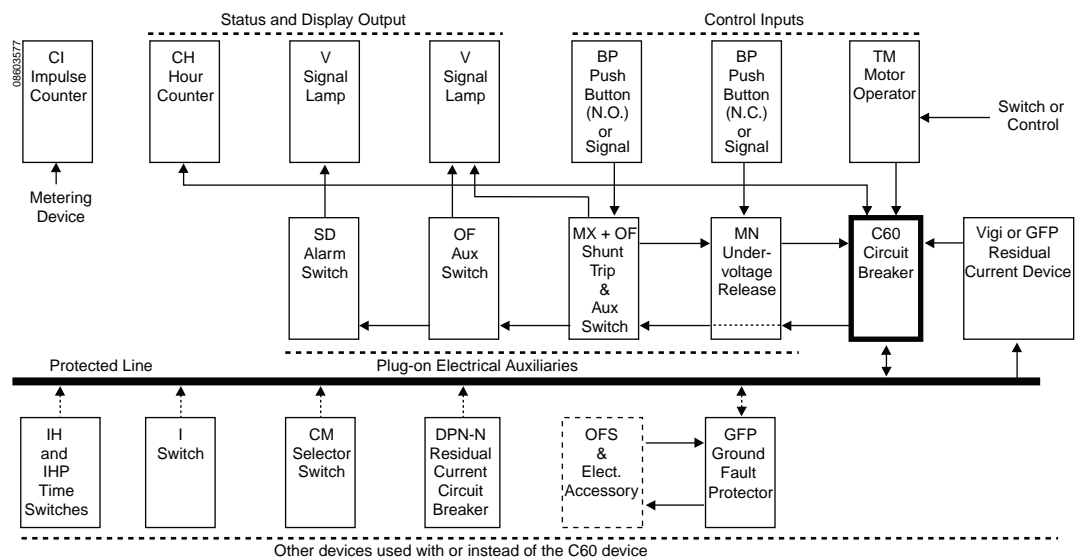

# Multi 9™ System Catalog

## Section 1—Introduction

### Advantages

Multi 9 C60 circuit breakers and supplementary protectors provide several features which are important to OEMs. These include:

- Small, compact size
- Easy installation on DIN rails
- Limits let-thru current
- Resetability, more convenient than fuses
- Electrical auxiliaries for control and status information
- Extensive variety of accessories

**Figure 2: UL 489/CSA C22.2 No. 5 Listed Multi 9 C60 Circuit Breakers**



**Better Protection**—Multi 9 supplementary protectors and miniature circuit breakers limit let-through current, providing faster separation of the component from the fault, thereby reducing system damage.

**More Selection**—More ratings compatible with low-power electronic circuits are available in the range from 0.5 to 10 A. Others are provided in convenient steps, up to 63 A for the C60 products.

**Reduction of Nuisance Tripping**—Available with different trip characteristics to meet system needs: B, C and D curves, depending on the model.

**Panel Space Savings**—Multi 9 products are compact. Width per pole is only 0.71 in. (18 mm) for the C60 circuit breaker. All of the products are built in a consistent format with incremental widths of 0.35 in. (9 mm) (therefore the name Multi 9).

**Simple Installation**—The Multi 9 products mount easily onto a 35 mm DIN mounting rail. Large box lug terminals (pressure plate type) are suitable for use with copper wiring up to 2 AWG for C60 circuit breakers and supplemental protectors.

**Reverse Feeding**—Reverse feeding of line power is permitted.

**Reliability**—Each C60 miniature circuit breaker has an endurance of 10,000 operation cycles and voltage withstand of 6000 V impulse rating.

**World-Wide Availability**—The Multi 9 products are available and supported throughout the world by Schneider Electric.

**From the Power Distribution Specialists**—Schneider Electric can be your single source of protection equipment, with a comprehensive line of products for OEM products or the factory. In addition to the Multi 9 circuit breakers and supplementary protectors, these products include the following:

- QO® and QOU Miniature Circuit Breakers 10–125 A
- Compact® Molded Case Circuit Breakers 15–3200 A
- Powerpact® Molded Case Circuit Breakers 15–3000 A
- Masterpact® Universal Power Circuit Breakers 250–6300 A



## Conformance to Standards

### Overview

Multi 9 circuit protection products conform to the standards most needed by OEMs—UL 489/CSA C22.2 No.5, UL 1077, CSA C22.2 No. 235, and IEC 60947-2.

Different applications call for circuit protection devices that meet different standards. The Multi 9 family allows OEMs to use a single family of products in their equipment, whether it is destined for the United States, Canada or an international market outside of North America. A variety of Multi 9 devices are tested per Underwriters Laboratories® (UL®) and Canadian Standards Association® (CSA®) Standards as required by the National Electrical Code® (NEC®) in the United States and the Canadian Electrical Code (CEC) in Canada. They are also tested per the standards of the International Electrotechnical Commission® (IEC®) and may therefore be used in International Markets where these products meet the requirements.

In this catalog, the products are grouped by the standards they are designed to meet, including:

- UL 489—Defines rigorous testing requirements for circuit breakers in the United States
- CSA C22.2 No. 5—Defines rigorous testing requirements for circuit breakers in Canada
- CSA C22.2 No. 235—Defines requirements for supplementary protectors
- UL 489A—Limited applications (dc circuits in communications equipment)
- UL 1077—Defines supplementary protectors for use within electrical equipment protected by branch circuit breakers
- IEC 60947-2—International standards for circuit breakers to be used in industrial applications

### UL 489/CSA C22.2 No.5 Standard—Branch Circuit Protection

An OEM product as a whole must be appropriately protected from overcurrent conditions, either by connection in the field to a protected branch circuit (in accordance with NEC) or by inclusion of branch circuit protection within the product itself. In the United States, these branch circuit protection devices must comply with the UL 489/CSA C22.2 No.5 Standard for Molded-Case Circuit Breakers. (see UL 489/CSA C22.2 No.5 No. 1 in Figure 3, which is a drawing of a hypothetical piece of OEM equipment requiring multiple protection devices.)

#### Applications Requiring UL 489/CSA C22.2 No.5 Listed Circuit Breakers

In some instances, the protective devices being installed in equipment must comply with UL 489/CSA C22.2 No.5. These include the following situations:

1. If a circuit such as a convenience receptacle could leave the equipment, that circuit must be protected by a UL 489/CSA C22.2 No.5 branch circuit protection device (see UL 489/CSA C22.2 No.5 No. 2).
2. If a circuit such as to an external motor could leave the equipment, that circuit must be protected by a UL 489/CSA C22.2 No.5 branch circuit protection device (see UL 489 No. 3).
3. Motors within the equipment should also be protected by a UL 489/CSA C22.2 No.5 device (see UL 489 No. 4).
4. All equipment which requires HACR (Heating, Air Conditioning, and Refrigeration) rating must be protected by a UL 489/CSA C22.2 No.5 branch circuit protection device (see UL 489 No. 5).

**NOTE:** The motor control circuit may be protected by a UL 1077 device. *It must also have over current protection even though there is a UL 1077 device downstream.*

In general, a UL 489/CSA C22.2 No.5 circuit breaker could also be used in any application for which a UL 1077 device is allowed, since the UL 489/CSA C22.2 No.5 devices meet or exceed the requirements of UL 1077 devices. The converse of this is not true, since UL 1077 devices cannot meet the more stringent UL 489/CSA C22.2 No.5 Standard.

**UL 1077 Standard—Supplementary Protection within the Product**

Within the OEM product itself, additional (supplementary) protection for sensitive or critical internal circuitry may be provided by one or more supplementary circuit protectors. A supplementary protector is an overcurrent protection device which is specifically designed for OEM applications and which complies with UL 1077 Standard for Supplementary Protectors for Use in Electrical Equipment.


Under UL 1077, supplementary protectors may be used under the following conditions:

- When branch overcurrent protection is already provided
- If short-circuit protection is needed for sensitive devices within the equipment
- When wiring connected to the supplementary protector does not exit the equipment to external devices such as receptacles or motors
- If the UL 1077 device does not provide the only means of disconnecting the product

The following applications illustrated in Figure 3 allow the use of UL 1077 supplementary protectors:

- The supplementary protection is used to supplement or provide additional protection to sensitive components inside the equipment (see UL 1077 No. 1). A UL 489/CSA C22.2 No.5 circuit breaker must be located upstream from the equipment.
- Critical or sensitive internal circuitry (see UL 1077 No. 2) such as: Computers and microprocessors, communications equipment, electronic controllers, power supplies and many other types of equipment
- Motor control circuits may be protected by a UL 1077 device, unless the circuit includes a transformer (in which case a UL 489/CSA C22.2 No.5 device is required).

Figure 3: Guidelines for Application of UL 489/CSA C22.2 No.5 Circuit Breakers and UL 1077 Supplementary Protectors

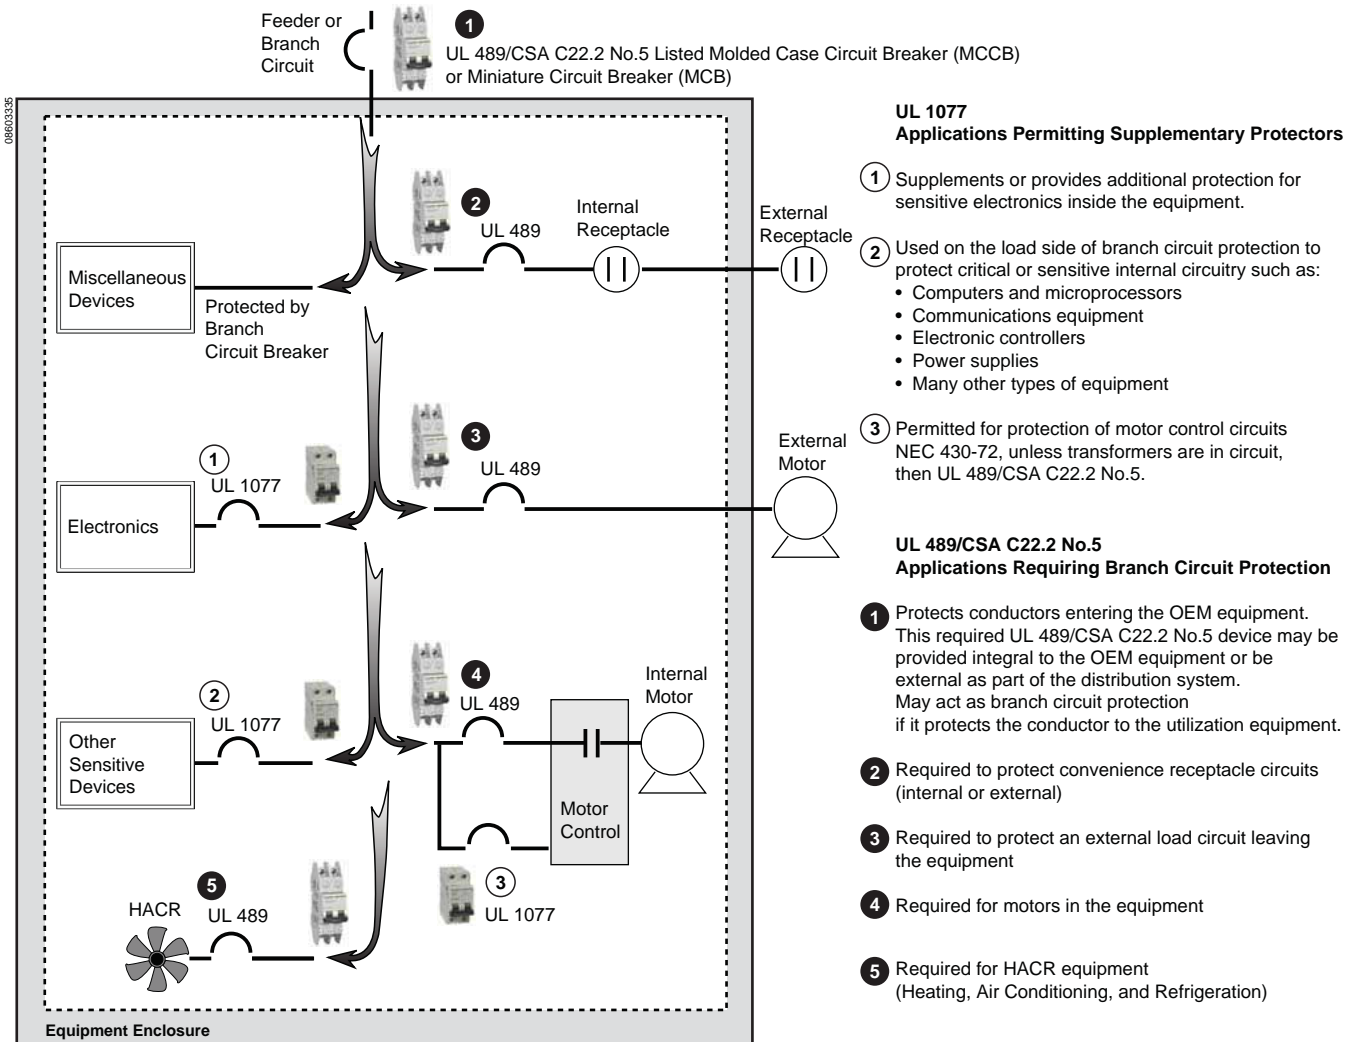


**NOTE:** This is a simplified summary of the standards. Refer to applicable codes for specific applications.


### Comparing Terminology for UL 489/CSA C22.2 No.5 and 1077 Standards

The terms used to differentiate these products can cause confusion if a user is not careful. Misapplying the terms may result in misapplication of the products.

Any one of the following terms can be used to identify supplementary protectors:

- Supplementary protector
- UL Recognized
- UL 1077
- The UL symbol 

Any of the following terms can be used to identify circuit breakers:

- Circuit breaker
- UL Listed
- UL 489/CSA C22.2 No.5
- The UL symbol 

### **UL 489A Standard—DC Telecommunication Applications**

The UL 489A Standard covers dc rated circuit breakers intended to provide branch circuit protection in telecommunications equipment. The products are marked as UL Listed circuit breakers for use in telecommunication equipment.

### **UL 486 Standard—Connection Terminals**

The UL 486 Standard applies to compression wiring connection terminals. It is a requirement for connections of a UL 489/CSA C22.2 No.5 circuit breaker. Although it is not a requirement for UL 1077 Recognized devices, UL 486 Rated terminals are included on those Multi 9 products. This allows the user to apply field wiring directly to any of these devices, without using intermediate, UL rated terminal blocks.

The connectors on Multi 9 devices are Rated UL 486A-B, which applies to copper conductors.

These standards apply to field-wired terminals that are an integral part of the equipment. Criteria includes static heating tests, secureness tests, and pull-out tests.

### **IEC 60947-2 Standard**

In countries which follow the IEC Standards, IEC 60947-2 is used for most industrial applications of circuit protection. IEC 60947-2 does not distinguish between the two levels of protection equivalent to UL 489/CSA C22.2 No.5 circuit breakers and 1077 supplementary protectors. Therefore, in equipment like that illustrated in figure 3, if IEC guidelines apply, then all of the devices could be selected from the IEC Rated portion of this catalog.

### **IEC 60898 Standard**

The IEC 60898 Standard is less stringent than 60947-2. It applies primarily to residential applications of circuit breakers in countries adhering to IEC Standards, and is not generally applicable to OEMs.

### **CSA C22.2 Standard**

The CSA (Canadian Standards Association) C22.2 Standards closely correspond to the UL Standards: CSA C22.2 No. 5-02 (harmonized to UL 489/CSA C22.2 No.5) and CSA C22.2 No. 235 (equivalent to UL 1077). All UL rated devices also have the corresponding CSA rating, unless otherwise noted.

### **CCC Mark**



#### **CCC Mark**

The China Compulsory Certification (CCC) mark is a new safety and quality mark system. Compulsory Product Certification System (CPCS) prohibits the sale or importation of equipment under the scope of the law that does not bear the CCC Mark issued by a Designated Certification Body (DCB). The CCC Mark covers both safety and Electromagnetic compatibility.

The CPCS regulates twenty-two different product groups, which include the following:

Electrical wires and cables; switches for circuits, installation protective and connection devices; low-voltage electrical apparatus; small power motors; electric tools; welding machines; household and similar electrical appliances; audio and video apparatus; information technology equipment; lighting apparatus; telecommunications terminal equipment; motor vehicles and safety parts; motor vehicle tires; safety glass; agricultural machinery; latex products; medical devices; fire fighting equipment; detectors for intruder alarm systems; wireless local area network equipment; security and protection equipment; and decoration and renovation products.

### **UL 508 Standard—Manual Motor Controllers**

UL Standard 508 covers industrial control equipment, specifically for motor control functions. It covers individual devices as well as assemblies.

There are UL 508 Listed manual motor controllers that look much like miniature circuit breakers, and have thermal settings and instantaneous settings similar to circuit breakers. These are specialized devices and cannot be used for a wide range of applications, as can UL 1077 and UL 489/CSA C22.2 No.5 devices.

Like UL 1077 supplementary protectors, a UL 508 Listed manual motor controller (or a group of them) must be protected by a UL 489/CSA C22.2 No.5 Listed branch circuit breaker.

Manual motor controllers are available from Schneider Electric (Telemecanique products GV2 and GV3) but are not included in this catalog.

**Table 1: Comparison Summary of Applicable UL and IEC Standards**

Characteristic	UL 489/CSA C22.2 No. 5	UL 1077/CSA C22.2 No. 235	IEC 60947-2
Labeling	UL Listed	UL Recognized component	IEC Certified device
Nomenclature	Circuit breakers	Supplementary protectors	Circuit breakers or supplementary protectors
Dielectric test (for 240 Vac)	2 times rated plus 1000 V for 1 minute (1,480 at 240 Vac)	2 times rated plus 1,000 V for 1 minute (1,480 at 240 Vac)	1,500 V
Interrupting rating	10 kA at 240 Vac	10 kA at 240 Vac	20 kA at 240 Vac
Overload protection	50 operations at 600% rating	50 operations at 150% rating	12 operations at 600% rating
Service capacity	Must be operational after two interruptions	May be tested in series with branch circuit device and may become inoperable after test	Must be operational after two interruptions
Calibration test	200% I <sub>n</sub> , 2 minutes max. (0–30 A)	Per manufacturer's trip curve	At 200% I <sub>n</sub> , time shall not exceed manufacturer's stated value
Calibration temperature	25°C (77°F), unless other value specified by manufacturer	Manufacturer must specify	Manufacturer must specify
Testing temperature	25°C (77°F) ambient, 50°C (122°F) rise max. at terminals	25°C (77°F) ambient, 50°C (122°F) rise max. at field wiring terminals; 65°C (149°F) rise max. on factory wiring terminals	At 25°C (77°F) ambient, 80°C (176°F) rise max. at terminals
Endurance	6000 operations at rated current and voltage, 75-80% PF, plus 4000 operations at no load	6000 operations at rated current and voltage, 75-80% PF	1500 operations at rated current and voltage, 75-80% PF
Air spacing	3/4 in. (20.1 mm)	3/8 in. (9.53 mm)	See dielectric
Surface spacing	1-1/4 in. (31.8 mm)	1/2 in. (12.7 mm)	See dielectric
Test and follow up tests	Initial, periodic and quarterly follow-up tests observed by UL representative	Initial tests observed by UL representative, plus quarterly visual follow-up inspection by UL	Conducted by manufacturer

**Section 2—UL® and CSA® Rated Protection Devices**

The Multi 9 system includes several families of miniature circuit protection devices that have the UL ratings required in the United States and some other countries. The products are summarized below and are described in detail on the following pages. They include the following families:

- UL Listed C60 240 V Circuit Breakers (UL 489/CSA C22.2 No.5)
- UL Listed C60 480 V Circuit Breakers (UL 489/CSA C22.2 No.5)
- UL Listed C60 Circuit Breakers for use in Communication Equipment (UL 489A) not CSA certified
- UL Recognized C60 Supplementary Protectors (UL 1077 and CSA C22.2 No. 235)

**NOTE:** Protection devices with only IEC ratings are described in Section 3, while accessories for both the UL and IEC devices are described in Section 5.

**Table 2: Specifications for UL 489/CSA C22.2 No.5 Circuit Breakers**

Ratings per UL Standards		UL 489/CSA C22.2 No.5 C60 (240 Vac)				UL 489/CSA C22.2 No.5 C60 (480Y/277 Vac)			
		1P		2P	3P	1P	2P	3P	
Number of Poles		0.5–20 A		25–35 A	0.5–35 A	0.5–35 A	0.5–20 A	1–20 A	1–20 A
Rated Current at 77°F (25°C)		0.5–20 A		25–35 A	0.5–35 A	0.5–35 A	0.5–20 A	1–20 A	1–20 A
Interrupting Ratings as per UL 489/CSA C22.2 No.5	AC 50/60 Hz	120 V	10 kA	10 kA	—	—	10 kA	—	—
		240 V	10 kA	5 kA	10 kA	10 kA	10 kA	10 kA	10 kA
		277 V	—	—	—	—	10 kA	10 kA	10 kA
		480Y/277 V	—	—	—	—	—	10 kA	10 kA
DC	60 V	10 kA		10 kA	—	—	—	—	
	125 V	—		10 kA	—	—	—	—	
Ultimate Breaking Capacity ( $I_{cu}$ ) as per IEC 60947-2	AC 50/60 Hz	240 V	10 kA	20 kA	20 kA	10 kA	10 kA	10 kA	
		415 V	10 kA	10 kA	10 kA	10 kA	10 kA	10 kA	
		440 V	—	6 kA	6 kA	—	6 kA	6 kA	
Service Breaking Capacity ( $I_{cs}$ ) (% $I_{cu}$ )		75%	75%	75%	75%	75%	75%	75%	
Magnetic Setting (Times Ampere Rating)	B curve	—				—			
	C curve	7 to 10				7 to 10			
	D curve	10 to 14				10 to 14			
Dimensions (in./mm)	Width	0.71/18	0.71/18	1.42/36	2.13/54	0.71/18	1.42/36	2.13/54	
	Height	box/box	4.21/107	4.21/107	4.21/107	4.21/107	5.56/141	5.56/141	5.56/141
		ring/ring <sup>1</sup>	4.86/123.4	4.86/123.4	4.86/123.4	4.86/123.4	5.56/141	5.56/141	5.56/141
		box/ring	4.54/115	4.54/115	4.54/115	4.54/115	—	—	—
Depth	3.00/76	3.00/76	3.00/76	3.00/76	3.00/76	3.00/76	3.00/76		
Weight (oz./g) max.	box/box	4.4/136	4.4/136	8.7/271	13.1/407	5.3 (166)	10.6/332	15.9 (498)	
	ring/ring	5.2/161	5.2/161	10.3/321	15.5/482	5.3 (166)	10.6/332	15.9 (498)	
	box/ring	4.8/148	4.8/148	9.5/297	14.3/445	—	—	—	

<sup>1</sup> Fingersafe 240 V C60 circuit breaker ring terminal dimensions are same as the 480 V C60 circuit breaker.

**Multi 9™ System Catalog**  
**Section 2—UL® and CSA® Rated Protection Devices**

**Figure 4: UL 1077 Recognized C60 Supplementary Protectors**



**Table 3: Specifications for UL 1077 Recognized Supplementary Protectors**

Ratings per UL Standards			UL 1077 C60			
Number of Poles			1P	2P	3P	4P
Rated Current at 77°F (25°C)			0.5–63 A	0.5–63 A	0.5–63 A	0.5–63 A
Interrupting Ratings as per UL 1077	50/60 Hz	120 Vac 240 Vac 277 Vac 480Y/277 Vac	10 kA 10 kA 5 kA —	— 10 kA — 5 kA	— 10 kA — 5 kA	— 10 kA — 5 kA
	—	65 Vdc 125 Vdc	10 kA —	— 10 kA	— —	— —
Ultimate Breaking Capacity (I <sub>CU</sub> ) as per IEC 60947-2	50/60 Hz	240 Vac	10 kA	20 kA	20 kA	20 kA
		415 Vac 440 Vac	3 kA —	10 kA 6 kA	10 kA 6 kA	10 kA 6 kA
Service Breaking Capacity (I <sub>CS</sub> ) (%I <sub>CU</sub> )			75%	75%	75%	75%
Plug-On Auxiliary Modules with Mechanical Linkage:			MN Undervoltage Trip MX + OF Shunt Trip/Auxiliary Switch OF Auxiliary Switch SD Alarm Switch			
Magnetic Setting	B Curve	Between 3.2 and 4.8 Times Ampere Rating				
	C Curve	Between 7 and 10 Times Ampere Rating (Between 7 and 14 for dc)				
	D Curve	Between 10 and 14 Times Ampere Rating (No DC Rating for D Curve)				
Dimensions (in./mm)	Width	0.71/18	1.42/36	2.13/54	2.84/72	
	Height	3.19/81	3.19/81	3.19/81	3.19/81	
	Depth	3.00/76	3.00/76	3.00/76	3.00/76	
Weight (oz./g)			3.85/110	7.70/220	11.55/330	15.40/440

**UL 489/CSA C22.2 No.5 Listed 240 Vac C60 Circuit Breakers (AC)**

A selected range of Multi 9 circuit breakers rated 240 V are UL 489/CSA C22.2 No.5 Listed. Unlike UL 1077 Supplementary Protectors, these UL 489/CSA C22.2 No.5 circuit breakers can be used for branch circuit protection as required by the National Electrical Code.

As shown in tables 5 and 6 the UL 489/CSA C22.2 No.5 Listed products are available in C and D curves. They include devices ranging from 0.5 to 35 A.

**Figure 5: UL 489/CSA C22.2 No.5 Listed Multi 9 C60 Circuit Breakers**



**Table 4: Specifications for UL 489/CSA C22.2 No.5 240 V Listed C60 Circuit Breakers**

High Voltage Withstand	6 kV	
Connector: Box Lug	Rating	UL 486A File No. E216919 (Use with Copper Wire Only)
	Connection	0.5–25 A: 14–4 AWG (2–25 mm <sup>2</sup> ) Cables Torque to 22 lb-in. (2.48 N•m) 30–35 A: 14–2 AWG (1–35 mm <sup>2</sup> ) Cables Torque to 31 lb-in. (3.52 N•m)
Connector: Ring Tongue	Use Single UL Listed or CSA Certified Insulated Ring Tongue Only	Screw dia. 0.2 in. (5 mm) Torque to 18 lb-in. (2.03 N•m)
	Max Ring Terminal Width	0.54 in. (14 mm)
Mounting	35 mm DIN rail	
Degree of Protection	Case	IP40 as per IEC 529
	Terminals	IP20
Temperatures	Calibration	25°C (77°F)
	Storage	-40 to 80°C (-40 to 176°F)
	Operating	-30 to 70°C (-22 to 158°F)
Plug-On Auxiliary Modules with Mechanical Linkage:	MN Undervoltage Trip	
	MX + OF Shunt Trip/Auxiliary Switch	
	OF Auxiliary Switch	
	SD Alarm Switch	
Tropicalization	Treatment 2	Relative Humidity: 95% at 131°F (55°C)
Number of Operating Cycles	Electrical (O-C)	6,000 load, 4,000 no-load

See specifications Table 2 on page 14 for dimensions, weights and interrupting ratings

**Standard Features**

- Fast closing: Allows increased withstand to the high inrush currents of some loads.
- Trip-free mechanism: Contacts cannot be held in the I-ON position when the C60 circuit breaker is tripped automatically.
- Positive indication of contact disconnect. Green mechanical indication on front face of circuit breaker shows that all poles are open.
- C curve: Overcurrent protection for all application types. Magnetic release operates from 7 to 10 times ampere rating (7 to 14 for DC applications).



## Multi 9™ System Catalog

### Section 2—UL® and CSA® Rated Protection Devices

- D curve: Overcurrent protection for loads with high inrush currents (motors, transformers). Magnetic release operates between 10 and 14 times ampere rating (no dc rating for D curve).
- Suitable for reverse feeding.
- Allows locking in O-OFF position using padlock attachment.

#### Connections

Three versions of field wiring connectors are available for the 240 Vac UL 489/CSA C22.2 No.5 Listed devices:

- Box lug, meeting UL 486A requirements
- Ring tongue terminal with 5 mm screw
- Ring Tongue terminals with Fingersafe (IP20) shrouds

The circuit breakers can be ordered with the following combinations of connectors:

- Line terminal box lug/load terminal box lug
- Line terminal ring tongue/load terminal ring tongue (for fingersafe version, add -F suffix to catalog number)

**Figure 6: Connection Options for 240 Vac UL 489/CSA C22.2 No.5 Listed Devices**



#### Standards

- UL 489 Circuit Breaker: File No. E215117
- Single-pole 15–20 A is UL Listed as SWD (switching duty).
- 1-, 2-, and 3-pole 15–35 A are HID (high intensity discharge) rated.
- CSA C22.2 No. 5.1 Circuit Breakers: File No. 179014
- IEC 60947-2
- CE Marked

# Multi 9™ System Catalog

## Section 2—UL® and CSA® Rated Protection Devices

### Catalog Numbers

**Table 5: Catalog Numbers for C Curve, UL 489/CSA C22.2 No.5 Listed 240 Vac C60 Miniature Circuit Breakers (Box Lug and Ring Tongue Terminal Combinations)**

Rating	1P		2P		3P	
	Box/Box	Ring/Ring <sup>1</sup>	Box/Box	Ring/Ring <sup>1</sup>	Box/Box	Ring/Ring <sup>1</sup>
0.5 A	60100	60200	60134	60234	—	—
1 A	60101	60201	60135	60235	60168	60268
1.5 A	60102	60202	60136	60236	60169	60269
2 A	60103	60203	60137	60237	60170	60270
3 A	60104	60204	60138	60238	60171	60271
4 A	60105	60205	60139	60239	60172	60272
5 A	60106	60206	60140	60240	60173	60273
6 A	60107	60207	60141	60241	60174	60274
7 A	60108	60208	60142	60242	60175	60275
8 A	60109	60209	60143	60243	60176	60276
10 A	60110	60210	60144	60244	60177	60277
13 A	60111	60211	60145	60245	60178	60278
15 A	60112	60212	60146	60246	60179	60279
20 A	60113	60213	60147	60247	60180	60280
25 A	60114	60214	60148	60248	60181	60281
30 A	60115	60215	60149	60249	60182	60282
35 A	60116	60216	60150	60250	60183	60283

<sup>1</sup> IP-20 Fingersafe ring tongue terminals may be ordered with an F suffix (example: 60210F).

**Table 6: Catalog Numbers for D Curve, UL 489/CSA C22.2 No.5 Listed 240 Vac C60 Miniature Circuit Breakers (Line/Load as Box Lug or Ring Tongue Terminals)**

Rating	1P		2P		3P	
	Box/Box	Ring/Ring <sup>1</sup>	Box/Box	Ring/Ring <sup>1</sup>	Box/Box	Ring/Ring <sup>1</sup>
0.5 A	60117	60217	60151	60251	—	—
1 A	60118	60218	60152	60252	60184	60284
1.5 A	60119	60219	60153	60253	60185	60285
2 A	60120	60220	60154	60254	60186	60286
3 A	60121	60221	60155	60255	60187	60287
4 A	60122	60222	60156	60256	60188	60288
5 A	60123	60223	60157	60257	60189	60289
6 A	60124	60224	60158	60258	60190	60290
7 A	60125	60225	60159	60259	60191	60291
8 A	60126	60226	60160	60260	60192	60292
10 A	60127	60227	60161	60261	60193	60293
13 A	60128	60228	60162	60262	60194	60294
15 A	60129	60229	60163	60263	60195	60295
20 A	60130	60230	60164	60264	60196	60296
25 A	60131	60231	60165	60265	60197	60297
30 A	60132	60232	60166	60266	60198	60298
35 A	60133	60233	60167	60267	60199	60299

<sup>1</sup> IP-20 Fingersafe ring tongue terminals may be ordered with an F suffix (example: 60210F).

**NOTE:** UL 489/CSA C22.2 No.5 Listed Multi 9 circuit breakers are calibrated at 25°C (77°F). Please refer to the rating tables (page 87) for applications at temperatures greater than 25°C (77°F).

**NOTE:** The NEC requires that the continuous load applied to the circuit breaker shall not exceed 80% of the circuit breaker ampere rating.

## UL 489/CSA C22.2 No. 5 Listed 480Y/277 Vac C60 Circuit Breakers (AC)

The UL 489/CSA C22.2 No.5 Listed 480Y/277 Vac Multi 9 C60 miniature circuit breakers can be used in 480Y/277 Vac systems. With amperages from 0.5 A to 20 A, they are ideal for fuse replacement, yet carry the UL 489/CSA C22.2 No.5 Listing that is required for branch circuit applications. See specifications in Table 2 on page 14 for dimensions, weights, and interrupting ratings.



**Table 7: Specifications for UL 489/CSA C22.2 No.5 Listed 480Y/277 Vac C60 Circuit Breakers**

Interruption Rating	2P and 3P 1P	480Y/277 V @ 10kA 277 Vac @ 10kA
Amperage	0.5 A through 20 A	
Construction	1P, 2P and 3P	
Magnetic Trip Curves	C-curve D-curve	7 to 10 Times Ampere Rating 10 to 14 Times Ampere Rating
UL 486E Listed Lug	18–16 AWG (1–1.5 mm <sup>2</sup> ), Cu Only Stranded Wire: 14–10 AWG (2–5 mm <sup>2</sup> ), Cu Only Solid or Stranded Wire	Torque to 7 lb-in (0.68 N•m) Torque to 14 lb-in (1.6 N•m)
Ring Tongue Screw	5 mm	Torque to 18 lb-in (2 N•m)
Plug-On Auxiliary Modules With Mechanical Linkage:	MN Undervoltage Trip MX + OF Shunt Trip/Auxiliary Switch OF Auxiliary Switch SD Alarm Switch	
Mounting	35 mm DIN Rail	

See selection Table 2 on page 14 for dimensions, weights, and interrupting ratings.

### Benefits

- Satisfies customer's preferences to use circuit breakers instead of fuses.
- Eliminates costs of spare fuses, blown fuse indicators, additional wiring, etc.
- Reduces concerns and uncertainty of misapplying a UL 1077 supplementary protector where a UL 489 branch circuit breaker is required.
- Facilitates one common design for UL 489/CSA C22.2 No.5, CSA and IEC applications.
- Simplifies installation with a compact, DIN-mounted circuit breaker that accepts a wide range of accessories.
- Offers alternative terminations for ring terminals or cable.

### Standard Features

- Fast closing: Allows increased withstand to the high inrush currents of some loads.
- Trip-free mechanism: Contacts cannot be held in the I-ON position when the circuit breaker is tripped automatically.
- Positive indication of contact disconnect. Green mechanical indication on front face of device shows that all poles are open.
- C curve: Overcurrent protection for all application types. Magnetic release operates from 7 to 10 times ampere rating. (7 to 14 for dc)
- D curve: Overcurrent protection for loads with high inrush currents (motors, transformers). Magnetic release operates between 10 and 14 times ampere rating (no dc rating for D curve).
- Suitable for reverse feeding
- Allows locking in O-OFF position using padlock attachment.

# Multi 9™ System Catalog

## Section 2—UL® and CSA® Rated Protection Devices

### Connections

Two versions of field wiring connectors are available:

- Single-barrel lug with binding screws for two 18–10 AWG wires.
- Crimp-type ring tongue terminal for up to 8 AWG wire.

Both of these terminals provide fingersafe ingress protection per IP20 of IEC EN60529. This feature reduces the potential of incidental contact with live circuit breaker components.

### Standards

- UL 489/CSA C22.2 No.5 Listed
- IEC 60947-2
- CE Marked

### Catalog Numbers

**Table 8: Catalog Numbers for UL 489/CSA C22.2 No.5 Listed 480Y/277 V C60 Miniature Circuit Breakers (AC)**

Rating	Single Barrel Wire Lug			Ring-Tongue Terminal		
	1P	2P	3P	1P	2P	3P
C-curve, 7–10 Times Ampere Rating						
0.5 A	MGN61300	—	—	MGN61366	—	—
1 A	MGN61301	MGN61312	MGN61323	MGN61367	MGN61378	MGN61389
2 A	MGN61302	MGN61313	MGN61324	MGN61368	MGN61379	MGN61390
3 A	MGN61303	MGN61314	MGN61325	MGN61369	MGN61380	MGN61391
4 A	MGN61304	MGN61315	MGN61326	MGN61370	MGN61381	MGN61392
5 A	MGN61305	MGN61316	MGN61327	MGN61371	MGN61382	MGN61393
6 A	MGN61306	MGN61317	MGN61328	MGN61372	MGN61383	MGN61394
8 A	MGN61307	MGN61318	MGN61329	MGN61373	MGN61384	MGN61395
10 A	MGN61308	MGN61319	MGN61330	MGN61374	MGN61385	MGN61396
15 A	MGN61309	MGN61320	MGN61331	MGN61375	MGN61386	MGN61397
20 A	MGN61310	MGN61321	MGN61332	MGN61376	MGN61387	MGN61398
D-curve, 10–14 Times Ampere Rating						
0.5 A	MGN61333	—	—	MGN61399	—	—
1 A	MGN61334	MGN61345	MGN61356	MGN61400	MGN61411	MGN61422
2 A	MGN61335	MGN61346	MGN61357	MGN61401	MGN61412	MGN61423
3 A	MGN61336	MGN61347	MGN61358	MGN61402	MGN61413	MGN61424
4 A	MGN61337	MGN61348	MGN61359	MGN61403	MGN61414	MGN61425
5 A	MGN61338	MGN61349	MGN61360	MGN61404	MGN61415	MGN61426
6 A	MGN61339	MGN61350	MGN61361	MGN61405	MGN61416	MGN61427
8 A	MGN61340	MGN61351	MGN61362	MGN61406	MGN61417	MGN61428
10 A	MGN61341	MGN61352	MGN61363	MGN61407	MGN61418	MGN61429
15 A	MGN61342	MGN61353	MGN61364	MGN61408	MGN61419	MGN61430
20 A	MGN61343	MGN61354	MGN61365	MGN61409	MGN61420	MGN61431

## UL 489/CSA C22.2 No. 5 Listed C60 Circuit Breakers (DC)

### Overview

A portion of the range of UL 489/CSA C22.2 No.5 circuit breakers are also Listed by UL for use with dc circuits. The specifications are the same as the UL 489/CSA C22.2 No.5 circuit breakers, with the following exceptions:

- Number of poles: 1 and 2
- Time/current curve: C curve
- Magnetic setting of C curve: between 7 and 14 times ampere rating
- DC voltage (nominal): 1 pole—60 Vdc, 2 pole—125 Vdc
- Connection: box lug, ring/ring only (same torque)




**Table 9: Specifications for UL 489/CSA C22.2 No.5 C60 DC Circuit Breakers**

Ratings per UL Standards		UL 489/CSA C22.2 No.5 C60 (DC)	
Number of Poles		1	2
Rated Current (A) at 77°F (25°C)		60 Vdc	
Interrupting Ratings per UL 489/CSA C22.2 No.5 (kA)	60 Vdc	10	—
	125 Vdc	—	10
Service Breaking Capacity (Ics) (%Icu)		75%	75%
Magnetic Setting (Times Ampere Rating)	B curve	—	—
	C Curve	7 to 14	7 to 14
	D Curve	—	—
Dimensions	Width	0.71 in. (18 mm)	1.42 in. (36 mm)
	Height (Box/Box)	4.21 in. (107 mm)	4.21 in. (107 mm)
	Depth	3.00 in. (76 mm)	—
Weight (Max.)		4.4 oz. (136 g)	8.7 oz. (271 g)

### Catalog Numbers

**Table 10: Catalog Numbers for UL 489/CSA C22.2 No.5 C60 Listed Miniature Circuit Breakers (DC)<sup>1</sup>**

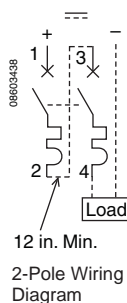

Rating	C Curve				Rating	C Curve			
	1P, Box/Box	Ring/Ring	2P, Box/Box	Ring/Ring		1P, Box/Box	Ring/Ring	2P, Box/Box	Ring/Ring
0.5 A	60100	60200	60134	60234	10 A	60110	60210	60144	60244
1 A	60101	60201	60135	60235	13 A	60111	60211	60145	60245
1.5 A	60102	60202	60136	60236	15 A	60112	60212	60146	60246
2 A	60103	60203	60137	60237	20 A	60113	60213	60147	60247
3 A	60104	60204	60138	60238	25 A	60114	60214	60148	60248
4 A	60105	60205	60139	60239	30 A	60115	60215	60149	60249
5 A	60106	60206	60140	60240	35 A	60116	60216	60150	60250
6 A	60107	60207	60141	60241	40 A	—	—	—	—
7 A	60108	60208	60142	60242	50 A	—	—	—	—
8 A	60109	60209	60143	60243	63 A	—	—	—	—

<sup>1</sup> The dc catalog numbers are the same as the UL 489/CSA C22.2 No.5 ac equivalents.

**UL 1077 Recognized C60 Supplementary Protectors**

The UL 1077 products are intended for use as supplementary protectors to provide overcurrent protection within appliances or electrical equipment where branch circuit protection is already provided or is not required.

As shown in the table of catalog numbers below, the UL 1077 Recognized products are available in B, C and D curves. They include devices ranging from 0.5 A to 63 A.

**Figure 7: UL 1077 Recognized C60N Supplementary Protectors**



**Table 11: Specifications for UL 1077 Recognized C60 Supplementary Protectors**

Package Size	0.71 in. (18 mm)	Width per Pole
Voltage	Nominal Voltage	480Y/277 Vac
	High Voltage Withstand	6 kV
Connection, Box Lug UL 486A File No. E90509 Pending	Cable: 0.5–25 A: 14–4 AWG (2–25 mm <sup>2</sup> ) Cu Only	Torque 22 lb-in (2.49 N•m)
	Cable: 30–63 A: 14–2 AWG (2–35 mm <sup>2</sup> ) Cu Only	Torque 31 lb-in (3.50 N•m)
Optional Ring Terminal Kit	Screw Dia.: 0.2 in. (5mm)	Torque 18 lb-in (2.03 N•m)
Mounting	35 mm DIN rail	
Time-Current Curves	B, C, and D Curves	
Degree of Protection as per IEC 68-2-30	Case	IP40 as per IEC 529
	Terminals	IP20
Temperatures	Calibration	25°C (77°F)
	Storage	-40 to 80°C (-40 to 176°F)
	Operating	-30 to 70°C (-22 to 158°F)
Tropicalization	Treatment 2	Relative Humidity: 95% at 131°F (55°C)
Number of Operating Cycles:	Electrical (O-C)	10,000 at 0.5–63 A

See Specification Table 3 on page 15 for dimensions, weights and interrupting ratings.

**Standards**

- UL 1077 Circuit Breaker, File No. E90509
- CSA C22.2 No. 235 File No. 179014
- IEC 60947-2
- VDE 0660
- CE Marked

**Standard Features**

- Trip-free mechanism: Contacts cannot be held in the on position when the C60 is tripped automatically.
- Positive indication of contact disconnect. Green mechanical indication on front face of device shows that all poles are open.
- B curve: Overcurrent protection for sensitive equipment (computers, electronic devices, etc.). Magnetic release operates between 3.2 and 4.8 (between 3.2 and 6.8 for dc).
- C curve: Overcurrent protection for all application types. Magnetic release operates from 7 to 10 times ampere rating (between 7 and 14 for dc).
- D curve: Overcurrent protection for loads with high inrush currents (motors, transformers). Magnetic release operates between 10 and 14 times ampere rating (no dc rating).
- Allows locking in O-OFF position using padlock attachment.
- Suitable for reverse feeding.

For rating and dimensional information, see Table 3 on page 15, Specifications for UL 1077 Recognized Supplementary Protectors.

**Catalog Numbers**

**Table 12: Catalog Numbers for UL 1077 Recognized C60 Supplementary Protectors**

Rating	B Curve				C Curve				D Curve			
	1P	2P	3P	4P	1P	2P	3P	4P	1P	2P	3P	4P
0.5 A	—	—	—	—	MG17411	—	—	—	MG17421	—	—	—
1 A	MG24110	MG24125	MG24140	MG24155	MG24425	MG24442	MG24459	MG24476	MG24500	MG24516	MG24532	MG24548
1.2 A	MG17402	MG17432	—	—	MG17412	MG17442	—	—	MG17422	MG17452	—	—
1.5 A	MG17403	MG17433	—	—	MG17413	MG17443	—	—	MG17423	MG17453	—	—
2 A	MG24111	MG24126	MG24141	MG24156	MG24426	MG24443	MG24460	MG24477	MG24501	MG24517	MG24533	MG24549
3 A	MG24112	MG24127	MG24142	MG24157	MG24427	MG24444	MG24461	MG24478	MG24502	MG24518	MG24534	MG24550
4 A	MG24113	MG24128	MG24143	MG24158	MG24428	MG24445	MG24462	MG24479	MG24503	MG24519	MG24535	MG24551
5 A	MG17404	MG17434	—	—	MG17414	MG17444	—	—	MG17424	MG17454	—	—
6 A	MG24114	MG24129	MG24144	MG24159	MG24430	MG24447	MG24464	MG24481	MG24504	MG24520	MG24536	MG24552
7 A	MG17405	MG17435	—	—	MG17415	MG17445	—	—	MG17425	MG17455	—	—
8 A	MG24115	MG24130	MG24145	MG24160	MG24431	MG24448	MG24465	MG24482	MG24505	MG24521	MG24537	MG24553
10 A	MG24116	MG24131	MG24146	MG24161	MG24432	MG24449	MG24466	MG24483	MG24506	MG24522	MG24538	MG24554
13 A	MG24117	MG24132	MG24147	MG24162	MG24433	MG24450	MG24467	MG24484	MG24507	MG24523	MG24539	MG24555
15 A	MG17406	MG17436	MG17461	—	MG17416	MG17446	MG17466	—	MG17426	MG17456	MG17471	—
16 A	MG24118	MG24133	MG24148	MG24163	MG24434	MG24451	MG24468	MG24485	MG24508	MG24524	MG24540	MG24556
20 A	MG24119	MG24134	MG24149	MG24164	MG24435	MG24452	MG24469	MG24486	MG24509	MG24525	MG24541	MG24557
25 A	MG24120	MG24135	MG24150	MG24165	MG24436	MG24453	MG24470	MG24487	MG24510	MG24526	MG24542	MG24558
30 A	MG17407	MG17437	MG17462	—	MG17417	MG17447	MG17467	—	MG17427	MG17457	MG17472	—
32 A	MG24121	MG24136	MG24151	MG24166	MG24437	MG24454	MG24471	MG24488	MG24511	MG24527	MG24543	MG24559
35 A	MG17408	MG17438	MG17463	—	MG17418	MG17448	MG17468	—	MG17428	MG17458	MG17473	—
40 A	MG24122	MG24137	MG24152	MG24167	MG24438	MG24455	MG24472	MG24489	MG24512	MG24528	MG24544	MG24560
50 A	MG24123	MG24138	MG24153	MG24168	MG24439	MG24456	MG24473	MG24490	MG24513	MG24529	MG24545	MG24561
60 A	MG17409	MG17439	MG17464	—	MG17419	MG17449	MG17469	—	MG17429	MG17459	MG17474	—
63 A	MG24124	MG24139	MG24154	MG24169	MG24440	MG24457	MG24474	MG24491	MG24514	MG24530	MG24546	MG24562

**Multi 9™ System Catalog**  
**Section 3—IEC 60947-2 Rated Protection Devices**

**Section 3—IEC 60947-2 Rated Protection Devices**

The Multi 9 system includes several families of miniature circuit protection devices that have the IEC ratings that are applicable in many countries other than the United States. These products are summarized below and discussed in more detail in the following pages. UL Listed and UL Recognized protection devices are described in Section 2, while accessories for both UL Listed and IEC Certified products are described in Section 5.

**Table 13: Specifications for IEC Rated Miniature Circuit Breakers**

Ratings per IEC 60947-2		DPN-N	C60N		C60H		C60L		C120H, NC125H	
Number of Poles		1 (Ø + N)	1	2, 3, 4	1	2, 3, 4	1	2, 3, 4	1	2, 3, 4
Rated Current 25°C (77°F)	$I_n$	1–40 A	1–63 A	1–63 A	1–40 A	1–40 A	1–25 A	1–25 A	—	—
Rated Current (A) 40°C (104°F)	$I_n$	—	—	—	—	—	—	—	63–125	63–125
Rated Voltage	$U_e$	230 V	440 V	440 V	440 V	440 V	440 V	440 V	440 V	440 V
Ultimate Breaking Capacity ( $I_{cu}$ ) as per IEC 60947-2 Standard	130 Vac	—	—	—	30 kA	—	—	—	30 kA	—
	230–240 Vac	7.5 kA	10 kA	20 kA	15 kA	30 kA	25 kA	50 kA	15 kA	30 kA
	400–415 Vac	2 <sup>1</sup> kA	3 <sup>1</sup> kA	10 kA	4 <sup>1</sup> kA	15 kA	6 <sup>1</sup> kA	25 kA	4 <sup>1</sup> kA	15 kA
	440 Vac	—	—	6 kA	—	10 kA	—	20 kA	—	10 kA
	1P 60 Vdc	—	15 kA	—	20 kA	—	25 kA	—	—	—
	2P 125 Vdc	—	—	2P 20 kA	—	2P 25 kA	—	2P 30 kA	—	—
		—	—	3P 30 kA	—	3P 40 kA	—	3P 50 kA	—	—
	3P 250 Vdc	—	—	4P 40 kA	—	4P 50 kA	—	4P 60 kA	—	—
Service Breaking Capacity	$I_{cs}$ (% $I_{cu}$ )	50%	75%	75%	50%	50%	50%	—	75%	75%
Magnetic Trip Curves	B Curve	3–5	—		—		—		3.2–4.8	
	C Curve	7–10	7–10		7–10		7–10		7–10	
	D Curve	—	10–14		10–14		10–14		10–14	
	K Curve	—	—		—		10–14		—	
	MA Curve	—	—		—		12		—	
	Z Curve	—	—		—		2.4–3.6		—	

<sup>1</sup> Single pole breaking capacity for IT type European grounding system (insulated neutral-double fault).

**Table 14: Dimensions and Weights**

Device	Size	Height		Width		Depth		Weight	
		in.	mm	in.	mm	in.	mm	oz.	g
DPN-N	1P	3.19	81	0.71	18	3.00	76	4.23	120
C60N	1P	3.19	81	0.71	18	3.00	76	3.88	110
	2P	3.19	81	1.42	36	3.00	76	7.75	220
	3P	3.19	81	2.13	54	3.00	76	11.64	330
	4P	3.19	81	2.48	72	3.00	76	15.52	440
C60H	1P	3.19	81	0.71	18	3.00	76	4.23	120
	2P	3.19	81	1.42	36	3.00	76	8.47	240
	3P	3.19	81	2.13	54	3.00	76	12.70	360
	4P	3.19	81	2.48	72	3.00	76	16.93	480
C60L	1P	3.19	81	0.71	18	3.00	76	4.23	120
	2P	3.19	81	1.42	36	3.00	76	8.47	240
	3P	3.19	81	2.13	54	3.00	76	12.70	360
	4P	3.19	81	2.48	72	3.00	76	16.93	480
C120H/NC125H	1P	3.19	81	0.71	27	3.00	76	6.35	180
	2P	3.19	81	2.13	54	3.00	76	12.70	360
	3P	3.19	81	3.19	81	3.00	76	19.05	540
	4P	3.19	81	4.25	108	3.00	76	25.40	720



### DPN-N Phase + Neutral Circuit Breakers

**Figure 8:**



The DPN-N Phase + Neutral Current Circuit Breaker provides phase and neutral protection against short-circuits and overloads. It provides protection on the phase pole, but switches both the phase and neutral. The DPN-N is available in only one version—1 phase + neutral. The DPN-N circuit breaker is available with B or C trip curve characteristics and with ratings from 1 to 40 A.

**Table 15: Specifications for DPN-N Phase + Neutral Circuit Breakers**

Package size:	Two 0.35 in. (9 mm) Modules	0.71 in. (18 mm) Width
	8 AWG (10 mm <sup>2</sup> ) Stranded Cables	
Connection:	6 AWG (16 mm <sup>2</sup> ) Solid cable (Copper Only)	
	Mounting: 35 mm DIN rail	Mounting: 35 mm DIN Rail
Degree of Protection	Case	IP40 as per IEC 529
	Terminals	IP20
Temperature	Calibration	86°F (30°C)
	Storage	40 to 176°F (-40 to 80°C)
	Operating	22 to 158°F (-30 to 70°C)
Tropicalization	Treatment 2	Relative Humidity: 95% at 131°F (55°C) as per IEC 68-2-30
Number of Operating Cycles	Mechanical	20,000 (O-C)
	Electrical	20,000 at 1–20 A 15,000 at 25 A 10,000 at 32 A 6,000 at 40 A

See selection table for dimensions, weights and interrupting ratings.

#### Time/Current Curves

**B curve**—Provides control and protection against overcurrents for very long cables. Magnetic trip units operate between 3 and 5 times ampere rating.

**C curve**—Provides control and protection against circuit overcurrents in tertiary and industrial final distribution with TT or TNS grounding systems. Magnetic trip units operate between 5 and 10 times ampere rating.

#### Accessories

These devices may be used in conjunction with the C60 electrical accessories, including the SD alarm switch, OF auxiliary switch, MN undervoltage release, and/or the MX + OF shunt trip and auxiliary switch.

#### Standards

- IEC 60947-2
- IEC 60898

**Multi 9™ System Catalog**  
**Section 3—IEC 60947-2 Rated Protection Devices**

**Catalog Numbers**

<b>Catalog Numbers for DPN-N Phase + Neutral Circuit Breakers</b>		
Type	1P+N	3P + N
Rating (In)	C Curve	C Curve
1 A	<b>M9P22601</b>	—
2 A	<b>M9P22602</b>	—
3 A	<b>M9P22603</b>	—
4 A	<b>M9P22604</b>	—
6 A	<b>M9P22606</b>	<b>M9P22706</b>
10 A	<b>M9P22610</b>	<b>M9P22710</b>
16 A	<b>M9P22616</b>	<b>M9P22716</b>
20 A	<b>M9P22620</b>	<b>M9P22720</b>
25 A	<b>M9P22625</b>	<b>M9P22725</b>
32 A	<b>M9P22632</b>	<b>M9P22732</b>
40 A	<b>M9P22640</b>	<b>M9P22740</b>
Width in 9-mm modules	2	6

## IEC Rated C60 Miniature Circuit Breakers

The C60 family of Multi 9 circuit breakers meeting IEC 60947-2 is available primarily for equipment for export from the United States to countries requiring IEC Certification rather than UL Listing.

Three types of IEC Rated C60 devices are available: C60N, C60H, and C60L circuit breakers. These model numbers refer to the maximum current interrupting (Ultimate Breaking Capacity) ratings.

Each of these devices is available with several characteristic trip curve ratings, as listed in the tables with catalog numbers. They include devices ranging from 1 to 63 A. (For higher current ratings, select devices from the higher current C120 series.)

**Table 16: Specifications for IEC Rated C60 Miniature Circuit Breakers**

High Voltage Withstand	6 kV	
Connections (Box Lug) for C60N/H/L Except C60L-MA <sup>1</sup>	1–25 A, 18–4 AWG (1–25 mm <sup>2</sup> ) Cu Only Cables	Torque to 22 lb-in (2.5 N•m)
	30–63 A, 18–2 AWG (1–35 mm <sup>2</sup> ) Cu Only Cables	Torque to 31 lb-in (3.5 N•m)
Connections for C60L-MA:	1.5–10 A Stranded 6 AWG (16 mm <sup>2</sup> )	Torque to 35 lb-in (4 N•m)
	1.5–10 A Solid 4 AWG (25 mm <sup>2</sup> )	Torque to 18 lb-in (2 N•m)
	12.5–40 A Stranded 4 AWG (25 mm <sup>2</sup> )	Torque to 35 lb-in (4 N•m)
	12.5–40 A Solid 2 AWG (35 mm <sup>2</sup> )	Torque to 31 lb-in (3.5 N•m)
Mounting	35 mm DIN rail	
Time-Current Curves	B, C, D, K, and MA	
Degree of Protection	Case	IP40 as per IEC 529
	Terminals	IP20
Temperature:	Calibration temperature: 30°C (86°F)	C60L calibrated at 40°C (104°F)
	Storage temperature	-40 to 80°C (-40 to 176°F)
	Operating temperature	-30 to 70°C (-22 to 158°F)
Tropicalization	Treatment 2	Relative Humidity: 95% at 131°F (55°C) per IEC 68-2-30
Number of Operating Cycles	Mechanical (O-C)	20,000
	Electrical (O-C)	10,000

See selection table for dimensions, weights and interrupting ratings.





<sup>1</sup> Ring tongue terminal is optional.

### Standard Features





- Fast closing: Allows increased withstand to the high inrush currents of some loads
- Trip-free mechanism: Contacts cannot be held in the I-ON position when the C60 device is tripped automatically.
- Positive indication of contact disconnect. Green mechanical indication on front face of device shows that all poles are open.
- Suitable for reverse feeding.
- B curve: Overcurrent protection for sensitive equipment (computers, electronic devices, etc.):
  - C60N/H: The magnetic release operates between 3 and 5 times ampere rating.
- C curve: Overcurrent protection for all application types:
  - C60N/H: The magnetic release operates between 5 and 10 times ampere rating.
  - C60L: The magnetic release operates between 7 and 10 times ampere rating.
- D and K curves: Overcurrent protection for loads with high inrush currents (motors, transformers):
  - C60N/H/L: The magnetic release operates between 10 and 14 times ampere rating.
- MA curve: C60L-MA circuit breakers are designed for motor circuit protection against short circuits. These circuit breakers are equipped with magnetic-only trip units at 12 times ampere rating. Therefore they must be combined with a suitable thermal protection device.

**Multi 9™ System Catalog**  
**Section 3—IEC 60947-2 Rated Protection Devices**

**Catalog Numbers**





<b>C60N Circuit Breaker</b>								
Type	1P		2P		3P		4P	
								
Rating (In)	C Curve	D Curve	C Curve	D Curve	C Curve	D Curve	C Curve	D Curve
1 A	M9F11101	M9F12101	M9F11201	M9F12201	M9F11301	M9F12301	M9F11401	M9F12401
2 A	M9F11102	M9F12102	M9F11202	M9F12202	M9F11302	M9F12302	M9F11402	M9F12402
3 A	M9F11103	M9F12103	M9F11203	M9F12203	M9F11303	M9F12303	M9F11403	M9F12403
4 A	M9F11104	M9F12104	M9F11204	M9F12204	M9F11304	M9F12304	M9F11404	M9F12404
6 A	M9F11106	M9F12106	M9F11206	M9F12206	M9F11306	M9F12306	M9F11406	M9F12406
10 A	M9F11110	M9F12110	M9F11210	M9F12210	M9F11310	M9F12310	M9F11410	M9F12410
16 A	M9F11116	M9F12116	M9F11216	M9F12216	M9F11316	M9F12316	M9F11416	M9F12416
20 A	M9F11120	M9F12120	M9F11220	M9F12220	M9F11320	M9F12320	M9F11420	M9F12420
25 A	M9F11125	M9F12125	M9F11225	M9F12225	M9F11325	M9F12325	M9F11425	M9F12425
32 A	M9F11132	M9F12132	M9F11232	M9F12232	M9F11332	M9F12332	M9F11432	M9F12432
40 A	M9F11140	M9F12140	M9F11240	M9F12240	M9F11340	M9F12340	M9F11440	M9F12440
50 A	M9F11150	—	M9F11250	—	M9F11350	—	M9F11450	—
63 A	M9F11163	—	M9F11263	—	M9F11363	—	M9F11463	—
Width in 9-mm modules	2		4		6		8	

**Catalog Numbers**

<b>C60H Circuit Breaker</b>								
Type	1P		2P		3P		4P	
								
Rating (In)	C Curve	D Curve	C Curve	D Curve	C Curve	D Curve	C Curve	D Curve
1 A	<b>M9F14101</b>	<b>M9F15101</b>	<b>M9F14201</b>	<b>M9F15201</b>	<b>M9F14301</b>	<b>M9F15301</b>	<b>M9F14401</b>	<b>M9F15401</b>
2 A	<b>M9F14102</b>	<b>M9F15102</b>	<b>M9F14202</b>	<b>M9F15202</b>	<b>M9F14302</b>	<b>M9F15302</b>	<b>M9F14402</b>	<b>M9F15402</b>
3 A	<b>M9F14103</b>	<b>M9F15103</b>	<b>M9F14203</b>	<b>M9F15203</b>	<b>M9F14303</b>	<b>M9F15303</b>	<b>M9F14403</b>	<b>M9F15403</b>
4 A	<b>M9F14104</b>	<b>M9F15104</b>	<b>M9F14204</b>	<b>M9F15204</b>	<b>M9F14304</b>	<b>M9F15304</b>	<b>M9F14404</b>	<b>M9F15404</b>
6 A	<b>M9F14106</b>	<b>M9F15106</b>	<b>M9F14206</b>	<b>M9F15206</b>	<b>M9F14306</b>	<b>M9F15306</b>	<b>M9F14406</b>	<b>M9F15406</b>
10 A	<b>M9F14110</b>	<b>M9F15110</b>	<b>M9F14210</b>	<b>M9F15210</b>	<b>M9F14310</b>	<b>M9F15310</b>	<b>M9F14410</b>	<b>M9F15410</b>
16 A	<b>M9F14116</b>	<b>M9F15116</b>	<b>M9F14216</b>	<b>M9F15216</b>	<b>M9F14316</b>	<b>M9F15316</b>	<b>M9F14416</b>	<b>M9F15416</b>
20 A	<b>M9F14120</b>	<b>M9F15120</b>	<b>M9F14220</b>	<b>M9F15220</b>	<b>M9F14320</b>	<b>M9F15320</b>	<b>M9F14420</b>	<b>M9F15420</b>
25 A	<b>M9F14125</b>	<b>M9F15125</b>	<b>M9F14225</b>	<b>M9F15225</b>	<b>M9F14325</b>	<b>M9F15325</b>	<b>M9F14425</b>	<b>M9F15425</b>
32 A	<b>M9F14132</b>	<b>M9F15132</b>	<b>M9F14232</b>	<b>M9F15232</b>	<b>M9F14332</b>	<b>M9F15332</b>	<b>M9F14432</b>	<b>M9F15432</b>
40 A	<b>M9F14140</b>	<b>M9F15140</b>	<b>M9F14240</b>	<b>M9F15240</b>	<b>M9F14340</b>	<b>M9F15340</b>	<b>M9F14440</b>	<b>M9F15440</b>
Width in 9-mm modules	2		4		6		8	

**Multi 9™ System Catalog**  
**Section 3—IEC 60947-2 Rated Protection Devices**

**Catalog Numbers**

<b>C60L Circuit Breaker</b>				
Type	1P	2P	3P	4P
				
Rating (In)	C Curve			
1 A	<b>M9F17101</b>	<b>M9F17201</b>	<b>M9F17301</b>	<b>M9F17401</b>
2 A	<b>M9F17102</b>	<b>M9F17202</b>	<b>M9F17302</b>	<b>M9F17402</b>
3 A	<b>M9F17103</b>	<b>M9F17203</b>	<b>M9F17303</b>	<b>M9F17403</b>
4 A	<b>M9F17104</b>	<b>M9F17204</b>	<b>M9F17304</b>	<b>M9F17404</b>
6 A	<b>M9F17106</b>	<b>M9F17206</b>	<b>M9F17306</b>	<b>M9F17406</b>
10 A	<b>M9F17110</b>	<b>M9F17210</b>	<b>M9F17310</b>	<b>M9F17410</b>
16 A	<b>M9F17116</b>	<b>M9F17216</b>	<b>M9F17316</b>	<b>M9F17416</b>
20 A	<b>M9F17120</b>	<b>M9F17220</b>	<b>M9F17320</b>	<b>M9F17420</b>
25 A	<b>M9F17125</b>	<b>M9F17225</b>	<b>M9F17325</b>	<b>M9F17425</b>
Width in 9-mm modules	2	4	4	6

## C60L Instantaneous Circuit Breakers (Icb) (Curve MA)

### IEC/EN 60947-2

- C60L curve MA circuit breakers combine the following functions:
  - circuit protection against short circuits
  - suitable for industrial isolation according to IEC/EN 60947-2 standards
  - fault tripping indication by a red mechanical indicator in circuit breaker front face
  - to be associate4d with overload protection for motors

**Table 17: Alternating Current (AC) 50/60 Hz**

Breaking Capacity (Icu) According to IEC/EN 60947-2					Service Breaking Capacity (Ics)
		Voltage (Ue)			
Ph/PH (2P, 3)		220 to 240 V	380 to 415 V	440 V	
Rating (In)	1.6 to 16 A	40 kA	20 kA	15 kA	50% of Icu
	25 to 40A	30 kA	15 kA	10 kA	50% of Icu

**Table 18: Technical Data**

Main Characteristics		
According to IEC/EN 60947-2		
Insulation Voltage (Ui)	500 Vac	
Pollution Degree	3	
Rated Impulse Withstand Voltage (Uimp)	6 kV	
Thermal Tripping	Reference Temperature	50°C
	Temperature Derating	See module CA908007
Magnetic Tripping	MA Curve	12 In +/- 20%
Utilization Category	A	
Additional Characteristics		
Degree of Protection (IEC 60529)	Device Only	IP20
	Device in Modular Enclosure	IP40 Insulation Class II
Endurance (O-C)	Electrical	10,000 cycles
	Mechanical	20,000 cycles
Overvoltage Category (IEC 60364)	IV	
Operating Temperature	-35°C to +70°C	
Storage Temperature	-40°C to +85°C	
Tropicalization (IEC 60068-1)	Treatment 2 (relative humidity 95% to 55°C)	

### Coordination of C60L-MA Circuit Breaker, Thermal Relay and Contactor

Standard IEC 60947-4 defines tests at various current levels with the aim of placing the switchgear in extreme conditions. According to the status of components after testing, the standard defines two types of coordination.

**Multi 9™ System Catalog**  
**Section 3—IEC 60947-2 Rated Protection Devices**

**Table 19: Definition of IEC Type 1 and Type 2 Coordination**

Types of Coordination	Type 1	Type 2
Deterioration of the contactor and relay is accepted under two conditions.	<ul style="list-style-type: none"> <li>• There is no risk to the operator</li> <li>• Parts other than the contactor and relay must not be damaged</li> </ul>	<ul style="list-style-type: none"> <li>• Welding of the contactor or starter is accepted only if they can be easily separated</li> <li>• After Type 2 coordination tests, the functions of protection and operation can be achieved</li> </ul>
The choice of coordination type depends on the operating parameters. It must be suitable for the user's needs and ensure optimized cost of the installation.	<ul style="list-style-type: none"> <li>• Qualified maintenance service</li> <li>• Reduced volume and cost of equipment</li> <li>• Continuity of service not required or ensured by replacing the faulty motor bucket</li> </ul>	<ul style="list-style-type: none"> <li>• Continuity of service is vital</li> <li>• Reduced maintenance service</li> <li>• Specification calling for Type 2 coordination</li> <li>• Various thermal relay classes: Thermal relay class must be appropriate for motor starting time</li> </ul>

The magnetic release of MA devices operates at 12 times ampere rating. These C60L-MA circuit breakers are listed in Table 20.

**Table 20: Catalog Numbers for IEC 60947-2 Rated C60L MA Curve Miniature Circuit Breakers**

Rating	MA Curve				Rating	MA Curve			
	1P	2P	3P	4P		1Ps	2P	3P	4P
1.6 A	—	26345	26357	—	12.5 A	—	26350	26362	—
2.5 A	—	26346	26358	—	16 A	—	26352	26368	—
4 A	—	26347	26359	—	25 A	—	26353	26369	—
6.3 A	—	26348	26360	—	40 A	—	26355	26370	—
10 A	—	26349	26361	—					

**Table 21: Tripping Times**

Class	Tripping Time (sec.) at 7.2 I <sub>r</sub>
10 A	2–10
20 A	6–20



## IEC Rated C120H Circuit Breakers

The IEC Rated C120H family of Multi 9 circuit breakers meets the requirements of IEC 947-2 and are available for OEMs wishing to export manufactured products to countries requiring IEC Certification instead of UL Listing.

They are suitable for protection of cables against overloads and short circuits in equipment. They can also be used for manual control and isolation of circuits.

The C120H circuit breakers are available in B, C, and D trip curves, as listed in Table 24. They include devices ranging from 10 to 125 A. (For lower current ratings, select devices from the C60 series.)



**Table 22: IEC 947-2 Rated C120H Circuit Breakers**

**Table 23: Specifications for IEC Rated C120H Circuit Breakers**

Package Size	Three 9 mm Modules	27 mm Width per Pole
Voltage	High Voltage Withstand	6 kV
	Maximum Voltage Rating	440 Vac
Connection: Box Lug, 10–100 A	18 to 1 AWG (1–50 mm <sup>2</sup> ) Cables	Cu Wire Only
Mounting	35 mm DIN Rail	
Degree of Protection:	Case	IP40 as per IEC 60529
	Terminals	IP20
Time/Current Curves	B, C and D Curves	
Temperature:	Calibration	30°C (85°F)
	Storage	-40 to 80°C (-40 to 176°F)
	Operating	-30 to 70°C (-22 to 158°F)
Tropicalization	Treatment 2	Relative Humidity: 95% at 55°C (131°F) as per IEC 68-2-30
Number of Operating Cycles	1000 (O-C) at 63 A	
	5000 (O-C) at 80–125 A	

### Standard Features

- Fast closing: Allows increased withstand to the high inrush currents of some loads.
- Trip-free mechanism: Contacts cannot be held in I-ON position when C120 is tripped automatically.
- Isolation with positive break indication: Green strip on operating handle indicates all poles are open
- Terminals ensure pull-out withstand of cables, guiding of cables into correct position, and tightening of wide cross-section cables.
- B curve: Overcurrent protection of very long cables and protection of networks supplied by generators. The magnetic release operates between 3 and 5 times ampere rating.
- C curve: Overcurrent protection for all application types. The magnetic release operates between 5 and 10 times ampere rating.
- D curve: Overcurrent protection for loads with high inrush currents (motors, transformers). The magnetic release operates between 10 and 14 times ampere rating.
- Suitable for reverse feeding.

# Multi 9™ System Catalog

## Section 3—IEC 60947-2 Rated Protection Devices

### Accessories

Ground-fault protection can be provided when combined with a Vigi C120 module. Remote tripping and indication can be provided by adding a variety of auxiliaries (see section 5 for accessories).

**NOTE:** The C120 circuit breakers use the same electrical auxiliaries as the C60 circuit breakers. They do not accept the NC100H circuit breaker accessories.

### Standards

- IEC 60947-2
- VDE 0660
- CE Marked

### Catalog Numbers

**Table 24: Catalog Numbers for Multi 9 C120H (10–125 A) Circuit Breakers—15 kA at 240 Vac**

Rating	1P	2P	3P	4P
B Curve (Magnetic Setting Between 3 and 5 Times Ampere Rating)				
63 A	A9N18401	A9N18412	A9N18423	A9N18434
80 A	A9N18402	A9N18413	A9N18424	A9N18435
100 A	A9N18403	A9N18414	A9N18425	A9N18436
125 A	A9N18404	A9N18415	A9N18426	A9N18437
C Curve (Magnetic Setting Between 5 and 10 Times Ampere Rating)				
63 A	A9N18445	A9N18456	A9N18467	A9N18478
80 A	A9N18446	A9N18457	A9N18468	A9N18479
100 A	A9N18447	A9N18458	A9N18469	A9N18480
125 A	A9N18448	A9N18459	A9N18470	A9N18481
D Curve (Magnetic Setting Between 10 and 14 Times Ampere Rating)				
63 A	A9N18489	A9N18500	A9N18511	A9N18522
80 A	A9N18490	A9N18501	A9N18512	A9N18523
100 A	A9N18491	A9N18502	A9N18513	A9N18524
125 A	A9N18492	A9N18503	A9N18514	A9N18525



## Section 4—Ground-Fault Protection Devices

### Selection Table

The Multi 9 System includes one UL Listed and three IEC rated product families that provide ground-fault protection. These products are summarized below and discussed in more detail in the following pages.

**Table 25: Selection Table for Multi 9 Ground-fault Protection Products**

		GFP			ID		C60 Vigi					
Standard		UL 1053 IEC 61008			IEC 61008		IEC 61009					
Number of Poles		2P	2P	4P	2P	4P	2P	2P	3P	4P		
Rated Current (A) 25°C (77°F)		$I_n$ Pickup		—	—	—	25–100	25–100	< 63	< 63	< 63	< 63
Sensitivities	Instantaneous	10 mA	—	—	—	Yes	—	—	Yes	—	—	
		30 mA	25–63	25–63	25–63	Yes	Yes	Yes	Yes	Yes	Yes	
		100 mA	25–63	25–63	25–63	—	—	—	—	—	—	
		300 mA	25–100	25–100	25–100	Yes	—	Yes	—	—	—	
		500 mA	—	—	—	—	—	—	—	—	—	
	Selective	300 $\square^1$	—	—	—	Yes	Yes	—	Yes	Yes	Yes	
500 $\square^1$		—	—	—	—	—	—	—	—	—		
1000 $\square^1$		—	—	—	—	—	—	Yes	Yes	Yes		
Voltage (Nominal) Vac, 50-60 Hz		120, 240	277, 480Y	240, 480Y/277	240/415		130	240/415				
Time/Current Curve		Depends on Circuit Breaker Used.										
Dimensions (in./mm)	Width	1.42 (36)	1.42 (36)	2.84 (72)	1.42 (36)	2.84 (72)	1.42 (36)	1.42 (36)	2.13 (54)	12.84 (72)		
	Height	3.19 (81)	3.19 (81)	3.19 (81)	3.19 (81)	3.19 (81)	3.19 (81)	3.19 (81)	3.19 (81)	3.19 (81)		
	Depth	3.00 (76)	3.00 (76)	3.00 (76)	3.00 (76)	3.00 (76)	3.00 (76)	3.00 (76)	3.00 (76)	3.00 (76)		
Weight (oz./g)		7.70/ 220	7.70/ 220	15.9/ 450	7.70/ 220	15.9/ 450	2.43/ 120	5.29/ 150	< 25 = 6.35 /180 > 63 = 7.41/210			

<sup>1</sup>  $\square^1$  Selective = has non-adjustable time delay to allow selective coordination.

**Table 26: Overcurrent Protection Required for UL Applications of GFP**

GFP	C60 Circuit Breaker				
	25 A, 240 Vac		20 A, 277 Vac	20 A, 480Y/277 Vac	
	1P and 2P	3 P	1P	2P	3P
2P 240 Vac	10	—	—	—	—
2P 480Y/277 Vac	—	—	10	10	—
4P 480Y/277 Vac	—	10	—	—	10

**UL 1053 Listed GFP Ground Fault Protectors**



The GFP Ground Fault Protector provides ground fault protection for electrical circuits. It will automatically open the circuit in the case of a ground fault between phase and ground greater than 10, 30 or 300 mA, depending on the model. An electromechanical release operates without any auxiliary source of supply to open the circuit. The GFP is available in 2-pole and 4-pole (3 or 4-wire) versions.

**NOTE:** The GFP has only one protective function—detection of ground fault current. There is no thermal or magnetic overcurrent protection. Therefore, the circuit must be protected upstream by an approved device such as the Multi 9 C60, QOU, QO, or HGL circuit breaker, or a fuse.

Multi 9 GFP products contain *Si* technology to increase immunity to noise and to minimize the potential for nuisance tripping in noisy electrical environments.

The toggle on the front of the GFP is used to reset the device after it has tripped. It should not be used to switch loads. A test button located on the front of the GFP is provided to allow periodic testing of the device. The tripped condition due to ground fault is displayed on the front face by a red mechanical indicator.

Remote monitoring and control can be provided with optional C60 accessories including the OF Auxiliary Switch, SD Alarm Switch, MN Undervoltage Release and/or MX + OF Shunt Trip.

**NOTE:** These auxiliaries require the use of the OFS Auxiliary Switch (Cat. No. 26923) to adapt to the ID Residual Current Switch.

**Table 27: Specifications for UL 1053 Listed GFP Ground Fault Protectors**

Voltage Rating	Two Poles at 120 or 240 Vac (-15/+10%) Two Poles at 277 or 480Y/277 Vac (-15/+10%) Four Poles at 240 Vac or 480Y/277 Vac (-15/+10%)	
Current Rating (40°C)	25 A, 40 A, 63 A, 80 A or 100 A	Depending on catalog number
Ground Fault Sensitivity:	GFP30	Must trip at 29.9 mA; must not trip below 22.1 mA
	GFP100	Must trip at 98.9 mA; must not trip below 73.1 mA
	GFP300	Must trip at 299 mA; must not trip below 221 mA
Short-Circuit Current Rating	10 kA with recommended circuit breaker or fuse upstream	See bulletin GHA1080850AB
Frequency	50 or 60 Hz	
Mounting	35 mm DIN rail	
Connection, Box Lug	Wire: 75°C copper wire only, stranded or solid 14 to 2 AWG (2.5 to 35 mm <sup>2</sup> )	Torque to 31 lb-in (3.5 N•m)
Padlocking in the "Tripped" Position is Possible	Use a padlocking device	Requires addition of OFS on left side of circuit breaker plus padlocking attachment M9PAFL
Ground-Fault Indication	Red indicator flag on front face	
Temperature	Operating temperature	-25 to +60°C (-13 to +140°F)
	Storage temperature	-40 to +70°C (-40 to + 158°F)
Tropicalization	Treatment 2	Relative humidity 95% at 55°C (131°F)

See Table 25 on page 35 for dimensions and weights.

**Standards**

- UL 1053 (not CSA certified)
- IEC 61008
- CE Marked

**Catalog Numbers**

**Table 28: Catalog Numbers for UL Rated GFP Ground Fault Protectors**

Poles	Voltage	Current	Maximum Sensitivity	Tripping Range	Family	Catalog Number
2P	UL 1053 120/240 V, 240 V 60 Hz	25 A	30 mA	22.1 to 29.9 mA	GFP 30	<b>60949</b>
			100 mA	73.1 to 98.9 mA	GFP 100	<b>60950</b>
	IEC 61008 230 V, 240 V 50 Hz	40 A	30 mA	22.1 to 29.9 mA	GFP 30	<b>60952</b>
			300 mA	221 to 299 mA	GFP 300	<b>60951</b>
2P	UL 1053 277 V, 480Y/277 V 60 Hz	25 A	30 mA	22.1 to 29.9 mA	GFP 30	<b>60969</b>
			300 mA	221 to 299 mA	GFP 300	<b>60971</b>
2P	IEC 61008 230/400 V, 240/415 V 50 Hz	40 A	30 mA	22.1 to 29.9 mA	GFP 30	<b>60972</b>
			300 mA	221 to 299 mA	GFP 300	<b>60973</b>
4P	UL 1053 240 V, 480Y/277 V 60 Hz	25 A	30 mA	22.1 to 29.9 mA	GFP 30	<b>60989</b>
			100 mA	73.1 to 98.9 mA	GFP 100	<b>60990</b>
	IEC 61008 230/400 V, 240/415 V 50 Hz	40 A	30 mA	22.1 to 29.9 mA	GFP 30	<b>60992</b>
			300 mA	221 to 299 mA	GFP 300	<b>60994</b>
	40 A	63 A	30 mA	22.1 to 29.9 mA	GFP 30	<b>60995</b>
			100 mA	73.1 to 98.9 mA	GFP 100	<b>60996</b>
100 A	300 mA	221 to 299 mA	GFP 300	<b>60999</b>		

**Figure 9: Possible Device Combinations**

OF Auxiliary Switch  
and/or  
SD Alarm Switch



+

MX Shunt Trip  
and/or  
MN Undervoltage  
Release



+

OFS Auxiliary Switch  
Required in order  
to mount either/both  
indicated accessories.



+

GFP  
Ground Fault Protector



**IEC Rated ID Residual Current Switches**

The ID Residual Current Switches provide ground fault protection for electrical circuits, as well as the functions of isolation and switching. ID switches have an electromechanical release that opens a circuit automatically in the case of a fault between phase and earth greater than 10, 30, or 300 mA, depending on the model. The switch operates without the need for an auxiliary source of power. A version with time delay (selective) provides non-adjustable time delay for coordination with downstream instantaneous residual current devices. The ID Switch is available in 2-pole (1-phase) and 4-pole (3-phase) versions.

The ground fault is displayed on the front face by a red mechanical indicator.


**NOTE:** The ID residual current switch has only one protective function—detection of earth leakage current. There is no thermal or magnetic overcurrent protection. Therefore, the circuit must be protected by an upstream circuit breaker or supplementary protector. For combined overcurrent and residual current protection, an alternative is a C60 circuit breaker equipped with an auxiliary Vigi ground-fault detector module.

The ID device can also be manually operated as a switch. Remote monitoring and control can be provided with optional C60 accessories including the OF Auxiliary Switch, SD Alarm Switch, MN Undervoltage Release, and/or MX + OF Shunt Trip.

**NOTE:** All of these auxiliaries require the use of the OFS Auxiliary Switch (Cat. No. 26923) to adapt to the ID Residual Current Switch.

A test button provided on the front of the ID Residual Current Switch to allow periodic testing of the device.

**Figure 10: IEC Rated ID Residual Current Switches**

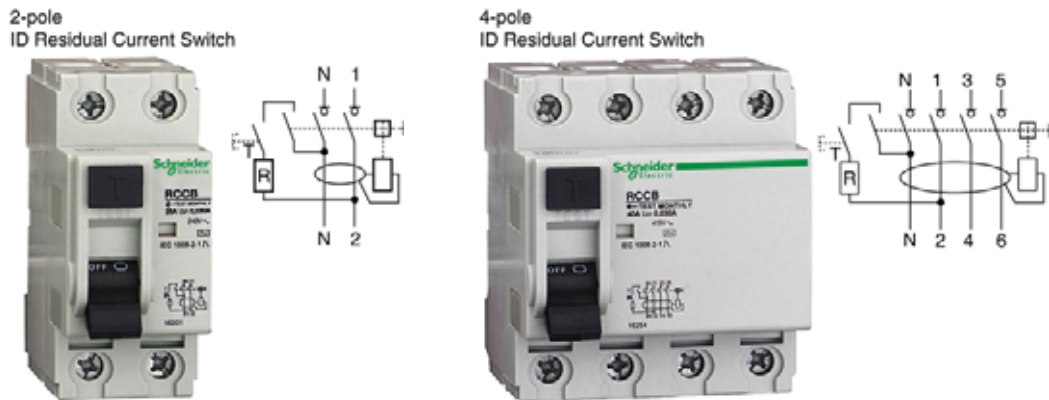

**Table 29: Specifications for IEC Rated ID Residual Current Switches**

Voltage	Nominal voltage	240 to 415 Vac, +10%, -20%, 50/60 Hz
	High voltage withstand	6 kV
Connection, Box Lug	14–2 AWG (2.5–35 mm <sup>2</sup> ) stranded cables, Cu wire only	Torque to 31 lb-in (3.5 N•m)
	1 AWG (50 mm <sup>2</sup> ) solid cables, Cu wire only	Torque to 31 lb-in (3.5 N•m)
Sensitivities	Fixed at 10, 30, or 300 mA	
Time/Current Curve	Instantaneous or selective release S (Time Delay)	
Level of Immunity	250 A Peak	According to 8/20 ms periodical wave
Operating Temperature	-5 to 60°C (22 to 140°F)	
Tropicalisation	Treatment 2	Relative humidity: 95% at 55°C (131°F) per IEC 68-2-30
Mounting	35 mm DIN Rail	
Number of Operating Cycles	Electrical (O-C)	20,000
See Table 25 for weights, dimensions and interrupting ratings.		

**Standards**


- IEC 61008
- CE Marked

**Catalog Numbers**

**Table 30: Catalog Numbers for IEC ID Residual Current Switches—AC Class**

Rating	Sensitivity (mA)	2P (240 Vac) 4 Modules	4P (415 Vac) 8 Modules
25 A	30	M9R11225	—
40 A	30	M9R11240	M9R11440
	300	M9R14240	M9R14440

**Figure 11: Possible Device Combinations**

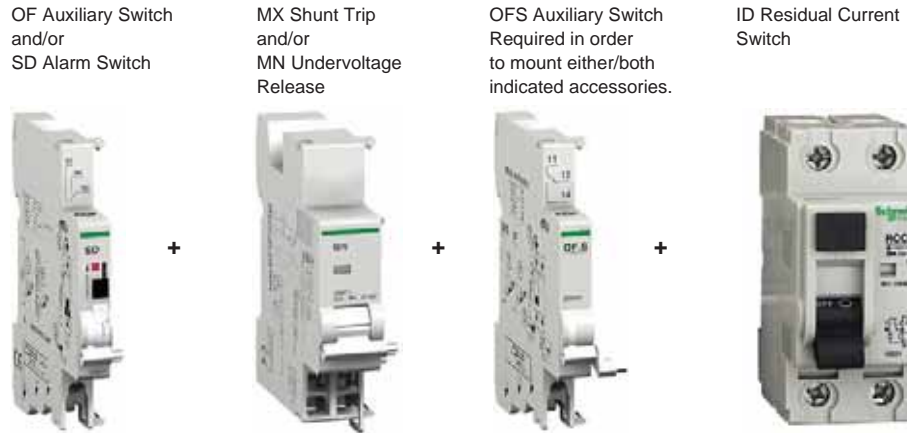

# Multi 9™ System Catalog

## Section 4—Ground-Fault Protection Devices

### IEC Rated C60 Vigi™ Modules for Ground-fault Protection

Figure 12:



The C60 Vigi residual current detector can be added to the C60 circuit breaker to provide a high level of protection against earth leakage faults. The Vigi module clips onto the right-hand side of a C60 protective device and is mechanically linked to the C60 circuit breaker, which it trips when the Vigi detects residual current. Vigi modules are available for use with 2-, 3-, and 4-pole C60 circuit breakers. The Vigi module may be field installed.

The Vigi module combines a current sensing toroid and residual current relay in one case and operates without an auxiliary power supply source. It may be ordered with a variety of non-adjustable sensitivities (10 to 1,000 mA). A version with time delay (selective) provides non-adjustable time delay for coordination with downstream instantaneous residual current devices.

A built-in filtering device minimizes nuisance tripping due to transient voltages (lightning, line disturbances, etc.) and transient currents (from high capacitive circuits).

A visual indicator of the ground fault is provided by a red flag on the Vigi operating handle. A manual test button on the face of the Vigi module allows manual testing of the Vigi module.

The C60 Vigi module can be field-adapted to reset in one of two modes: Automatic reset when the associated protective device handle is reset, or by manually resetting the Vigi prior to reclosing the supplementary protector.

A version with time delay (selective) provides additional time discrimination with downstream instantaneous residual current devices.

**NOTE:** The C60 version of the Vigi Module cannot be used with the C120 series. A different series of Vigi Modules is available for the C120 devices.

Figure 13: Example of Residual Current Circuit Breaker



**NOTE:** Also see the ID Residual Current Switches.

Table 31: Specifications for IEC Rated C60 Vigi Modules for Ground-Fault Protection

Voltage (Nominal):	130–240 Vac	+10/ -20%, 50/60 Hz
	220–415 Vac	+10/ -20%, 50/60 Hz
High Voltage Withstand: 6 kV	6 kV	
Connection: Box Lug:	≤ 25 Stranded 6 AWG (16 mm <sup>2</sup> ) Cu Wire	4 N•m
	≤ 25 Solid 6 AWG (16 mm <sup>2</sup> ) Cu Wire	2 N•m
	≤ 63 Stranded 6 AWG (16 mm <sup>2</sup> ) Cu Wire	4 N•m
	≤ 63 Solid 6 AWG (16 mm <sup>2</sup> ) Cu Wire	3.5 N•m
Mounting	35 mm DIN rail	
Time-Current Curves	Depends on Circuit Breaker	
Time/Current Curve	Instantaneous or Selective Release	
Sensitivities	Fixed at 10, 30, 300, or 1000 mA	
Temperatures	Calibration	77°F (25°C)
	Operating	22 to 140°F (-5 to 60°C)

See Table 25 on page 35 for weights, dimensions and interrupting ratings.



**Accessories**

Terminal screw shields prevent contact with the Vigi module terminal screws. The bag includes twenty pieces of single-pole shields (Cat. No. 26982).


**Standards**

Combined with C60, the Vigi module forms a residual current device which conforms to the following standards:

- IEC 61009
- EN 61009


**Catalog Numbers**

**Table 32: Catalog Numbers for Vigi C60 Modules—AC Class (Not UL/CSA Recognized)**

Rating	Voltage	Sensitivity (mA)	2P	2P	3P	4P
≤ 63 A	220–415 Vac	30	—	M9V11263	M9V11363	M9V11463
		300  <sup>1</sup>	—	M9V14263	M9V14363	M9V14463

<sup>1</sup>  Selective = has non-adjustable time delay to allow selective coordination.

**Figure 14: IEC Rated C60 Vigi Modules**

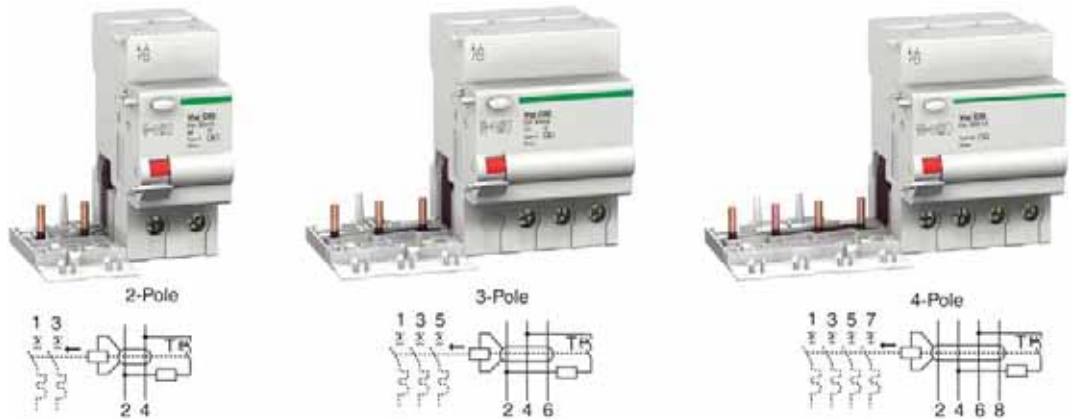

## IEC Rated C120 Vigi Residual Current Circuit Breakers

Figure 15:



The C120 Vigi residual current detector can be added to the C120 circuit breaker to provide a high level of protection against earth leakage faults. The Vigi module clips onto the right-hand side of a C120 protective device and is mechanically linked to the C120 circuit breaker, which it trips when the Vigi detects residual current.

The C120 circuit breaker and Vigi module combination is reset in a single operation by resetting the circuit breaker.

The Vigi module combines a current sensing toroid and residual current relay in one case and operates without an auxiliary power supply source. It may be ordered with a variety of non-adjustable sensitivities (30 to 1,000 mA). A version with time delay (selective) provides additional time discrimination with downstream instantaneous residual current devices.

Vigi modules combine with the C120 2-, 3- and 4-pole circuit breakers to provide:

- Protection of people against indirect contact (per IEC Standards)
- Additional protection of people against direct contact (30 mA)
- Protection of electrical installations against insulation faults

The C120 circuit breaker and Vigi module combination is protected against nuisance tripping due to transient overvoltages such as lightning, switching on the network, etc.

**Table 33: Specifications for IEC Rated C120 Vigi Residual Current Circuit Breakers**

Current Rating	125 A	
Guarantees Tripping for Sinusoidal AC Residual Currents	Either suddenly applied or slowly increasing	
Total Vertical Discrimination with the $I_{\Delta n}$ 300 mA to 1 A [S] "Selective" Sensitivities if it is Installed:	Upstream from an instantaneous residual current device	
	Downstream from an Index II, Time-Delayed Residual Current Device	Where in both cases the $I_{\Delta n}$ of the downstream device $\leq I_{\Delta n/2}$ of the upstream device
Connections	16–2 AWG (1–35 mm <sup>2</sup> ) stranded wire	31 lb-in (3.5 N•m)
	16–1 AWG (1–50 mm <sup>2</sup> ) solid wire	31 lb-in (3.5 N•m)
Voltage	220–415 Vac	+10%, -20%, 50/60 Hz
Mechanical Indication	Red indicator	On front face of the Vigi module
Instantaneous or Selective Tripping	Fixed sensitivities for all ratings	

See Table 25 on page 35 for weights and interrupting ratings.

### Standards

Complies with IEC 1009 Standard


### Catalog Numbers

**Table 34: Catalog Numbers for IEC C120 Vigi Si (Noise Immune) Module—AC Class**

Rating	Voltage	Sensitivity (mA)	2P	3P	4P
125 A	220–415 Vac	30	A9N18591	A9N18594	A9N18597
		300	A9N18592	A9N18595	A9N18598
		300 [S] <sup>1</sup>	A9N18556	A9N18558	A9N18560
		500	—	—	A9N18599
		1000	A9N18557	A9N18559	A9N18561

<sup>1</sup> [S] Selective = has non-adjustable time delay to allow selective coordination.

Figure 16: IEC Rated C120 Vigi™ Modules

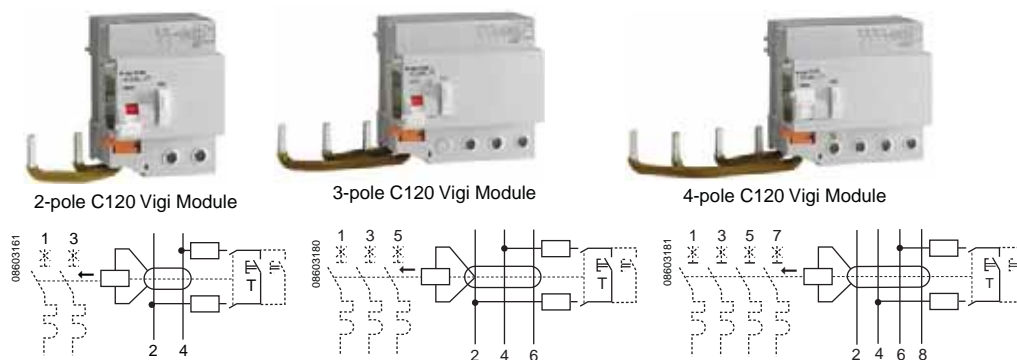

## DPN-N Vigi Residual Current Circuit Breaker

### Function



- The DPN N Vigi residual current device provides complete protection of final circuits (overcurrents and insulation faults):
  - protection of people against electric shocks by direct contacts (30 mA),
  - protection of people against electric shocks by indirect contacts (300 mA),
  - protection of installations from fire hazards (300 mA).
- Fast closing.
- Positive break indication.
- Display of earth fault on the front panel by position of toggle.
- The "si" range has been designed to maintain a network with optimum safety and continuity of service in installations disturbed by:
  - extreme atmospheric conditions,
  - harmonic generating loads,
  - transient operating currents.

### Catalog Numbers

Table 35: DPN-N VIGI Residual Current Circuit Breaker

Rating (A)	1-pole + N (C Curve) 4 Modules		Width in 9-mm Modules
	30 mA	300 mA	
10	M9D11610	M9D14610	4
16	M9D11616	M9D14616	
20	M9D11620	M9D14620	
25	M9D11625	M9D14625	
40	M9D11640	M9D14640	
Voltage Rating (Ue)	230 Vac		
Operating Frequency	50/60 Hz		

### Standards


- European standard EN 61009.
- International standard IEC 61009.

## Section 5—Accessories

The Multi 9 System includes an extensive line of field-installable accessories that enables the system to be used in many applications. Electrical auxiliaries include shunt trip, undervoltage release, auxiliary switch, and alarm switch. Control and display devices include push buttons, motor operators, and signal lamps. Also available is a variety of accessories for locking, operating, shielding, mounting, etc. Other devices include switches and timers. The following diagram shows many of the accessories.


All of the accessories described in this section may be field-installed. These include electrical auxiliaries, comb bus bars, mounting devices, shielding and identification systems, operators, and display, status, and control devices.

Figure 17: Overview of Multi 9 System Accessories



Rating	Tightening Torque	Copper Cables	
		Rigid	Flexible or with End-Piece
4–40 A	3.5 N•m	1–16 mm <sup>2</sup>	1–10 mm <sup>2</sup>

1. DC Circuit Breaker (UL 489A)
2. C60 UL 1077 Recogniz ed Supplementary Protectors or UL 489 Listed Circuit Breakers
3. Undervoltage Release (MN)
4. Shunt Trip (MX + OF)
5. Auxiliary Switch (OF)
6. Alarm Switch (SD)
7. Comb Bus Bar
8. Connector
9. Ring Tongue Terminal Kit
10. C60N/NC100 Vigi Module
11. Terminal Cover
12. Interphase Barrier
13. Terminal Screw Shield
14. Padlock Attachment (Off Position)
15. Plug-in Base
16. Rotary Handle
17. Spacer
18. Identification System
19. Left Side Padlock Attachment
20. Right Side Padlock Attachment

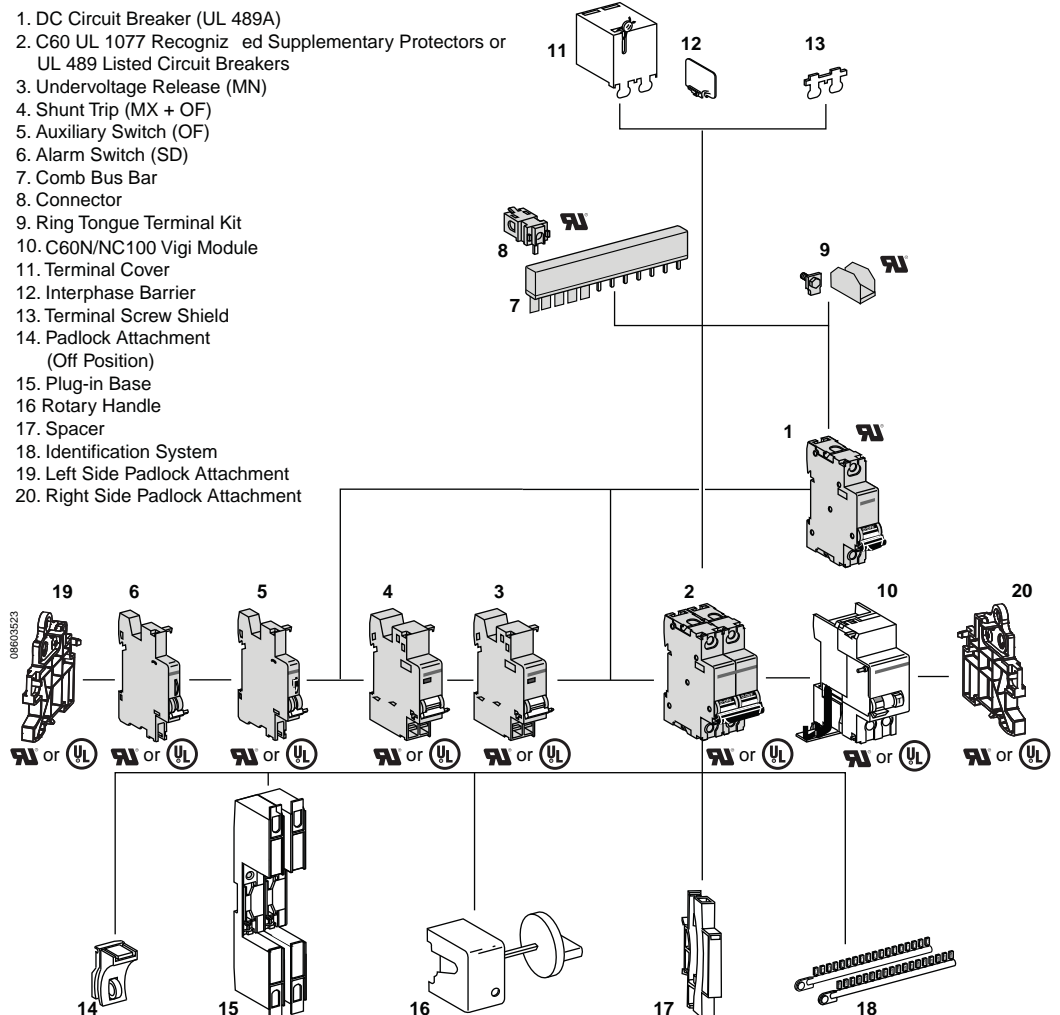

Technical Data

Main Characteristics	
Earth leakage protection with instantaneous tripping	30, 300 mA
Setting temperature for ratings 4 to 40 A	30°C
Tripping curve	Curve B: the magnetic tripping devices act at between 3 and 5 I <sub>n</sub>
	Curve C: the magnetic tripping devices act at between 5 and 10 I <sub>n</sub>

Breaking Capacity

EN61009	
Rated breaking capacity (I <sub>cn</sub> )	6,000 A
Rated residual breaking and making capacity (I <sub>Δm</sub> )	6,000 A


Endurance

Ratings (A)	Mechanical Endurance	Electrical Endurance Under Rated Current
	Number of O/C cycles	Number of O/C cycles
4 to 40	20,000	20,000 ≤ 20 A
		10,000 ≥ 25 A

Other characteristics

Degree of protection	IP4/IPxxD for the part outside of the enclosure
Insulation voltage (U <sub>i</sub> )	400 V
Rated impulse withstand voltage (U <sub>imp</sub> )	4 kV
Service temperature	Type AC: from -5°C to +60°C
	Type A and type A-si: from -25°C to +60°C
Storage temperature	-30°C to +70°C
8/20 is impulse withstand	Type AC and type A: 250 Å
	Type A-si: 3 kÅ
Limitation class	3
Insulation class	2
Tropicalization	Treatment 2 (relative humidity 95% at 55°C)

Dimensions

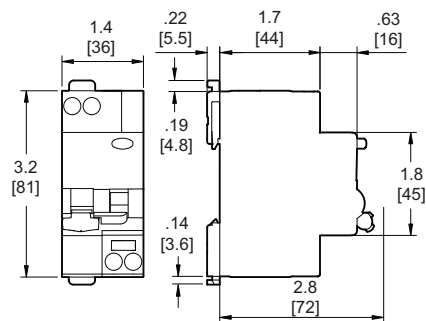

Dimensions: in.  
(mm)

**Weight**

Residual Current Device	
Type	DPN N Vigi
1P+N	125 g

**Electrical Auxiliaries**


The Multi 9 product line includes a variety of electrical auxiliaries for the C60, C120, and NC120 supplementary protectors and circuit breakers. They may be attached to the protective device as needed to fulfill the tripping or monitoring application requirements. They include the following devices:

- MN Undervoltage Release
- MX + OF Shunt Trip and Auxiliary Switch
- OF Auxiliary Switch
- SD Alarm Switch
- TM Motor Operator
- OFS Special Auxiliary Switch (For use with GFP and ID RCCB's, allows other accessories to be mounted to the side of the GFP.)

The Multi 9 Vigi Module, which adds ground-fault protection, is described in Section 4.

Accessories have a maximum width of 54 mm and are mechanically linked to the base C60 or C120 protective devices.

**Figure 18: Possible Auxiliary Combinations**

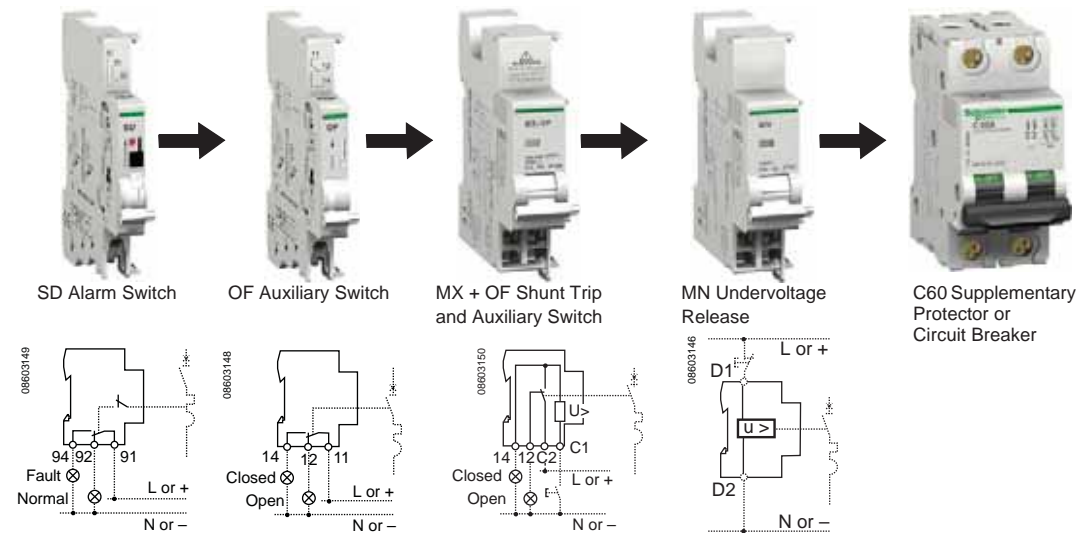

**Table 36: Catalog Numbers for Electrical Auxiliary Devices**

Device	Control Voltage		Modules (9mm)	C60 / GFP		C120
	Vac	Vdc		UL/IEC	IEC	IEC
MX + OF Shunt Trip + Aux Switch	24	24	2	27118	27118	A9N20948
	48	48	2	27110	27110	A9N26947
	110-240-277	125	2	27109	27109	A9N26946
	220-277	—	—	—	—	—
MN Undervoltage Release	24	24	2	27108	27108	—
	48	48	2	27106	27106	A9N26961
	120	—	2	27107	27107	—
	240	—	2	27105	27105	A9N26960
OF Auxiliary Switch	12-277	12-125	1	MG26925	26924	26924
SD Alarm Switch	12-277	12-125	1	MG26928	26927	26927
OFS Alarm Switch for GFP Only	240/415	130	1	—	—	26923

### MN Undervoltage Release

The MN Undervoltage Release provides remote tripping of C60 or C120 devices. It causes the device to trip whenever the MN detects a drop of its control voltage to the range of 70 to 35% of nominal. The tripped condition is shown by a red indicator flag on the front panel of the MN undervoltage release. The MN undervoltage release is mechanically linked to the C60 or C120 device. It may be used in conjunction with the SD Alarm Switch, OF Auxiliary Switch, and/or the MX + OF Shunt Trip and Auxiliary Switch.

**NOTE:** The tripped circuit breaker or supplementary protector must be manually reset. The MN Undervoltage Trip prevents the device from being reclosed until the control voltage has been restored.

Models must be selected depending on the level of control voltage source (ac or dc).


- Used for emergency stop via push button.
- Used as safety feature on circuit supplying several machines, to prevent uncontrolled restarting of motors.
- UL Recognized for use with UL 1077 Recognized devices and UL Listed for use with UL 489/CSA C22.2 No.5 Listed devices.
- CSA and IEC Rated

The linkage is mechanical, thus ensuring the integrity of the protection function. Multiple auxiliaries may be used in combination with a single C60 or C120 protective device. Terminal pads for connection of control wiring are provided for either one or two 16–14 AWG (1.5–2.5 mm<sup>2</sup>) cables.

#### MN Time-delayed Undervoltage Release

The time-delayed undervoltage release is identical to the standard MN undervoltage release, except that it allows brief interruptions of control power without opening the circuit breaker due to undervoltage. It allows a 0.5 second time delay before opening the associated protective device.

**Table 37: Power Consumption of MX and MN Accessories**

Type	Voltage	VA or W	Type	Voltage	VA or W
MX (inrush)	415 Vac	120	MN (holding)	220–240 Vac	4.1
	220–240 Vac	50		48 Vac	4.3
	48–130 Vac	200		48 Vdc	2.0
	110–130 Vdc	10	MN  (holding) <sup>1</sup>	220–240 Vac	4.1
	48 Vac/Vdc	22			
	24 Vac/Vdc	120			

<sup>1</sup> IEC Rated; not UL/CSA Recognized.



**Table 38: Wiring for MX and MN Accessories**

Wire	Torque
16–14 AWG (0.5–2.5 mm <sup>2</sup> ) solid or stranded wire	9 lb-in. (1 N•m)

**MX + OF Shunt Trip and Auxiliary Switch**

The MX + OF switch combines the functions of shunt trip and auxiliary switch into one device. The MX Shunt Trip, when energized by a control voltage, provides remote tripping of the associated C60 circuit breaker or supplementary protector to which it is mechanically linked.

The tripped condition is indicated by a red indicator flag on the front panel of the MX + OF. The protective device must be manually reset after being tripped by the MX.

**NOTE:** When the OF function is combined with the MX Shunt Trip, no test button is provided.

The MX + OF Switch may be used in conjunction with the SD Alarm Switch, which presents the trip status, and/or the MN Undervoltage Release.

- UL Recognized for use with UL 1077 Recognized devices and UL Listed for use with UL 489/CSA C22.2 No.5 Listed devices.
- CSA and IEC Rated.

**OF Auxiliary Switch**

The OF Auxiliary Switch communicates the OPEN or CLOSED status of the associated C60 circuit breaker or supplementary protector via auxiliary contacts. It is mechanically linked to the supplementary protector (See the SD Alarm Switch for TRIP status).

It may be used in conjunction with the SD Alarm Switch, which presents the trip status, and the MN Undervoltage Release. It would not normally be used with the MX + OF Shunt Trip because that device already includes the OF function.

- UL Recognized for use with UL 1077 Recognized devices and UL 489/CSA C22.2 No.5 Listed devices.
- CSA and IEC Rated.

**OFS Auxiliary Switch and Adapter (for GFP and ID RCD)**

The OFS Auxiliary Switch and Adapter has an auxiliary switch to provide the auxiliary switch function and an adapter which allows the UL Listed GFP ground fault protector and the IEC Rated ID Residual Current Switches (in Section 4) to use the same electrical accessories as the C60 supplementary protectors, including the OF Auxiliary Switch, SD Alarm Switch, MN Undervoltage Release, and/or MX + OF Shunt Trip. It may be used alone or with accessories.

IEC Rated; not UL/CSA Recognized.

**Table 39: Catalog Number for OFS Auxiliary Switch and Adapter**

Description	Width in Modules	Catalog Number
OFS Auxiliary Switch and Adapter	1	26923



**Figure 19:**



**Figure 20:**





**SD Alarm Switch**

The SD Alarm Switch communicates the trip status of the associated C60 or C120 circuit breakers or supplementary protectors via auxiliary contacts. It is mechanically linked to the protective device. Locally, it also indicates a tripped-on-fault condition of the protective device with a red indicator flag on the front panel. (Use the OF Auxiliary Switch for open or closed status.)

A test switch allows simulation of the SD function without operating the protective device.

The SD Alarm Switch is reset when the associated protective device is reset, or it may be reset independently of the protective device with a reset lever on its front panel.


The SD Alarm Switch may show the circuit breaker status, using V Type Signal Lamps, other annunciators, or a control system. It may be used in conjunction with the OF Auxiliary Switch which presents the open or closed status, the MN Undervoltage Release, and/or the MX + OF Shunt Trip.

- UL Recognized for use with UL 1077 Recognized devices and UL Listed for use with UL 489/CSA C22.2 No.5 Listed devices.
- CSA and IEC Rated



Voltage	Breaking Capacity (A)	
	SD	OF
277 Vac	3	3
< 240 Vac	6	6
130 Vac	1	1
< 48 Vdc	2	2
< 24 Vdc	6	6

**Figure 21: Electrical Auxiliary Schematics**

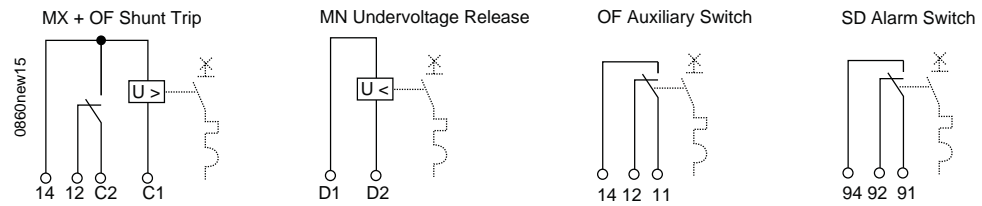

**Comb Bus Bars**

**UL Recognized C60 Comb Bus Bars**

A Comb Bus Bar can be used to provide common service to a number of Multi 9 supplementary protectors and accessories. This eliminates the hassle of providing discrete wiring to a number of protective devices operating from one power source. It is available in 0.71 in. (18 mm) pole spacings for the C60 series. It meets the UL 1077 requirements.

These are available in 1-, 2-, or 3-phase (conductor) models, and can be purchased in 12-pole (12P) lengths.

Field wiring may be applied directly to the comb bus bar by inserting both the conductor and the tooth of the comb into the same box lug connector of the C60N supplementary protector.

**Figure 22: UL Recognized C60 3-phase Comb Bus Bar**



Refer also to the tooth cap accessories for the comb bus bar.

- Rated insulation voltage: 480Y/277 Vac
- Rated current: 63 A service single-feed
- Available in 1-, 2-, or 3-phases (conductors)
- Spacing of outgoing poles: 0.71 in. (18 mm)
- Lengths: Fixed length of 12 poles
- Height: 0.80 inches (20 mm) above circuit breaker
- Connection: Comb tooth and main feed wire (10 AWG to 3 AWG) connect to box lug of UL 1077 C60N supplementary protector
- UL Recognized for use with UL 1077 devices only; not CSA Recognized

**Table 40: Catalog Numbers for UL Recognized C60 Comb Bus Bars**

Description	Length	Type	Cat. No.
12P Comb Bus Bar	8.5 in. (216 mm)	1Ø	MG10285
		2Ø	MG10286
		3Ø	MG10287

**Tooth Caps for UL Recognized Comb Bus Bars**

Tooth Caps for UL Recognized Comb Bus Bars may be slipped onto the unused teeth of the Comb Bus Bar. They come in strips of five with 1-pole spacing, but can be snapped apart to be used individually.

**Figure 23:**



**Table 41: Tooth Caps for UL Recognized Comb Bus Bars**





Description	Cat. No.
Tooth Caps for 0.71 in. (18 mm) Comb Bus Bar (20 Pieces)	60488

Connection Comb Bus Bars for C60 UL 1077 Circuit Breakers


The comb busbars are used only for C60 circuit breakers in conformity with standards UL 1077/ CSA C22.2 No. 3345-04 / IEC 60947-2 / GB 14048-2.

They perform distribution and sub-distribution of the electric power supply and allow rapid assembly and disassembly of equipment.



Connection Accessories	Comb Bus Bars			Tooth Cover End-Place Accessory
				
Function	<ul style="list-style-type: none"> <li>The comb bus bars make it easier to install Schneider Electric UL 1077 circuit breakers</li> <li>Power supply directly in the cage of the circuit breaker</li> </ul>			<ul style="list-style-type: none"> <li>The Tooth Caps are insulated protectors which may be slipped onto the unused teeth of the comb busbar</li> <li>They come in strips with 1-pole spacing, but can be snapped apart to be used separately</li> </ul>
Number of poles	1P	2P	3P	All
Voltage rating (Ue)	4870Y/277 Vac			—
Catalog number	10285	10286	10287	60488
Number of 18 mm modules	12 (8.5 in. / 216 mm)	12 (8.5 in. / 216 mm)	12 (8.5 in. / 216 mm)	—
Set of	1	1	1	29
Technical Specifications				
Insulation Voltage (U)	690 V			
Impulse withstand voltage (Uimp)				
Acceptable current at 40°C	65 A with 1 central power supply point		100 A with 2 power supply points	
				
	Power supply via cable directly in the cage of the device: <ul style="list-style-type: none"> <li>cross section max: 3 AWG (25 mm<sup>2</sup>)</li> <li>cross section min: 10 AWG (5.27 mm<sup>2</sup>)</li> </ul>			
Resistance to short-circuit currents	Compatible with the breaking capacity of C60 YL 1077 Schneider Electric modular circuit breakers			
Fire resistance	Self-extinguishability 960°C 30 s/30 s			
Color	RAL 9001			RAL 1021

Dimensions: :in.  
(mm)

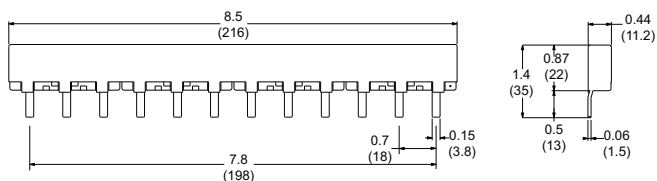

# Multi 9™ System Catalog

## Section 5—Accessories

### Connection Comb Bus Bars for C60 UL489 Circuit Breakers

The comb busbars are used only for C60 circuit breakers in conformity with standards UL 489 / CSA C22.2 No.5-02 or IEC 60947-2 /fitted with tunnel terminals.


They perform distribution and sub-distribution of the electric power supply and allow rapid assembly and disassembly of equipment.



Connection Accessories	Comb Busbar						Insulated Connector		Tooth Cover End-Place
	1P x 240 V - 12 modules		3p x 480Y - 12 modules		3p 480Y - Can accept auxiliaries				
Function	<ul style="list-style-type: none"> <li>The comb busbars make it easier to install Schneider Electric UL 489 circuit breakers</li> <li>They must not be cut</li> </ul>						<ul style="list-style-type: none"> <li>Comb busbar power supply</li> <li>Vertical incoming feeder</li> </ul>		<ul style="list-style-type: none"> <li>Insulation of teeth remaining free</li> </ul>
Use	<ul style="list-style-type: none"> <li>Power supply by insulated connector</li> </ul>						<ul style="list-style-type: none"> <li>For semi-rigid copper cable of #1–#12 AWG (4–36 mm<sup>2</sup>)</li> <li>Tightening torque: 53 lb-in (6 N•m) max.</li> </ul>		
No. of poles	1P		2P		3P		All		All
Voltage rating (Ue)	240 Vac		480Y/277 Vac		240 Vac 480Y/277 Vac		240 Vac 480Y/277 Vac		—
Catalog Numbers	10170	10171	10180	10181	10172	10182	10173	10182 10193 <sup>1</sup>	10175 10185 10190
No. of 18 mm modules	6	12	6	12	12		12		—
Set of	5		5		5		15		9

Technical Specifications			
Insulation voltage (Ui)	1000 V		
Impulse withstand voltage (Uimp)	12 kA		
Acceptable current at 40°C (Ia)	240 V: 100 A 480Y: 20 A		—
Max. current per feeder	—		—
Resistance to short-circuit currents	Compatible with the breaking capacity of Schneider Electric modular circuit breakers		—
Fire resistance	Self-extinguishability 960°C 30s/30s		
Color	RAL9001		RAL1021
Standards	UL506		UL485E —

<sup>1</sup> With spare spaces of 18 mm for electrical auxiliary.

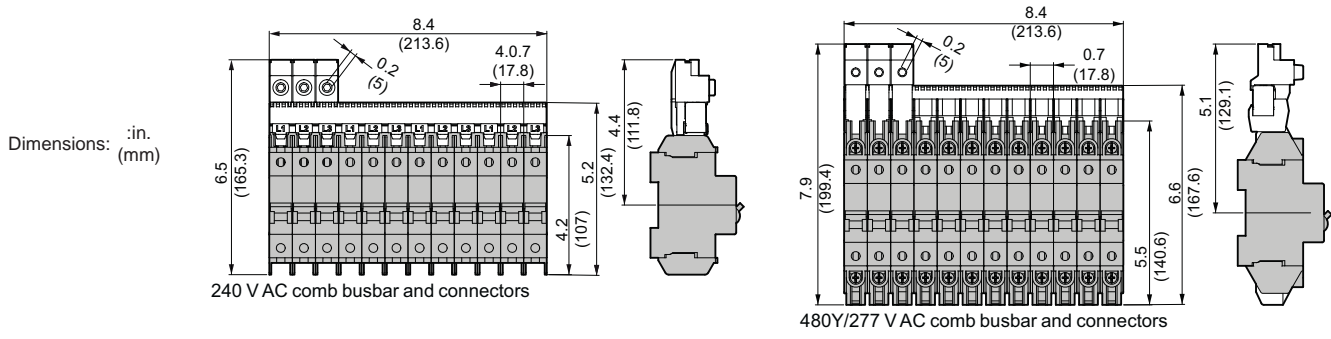

**IEC Rated C60 Comb Bus Bars**

These are available in 1-, 2-, 3- or 4-phase (conductor) models, and can be purchased in 12-pole, 24-pole, or 54-pole (1 meter) lengths.

Refer also to the accessories for the Comb Bus Bar described below.

- Rated insulation voltage: 500 Vac as per IEC 664.
- Rated Current: 100 A service single-feed, 120 A double-feed
- Available in 1-, 2-, 3-, or 4-phase (conductor) models
- Spacing of outgoing poles: 18 mm (0.71 in.) on center
- Lengths: 12, 24, or 54 poles; may be cut to desired length
- IEC Rated

**Figure 24: IEC Rated C60 Comb Bus Bars and End Caps**



**Table 42: Catalog Numbers for IEC Rated C60 Comb Bus Bars**

Description	Length	Type	Cat. No.
12P Comb Bus Bar	8.5 in. (216 mm)	1Ø	A9XPH112
		2Ø	A9XPH212
		3Ø	A9XPH312
		4Ø	A9XPH412
24P Comb Bus Bar (package of 2)	17 in. (432 mm)	1Ø	MG14891
		2Ø	A9XPH224
		3Ø	A9XPH324
		4Ø	A9XPH424
54P Comb Bus Bar	39.4 in. (1 m)	1Ø	A9XPH157
		2Ø	A9XPH257
		3Ø	A9XPH357
		4Ø	A9XPH457

**End Caps for IEC Rated C60 Comb Bus Bars**

The End Caps are IEC Rated insulating devices which snap onto the ends of the Comb Bus Bar to retain the bus bars within their protective shield and to ensure the spacing of the conductors.

**Figure 25:**



**Table 43: End Caps for IEC Rated C60 Comb Bus Bars**

Description	Type	Cat. No.
End Caps for Comb Bus Bar (10 pieces)	1Ø	A9XPE110
	2Ø	A9XPE210
	3Ø	A9XPE310
	4Ø	A9XPE410

**Connector for IEC Rated Comb Bus Bars**

The IEC Rated connectors are provided for connecting field wiring to a comb bus bar.

**Figure 26:**



- These connectors accept up to 2 AWG wiring.
- Torque to 22 lb-in (2.5 N•m)

**Table 44: IEC Rated C60 Connectors**

Description	Wire Size	Cat. No.
Connector (4 Pieces)	2 AWG (25 mm <sup>2</sup> )	A9XPCM04

**Tooth Caps for IEC Rated Comb Bus Bars**

Tooth Caps for IEC Rated Comb Bus Bars are insulated protectors which may be slipped onto the unused teeth of the Comb Bus Bar. Tooth caps come in strips of five with 1-pole spacing, but can be snapped apart to be used individually.



**Table 45: Tooth Caps for IEC Rated Comb Bus Bars**

Description	Cat. No.
Tooth Caps for Comb Bus Bar (20 pieces)	A9XPT920

**Device Shielding**

**DIN Rail Spacer**

**Figure 27:**



The Spacer clips onto a DIN rail to occupy the space of one 0.35 in. (9 mm) module. It can be used to provide space for future protective devices and accessories. It may also be used to provide a ventilation gap to prevent overheating.

IEC Rated; not UL/CSA Recognized

**Table 46: Catalog Numbers for IEC Rated DIN Rail Spacer**

Description	Width	US No.	IEC No.
Spacer for IEC Rated C60 and C120 Circuit Breakers	0.354 in. (9 mm)	MG27062	27062

### Interphase Barriers

Figure 28:



The Interphase Barriers snap onto the top and bottom of the C60 devices to provide increased isolation distance between two adjacent connectors.

**NOTE:** These are not needed with the versions of C60 with UL 489/CSA C22.2 No.5 Rating nor with the Ring Lug Terminal kit, since those products already include increased isolation barriers.

IEC Rated; not UL/CSA Recognized

Table 47: Catalog Numbers IEC Rated Interphase Barrier

Description	Quantity	US No.	IEC No.
Interphase Barriers for C60 Circuit Breakers	10 Pieces	MG27001	27001

### Terminal Screw Shields

Figure 29:



The Terminal Screw Shield snaps onto the front of the C60N or C120 protective devices to provide greater insulation of the terminal screws.

IEC Rated; not UL/CSA Recognized

Table 48: IEC Rated Terminal Screw Shields for C60 Circuit Breakers<sup>1</sup>

Description	Quantity	Cat. No.
Terminal Screw Shield	Bag of 2 strips of 4	MG26981

<sup>1</sup> Not for the UL 489/CSA C22.2 No.5 Listed C60 circuit breakers.

### Terminal Covers



The Terminal Covers completely cover the terminals, either standard or screw-type connectors. They make the use of the interphase barriers unnecessary.

IEC Rated; not UL 1077/CSA C22.2 No. 235 Recognized

Table 49: Catalog Numbers for Terminal Covers for C60 Circuit Breakers<sup>1</sup>

Description	Device	Size	UL Recognized Cat. No.	IEC Rated Cat. No.
Terminal Cover	C60	1P	MG26975	26975
		2P	MG26976	26976
		3P	MG26975 + MG26976	26975 + 26976
		4P	MG26978	26978

<sup>1</sup> Not for the UL 489/CSA C22.2 No.5 Listed C60 circuit breaker.

### Ring Lug Terminal Kit

Figure 30:



The Ring Lug Terminal kit provides isolation barriers and ring terminals to convert a standard box lug UL 1077 Recognized C60 supplementary protector or UL 489A DC rated Communications circuit breaker to allow front or rear connection with ring type terminals. The kit allows a UL 1077 Recognized C60 device or UL 489A DC rated Communications to retain its rating. It cannot be field-installed on a UL 489/CSA C22.2 No.5 Listed C60 product. UL 489/CSA C22.2 No.5 circuit breakers may be ordered with factory installed ring terminals.

These are user-installed. The Interphase Barriers (or Terminal Covers) cannot be used in conjunction with the ring tongue terminal kits.

- Torque for ring tongue into box lug: 30 lb-in. (3.4 N•m).
- Torque for ring terminal: 18 lb-in (2.0 N•m).


Table 50: UL Recognized Ring Lug Terminal Kit

Description	Quantity	Cat. No.
Ring Lug Terminal Kit	Two Ring Tongue Terminals Two Isolation Shrouds Two 5 mm Screws	17400

## Identification System

### Snap-on Marking Symbols

Figure 31:



The Identification System provides marking symbols which can be used on the C60 and C120 devices. They provide pre-labeled, snap-on plastic clips with one character each. They mount just below the toggle on the C60 devices.

The following symbols are available: Blank, 0-9, +, -, and A-Z.

Orders must specify standard package quantity of 25 strips of each character or multiples of 25.

**NOTE:** These are same as markers for Telemecanique AB1 terminal blocks.

IEC Rated; not UL/CSA Recognized

Table 51: Catalog Numbers for Snap-on Marking Symbols

Marking	Quantity	Cat. No.	Marking	Quantity	Cat. No.
A	Strip of 10	AB1GA	1	Strip of 10	AB1R1
B	Strip of 10	AB1GB	2	Strip of 10	AB1R2
C	Strip of 10	AB1GC	3	Strip of 10	AB1R3
D	Strip of 10	AB1GD	4	Strip of 10	AB1R4
E	Strip of 10	AB1GE	5	Strip of 10	AB1R5
F	Strip of 10	AB1GF	6	Strip of 10	AB1R6
G	Strip of 10	AB1GG	7	Strip of 10	AB1R7
H	Strip of 10	AB1GH	8	Strip of 10	AB1R8
I	Strip of 10	AB1GI			
J	Strip of 10	AB1GJ	9	Strip of 10	AB1R9
K	Strip of 10	AB1GK	0	Strip of 10	AB1R0
L	Strip of 10	AB1GL			
M	Strip of 10	AB1GM			
N	Strip of 10	AB1GN	0-9	Strip of 10	AB1R11
O	Strip of 10	AB1GO			
P	Strip of 10	AB1GP			
Q	Strip of 10	AB1GQ			
R	Strip of 10	AB1GR	+	Strip of 10	AB1R12
S	Strip of 10	AB1GS	-	Strip of 10	AB1R13
T	Strip of 10	AB1GT			
U	Strip of 10	AB1GU			
V	Strip of 10	AB1GV			
W	Strip of 10	AB1GW			
X	Strip of 10	AB1GX	Blank	Strip of 10	AB1RV
Y	Strip of 10	AB1GY			
Z	Strip of 10	AB1GZ			



## Operation Devices

### Rotary Handles

A C60 or C120 protection device with 2-, 3-, or 4-poles can be equipped with a rotary handle with an extension to allow operation of the circuit breaker from either the front or the side (lateral) from the outside of a panel.

The handle requires that an operating subassembly be affixed to the supplementary protector or circuit breaker. The operating subassembly requires one of two versions of the rotary handle:

- The first is a fixed handle for front or lateral mounting on a fixed panel.
  - The second is a draw-out extended handle which may be mounted on a door or hinged panel. It mates with the operating subassembly as the door is closed.
- Minimum depth for drawout is 6.8 in. (174 mm) including circuit breaker.
  - Minimum depth for lateral installation is 4.8 in. (122 mm) including circuit breaker.
  - IEC Rated; not UL/CSA Recognized

**Table 52: IEC Rated Rotary Handles**

Description	US Cat. No.	IEC Cat. No.
Operating Subassembly for C60 or C120 Protection Device (Fixed to Protection Device)	MG27046	27046
Drawout Extended Handle (Mounted on Door or Hinged Panel)	MG27047	27047
Fixed Handle Front or Lateral (Mounted on Fixed Panel)	MG27048	27048

Operating Subassembly with Lateral Rotary Handle



### Padlock Attachments

The Padlock Attachment clips onto the face of the C60N device to prevent the handle from being operated. It cannot be installed or removed when padlocked. No tools are needed to install it.

The Padlock Attachment allows the IEC C60 circuit breaker to be locked in either the ON or the OFF position (UL 489/CSA C22.2 No.5 Listed and UL 1077 Recognized devices can lock in the OFF position only). The padlock attachment accepts a 0.315 in. (8 mm) diameter padlock, which is not supplied.

The front plate or functional door can be opened with the circuit breaker locked in the OFF position.


**NOTE:** Locking the C60 or C120 in the ON position will not prevent the device from tripping under overcurrent or ground fault conditions.

IEC Rated; not UL/CSA Recognized

**Table 53: Catalog Numbers for IEC Rated Padlock Attachments**

Description	Quantity	US Cat. No.	IEC Cat. No.
Padlock Attachment for C60 Protection Device	Bag of 2	MG26970	26970
Heavy-Duty Padlock Attachment for C60N	Bag of 1	L4D	—
Padlock Attachment for C120 Protection Device	Bag of 4	MG27145	27145

Padlock Attachment



# Multi 9™ System Catalog

## Section 5—Accessories

### Lock-Off Attachments

Handle Lockoff Attachment



The Lock-Off Attachment is a permanently-installed, side-mounted accessory for the C60 and C120 circuit breakers to allow locking the circuit breaker in the off position. The attachment is available for right or left side application and is made of optically clear materials so text on the side of the circuit breaker can still be read after installation. The lock-off attachment accepts a 0.25–0.375 in. (6–9.5 mm) diameter padlock, which is not supplied.

The front plate or functional door can be opened with the circuit breaker locked in the OFF position.

UL Rated; CSA Recognized


**Table 54: Catalog Numbers for Handle Lock-Off Attachments**

Description	Left Hand Kit	Right Hand Kit
Handle Lock-Off Kit for C60 Protection Device	MGN26380	MGN26381
Handle Lock-Off Kit for C120 Protection Device	MGN26382	MGN26383

## Mounting Accessories

### Plug-in Base

Figure 32:

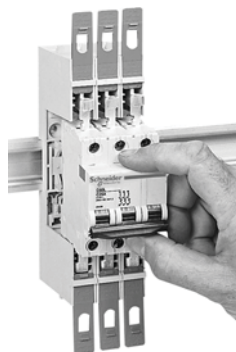

The Plug-in Base allows permanent field wiring connections to be made to the base, so that a C60 device can be plugged in or removed without affecting field wiring.

The Plug-in Base kit includes spade connectors which must be installed on the circuit breaker so it will mate with the Plug-in Base. The Plug-in Base provides no-load isolation of a circuit protected by C60 supplementary protectors.

While the circuit breaker is removed, the base can be locked using a 0.32 in. (8 mm) dia. padlock (not provided).

- Height of base: 7.0 in. (178 mm); with terminal cover extended, 9.3 in. (237 mm)
- Allow minimum center spacing of 7.87 in. (200 mm) between two rows of bases
- Multiple bases may be used for multi-pole devices
- IEC Rated; not UL/CSA Recognized

Table 55: Catalog Numbers for IEC Rated Plug-in Base

Description	US Cat. No.	IEC Cat. No.
Plug-In Base for C60 Devices	MG26996	26996

### Front Mounting Bracket (Kit)

Figure 33:



The Front Mounting Bracket provides a convenient way to mount Multi 9 circuit breakers, supplementary protectors or accessories. Its height is equal to a 35 mm DIN rail, and allows the C60 and C120 devices to be clipped onto it in a standard manner. Its width is available for 1-, 2-, 3-, or 4-pole devices.

In 480 Vac UL 1077 applications, Cat. No. 26981 (C60) or 27152 (C120) Terminal Screw Shield should be used for increased isolation between the terminal screws of the Multi 9 device and the mounting bracket. These shields are included with the mounting bracket kits.

UL/CSA Recognized and IEC Rated

Table 56: Catalog Numbers for Front Mounting Bracket Ordering Information

Description	Size	Cat. No.
Front Mounting Bracket for C60 Protective Devices	1P	MG26983
	2P	MG26984
	3P	MG26985
	4P	MG26989
Front Mounting Bracket for C120 Protective Devices	1P	MG26986
	2P	MG26987
	3P	MG26988
	4P	MG26990

**NOTE:** See dimensional drawings in Section 7.

**DIN Rail Mounting Clips**

Additional DIN Rail Mounting Clips for Multi 9 products are available.

**Figure 34:**



**Table 57: DIN Rail Mounting Clips**

Description	Cat. No.
DIN Rail Mounting Clip (Bag of 50)	<b>MG27124</b>

**UL/CSA Recognized Mounting Base for Multi 9 C60 Circuit Breakers**

The mounting base for UL 489/CSA C22.2 No.5 240 V Multi 9 C60 miniature circuit breakers is designed for OEM applications requiring a large number of Multi 9 circuit breakers in a single piece of equipment. Providing a means for mounting and a bus for line power, this mounting base offers a convenient solution to powering an entire group of circuit breakers. In addition to simplifying wiring for multiple UL 489 240 V devices, the mounting base minimizes the cost of installation by eliminating discrete wiring of line conductors.



The mounting bases for UL 489/CSA C22.2 No.5 240 V Multi 9 C60 circuit breakers are offered in a variety of configurations, which meet most OEM applications. Available in lengths from 12 to 60 poles, this mounting base handles the large number of Multi 9 circuit breakers found in OEM equipment.

The standard terminals on the US mounted base are 1-inch wide and have 1/4-20 x 1-in. studs, which can be used with compression (ring) terminals or with a bus bar. Nuts with washers are provided for each terminal stud. The terminals of the UL mounting base are aligned with the load terminals of the PowerPact H- and J-frame molded case circuit breakers. This allows them to be connected using straight, flat jumper bars.

UL/CSA Recognized for use with U489 240 V Multi 9 C60 miniature circuit breakers per UL 67, CSA C22.2 No. 29 and IEC 60439-1. Also CE marked.

**Table 58: Specifications for Mounting Base for UL 489/CSA C22.2 No.5 Multi 9 C60 Circuit Breakers**

Voltage	240 Vac 125 Vdc
Ampacity	200 A Maximum, see table below
Withstand Rating	10 ka @ 0.05 seconds
Conductors/Bus	1, 2 and 3 Conductors, Suitable for Use with 1P, 2P and 3P Circuit Breakers
Pole Capacity	12, 24, 36, 48, 60
Branch Circuit Breakers	UL 489/CSA C22.2 No.5 240 V C60 with 18 mm Spacing
Input Terminal	1 in. Wide Terminal with 1/4-20 x 1 in. Studs with Nuts/Washers for Compression Ring Lugs, Bus Bar or Optional Lugs

**Table 59: Catalog Numbers for Mounting Base for UL 489/CSA C22.2 No.5 Multi 9 C60 Circuit Breakers**

Poles	1 Conductor		2 Conductors		3 Conductors	
	Maximum Amperage	Cat. No	Maximum Amperage	Cat. No	Maximum Amperage	Cat. No
12	200 A	<b>US11220018</b>	150 A	<b>US21215018</b>	100 A	<b>US31210018</b>
24	200 A	<b>US12420018</b>	200 A	<b>US22420018</b>	200 A	<b>US32420018</b>
36	200 A	<b>US13620018</b>	200 A	<b>US23620018</b>	200 A	<b>US33620018</b>
48	200 A	<b>US14820018</b>	200 A	<b>US24820018</b>	200 A	<b>US34820018</b>
60	200 A	<b>US16020018</b>	200 A	<b>US26020018</b>	200 A	<b>US36020018</b>


### Mounting Base Accessories

#### Wire Lug Kit

The optional Wire Lug Kit, Catalog Number USMBLK, can be field installed for use with cable. Each kit consists of one lug, one nut and washer assembly. One kit must be ordered for each conductor terminal. The lug mounts on the 1/4-in. terminal stud of the mount base and is secured with a nut with washer. This lug accepts 6 AWG to 300 kcmil copper or aluminum cable. The barriers between the phases provide separation between the phases; an optional terminal cover is also available.

#### Terminal Cover Kit

The optional Terminal Cover Kit, Catalog Number USMBTC, is designed to provide shielding of the terminals, bus bars, lugs and cabling. Snapping onto the terminal end of the mounting base, the terminal cover has an opening for a bus bar jumper and knock-outs to accommodate various sizes of cable.

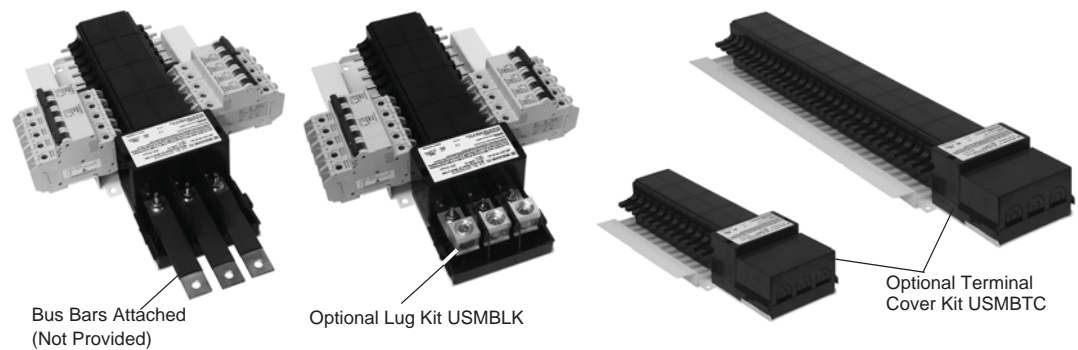

**MSC IEC Mounting Base**

The Multi 9 MSC Mounting Base is an integral package that provides DIN mounting of Multi 9 devices and provides either a 2-phase or 3-phase bus bar for up to 24 poles (in two rows) of C60 devices and accessories. The MSC 27 is used for IEC rated C120 products.

**Figure 35:**



The base is rugged, gloss-white, zinc annealed sheet steel with two rows of DIN mounting rails. The heavy-duty base plate allows surface mounting. The single-piece copper bus conductors are insulated and color-coded. Power may be supplied by a reverse-fed C60 circuit breaker, or via the feed-through connections at the end of the bus. The feed lugs are compatible with Compact® NS250 molded case circuit breakers and Interpact™ INS-250 switches.

- Rating: Up to 250 A service
- Insulation voltage: 690 Vac
- Current withstand:
  - Peak: 52.5 kA
  - Short-time: 25 kA for 0.1 sec.
- Phases are color-coded
- Width: Base 8.5 in. (216 mm); see Table 60 for length
- Tested to Australian AS3439-1 and AS3439-3 standards (equivalent to IEC 439)
- IEC Rated; not UL/CSA Recognized

**Table 60: Catalog Numbers for IEC Rated MSC Mounting Base for Multi 9 Devices**

Type	Size	No. of Poles	Base Length <sup>1</sup> (in./mm)	Cat. No. <sup>2</sup>
MSC DC for C60 Protection Devices (Black, Red)	2Ø	12	4.33/110	<b>C3DC123</b>
		16	5.75/146	<b>C3DC163</b>
		20	7.17/182	<b>C3DC203</b>
MSC 18 for C60 Protection Devices (Red, White, Blue)	3Ø	12	4.33/110	<b>C325123</b>
		18	6.46/164	<b>C325183</b>
		24	8.58/218	<b>C325243</b>
MSC 27 for C120 Protection Devices (Red, White, Blue)	3Ø	12	9.57/162	<b>C125123</b>
		18	14.35/243	<b>C125183</b>
		24	19.13/324	<b>C125243</b>

<sup>1</sup> For overall length, add approximately 5 in. (127 mm) for bus terminals.

<sup>2</sup> Add -TF suffix for top feed only.

**NOTE:** Other options are available by special order, including: lengths up to 72 poles, line feed lugs at one end only, and other variations.

### Multi-Pole Front Mounting Kit

The Multi-Pole Front Mounting Kit consists of a transparent, hinged, weatherproof cover. It allows installation of up to twenty modules (10 poles of C60) of Multi 9 circuit breakers or supplementary protectors and accessories. A DIN mounting rail with support is also available.

- Degree of protection as per IEC 529: IP55
- Dimensions (w x h x d): 9.25 x 4.96 x 1.3 in. (235 x 126 x 33 mm)
- Cutout dimensions: 7.32 x 3.78 in. (186 x 96 mm)
- IEC Rated; not UL/CSA Recognized

Figure 36:

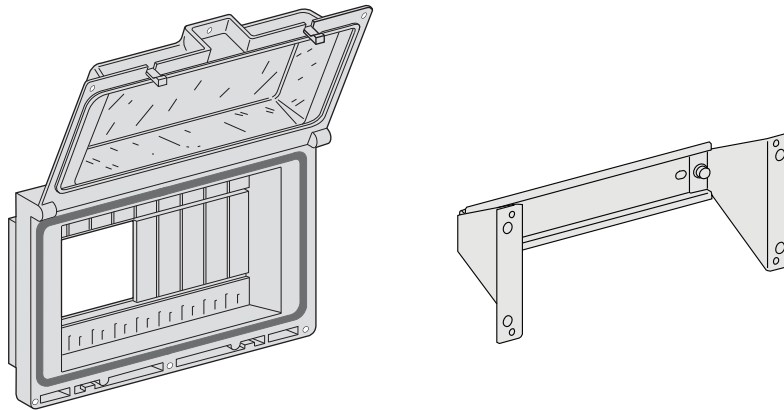


Table 61: Catalog Numbers for IEC Rated Multi-Pole Front Mounting Kit

Description	Cat. No.
Multi-Pole Front Mounting Kit with Transparent Hinged Cover (Includes a 10-Module Divisible Blanking Plate and Mounting Template)	14210
DIN Rail with Support	14211

### Pole Filler

The Multi 9 M9PF4 pole filler is used to fill empty panel spaces. They clip into the space. Each M9PF4 consists of four strips of four by 18 mm pole fillers (16 poles total). They may be snapped apart in 9 mm increments.



One Strip of M9PF4

Table 62: Pole Filler

Description	Cat. No.
Pole Filler, four strips of four by 18 mm	M9PF4

## Section 6—Additional System Devices

In addition to the C60 and C120 Circuit Breakers and Supplementary Protectors which form the heart of the Multi 9 product line, there are a variety of other devices which may be used with C60 or C120 devices or as stand-alone devices.

These include the following:

- CM Selector Switches (Change-Over)
- I Current Isolating Switches
- V Signal Lamps and BP Push Buttons
- CI Impulse Counters and CH Hour Counters

**NOTE:** See Section 4 for Ground-Fault Protection Devices.

All of these devices adhere to the Multi 9 packaging format, and can be mounted on a DIN rail in the protection and control cabinet.

**NOTE:** See Class 1312 Catalog (document no. 1312CT0101) for recommended protection of the SPD.

### CM Selector Switches

The CM Selector Switch allows manual selection of circuits. Different models are available to allow selection of two or three positions (including off) for one or two circuits. They have maximum ratings of 20 A and 250 Vac and accept cable up to 7 AWG (10 mm<sup>2</sup>). Torque cable to 11 in-lb (1.2 N•m).

This device may be installed on the DIN rail adjacent to the C60 device and its accessories or remotely in a user interface panel.

IEC Rated; not UL/CSA Recognized

Figure 37:





Table 63: IEC Rated CM Selector Switches






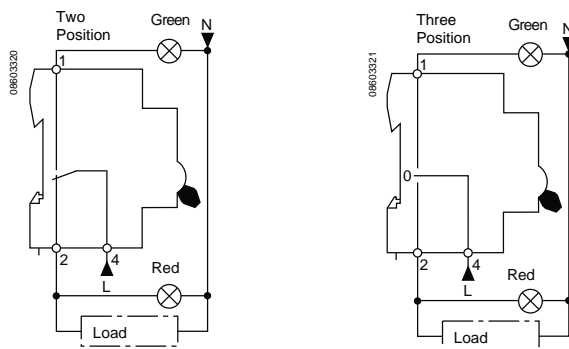
CM Selector Switch Type	No. of Circuits	No. of Positions	Width in Modules	Cat. No.
	1	2	2	A9E18070
	1	3	2	A9E18073
	2	2	4	A9E18071
	2	3	4	A9E18074
	2	2	4	A9E18072

Figure 38: IEC Rated CM Selector Switch Schematics



# Multi 9™ System Catalog

## Section 6—Additional System Devices

### I Current Isolating Switch

The I Isolating Switch provides manual on-load opening or closing of a circuit. Note that it does not provide either thermal or magnetic protection.

It can be used with the OF auxiliary switch and with other non-electrical accessories in the C60 circuit breaker family. This device may be installed on the DIN rail adjacent to the C60 device and its accessories or remotely in a user interface panel.

IEC Rated; not UL/CSA Recognized

**Table 64: I Current Isolating Switch Termination**

Amperage	Wire Type	Wire Size		Torque	
20 and 32 A	Stranded	16–6 AWG	1.5–10 mm <sup>2</sup>	16 lb-in.	1.8 N•m
	Solid	16–6 AWG	1.5–10 mm <sup>2</sup>	16 lb-in.	1.8 N•m
40–125 A	Stranded	10–1 AWG	6–50 mm <sup>2</sup>	40 lb-in.	4.5 N•m
	Solid	14–4 AWG	2.5–35 mm <sup>2</sup>	40 lb-in.	4.5 N•m

**Table 65: Catalog Numbers for IEC Rated I Current Isolating Switches**

Rating (A)	1P (250 Vac) 2 Modules	2P (415 Vac) 2 Modules	3P (415 Vac) 4 Modules	4P (415 Vac) 4 Modules
20	A9S60120	A9S60220	A9S60320	A9S60420
32	A9S60132	A9S60232	A9S60332	A9S60432
40	A9S60140	—	—	—
63	A9S60163	—	—	—
100	A9S60191	—	—	—
125	A9S60192	—	—	—

**Figure 39: I Switches**



## Status, Display and Control Accessories

There are a variety of other accessories which may be used with the C60 or C120 devices to communicate control and/or status information. These include the following:

- V Type Signal Lamps
- BP Push Buttons
- CH Hour Counter
- CI Impulse Counter

These accessories may be located adjacent to the C60 or C120 devices or may be located remotely.

### V Signal Lamp

The V Type Signal Lamp indicates when voltage is applied to a circuit and may be used with Multi 9 circuit protection systems or other applications. The lamps are high-efficiency, long-life LEDs. The lenses are available in a variety of colors.

This accessory device may be installed on the DIN rail adjacent to the C60 devices and its accessories or remotely in a user interface panel. It accepts cable up to 7 AWG (10 mm<sup>2</sup>). Torque cable to 11 lb-in. (1.2 N•m).

**NOTE:** IEC Rated; not UL/CSA Recognized



**Table 66: Multi 9 IEC Rated V Indicator Lights**

Type	Width in 9 mm Modules	Color	Cat No. 110-230 Vac	Cat No. 12-48 Vac/Vdc
<b>Single LED Indicator Light</b>				
	2	Red	A9E18320	—
		Green	A9E18321	—
		White	A9E18322	—
		Blue	A9E18323	—
		Yellow	A9E18324	—
<b>Double LED Indicator Light</b>				
	2	Green/Red	A9E18325	A9E18335
<b>Blinker</b>				
	2	Red	A9E18326	

# Multi 9™ System Catalog

## Section 6—Additional System Devices

### BP Push Buttons

Figure 40:



Push Buttons with Signal Lamps

The BP Push Button device may be used to control Multi 9 circuit protection systems or other equipment. It provides momentary switching and is available with one N.O., one N.C., or combined with one each N.O. + N.C. contact.

It is available with or without a signal lamp, which is available in a variety of colors. The lamps are high-efficiency long-life LEDs.


This device may be installed on the DIN rail adjacent to the C60 and its accessories or remotely in a user interface panel. It accepts cable up to 7 AWG (10 mm<sup>2</sup>). Torque cable to 11 lb-in. (1.2 N•m).

IEC Rated; not UL/CSA Recognized.

Table 67: IEC Rated Multi 9 BP Pushbuttons Catalog Numbers

Type	Width in 9 mm Modules	Power	Lamp Color	Pushbutton Color	Circuit	Catalog Number
<b>Single BP</b>						
	2			Grey	1 NC	A9E18030
				Red	1 NC	A9E18031
				Grey	1 NO	A9E18032
				Grey	1 NO + 1 NC	A9E18033
<b>Double BP</b>						
	2			Green/Red	1 NO / 1 NC	A9E18034
				Grey/Grey	1 NO / 1 NO	A9E18035
<b>Single BP + LED Indicator Light</b>						
	2	110-230 Vac	Green	Grey	1 NO	A9E18036
			Red	Grey	1 NC	A9E18037
		12-48 Vac/Vdc	Green	Grey	1 NO	A9E18038
			Red	Grey	1 NC	A9E18039

Figure 41: Schematics for IEC Rated BP Push Button Types

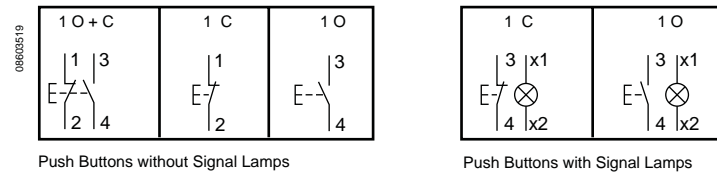

**CH Hour Counter**

Figure 42:



The CH Hour Counter is used for measuring the total operating time of a circuit or load. It is capable of counting to a maximum of 99,999.99 hours. It operates on 224–440 Vac, 50 Hz. The CH must be installed downstream of a circuit breaker or supplementary protector.


The CH Hour Counter is useful for metering of activity or for scheduling maintenance.

This device may be installed on the DIN rail adjacent to the C60 and its accessories or remotely in a user interface panel.

**NOTE:** IEC Rated; not UL/CSA Recognized

Table 68: Information for IEC Rated CH Hour Counter

Wire Size		Torque	
16–14 AWG	1–2.5 mm <sup>2</sup>	0.8 lb-in	1.1 N•m



**CI Impulse Counter**



The CI Impulse Counter is an electromechanical counter designed to measure impulses produced by various devices. It displays the running total of metered impulses up to a maximum count of 9,999,999 impulses. The CI Impulse Counter is unaffected by interruptions in the main power supply.

It is most suitable for counting impulses emitted by detectors such as kilowatt-hour metering, temperature overrun, etc.

This device may be installed on the DIN rail adjacent to the C60 device and its accessories or remotely in a user interface panel.



Figure 43: Schematics for IEC Rated CI Impulse Counter

**NOTE:** IEC Rated; Not UL/CSA Recognized

Table 69: CH Hour Counter and CI Impulse Counter

Type	Voltage (Vac)	Frequency (15% to +6%)	Width in Modules	Cat. No.
CH	220–240	50 Hz	4	15440
CI	220–240	50/60 Hz	4	15443

Table 70: Wiring Information

Wire Size		Torque	
16–14 AWG	1–2.5 mm <sup>2</sup>	0.8 lb-in	1.1 N•m

## **Kaedra™ Weatherproof DIN Type Enclosures**

### **Applications**

- Expandable enclosures for service, industrial, or equipment applications
- Protects against water, dust, and chemical and atmospheric agents
- Kaedra mini-enclosures are designed for small installations (3 to 12 modules) replacing Mini-Pragma™ weatherproof enclosures.
- Kaedra enclosures come in seven sizes from 12 to 72 modules (18 mm per module).

### **Standard Features**

- IP 65: as per IEC 60529 for protection against ingress of solids and liquids.
- IK09: Protection against shocks and resistance to chemical and atmospheric agents, ultraviolet light, etc.
- Class 2: Total insulation
- Flame and abnormal heat resistance: 750°C as per IEC 60695-2-1
- Conformity with IEC 670 standard for empty enclosures and with IEC 439-3 standard for equipped switchboards.
- It is made of insulating material, Class 2, and can be sealed and/or locked (keylock or insert). It complies with IEC 60439-3 Standards.  
Not UL/CSA recognized.

### **Construction**

- Modern, non-metallic (styrene), sturdy appearance in light gray RAL 7035; smooth surfaces and rounded corners to increase impact strength.
- Transparent (green) door for immediate visibility; door can be mounted left or right with clip-on hinges; secure closing due to multiple latching points; door may be locked to limit access.
- Punchout holes on four sides and back enable cable insertion throughout.

### **Installation**

- Can be installed horizontally and/or vertically
- Enclosures can be combined and added at any time using the association kits to provide mechanical connection and cable routing.
- Cabling is quick and efficient with the provided terminal blocks and wiring straps.
- Distance between rails (125, 150, 175 mm) and rail depth are adjustable. Chassis can be removed for assembly of equipment.
- Function identification with a clip-on label with protection cover.

Figure 44:



Table 71: Kaedra Weatherproof Mini-Enclosures<sup>1</sup>

Description	Dimensions						Cat. No.
	W		H		D		
	in.	mm	in.	mm	in.	mm	
1 Row of 3 Modules <sup>2</sup>	3.15	80	5.9	150	3.86	98	13956
1 Row of 4 Modules	4.84	123	7.87	200	4.41	112	13957
1 Row of 6 Modules	6.26	159	7.87	200	4.41	112	13958
1 Row of 8 Modules	7.68	159	7.87	200	4.41	112	13959
1 Row of 12 Modules	10.51	267	7.87	200	4.41	112	13960

<sup>1</sup> Accessories include: terminal blocks and terminal block support; Class II plugs.

<sup>2</sup> Enclosure modules are 18 mm wide.

**NOTE:** The Kaedra Weatherproof enclosures replace the Mini-Pragma enclosures.

Figure 45:



Table 72: Kaedra Weatherproof Enclosures<sup>1</sup>

Description	Dimensions						Cat. No.
	W		H		D		
	in.	mm	in.	mm	in.	mm	
1 Row of 12 Modules <sup>2</sup>	13.39	340	11.02	280	6.23	160	13962
2 Rows of 12 Modules	13.39	340	18.11	460	6.23	160	13964
3 Rows of 12 Modules	13.39	340	24.02	610	6.23	160	13966
1 Row of 18 Modules	13.39	340	11.02	280	6.23	160	13963
2 Rows of 18 Modules	13.39	340	18.11	460	6.23	160	13965
3 Rows of 18 Modules	13.39	340	24.02	610	6.23	160	13967
4 Rows of 18 Modules	13.39	340	33.15	842	6.23	160	13968

<sup>1</sup> Accessories include: Terminal blocks and terminal block support; 1 marking kit per row; 1 wiring strap per row; Class II plugs, and blanking plates (5 x 18 mm modules per row).

<sup>2</sup> Enclosure modules are 18 mm wide.

### Accessories

Necessary accessories are included with enclosure, including: Terminal blocks and terminal block support; one marking kit; Class II plugs.

Other options available are listed in Table 73.

Table 73: Kaedra Weatherproof Enclosure Accessories

Description	Cat. No.
Association Kit (2 Sleeves + 4 Nuts + 4 Washers)	13934
Blanking Plate (Set of 10 x 5 Modules)	13940
Sealing Kit (2 Screws, 5 Fasteners)	13947
Keylock (Eurolock no. 850)	13948
Plain Front Plate, 12 Modules	13944
Plain Front Plate, 18 Modules	13945
Cable Gland, PG11 (0.732 in./18.6 mm)	83992
Cable Gland, PG13.5	83993
Cable Gland, PG16 (0.886 in./22.5 mm)	83994
Cable Gland, PG21 (1.114 in./28.3 mm)	83995
Cable Gland, PG29 (1.457 in./37 mm)	83996
Cable Gland, PG36 (1.85 in./47 mm)	83997

Section 7—Dimensions

UL 489/CSA C22.2 No. 5 Listed C60 Circuit Breakers

Figure 46: UL 489/CSA C22.2 No.5 Listed C60 240 Vac Circuit Breaker with Box Lug Terminals

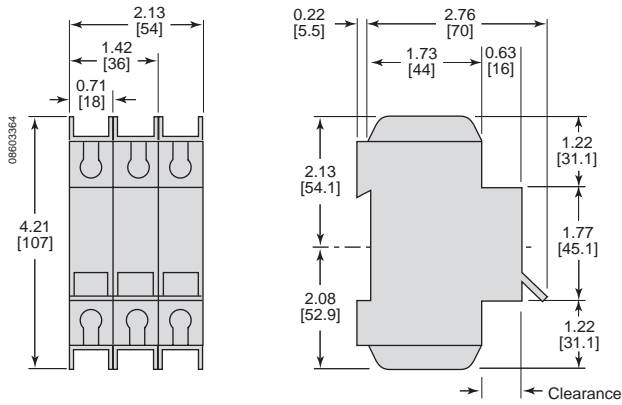


Figure 47: UL 489/CSA C22.2 No.5 Listed C60 240 Vac Circuit Breaker with Ring Tongue Terminals


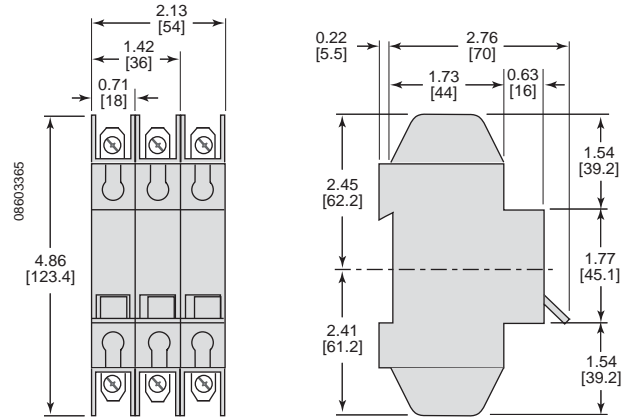


Figure 48: UL 489/CSA C22.2 No.5 C60 480 Vac and 240 Vac Circuit Breaker with Fingersafe Shields




Dimensions: in.  
[mm]

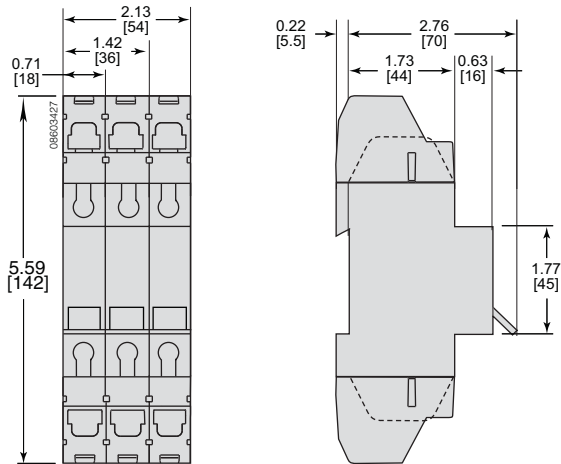

UL 1077 Supplementary Protectors

Figure 49: C60 UL 1077 Supplementary Protectors

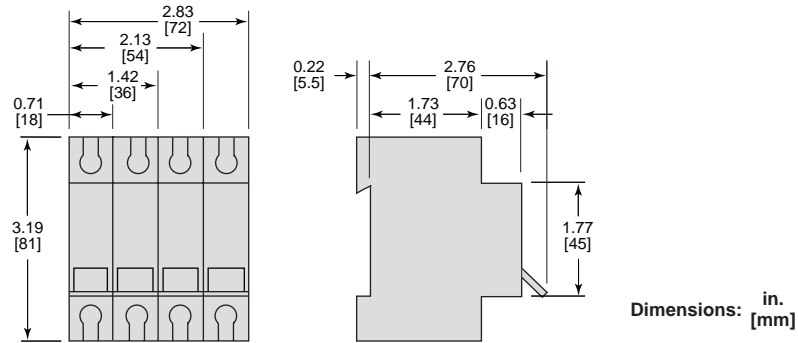

IEC Rated Circuit Breakers

Figure 50: IEC DPN-N Circuit Breaker

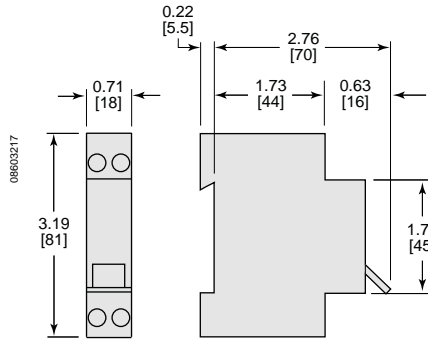


Figure 51: C60 IEC Circuit Breakers


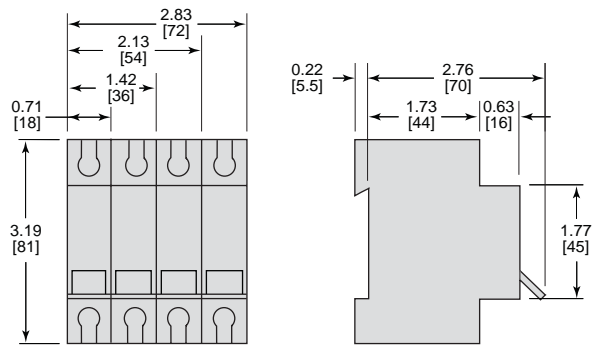


Figure 52: C120 IEC Circuit Breaker

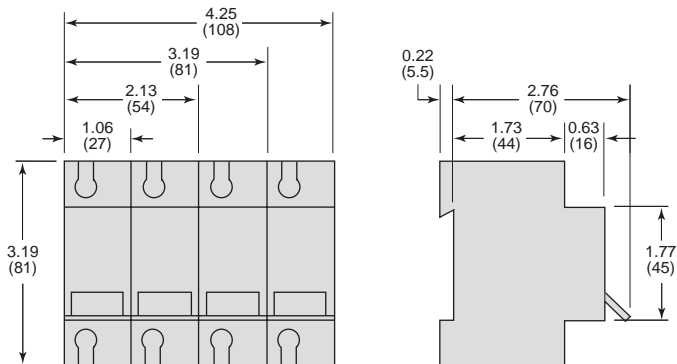

Dimensions: in. [mm]

UL and IEC Rated Ground-Fault Products

Figure 53: UL GFP Ground-Fault Protector and IEC ID Residual Current Switch

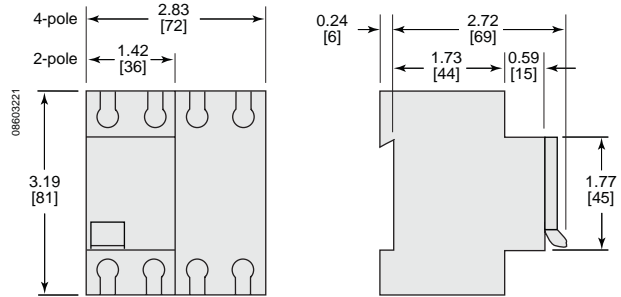


Figure 54: IEC Vigi Ground-Fault Module for C60 Devices


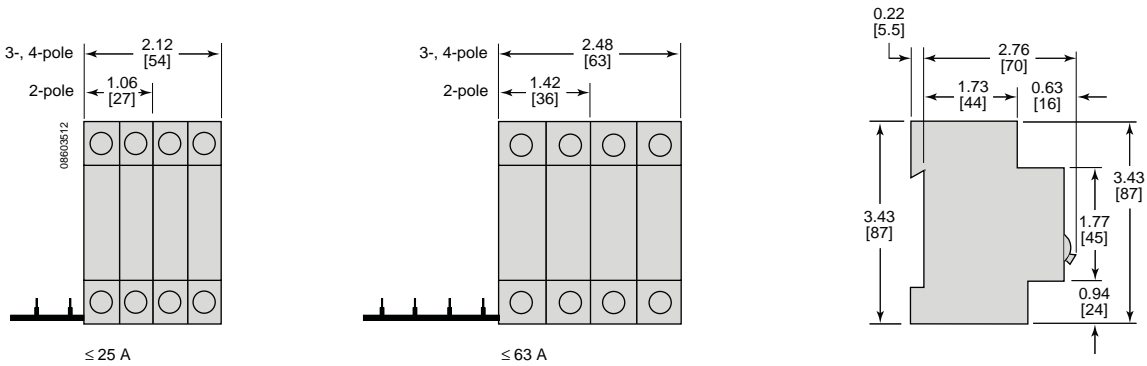


Figure 55: IEC Vigi Ground-Fault Module for C120 Devices

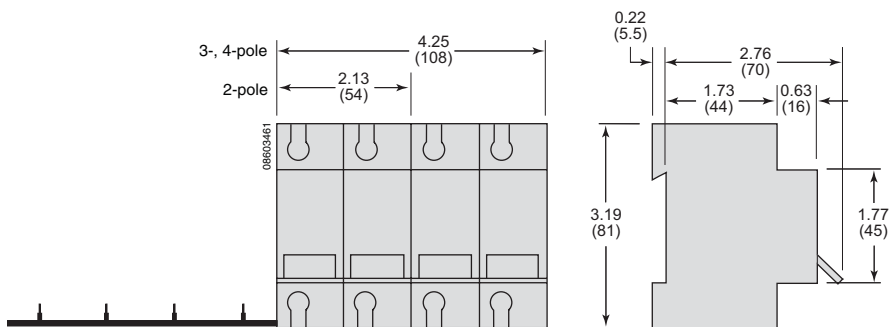

Dimensions: :in.  
[mm]

Accessory Dimensions

Figure 56: OF Auxiliary Switch, SD Alarm Switch, MN Undervoltage Release and MX + OF Shunt Trip with Auxiliary Switch for C60 and C120

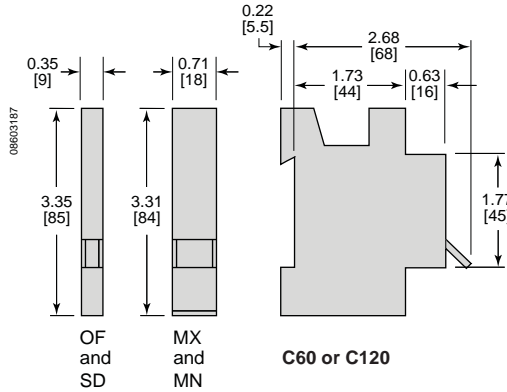


Figure 57: OFS Auxiliary Switch and Adapter for GFP Ground-Fault Protector and ID Residual Current Switch

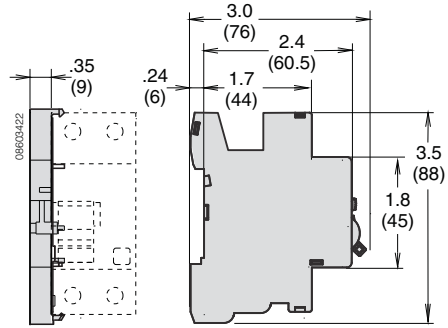


Figure 58: TM Motor Operator for C60 Devices

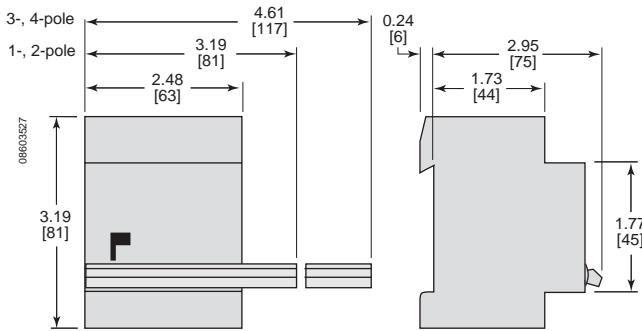


Figure 59: Spacer for C60 and C120 Devices

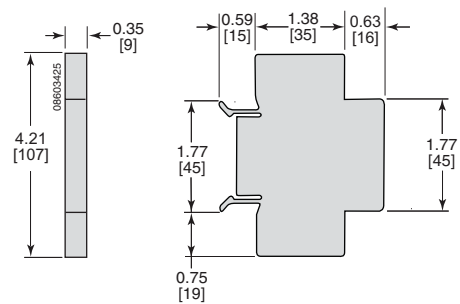


Figure 60: Interphase Barriers for C60 Devices


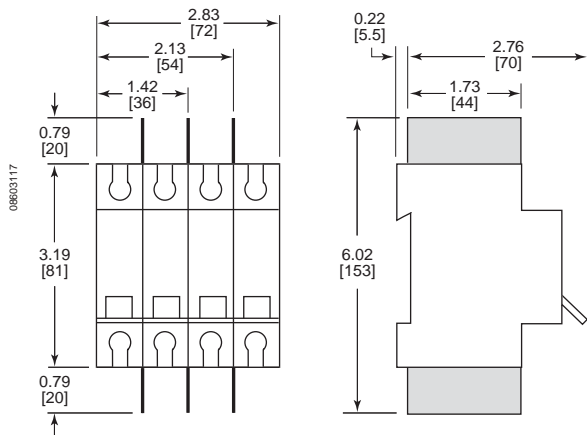


Figure 61: Terminal Screw Shield for UL 489A, UL 1077 and IEC C60 Devices

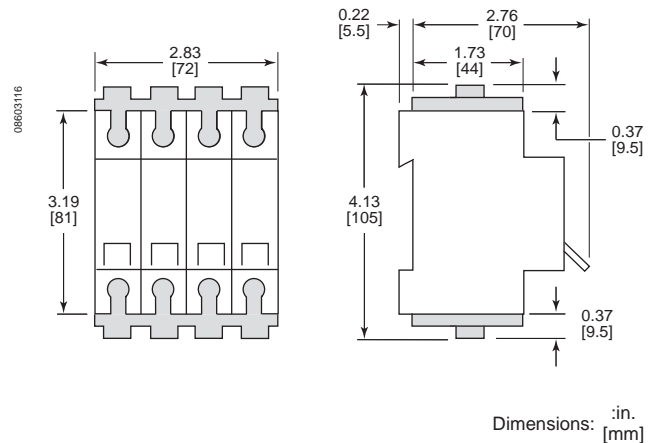


Dimensions: .in.  
[mm]


# Multi 9™ System Catalog

## Section 7—Dimensions


**Figure 62: Plug-In Base for UL 489A, UL 1077 and IEC C60 Devices**

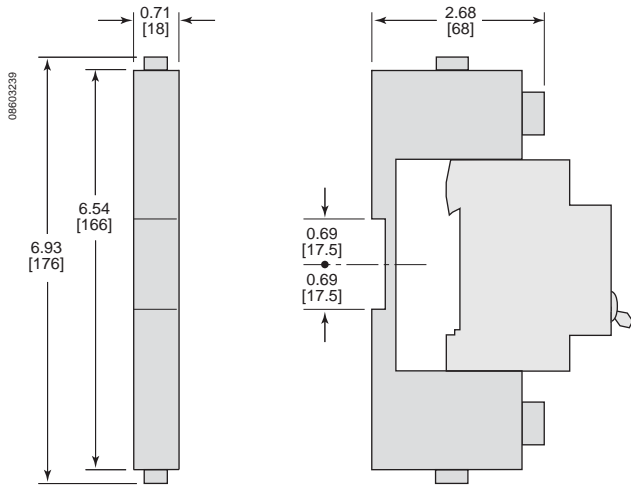

**Figure 63: Terminal Cover for UL 489A, UL 1077 and IEC C60 Devices**

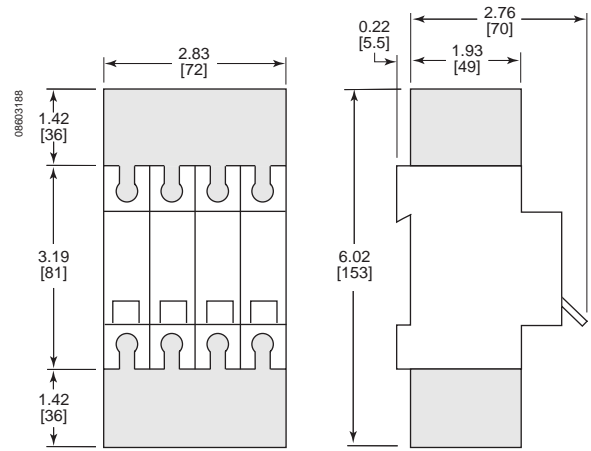


**Figure 64: Front Mounting Bracket Kit**

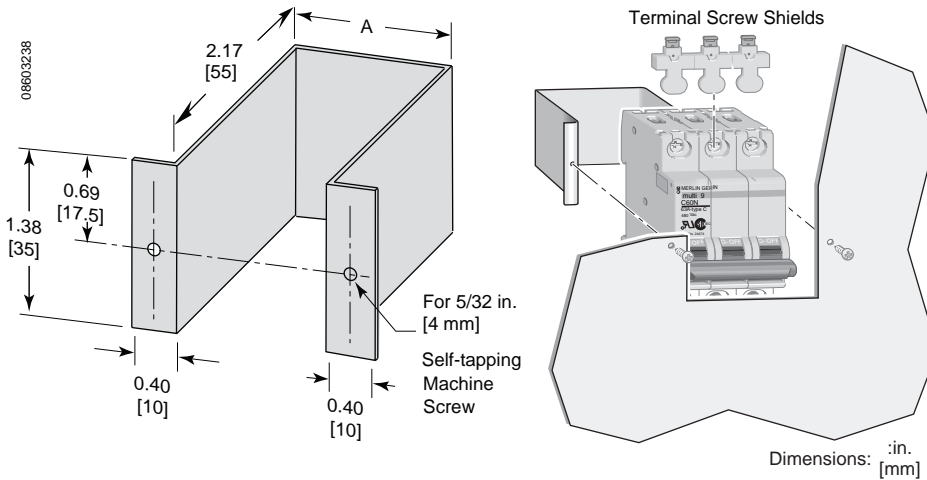

**Dimension A**

No. of Poles	in.	mm	Catalog No.
<b>Bracket for C60 (18 mm/pole)</b>			
1	0.75	19	MG26983
2	1.46	37	MG26984
3	2.32	55	MG26985
4	2.87	73	MG26989
<b>Bracket for C120 (27 mm/pole)</b>			
1	1.10	28	MG26986
2	2.16	55	MG26987
3	3.23	82	MG26988
4	4.29	109	MG26990

**Figure 65: Rotary Handle for C60 Devices**

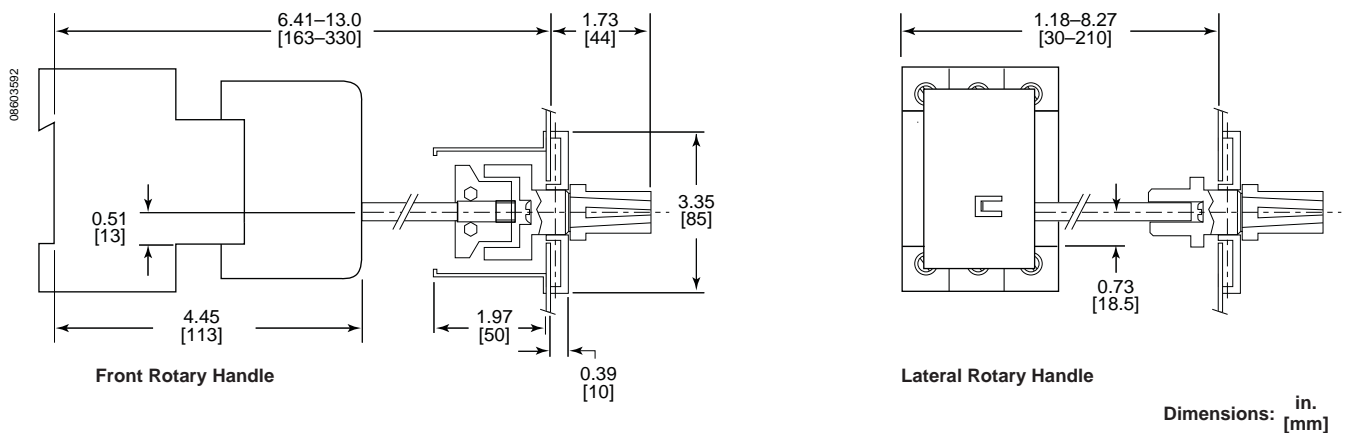



# Multi 9™ System Catalog

## Section 7—Dimensions

Figure 68: IEC MSC Chassis for C60 Devices

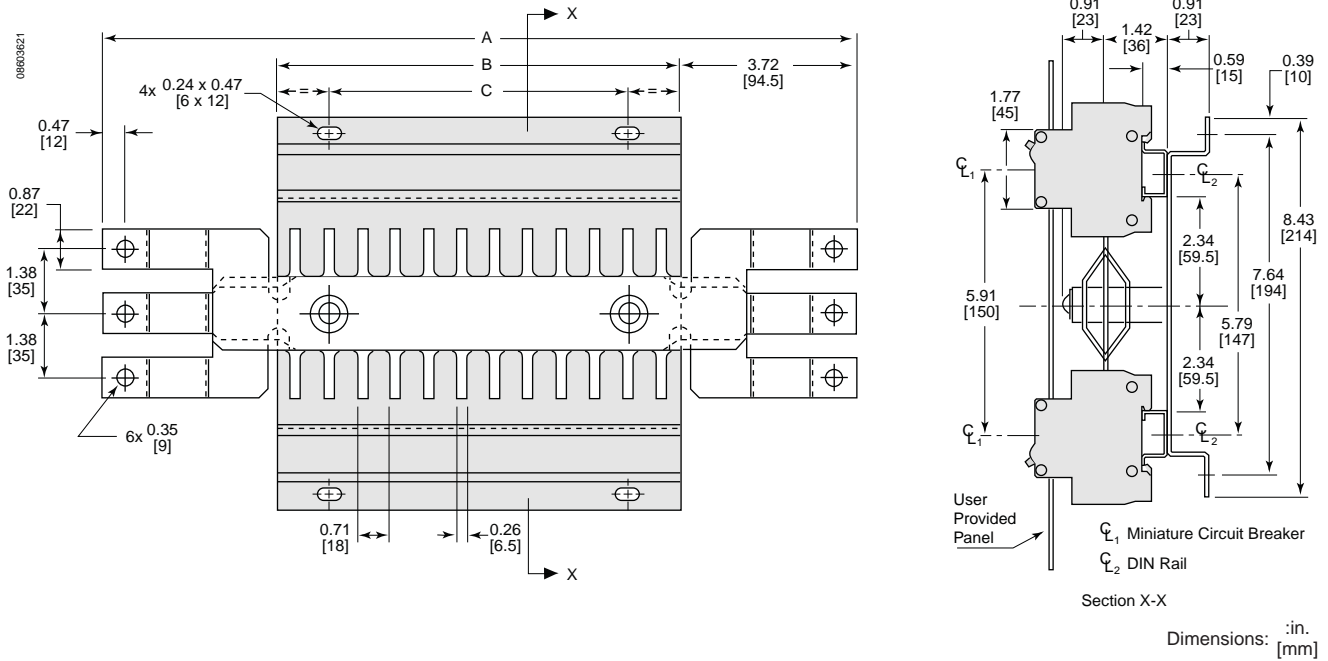


Table 74: MSC Chassis for C60 Devices

Type	Number of Poles	Dimensions					
		A <sup>1</sup>		B		C	
		in.	mm	in.	mm	in.	mm
MSC DC (for C60 2 pole)	12	11.7	299	4.33	110	2.13	54
	16	13.2	335	5.75	146	3.54	90
	20	14.6	371	7.17	182	4.57	116
MSC 18 (for C60 3 pole)	12	11.7	299	4.33	110	15.9	405
	18	13.9	353	6.46	164	8.58	218
	24	15.9	405	8.58	218	6.38	162
MSC 27 (for C120 3 pole)	12	17.0	432	9.57	162	4.25	108
	18	21.7	551	14.35	243	7.44	189
	24	26.5	673	19.13	324	10.63	270

<sup>1</sup> For TF suffix (top feed only), reduce length by 3.72 in. (94.5 mm).

Figure 69: Multi-Pole Front Mounting Kit for C60 Devices

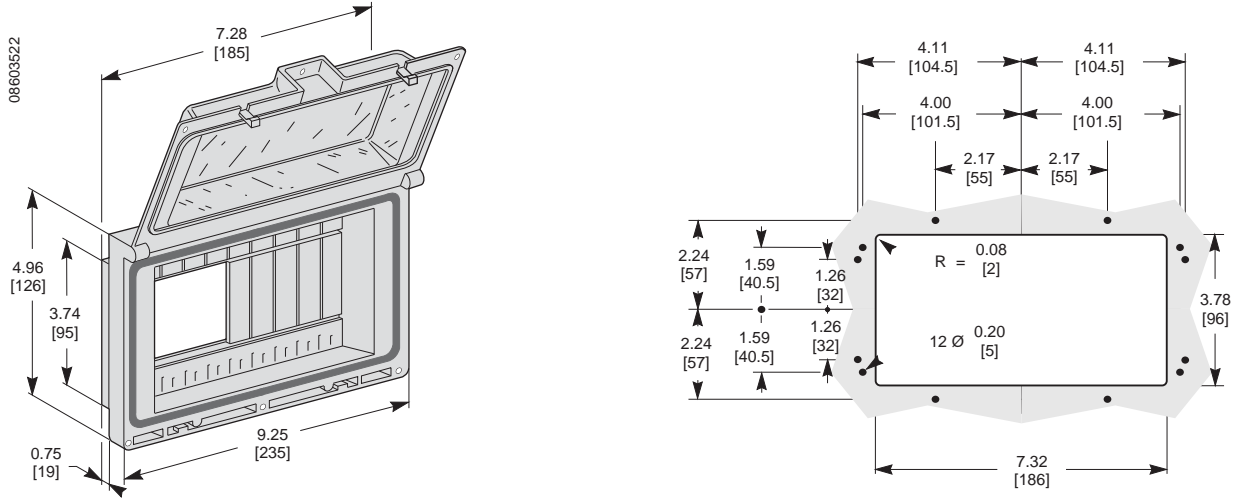


Figure 70: Bracket for Front Mounting Kit

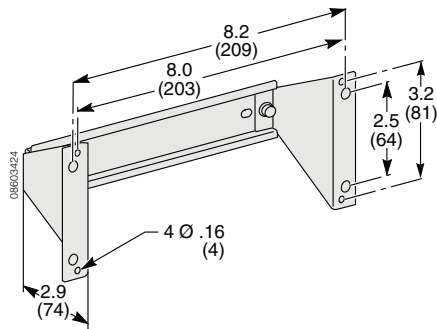


Figure 71: M9PF4 Pole Filler


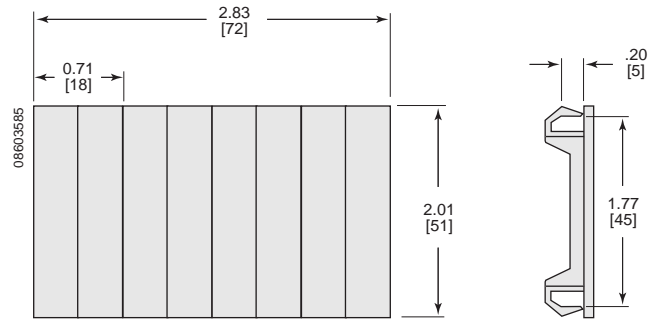


Figure 72: SPD Surge Protectors

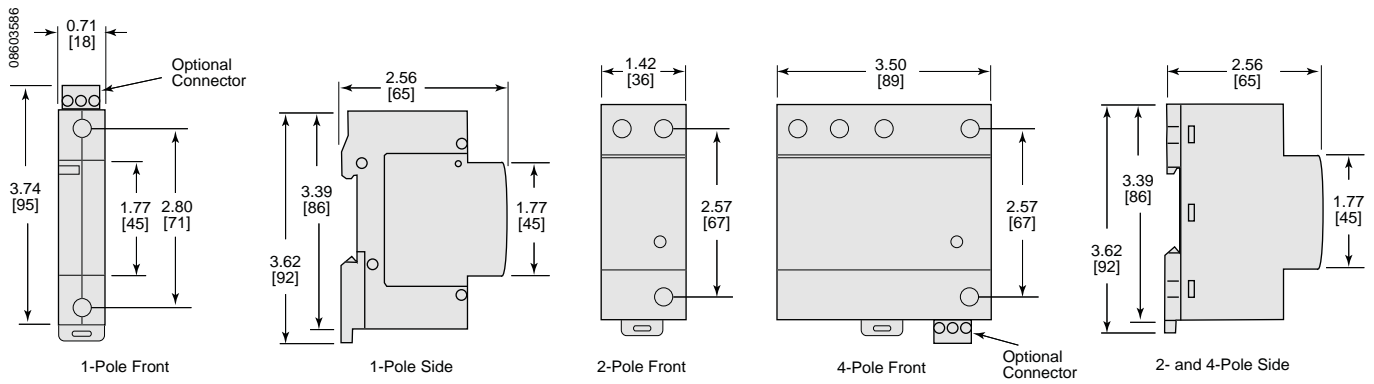


Dimensions: in.  
[mm]


# Multi 9™ System Catalog

## Section 7—Dimensions


**Figure 73: CM Switches**

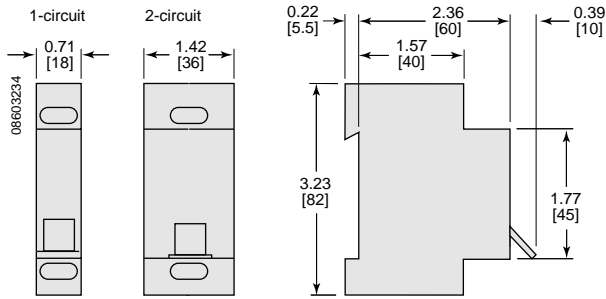


**Figure 74: I Switch (20–32 A)**

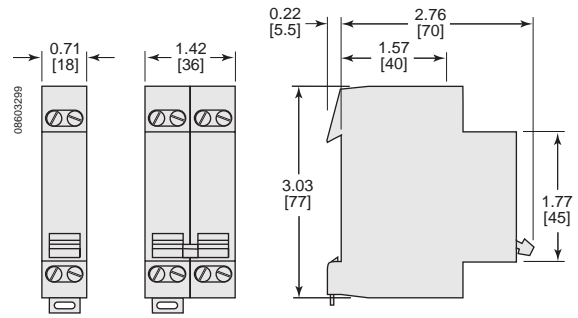

**Figure 75: I Switch (40–125 A)**

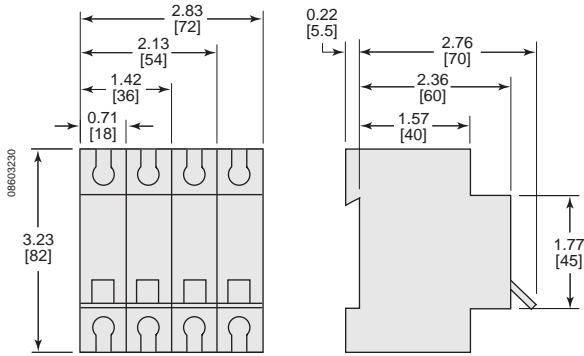


**Figure 76: V Signal Lamps**

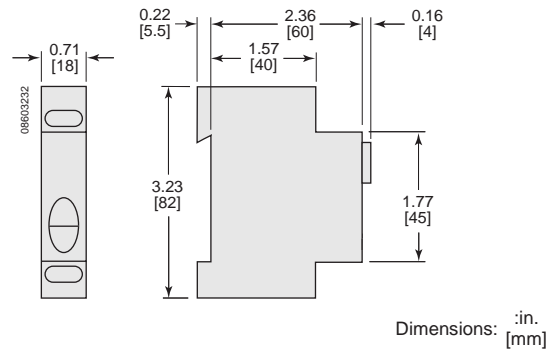


Dimensions: :in. [mm]


**Figure 77: BP Push Buttons**

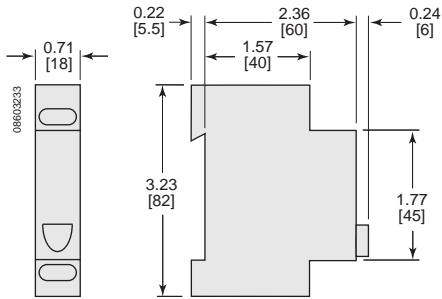

**Figure 78: CH Hour Counter**

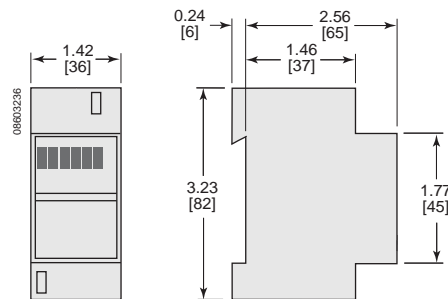

**Figure 79: CI Impulse Counter**

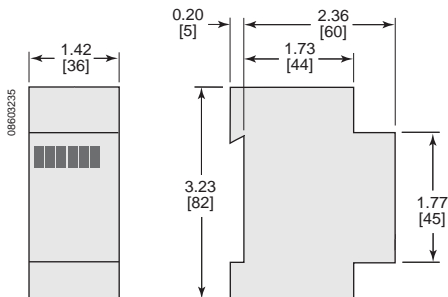

Dimensions: :in. [mm]




**Kaetra Weatherproof Mini-Enclosure Dimensions**


**Table 75: Kaetra Weatherproof Mini-Enclosure Dimensions**

No. of Modules	L		H		Weight		Cat. No.
	in	mm	in	mm	lbs	grams	
3	3.1	80	5.9	150	0.66	300	13956
4	4.8	123	7.9	200	0.99	450	13957
6	6.3	159	7.9	200	1.32	600	13958
8	7.7	195	7.9	200	1.76	800	13959
12	10.5	267	7.9	200	1.98	900	13960

**Figure 80: Kaetra Weatherproof Mini-Enclosures**

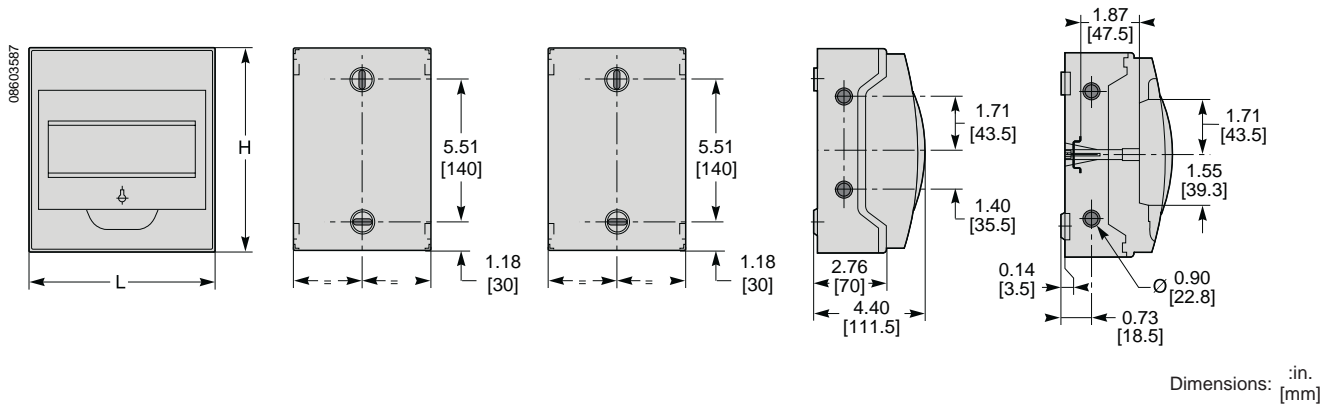

**Figure 81: Top View for Kaetra Weatherproof Type Mini Enclosures**

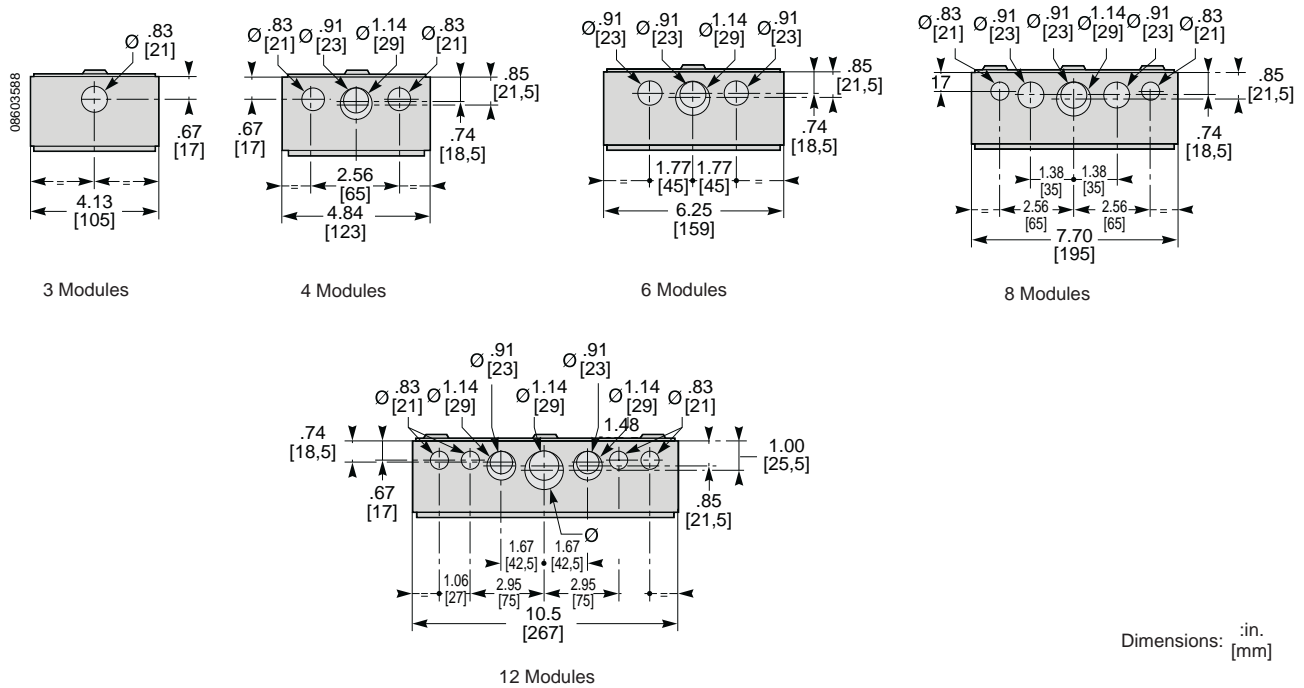

Kaedra Weatherproof Enclosures

Table 76: Kaedra Weatherproof Enclosure Dimensions (12 Module)

A		B		C		Weight		Cat. No.
in	mm	in	mm	in	mm	lbs	grams	
11.02	280	4.65	118	3.19	81	4.19	1900	13962
18.11	460	9.88	251	4.15	104.5	7.28	3300	13964
24.02	610	15.79	401	4.15	104.5	9.04	4100	13968

Figure 82: Kaedra Weatherproof Type Enclosures (12 Module)

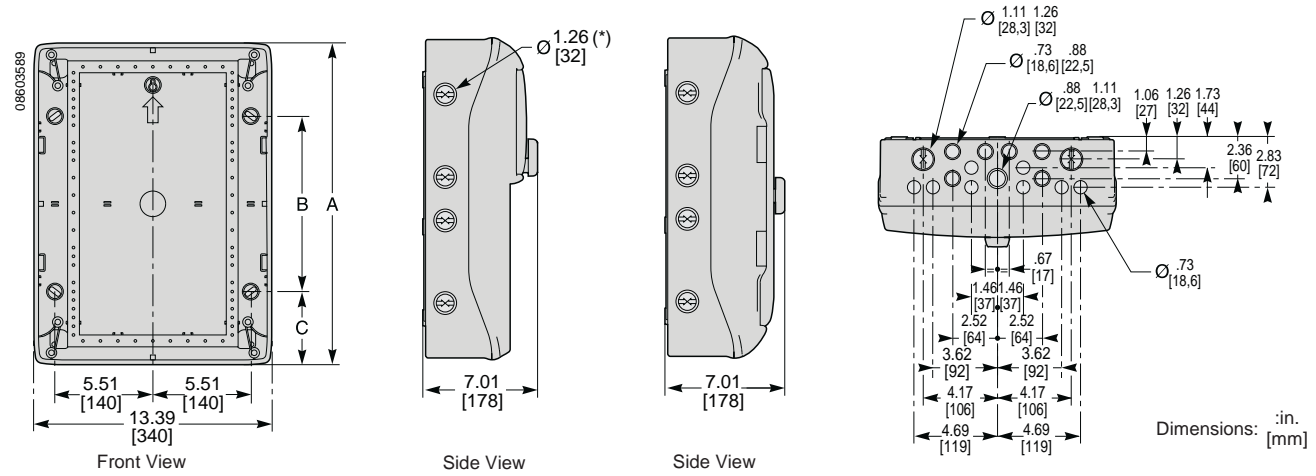


Table 77: Kaedra Weatherproof Enclosure Dimensions (18 Module)

A		B		C		Weight		Cat. No.
in	mm	in	mm	in	mm	lbs	grams	
11.02	280	4.65	118	3.19	81	5.29	2400	13963
18.11	460	9.88	251	4.15	104.5	9.04	4100	13965
24.02	610	15.79	401	4.15	104.5	12.35	5600	13967
33.15	842	24.92	633	4.15	104.5	14.55	6600	13968

Figure 83: Kaedra Weatherproof Type Enclosures (18 Module)


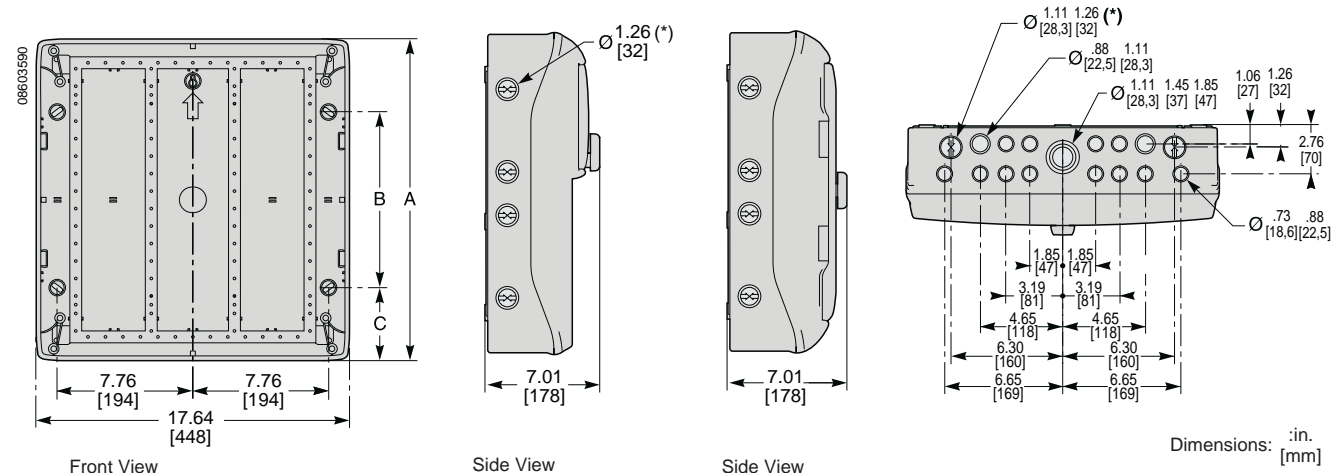


Table 78: Kaedra Cable Glands for Weatherproof Enclosures

Cable Size		Drilling Diameter		Thread Diameter	Pre-Punchout	Cat. No.
in	mm	in	mm	mm	mm	
0.354–0.433	9–11	0.740	18.8	18.6	PG 11	83992
0.354–0.472	9–12	0.815	20.7	20.4	PG 13.5	83993
0.394–0.512	10–13	0.898	22.8	22.5	PG 16	83994
0.551–0.669	14–17	1.125	28.6	28.3	PG 21	83995
0.748–1.024	19–26	1.472	37.4	37	PG 29	83996
1.102–1.417	28–36	1.870	47.5	47	PG 36	83997

Figure 84: Kaedra Horizontal Side-by-Side Interconnection References

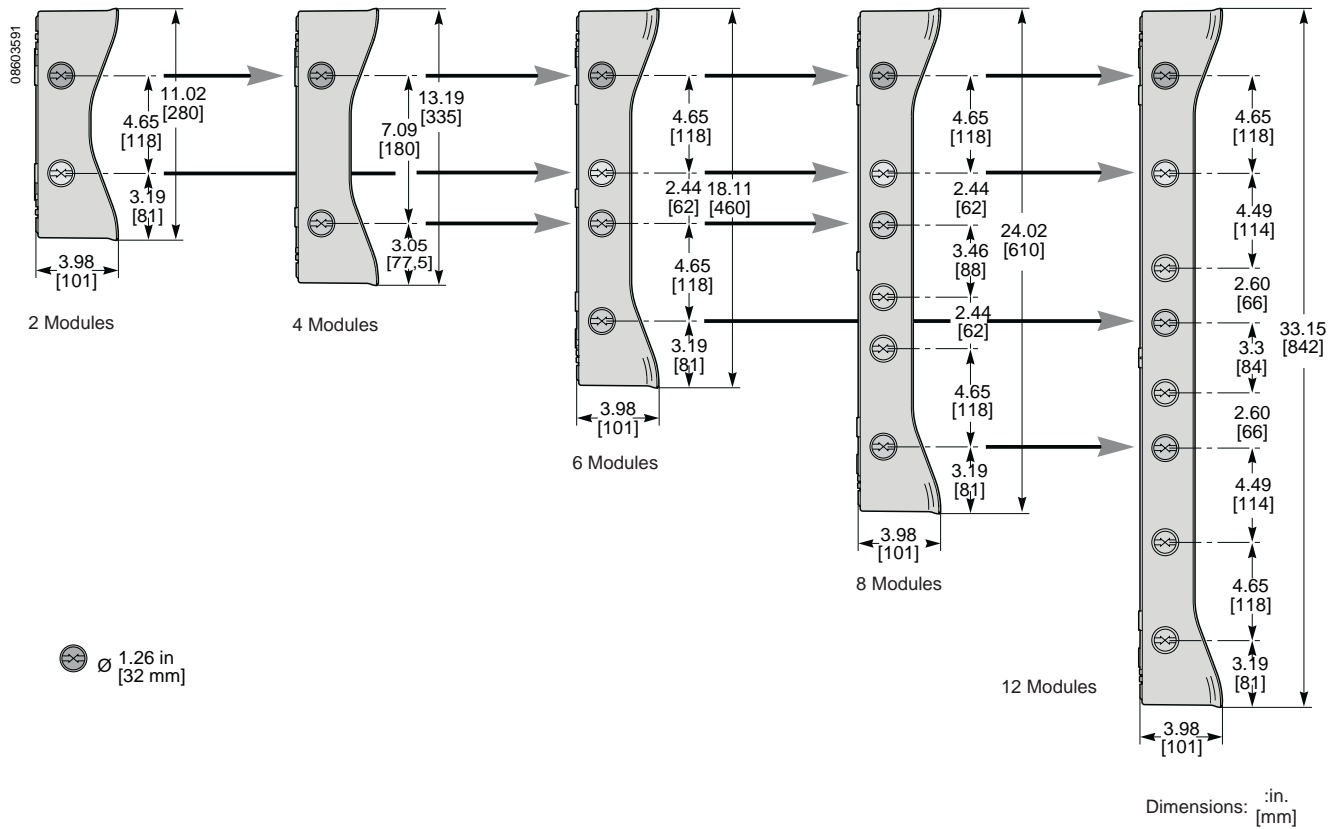

## Section 8—Applications












### Degree of Protection (IP)

The IEC 529 Standard publication or the European EN 60529 Standard define the IP degree of protection characterizing the ability of a device to withstand the two external influences below:

- Ingress of solid bodies and protection of people
- Ingress of water

The IP contains two digits, one for each of these external influences, and is assigned to the device after a series of tests defined by the NF EN 60529 Standard. The IP degree of protection must always be read and understood digit by digit and not globally. The two IP digits may contain an optional letter which indicates the enclosure's ability to protect people against access to live parts.

**Table 79: Explanation of IP Degree of Protection Digits<sup>1</sup>**

First Digit Solid Body Protection		Second Digit Liquid Protection		Third Digit Mechanical Protection	
IP	Tests	IP	Tests	IP	IK
0	No protection	0	No protection	0	No protection
1	 1.97 in (50 mm) Protected against solid bodies larger than 1.97 in. (50 mm), e.g., accidental hand contact	1	 Protected against vertically falling water droplets (condensation)	1	Impact energy 0.225 joules
2	 0.492 in (12.5 mm) Protected against solid bodies larger than 0.47 in. (12 mm), e.g., fingers	2	 15° Protected against falling water droplets up to 15° from vertical	3	Impact energy 500 joules
3	 0.492 in (12.5 mm) Protected against solid bodies larger than 0.098 in. (2.5 mm), e.g., tools, wires	3	 60° Protected against rainwater up to 60° from vertical	5	Impact energy 2.00 joules
4	 0.039 in (1 mm) Protected against solid bodies larger than 0.039 in. (1 mm), e.g., fine tools, small wires	4	 Protected against water spray from all directions	7	Impact energy 6.00 joules
5	Protected against dust (no harmful deposit)	5	 Protected against water splashes from all directions by jet pipes	9	Impact energy 20.00 joules
6	Completely protected against dust	6	 Protected against water splashes/waves (of the heavy sea kind)		
		7	 Protected against immersion effects		

<sup>1</sup> When mounted outdoors, the IP ≥ 54 enclosures must be equipped with a protectable top, or installed in a shelter.

The degrees of protection given in this catalog apply for enclosures as described here. However, the initial degree of protection can only be maintained if the device is properly assembled and installed.

Class 2: The term “double insulation” is also used. This consists of backing up the main insulation of an electrical device by an additional insulation in order to protect people against direct contact.

## Vibration

**Table 80: Vibration as per IEC 68.2.6 Standard<sup>1</sup>**

Curve	Sequence	Vibration
Curve B	Sequence S3: 0.14 oz. (4 g)	5–13 Hz: ±0.24 in. (6 mm) 13–300 Hz: 0.14 oz. (4 g)
Curve C and D	Sequence S6: 0.25 oz. (7 g)	5–58 Hz: ±0.02 in. (0.5 mm) 58–300 Hz: 0.25 oz. (7 g)

<sup>1</sup> Results depend on magnetic trip level. Five frequency sweeps per axis.

## Mechanical Shock (IK)

As per IEC 68.2.27 Standard: 1.06 oz./30 g, 18 ms., 3 shocks per axis.

Standard EN 50.102 defines an IK code characterizing the ability of a device to withstand mechanical shocks. The IK code replaces the third digit of the old IP.

## Protection of 400 Hz Circuits

The C60 and C120 miniature circuit breakers are designed to be applied on 50/60 Hz systems and can be re-rated for use on 400 Hz systems.

**Table 81: 400 Hz Circuits**

Type	No. of Poles	Interrupting Ratings (Vac)		
		240	277	480Y/277
C60N (0.5–63 A)	1P	4,000	3,000	—
	2P, 3P and 4P	4,000	—	3,000
C120H (50–80 A)	1P	3,000	—	—
	2P, 3P and 4P	3,000	—	—
C120H (10–40 A)	1P	5,000	4,000	—
	2P, 3P and 4P	5,000	—	4,000

- Thermal: No variation
- Magnetic increase in thresholds multiplier:
  - DPN-N: 1.50
  - C60N: 1.48
  - C120H: 1.40

Vigi ground-fault modules and residual current circuit breakers and switches can also be used on 400 Hz systems. Note in Figure 85 that the mA threshold varies according to system frequency.


# Multi 9™ System Catalog

## Section 8—Applications

**Table 82: Curve Sensitivity at 400 Hz**

Class	Rating (A)	Curve No. Sensitivity (mA)			
		10	30	100	300
DPN-N Residual Current Circuit Breakers					
AC	≤ 25	①	①	—	①
C60 Vigi Ground-Fault Module					
110/220 V, 50 Hz Vigi C60					
AC	≤ 25	②	①	①	—
	≤ 63	—	②	①	—
2P, 3P, 4P 220/415 V, 50 Hz Vigi C60					
AC	≤ 25	②	①	①	—
	≤ 63	—	②	①	—
AC	☒	—	③	②	②
C120 Vigi Ground-Fault Module					
AC	≤ 100	—	③	—	①
AC	☒ ≤ 100	—	②	②	②
ID Residual Current Switch					
AC	25	②	①	—	①
	25–40	—	①	①	①
	63–80–100	—	②	①	①
	☒ 63–80–100	—	—	—	②

**Figure 85: Protection of 400 Hz Circuits**

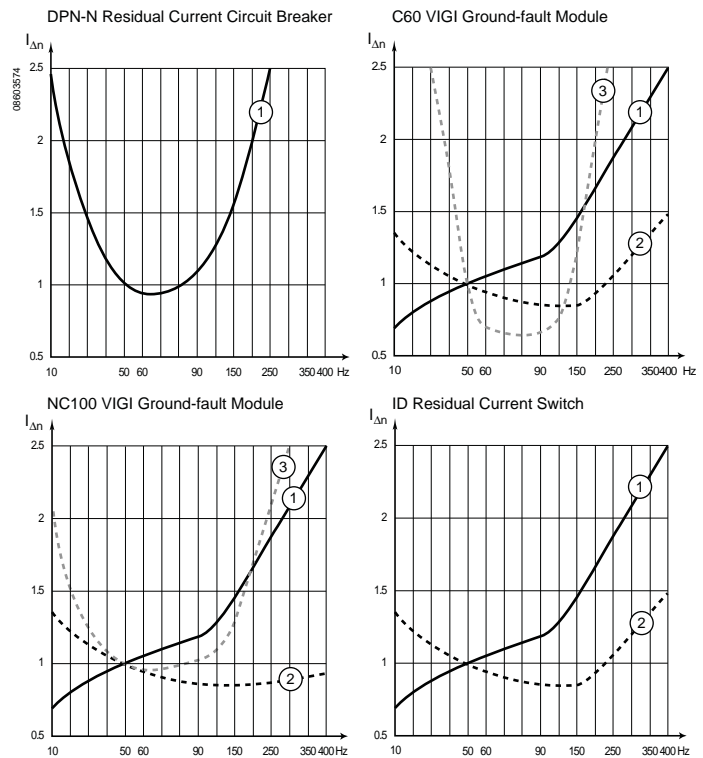

## Temperature Rating

**The operating current of the circuit breakers varies depending on the ambient temperature in which the circuit breaker is located.**

If the circuit breaker is installed in an enclosure or in a hot room (boiler room, etc.), the current needed to trip the circuit breaker in the event of an overload will be lower. If the ambient temperature exceeds the circuit breaker's reference temperature, the supplementary protective device or the circuit breaker will then be "derated". That is why circuit breaker manufacturers supply tables showing the derated current (A) to be applied for given temperatures. NB: In the event of an ambient temperature less than the rated temperature, the supplementary protective device or the circuit breaker is "uprated".

**Moreover, when several circuit breakers operating simultaneously are mounted side by side in a small enclosure, the temperature rise inside the enclosure entails a reduction in the operating current.**

This mutual temperature rise in theory requires the application of an additional derating factor of 0.8.

**Table 83: Rated Temperatures for UL Listed Circuit Breakers and UL Recognized C60 Supplementary Protectors**  
(The reference temperature is in half-tone color.)

Rating (A)	-22°F -30°C	-13°F -25°C	-4°F -20°C	5°F -15°C	14°F -10°C	23°F -5°C	32°F 0°C	41°F 5°C	50°F 10°C	59°F 15°C	68°F 20°C	77°F 25°C	86°F 30°C	104°F 40°C	122°F 50°C	140°F 60°C	158°F 70°C
0.5	1.26	1.24	1.22	1.20	1.17	1.15	1.13	1.10	1.08	1.05	1.03	1.00	0.97	0.92	0.85	0.79	0.72
1	1.21	1.19	1.18	1.16	1.14	1.12	1.10	1.08	1.06	1.04	1.02	1.00	0.98	0.93	0.89	0.84	0.79
1.2	1.26	1.24	1.22	1.20	1.17	1.15	1.13	1.10	1.08	1.05	1.03	1.00	0.97	0.92	0.85	0.79	0.72
1.5	1.32	1.29	1.27	1.24	1.21	1.19	1.16	1.13	1.10	1.07	1.03	1.00	0.97	0.89	0.81	0.73	0.63
2	1.21	1.19	1.18	1.16	1.14	1.12	1.10	1.08	1.06	1.04	1.02	1.00	0.98	0.93	0.89	0.84	0.79
3	1.27	1.25	1.22	1.20	1.18	1.15	1.13	1.11	1.08	1.05	1.03	1.00	0.97	0.91	0.85	0.78	0.71
4	1.25	1.23	1.21	1.19	1.17	1.15	1.12	1.10	1.07	1.05	1.03	1.00	0.97	0.92	0.86	0.80	0.73
5	1.26	1.24	1.22	1.19	1.17	1.15	1.13	1.10	1.08	1.05	1.03	1.00	1.97	0.92	0.86	0.79	0.72
6	1.23	1.21	1.19	1.17	1.15	1.13	1.11	1.09	1.07	1.05	1.02	1.00	0.98	0.93	0.87	0.82	0.76
7	1.29	1.26	1.24	1.22	1.19	1.17	1.14	1.11	1.09	1.06	1.03	1.00	0.97	0.91	0.84	0.76	0.68
8	1.29	1.26	1.24	1.22	1.19	1.17	1.14	1.11	1.09	1.06	1.03	1.00	0.97	0.91	0.84	0.76	0.68
10	1.28	1.25	1.23	1.21	1.18	1.16	1.13	1.11	1.08	1.06	1.03	1.00	0.97	0.91	0.85	0.78	0.70
13	1.20	1.18	1.16	1.15	1.13	1.11	1.09	1.08	1.06	1.04	1.02	1.00	0.98	0.94	0.90	0.85	0.80
15	1.28	1.25	1.23	1.21	1.18	1.16	1.13	1.11	1.08	1.06	1.03	1.00	0.97	0.91	0.85	0.78	0.70
16	1.24	1.22	1.20	1.18	1.16	1.14	1.11	1.09	1.07	1.05	1.02	1.00	0.98	0.93	0.87	0.81	0.75
20	1.23	1.21	1.19	1.17	1.15	1.13	1.11	1.09	1.07	1.05	1.02	1.00	0.98	0.93	0.87	0.82	0.76
25	1.24	1.22	1.20	1.18	1.16	1.14	1.11	1.09	1.07	1.05	1.02	1.00	0.98	0.93	0.87	0.81	0.75
30	1.30	1.27	1.25	1.22	1.20	1.17	1.15	1.12	1.09	1.06	1.03	1.00	0.97	0.90	0.83	0.75	0.66
32	1.23	1.21	1.19	1.17	1.15	1.13	1.11	1.09	1.07	1.04	1.02	1.00	0.98	0.93	0.88	0.82	0.77
35	1.31	1.29	1.26	1.23	1.21	1.18	1.15	1.12	1.09	1.06	1.03	1.00	0.97	0.90	0.82	0.74	0.64
40	1.23	1.21	1.19	1.17	1.15	1.13	1.11	1.09	1.07	1.05	1.02	1.00	0.98	0.93	0.88	0.82	0.76
50	1.23	1.21	1.19	1.17	1.15	1.13	1.11	1.09	1.07	1.05	1.02	1.00	0.98	0.93	0.88	0.82	0.76
60	1.29	1.27	1.24	1.22	1.19	1.17	1.14	1.11	1.09	1.06	1.03	1.00	0.97	0.90	0.84	0.76	0.67
63	1.27	1.25	1.22	1.20	1.18	1.15	1.13	1.11	1.08	1.05	1.03	1.00	0.97	0.91	0.85	0.78	0.71

**NOTE:** The UL 489/CSA C22.2 No.5 Listed Multi 9 C60 circuit breakers are calibrated at 77°F (25°C), unlike some other UL 489/CSA 22.2 No.5 circuit breakers which are calibrated at 104°F (40°C). Depending on the operating environment, you may need to rerate according to these tables to determine the appropriate handle rating.

**NOTE:** UL 489/CSA C22.2 No.5 Listed circuit breakers should be loaded to no more than 80% if used with continuous loads.

**Table 84: Rated Temperatures for IEC Rated DPN-N Circuit Breakers**

Ampere Rating (A)	68°F 20°C	77°F 25°C	86°F 30°C	95°F 35°C	104°F 40°C	113°F 45°C	122°F 50°C	131°F 55°C	140°F 60°C
1	1.04	1.02	1.00	0.98	0.96	0.93	0.91	0.89	0.86
2	1.04	1.02	1.00	0.98	0.96	0.94	0.91	0.89	0.86
3	1.04	1.02	1.00	0.97	0.94	0.92	0.89	0.86	0.82
6	1.04	1.02	1.00	0.98	0.96	0.93	0.91	0.89	0.86
10	1.05	1.03	1.00	0.97	0.95	0.92	0.89	0.86	0.83
16	1.05	1.02	1.00	0.98	0.95	0.93	0.90	0.87	0.85
20	1.05	1.02	1.00	0.98	0.95	0.93	0.90	0.88	0.85
25	1.04	1.02	1.00	0.98	0.95	0.93	0.91	0.88	0.86
32	1.05	1.03	1.00	0.97	0.95	0.92	0.89	0.86	0.83
40	1.05	1.03	1.00	0.97	0.95	0.92	0.89	0.86	0.83

# Multi 9™ System Catalog

## Section 8—Applications

**Table 85: Rated Temperature for IEC Rated C60H (C Curve) and C60L (B and C Curve) Circuit Breakers**

Ampere Rating (A)	68°F 20°C	77°F 25°C	86°F 30°C	95°F 35°C	104°F 40°C	113°F 45°C	122°F 50°C	131°F 55°C	140°F 60°C
1	1.05	1.02	1.00	0.98	0.95	0.93	0.90	0.88	0.85
2	1.04	1.02	1.00	0.98	0.96	0.94	0.92	0.90	0.87
3	1.06	1.03	1.00	0.97	0.94	0.90	0.87	0.83	0.79
4	1.06	1.03	1.00	0.97	0.94	0.91	0.88	0.84	0.81
6	1.04	1.02	1.00	0.98	0.96	0.94	0.92	0.90	0.88
10	1.06	1.03	1.00	0.97	0.93	0.90	0.86	0.82	0.78
16	1.05	1.03	1.00	0.97	0.95	0.92	0.89	0.86	0.83
20	1.05	1.03	1.00	0.97	0.95	0.92	0.89	0.87	0.84
25	1.05	1.03	1.00	0.97	0.95	0.92	0.89	0.86	0.83
32	1.05	1.03	1.00	0.98	1.19	0.93	0.89	0.88	0.86
40	1.05	1.03	1.00	0.97	0.95	0.92	0.89	0.86	0.81
50	1.05	1.03	1.00	0.97	0.95	0.91	0.88	0.85	0.81
63	1.05	1.03	1.00	0.97	0.92	0.90	0.86	0.82	0.78

**Table 86: Rated Temperatures for IEC Rated C60 (D Curve) and C60L (B, C, Z and K Curve) Circuit Breakers**

Ampere Rating (A)	68°F 20°C	77°F 25°C	86°F 30°C	95°F 35°C	104°F 40°C	113°F 45°C	122°F 50°C	131°F 55°C	140°F 60°C
1	1.10	1.08	1.05	1.03	1.00	0.97	0.95	0.92	0.89
2	1.09	1.07	1.04	1.02	1.00	0.98	0.95	0.93	0.90
3	1.14	1.10	1.07	1.04	1.00	0.96	0.92	0.88	0.84
4	1.13	1.10	1.06	1.03	1.00	0.97	0.93	0.89	0.86
6	1.08	1.06	1.04	1.02	1.00	0.98	0.96	0.93	0.91
10	1.14	1.11	1.07	1.04	1.00	0.96	0.92	0.88	0.84
16	1.12	1.09	1.06	1.03	1.00	0.97	0.94	0.90	0.87
20	1.11	1.08	1.06	1.03	1.00	0.97	0.94	0.91	0.88
25	1.11	1.08	1.06	1.03	1.00	0.97	0.94	0.91	0.87
32	1.10	1.07	1.05	1.03	1.00	0.97	0.95	0.92	0.89
40	1.11	1.09	1.06	1.03	1.00	0.97	0.94	0.91	0.87
50	1.12	1.09	1.06	1.03	1.00	0.97	0.93	0.90	0.86
63	1.14	1.11	1.07	1.04	1.00	0.96	0.92	0.88	0.84

**Table 87: Rated Temperatures for IEC Rated C120 Circuit Breakers**

Ampere Rating (A)	68°F 20°C	77°F 25°C	86°F 30°C	95°F 35°C	104°F 40°C	113°F 45°C	122°F 50°C	131°F 55°C	140°F 60°C
10	1.10	1.07	1.05	1.03	1.00	0.95	0.90	0.87	0.85
16	1.06	1.03	1.00	1.00	1.00	0.97	0.94	0.91	0.88
20	1.13	1.10	1.05	1.03	1.00	0.95	0.93	0.90	0.85
25	1.08	1.06	1.04	1.02	1.00	0.96	0.92	0.90	0.88
32	1.13	1.09	1.06	1.03	1.00	0.97	0.92	0.88	0.84
40	1.14	1.10	1.08	1.04	1.00	0.96	0.93	0.88	0.84
50	1.15	1.12	1.08	1.04	1.00	0.96	0.91	0.87	0.82
63	1.15	1.12	1.08	1.04	1.00	0.96	0.91	0.87	0.82
80	1.15	1.11	1.08	1.04	1.00	0.96	0.92	0.87	0.83
100	1.15	1.12	1.08	1.04	1.00	0.96	0.92	0.87	0.83
125	1.12	1.10	1.08	1.04	1.00	0.96	0.90	0.86	0.82



## Typical IEC Grounding Systems

All electrical installations complying with safety standards and regulations are grounded in order to protect people and equipment. The term “grounding system” standardizes the grounding method used in the installation. The grounding system runs:

- First, from the neutral of the secondary side of the transformer,
- Next, from the installation frames.

The IEC 364 (Section 3) Standard defines three types of grounding systems: TT, IT and TN-C or TN-S.

### Codification of the Grounding Systems

Grounding systems are referred to by two or three letters **T** **N** **S** for example:

- 1st letter—Status of the neutral of the transformer or source:
  - I: Ungrounded
  - T: Grounded
- 2nd letter—Status of the electrical frames of the loads:
  - T: Grounded
  - N: Connected to neutral
- 3rd letter—Status of the neutral (N) and the protective conductor (PE):
  - S: N and PE are separate
  - C: N and PE are in the same conductor (PEN)

### The TT Grounded Neutral System


This “directly-grounded neutral” system is the easiest to install, monitor and use. Main features are:

- The neutral point of the distribution transformer is directly grounded.
- The installation frames are connected to several ground connections by the PE protective conductor.
- The frame and neutral ground connections are separate.

System characteristics upon installation:

- Tripping is compulsory on the first fault.
- Thus, at least one RCD is necessary at the incoming end of the installation.
- If the load frames are not all connected to the same grounding connection, one RCD must be installed for each set of equipment.

**Figure 86: TT Grounding Systems**

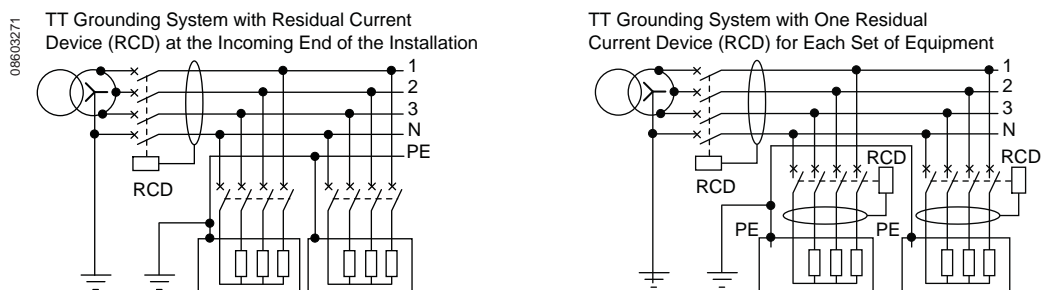

**The IT Grounding System**


This “ungrounded neutral” system has the following main features:

- The neutral point of the distribution transformer is ungrounded, or grounded by a high impedance.
- The installation frames are connected to the same grounding connection by the PE protective conductor.

System characteristics and constraints upon installation:

- The appearance of the first insulation fault is risk-free for people.
- The appearance of the second insulation fault is dangerous to people, and thus requires tripping.
- If the application frames and the transformer frame are not all connected to the same ground connection, an RCD must be placed at the incoming end of the installation.
- The standard stipulates the installation of a Continuous Insulation Monitor (CIM) at the incoming end of the installation.

**Figure 87: IT Grounding Systems**

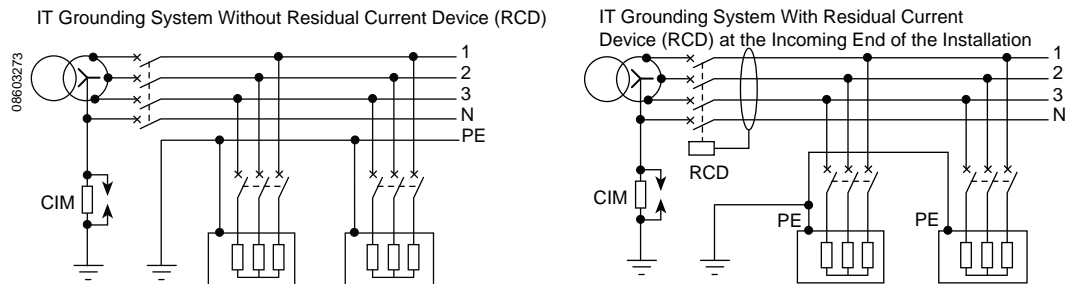

**The TN-S Grounding System**

This “multiple-grounded neutral” system has the following main features:


- The neutral point of the distribution transformer is grounded.
- All installation frames are grounded by a PE protective conductor.
- The PE protective conductors and the N neutral conductor are separate.

System characteristics and constraints upon installation:

- Allows tripping on the first fault via an overcurrent protection device.
- Use of an RCD, although not compulsory, is recommended.
- Requires calculation, sometimes complex, of loop impedance.
- Tripping of the protection devices must be checked when these devices are installed, B curve is recommended.

**NOTE:** This grounding system is compulsory on premises where there is a risk of explosion.

**Figure 88: TN-S Grounding System**

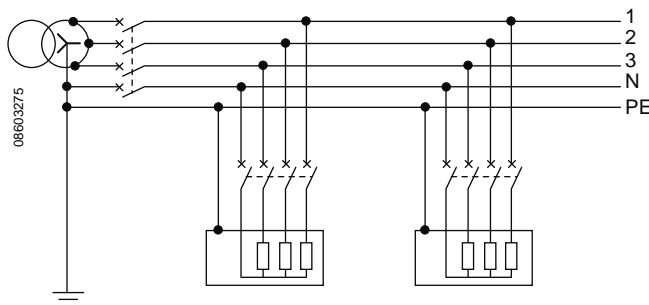

Section 9—Time/Current Curves

UL 489/CSA C22.2 No. 5 & UL 489A Listed C60 Miniature Circuit Breakers

Figure 89: UL 489/CSA C22.2 No.5 Listed C60—C Curve (0.5–35 A) AC & DC

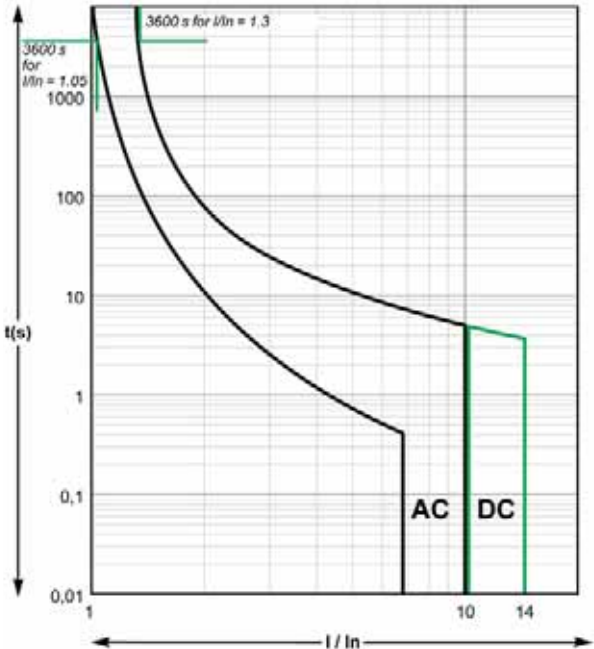


Figure 90: UL 489/CSA C22.2 No.5 Listed C60—D Curve (0.5–35 A) AC


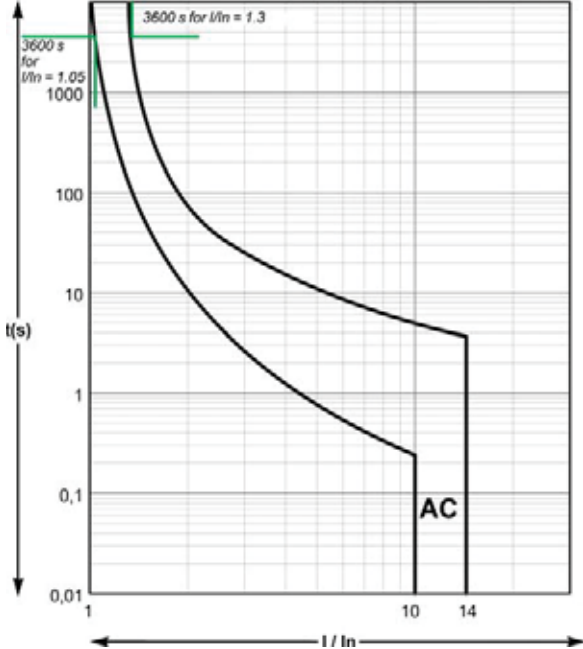


Figure 91: UL 489/CSA C22.2 No.5 Listed C60—C Curve (0.5–35 A) DC

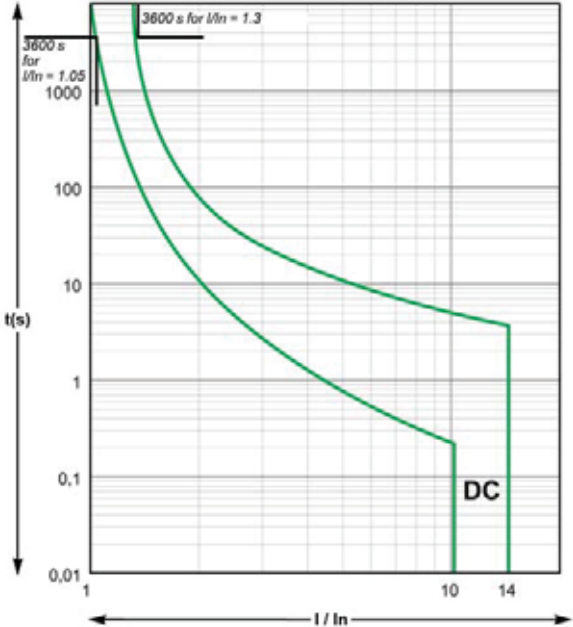

UL 1077 Recognized Supplementary Protectors<sup>1</sup>

Figure 92: UL 1077 Recognized C60—B Curve

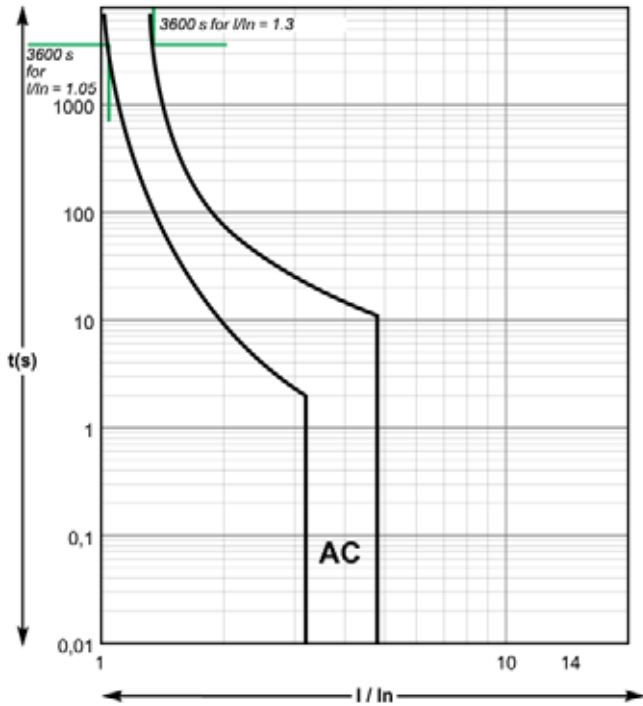


Figure 93: UL 1077 Recognized C60—C Curve


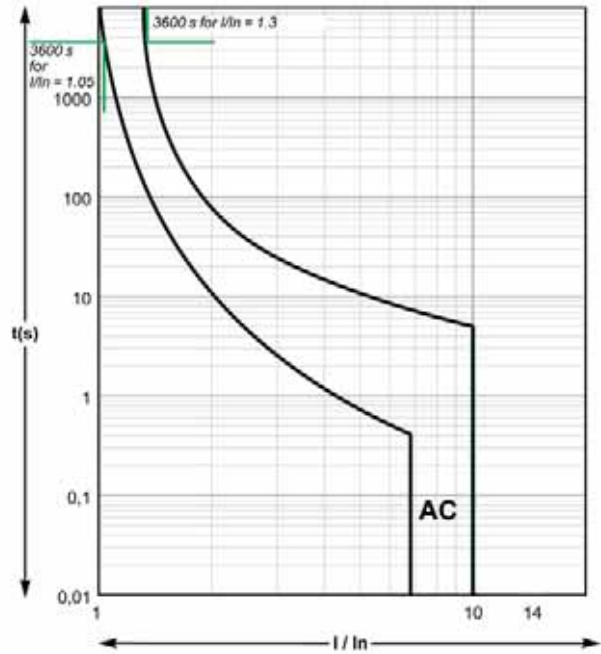


Figure 94: UL 1077 Recognized C60—D Curve

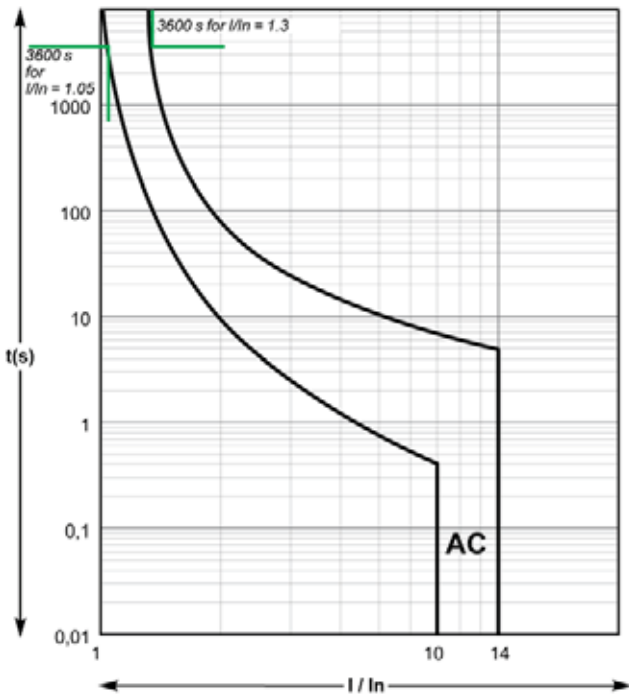


<sup>1</sup> Dotted Line is the tripping limit of a single pole of multi-pole device.

IEC60947-2 Rated D PN-N Circuit Breakers

Table 88: DPNa/N

According to IEC/EN 6098 (Reference Temperature 30°C)  
 Curves B, C, D

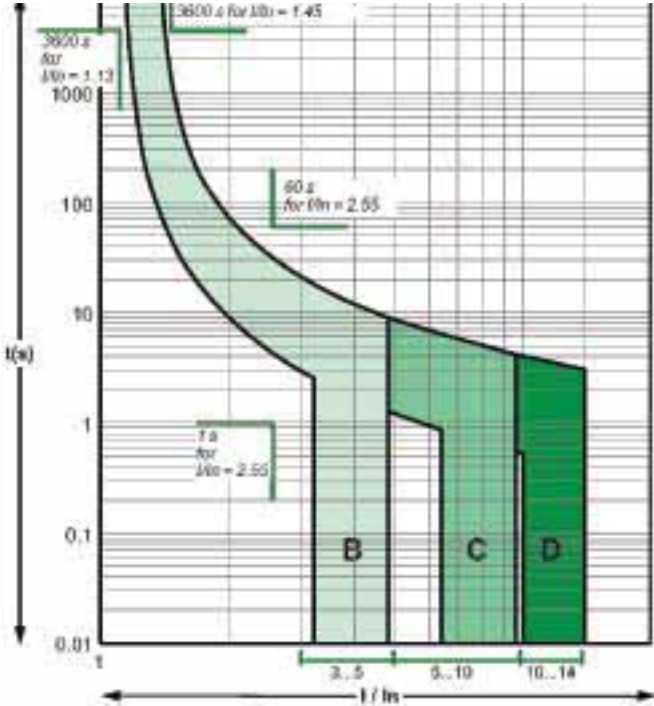



**Multi 9™ System Catalog**  
**Section 9—Time/Current Curves**

**Alternative Current 50/60 Hz**

**Table 89: C60N/H/L**



According to IEC/EN 60947-2 (Reference Temperature 50°C)  
 Curves B, C, D Rating up to 4 A

Curves Z, K Rating up to 4 A

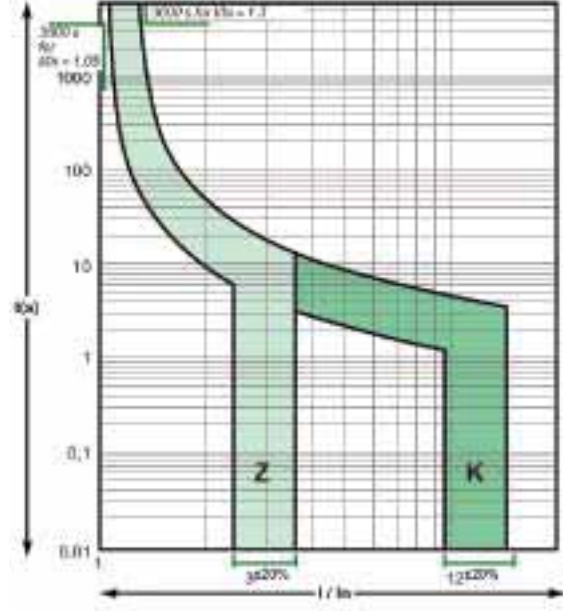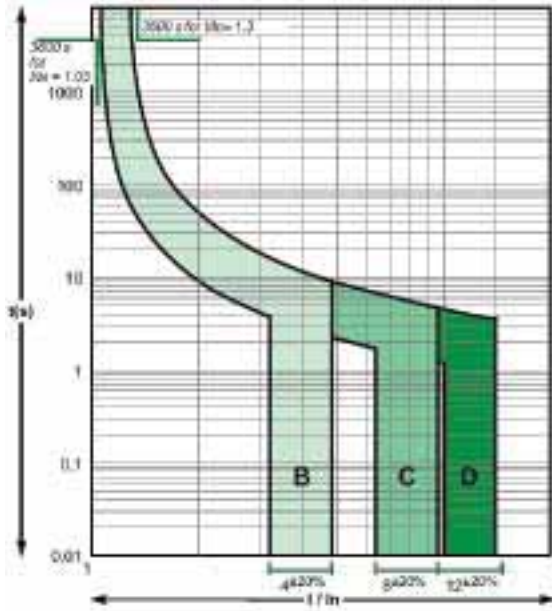

Curves B, C, D Rating 6 A to 63 A


Curves Z, K Rating 6 A to 63 A

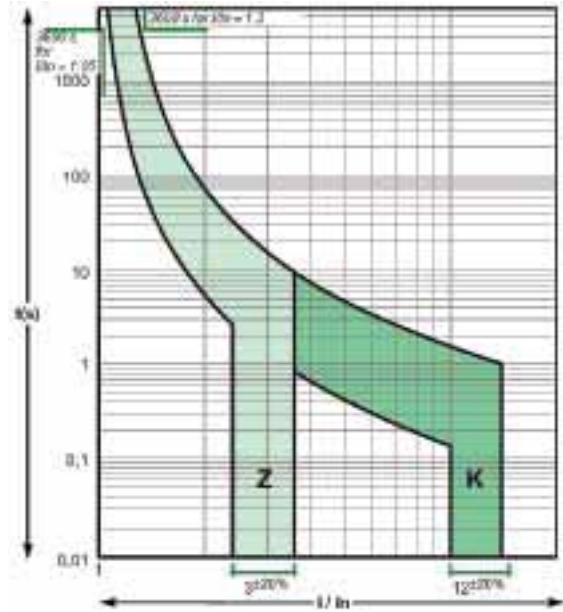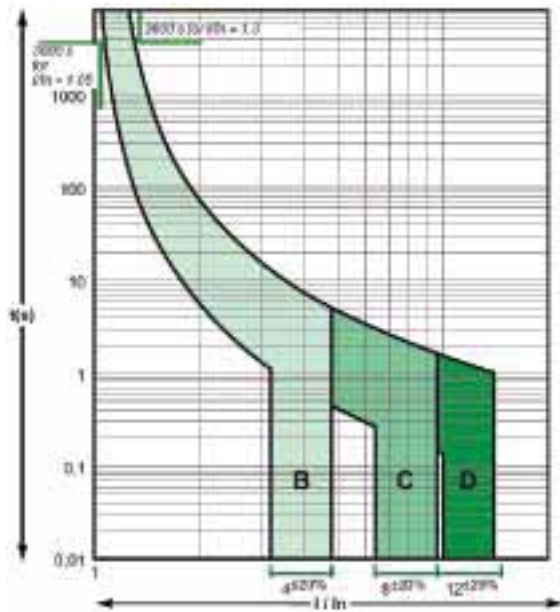

Motor Curve

Table 90: C60L-MA

According to IEC/EN 60947-2  
Curve MA

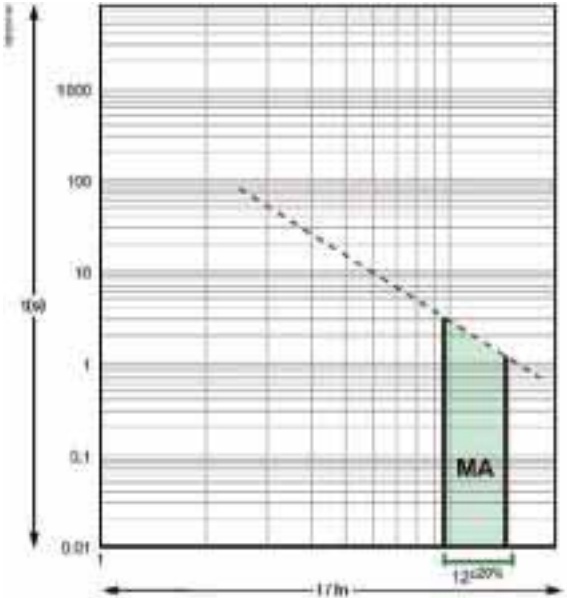

Section 10—Let-Through Curves

UL Listed C60 Miniature Circuit Breakers and UL Recognized C60 Supplementary Protectors

Figure 96: UL 489/CSA C22.2 No.5/489A Listed and UL 1077 Recognized C60 1P (240 Vac) Max Let-Through Peak Current


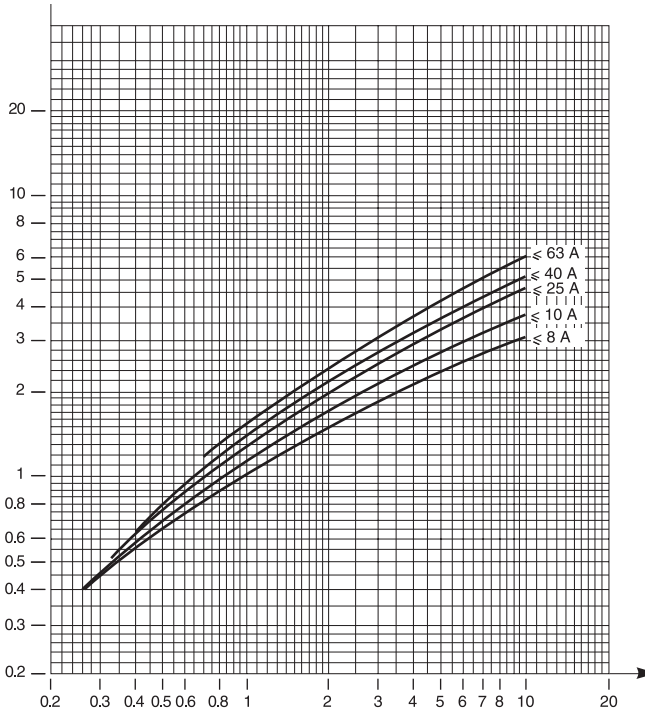


Figure 97: UL 489/CSA C22.2 No.5/489A Listed and UL 1077 Recognized C60 1P (240 Vac) Max Let-Through I<sup>2</sup>t Current




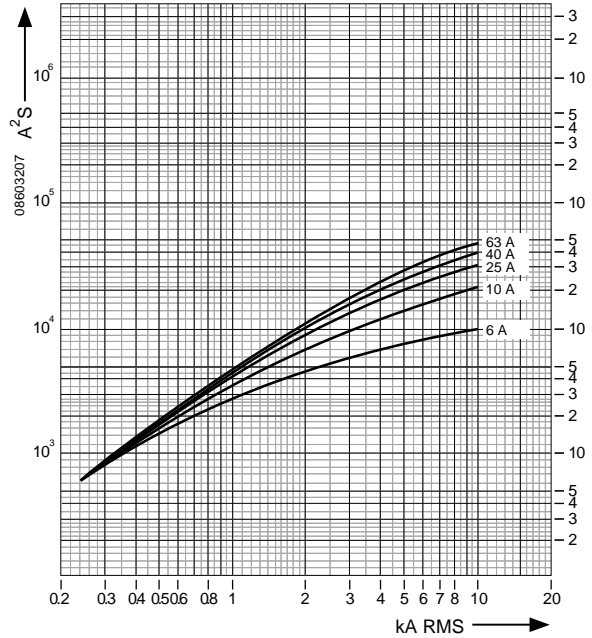


# Multi 9™ System Catalog

## Section 10—Let-Through Curves

**Figure 98:** UL 489/CSA C22.2 No.5 Listed and UL 1077 Recognized C60 2P, 3P, and 4P (240 Vac) Max Let-Through Peak Current

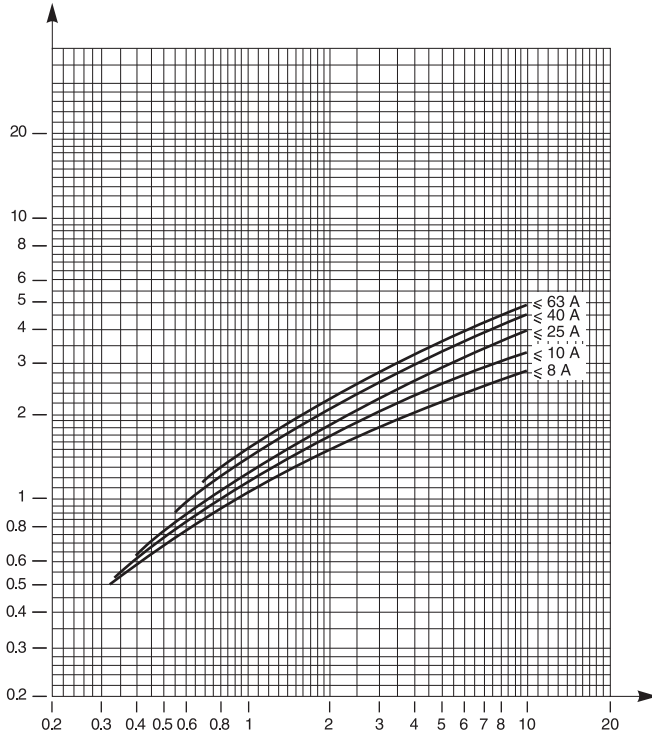


**Figure 99:** UL 489/CSA C22.2 No.5 Listed and UL 1077 Recognized C60 2P, 3P, and 4P (240 Vac) Max I<sup>2</sup>t Peak Current

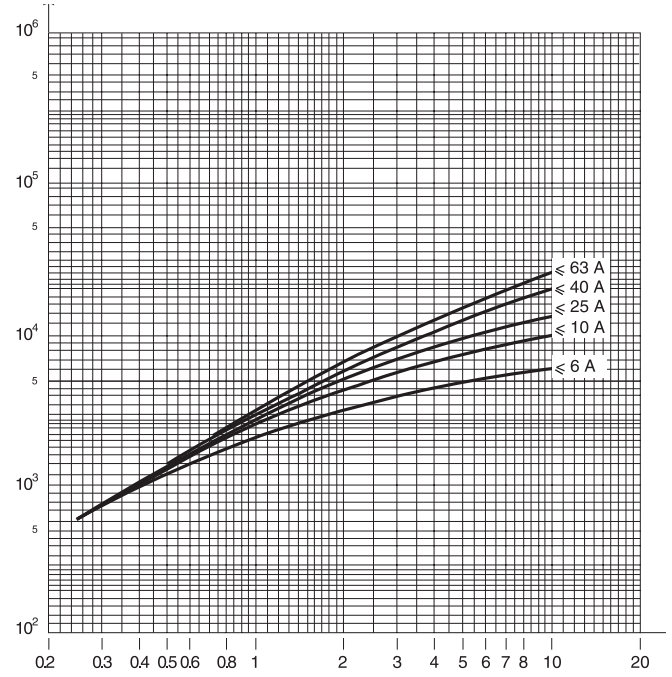


# Multi 9™ System Catalog

## Section 10—Let-Through Curves


**Figure 100: UL 489/CSA C22.2 No.5 Listed and UL 1077 Recognized C60 1P (277 Vac) Maximum Let-Through Peak Current**

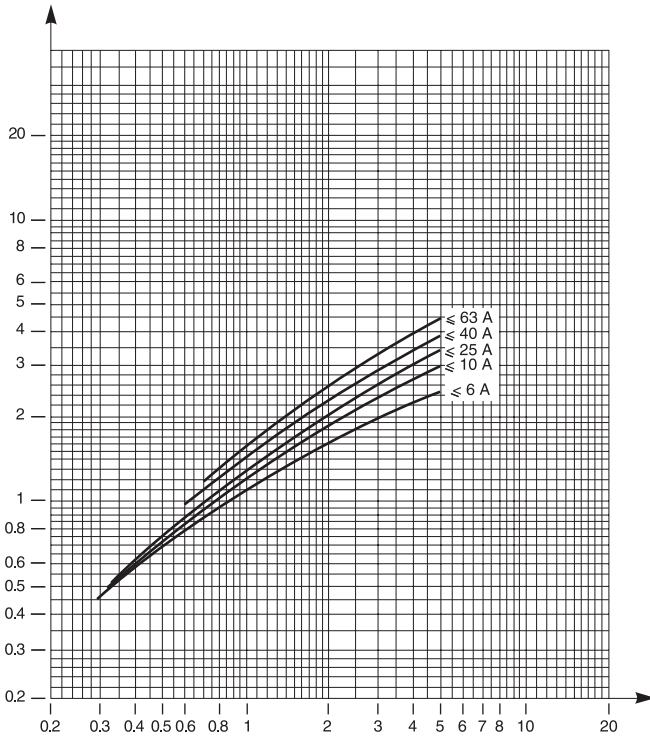

**Figure 101: UL 489/CSA C22.2 No.5 Listed and UL 1077 Recognized C60 1P (277 Vac) Maximum I<sup>2</sup>t Peak Current**

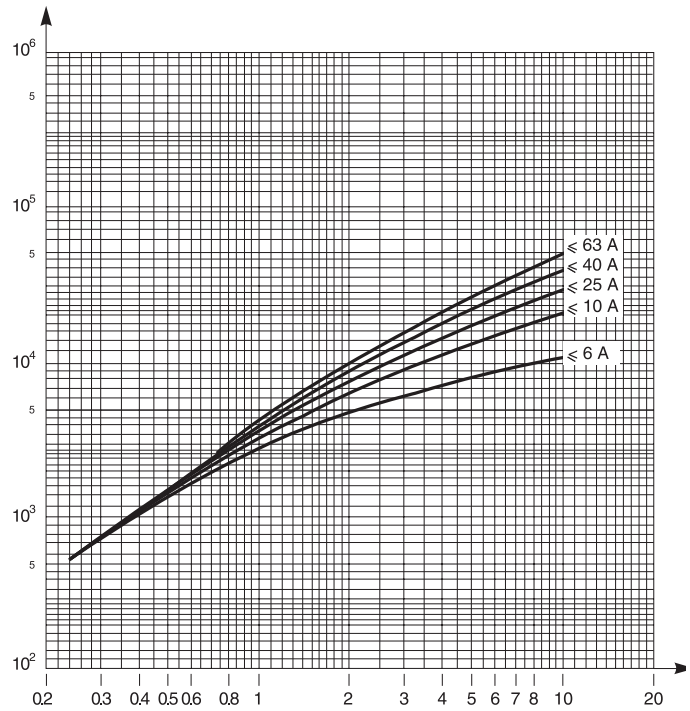

**Figure 102: UL 1077 Recognized C60 2P, 3P, and 4P (480Y/277 Vac) Maximum Let-Through Peak Current**

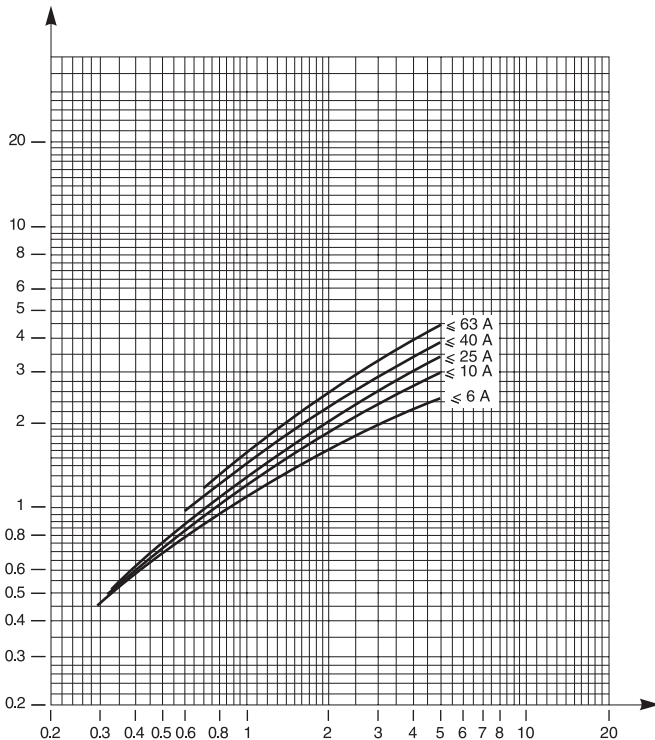

**Figure 103: UL 1077 Recognized C60 2P, 3P, and 4P (480Y/277 Vac) Maximum Let-Through I<sup>2</sup>t Current**

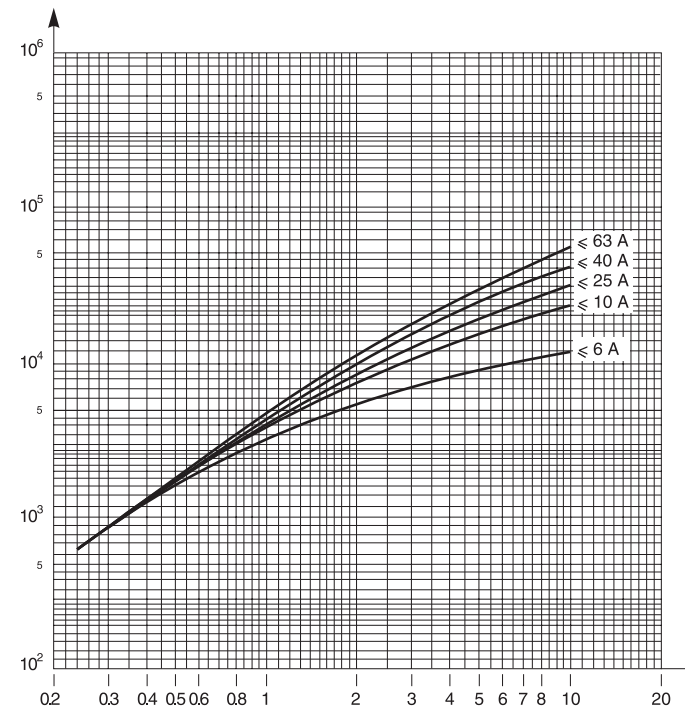


Figure 104: UL 1077 Recognized C60 2P, 3P, and 4P  
(480 Vac) Maximum Let-Through Peak Current


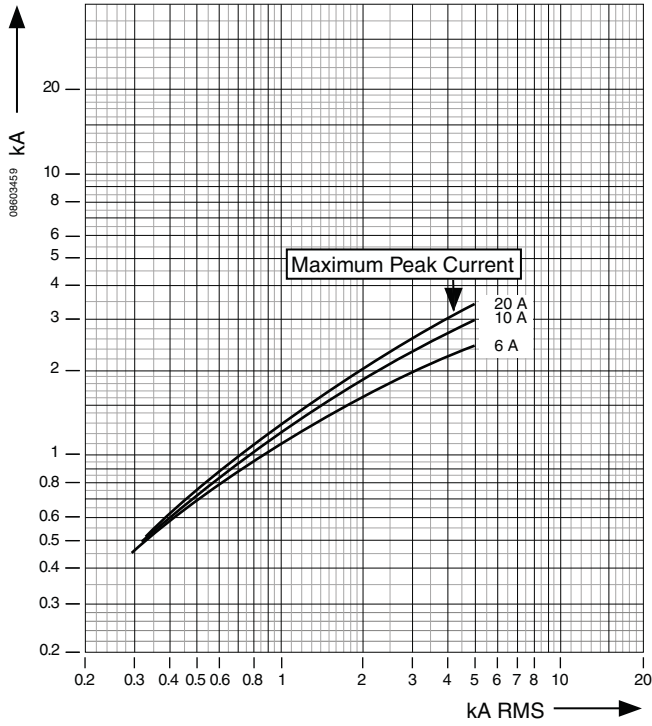


Figure 105: UL 1077 Recognized C60 2P, 3P, and 4P  
(480 Vac) Maximum Let-Through I<sup>2</sup>t Current

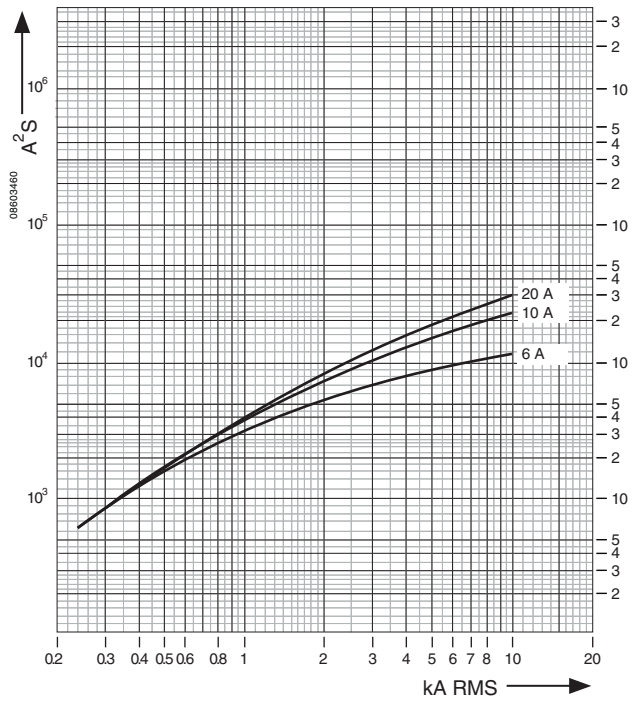


**Multi 9™ System Catalog**  
**Section 10—Let-Through Curves**

**Limitation curves**


For 230 V single-phase or 400 V three-phase network (TN or TT earthing system).

**Table 91: Limitation Curves—C60N**


1P / 3P / 4P Circuit Breakers  
 Peak Currents

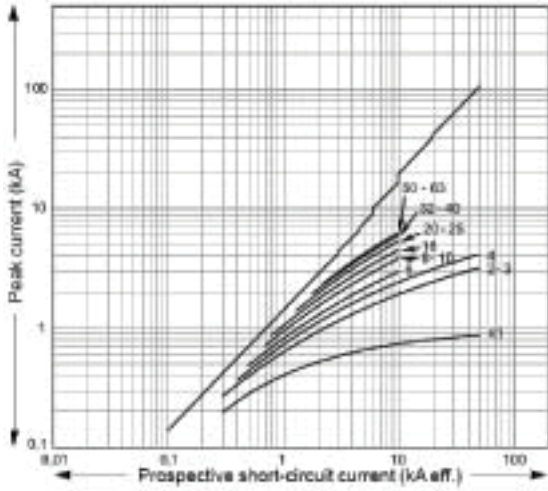


Thermal Stress

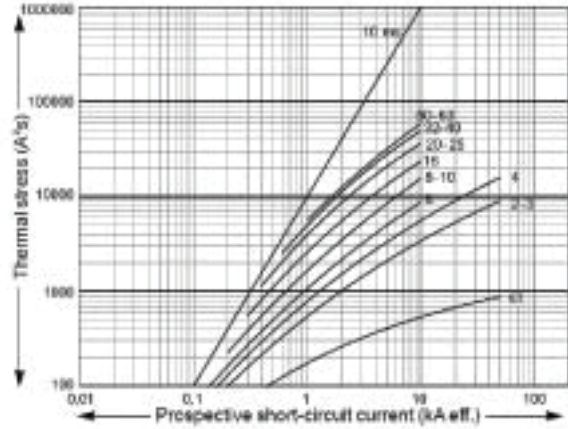

1P+N / 2P Circuit Breakers  
 Peak Currents

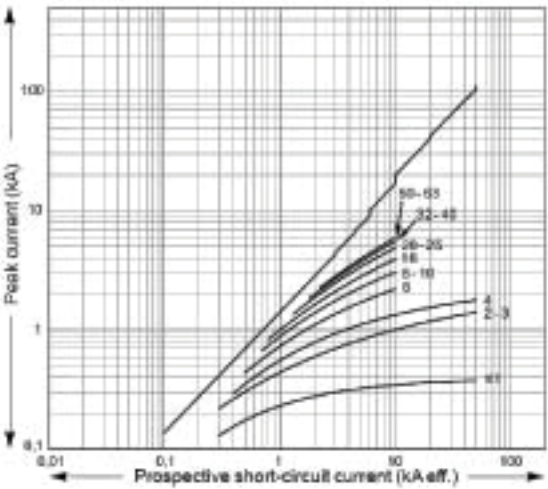


Thermal Stress

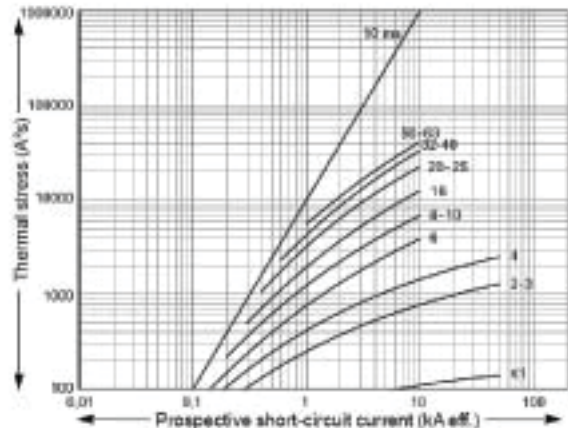


**Table 92: Limitation Curves—C60H**

1P / 3P / 4P Circuit Breakers

Peak Currents

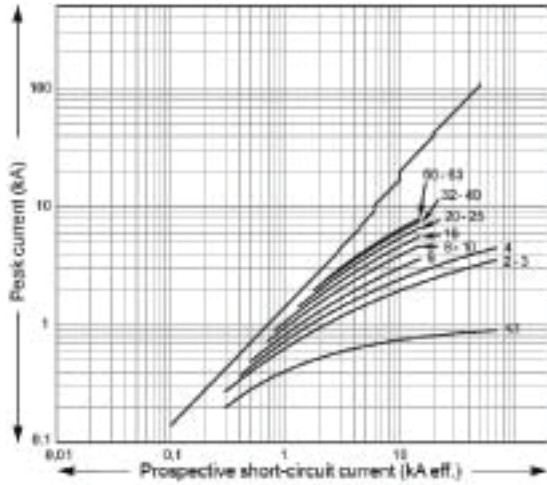


Thermal Stress

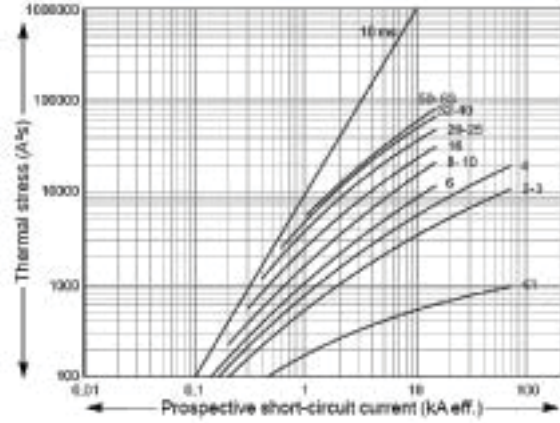


1P+N / 2P Circuit Breakers

Peak Currents

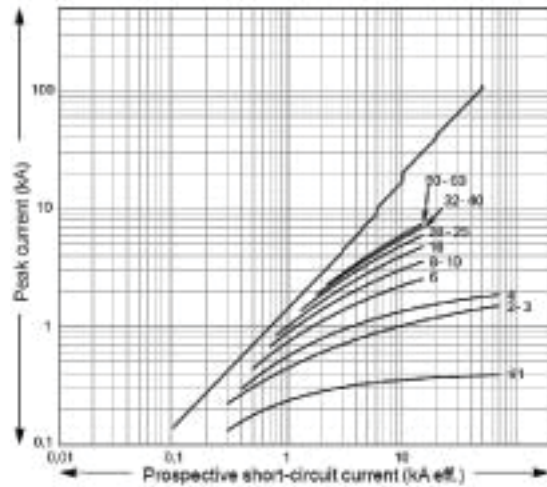

Thermal Stress

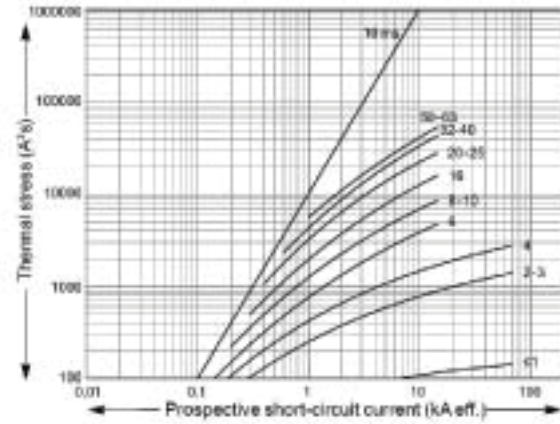


# Multi 9™ System Catalog

## Section 10—Let-Through Curves


**Table 93: Limitation Curves—C60L**

1P / 3P / 4P Circuit Breakers

Peak Currents

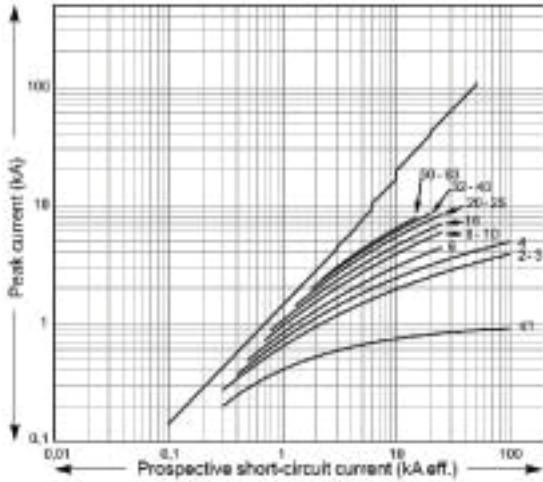


Thermal Stress

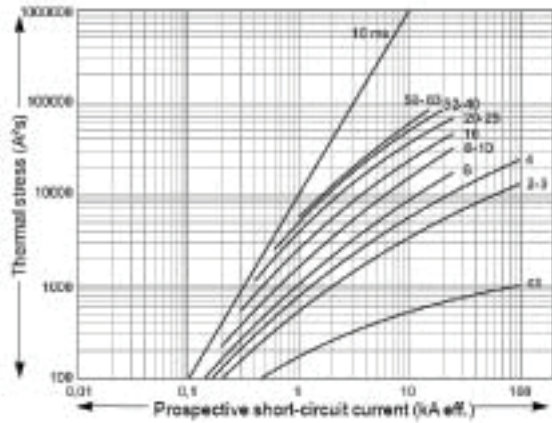


1P+N / 2P Circuit Breakers

Peak Currents

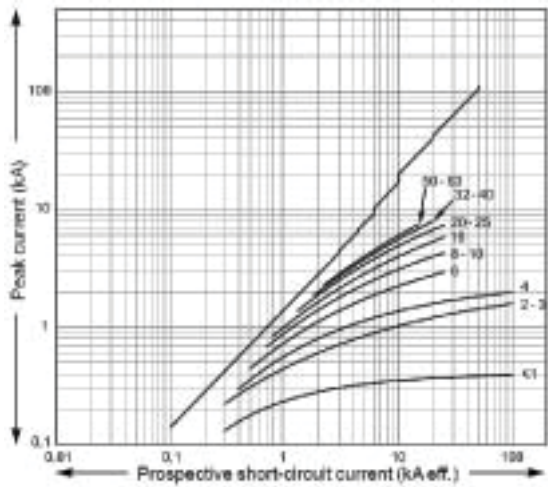

Thermal Stress

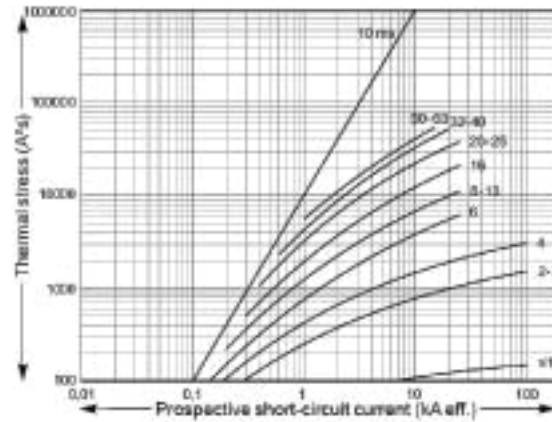

## Index of Part Numbers

<b>Numerics</b>		18402	34	26347	32	60121	18	60182	18
13934	71	18403	34	26348	32	60122	18	60183	18
13940	71	18404	34	26349	32	60123	18	60184	18
13944	71	18412	34	26350	32	60124	18	60185	18
13945	71	18413	34	26352	32	60125	18	60186	18
13947	71	18414	34	26353	32	60126	18	60187	18
13948	71	18415	34	26355	32	60127	18	60188	18
13956	71, 81	18423	34	26357	32	60128	18	60189	18
13957	71, 81	18424	34	26358	32	60129	18	60190	18
13958	71, 81	18425	34	26359	32	60130	18	60191	18
13959	71, 81	18426	34	26360	32	60131	18	60192	18
13960	71, 81	18434	34	26361	32	60132	18	60193	18
13962	71, 82	18435	34	26362	32	60133	18	60194	18
13963	71, 82	18436	34	26368	32	60134	18	60195	18
13964	71, 82	18437	34	26369	32	60135	18	60196	18
13965	71, 82	18445	34	26370	32	60136	18	60197	18
13966	71	18456	34	26923	38, 48	60137	18	60198	18
13967	71, 82	18457	34	26924	47	60138	18	60199	18
13968	71, 82	18458	34	26927	47	60139	18	60200	18
14210	63	18459	34	26970	57	60140	18	60201	18
14211	63	18467	34	26975	55	60141	18	60202	18
14881	53	18468	34	26976	55	60142	18	60203	18
14882	53	18469	34	26978	55	60143	18	60204	18
14886	54	18470	34	26981	55, 59	60144	18	60205	18
14891	53	18478	34	26982	41	60145	18	60206	18
14893	53	18479	34	26996	59	60146	18	60207	18
15005	66	18480	34	27001	55	60147	18	60208	18
15006	66	18481	34	27046	57	60148	18	60209	18
15007	66	18489	34	27047	57	60149	18	60210	18
15008	66	18490	34	27048	57	60150	18	60211	18
15009	66	18491	34	27062	54	60151	18	60212	18
15010	66	18492	34	27105	47	60152	18	60213	18
15102	65	18500	34	27106	47	60153	18	60214	18
15103	65	18501	34	27107	47	60154	18	60215	18
15129	65	18502	34	27108	47	60155	18	60216	18
15440	69	18503	34	27109	47	60156	18	60217	18
15443	69	18511	34	27110	47	60157	18	60218	18
17400	56	18512	34	27118	47	60158	18	60219	18
18030	68	18513	34	27145	57	60159	18	60220	18
18031	68	18514	34	27152	59	60160	18	60221	18
18032	68	18522	34	60100	18	60161	18	60222	18
18033	68	18523	34	60101	18	60162	18	60223	18
18034	68	18524	34	60102	18	60163	18	60224	18
18035	68	18525	34	60103	18	60164	18	60225	18
18036	68	18556	42	60104	18	60165	18	60226	18
18037	68	18557	42	60105	18	60166	18	60227	18
18038	68	18558	42	60106	18	60167	18	60228	18
18039	68	18559	42	60107	18	60168	18	60229	18
18320	67–68	18560	42	60108	18	60169	18	60230	18
18321	67	18561	42	60109	18	60170	18	60231	18
18322	67	18591	42–43, 47	60110	18	60171	18	60232	18
18323	67	18592	42	60111	18	60172	18	60233	18
18324	67	18593	42	60112	18	60173	18	60234	18
18325	67	18594	42	60113	18	60174	18	60235	18
18326	67	18595	42	60114	18	60175	18	60236	18
18330	67	18596	42	60115	18	60176	18	60237	18
18333	67	18597	42	60116	18	60177	18	60238	18
18334	67	18598	42	60117	18	60178	18	60239	18
18335	67	18599	42	60118	18	60179	18	60240	18
18401	34	26345	32	60119	18	60180	18	60241	18
		26346	32	60120	18	60181	18	60242	18

60243	18	60969	37	C325123	62	MG17458	23	MG24162	23
60244	18	60971	37	C325183	62	MG17459	23	MG24163	23
60245	18	60972	37	C325243	62	MG17461	23	MG24164	23
60246	18	60989	37	C3DC123	62	MG17462	23	MG24165	23
60247	18	60990	37	C3DC163	62	MG17463	23	MG24166	23
60248	18	60991	37	C3DC203	62	MG17464	23	MG24167	23
60249	18	60992	37			MG17466	23	MG24168	23
60250	18	60993	37	<b>M</b>		MG17467	23	MG24169	23
60251	18	60995	37	M9PAF	57	MG17468	23	MG24425	23
60252	18	60996	37	M9PF4	63	MG17469	23	MG24426	23
60253	18	60999	37	MG10285	50	MG17471	23	MG24427	23
60254	18	83992	71, 83	MG10286	50	MG17472	23	MG24428	23
60255	18	83993	71, 83	MG10287	50	MG17473	23	MG24430	23
60256	18	83994	71, 83	MG12279	23	MG17474	23	MG24431	23
60257	18	83995	71, 83	MG14885	54	MG24110	23	MG24432	23
60258	18	83996	71, 83	MG14892	53	MG24111	23	MG24433	23
60259	18	83997	71, 83	MG17402	23	MG24112	23	MG24434	23
60260	18			MG17403	23	MG24113	23	MG24435	23
60261	18	<b>A</b>		MG17404	23	MG24114	23	MG24436	23
60262	18	AB1GA	56	MG17405	23	MG24115	23	MG24437	23
60263	18	AB1GB	56	MG17406	23	MG24116	23	MG24438	23
60264	18	AB1GC	56	MG17407	23	MG24117	23	MG24439	23
60265	18	AB1GD	56	MG17408	23	MG24118	23	MG24440	23
60266	18	AB1GE	56	MG17409	23	MG24119	23	MG24442	23
60267	18	AB1GF	56	MG17411	23	MG24121	23	MG24443	23
60268	18	AB1GG	56	MG17412	23	MG24122	23	MG24444	23
60269	18	AB1GH	56	MG17413	23	MG24123	23	MG24445	23
60270	18	AB1GI	56	MG17414	23	MG24124	23	MG24447	23
60271	18	AB1GJ	56	MG17415	23	MG24125	23	MG24448	23
60272	18	AB1GK	56	MG17416	23	MG24126	23	MG24449	23
60273	18	AB1GL	56	MG17417	23	MG24127	23	MG24450	23
60274	18	AB1GM	56	MG17418	23	MG24128	23	MG24451	23
60275	18	AB1GN	56	MG17419	23	MG24129	23	MG24452	23
60276	18	AB1GO	56	MG17421	23	MG24130	23	MG24453	23
60277	18	AB1GP	56	MG17422	23	MG24131	23	MG24454	23
60278	18	AB1GQ	56	MG17423	23	MG24132	23	MG24455	23
60279	18	AB1GR	56	MG17424	23	MG24133	23	MG24456	23
60280	18	AB1GS	56	MG17425	23	MG24134	23	MG24457	23
60281	18	AB1GT	56	MG17426	23	MG24136	23	MG24459	23
60282	18	AB1GU	56	MG17427	23	MG24137	23	MG24460	23
60283	18	AB1GV	56	MG17428	23	MG24138	23	MG24461	23
60284	18	AB1GW	56	MG17429	23	MG24139	23	MG24462	23
60285	18	AB1GX	56	MG17432	23	MG24140	23	MG24464	23
60286	18	AB1GY	56	MG17433	23	MG24141	23	MG24465	23
60287	18	AB1GZ	56	MG17434	23	MG24142	23	MG24466	23
60288	18	AB1R0	56	MG17435	23	MG24143	23	MG24467	23
60289	18	AB1R1	56	MG17436	23	MG24144	23	MG24468	23
60290	18	AB1R11	56	MG17437	23	MG24145	23	MG24469	23
60291	18	AB1R12	56	MG17438	23	MG24146	23	MG24470	23
60292	18	AB1R13	56	MG17439	23	MG24147	23	MG24471	23
60293	18	AB1R2	56	MG17442	23	MG24148	23	MG24472	23
60294	18	AB1R3	56	MG17443	23	MG24149	23	MG24473	23
60295	18	AB1R4	56	MG17444	23	MG24150	23	MG24474	23
60296	18	AB1R5	56	MG17445	23	MG24151	23	MG24476	23
60297	18	AB1R6	56	MG17446	23	MG24152	23	MG24477	23
60298	18	AB1R7	56	MG17447	23	MG24153	23	MG24478	23
60299	18	AB1R8	56	MG17448	23	MG24154	23	MG24481	23
60488	50	AB1R9	56	MG17449	23	MG24155	23	MG24482	23
60949	37	AB1RV	56	MG17452	23	MG24156	23	MG24483	23
60950	37			MG17453	23	MG24157	23	MG24484	23
60951	37	<b>C</b>		MG17454	23	MG24158	23	MG24485	23
60952	37	C125123	62	MG17455	23	MG24159	23	MG24486	23
60954	37	C125183	62	MG17456	23	MG24160	23	MG24487	23
60955	37	C125243	62	MG17457	23	MG24161	23	MG24488	23



MG24489	23	MG26928	47	MGN613403	20	MGN61378	20
MG24490	23	MG26970	57	MGN613404	20	MGN61379	20
MG24491	23	MG26975	55	MGN613405	20	MGN61380	20
MG24500	23	MG26976	55	MGN613406	20	MGN61381	20
MG24501	23	MG26978	55	MGN613407	20	MGN61382	20
MG24502	23	MG26983	59	MGN613408	20	MGN61383	20
MG24503	23	MG26984	59	MGN613409	20	MGN61384	20
MG24504	23	MG26985	59	MGN61341	20	MGN61385	20
MG24505	23	MG26986	59	MGN613410	20	MGN61386	20
MG24506	23	MG26987	59	MGN613411	20	MGN61387	20
MG24507	23	MG26988	59	MGN613412	20	MGN61389	20
MG24508	23	MG26989	59	MGN613413	20	MGN61390	20
MG24509	23	MG26990	59	MGN613414	20	MGN61391	20
MG24510	23	MG26996	59	MGN613415	20	MGN61392	20
MG24511	23	MG27001	55	MGN613416	20	MGN61393	20
MG24512	23	MG27046	57	MGN613417	20	MGN61394	20
MG24513	23	MG27047	57	MGN613418	20	MGN61395	20
MG24514	23	MG27048	57	MGN613419	20	MGN61396	20
MG24516	23	MG27062	54	MGN61342	20	MGN61397	20
MG24517	23	MG27124	60	MGN613420	20	MGN61398	20
MG24518	23	MG27145	57	MGN613422	20	MGN61399	20
MG24519	23	MGN61300	20	MGN613423	20		
MG24520	23	MGN61301	20	MGN613424	20		
MG24521	23	MGN61302	20	MGN613425	20	US11220018	60
MG24522	23	MGN61303	20	MGN613426	20	US12420018	60
MG24523	23	MGN61304	20	MGN613427	20	US13620018	60
MG24524	23	MGN61305	20	MGN613428	20	US14820018	60
MG24525	23	MGN61306	20	MGN613429	20	US16020018	60
MG24526	23	MGN61307	20	MGN61343	20	US21215018	60
MG24527	23	MGN61308	20	MGN613430	20	US22420018	60
MG24528	23	MGN61309	20	MGN613431	20	US23620018	60
MG24529	23	MGN61310	20	MGN61344	20	US24820018	60
MG24530	23	MGN61311	20	MGN61345	20	US26020018	60
MG24532	23	MGN61312	20	MGN61346	20	US31220018	60
MG24533	23	MGN61313	20	MGN61347	20	US32420018	60
MG24534	23	MGN61314	20	MGN61348	20	US33620018	60
MG24535	23	MGN61315	20	MGN61349	20	US34820018	60
MG24536	23	MGN61316	20	MGN61350	20	US36020018	60
MG24537	23	MGN61317	20	MGN61351	20		
MG24538	23	MGN61318	20	MGN61352	20		
MG24539	23	MGN61319	20	MGN61353	20		
MG24540	23	MGN61320	20	MGN61354	20		
MG24541	23	MGN61321	20	MGN61356	20		
MG24542	23	MGN61323	20	MGN61357	20		
MG24543	23	MGN61324	20	MGN61358	20		
MG24544	23	MGN61325	20	MGN61359	20		
MG24545	23	MGN61326	20	MGN61360	20		
MG24546	23	MGN61327	20	MGN61361	20		
MG24548	23	MGN61328	20	MGN61362	20		
MG24549	23	MGN61329	20	MGN61363	20		
MG24550	23	MGN61330	20	MGN61364	20		
MG24551	23	MGN61331	20	MGN61365	20		
MG24552	23	MGN61332	20	MGN61366	20		
MG24553	23	MGN61333	20	MGN61367	20		
MG24554	23	MGN61334	20	MGN61368	20		
MG24555	23	MGN61335	20	MGN61369	20		
MG24556	23	MGN61336	20	MGN61370	20		
MG24557	23	MGN61337	20	MGN61371	20		
MG24558	23	MGN61338	20	MGN61372	20		
MG24559	23	MGN61339	20	MGN61373	20		
MG24560	23	MGN61340	20	MGN61374	20		
MG24561	23	MGN613400	20	MGN61375	20		
MG24562	23	MGN613401	20	MGN61376	20		
MG26925	47	MGN613402	20	MGN61377	20		

**U**

**Schneider Electric USA, Inc.**  
1415 S. Roselle Road  
Palatine, IL 60067 USA  
1-888-778-2733  
[www.us.SquareD.com](http://www.us.SquareD.com)

**Schneider Electric Canada, Inc.**  
5985 McLaughlin Road  
Mississauga, ON L5R 1B8 Canada  
Tel: 1-800-565-6699  
[www.schneider-electric.ca](http://www.schneider-electric.ca)

© 2008–2014 Schneider Electric All Rights Reserved  
Schneider Electric, Square D, and Multi 9 are trademarks owned by Schneider Electric Industries SAS or its affiliated companies. All other trademarks are the property of their respective owners.

0860CT0201 R02/14