

TeSys™ IEC Contactors and Starters



TeSys D Contactors (p. 18-4)



New!
TeSys
F1700, F2100

TeSys F Contactors (p. 18-5)



GV7 Manual Motor Starters and Protectors (p. 18-35)



GV3P (p.18-33)



LUB•2 (p. 18-28)



GV2P21 (p.18-33)

Contactors

TeSys D	18-4
TeSys D Reversing	18-6
TeSys F	18-5
TeSys D and F Accessories	18-8
TeSys K	18-24
TeSys K Accessories	18-27

Motor Starters and Protectors

TeSys U	18-28
GV2, GV3, GV7 Manual Motor Protectors	18-33
Enclosed D-Line	18-21
GV Accessories	18-34
LS1D Fuse Block	18-36

Overload Relays

TeSys D	18-4
TeSys F	18-5
TeSys D and F Accessories	18-16
TeSys K	18-24
TeSys K Accessories	18-27
TeSys T Motor Management System	Section 16

Soft Start Module ATS01

18-32

Replacement Parts

TeSys D Coils	18-17
TeSys F Coils	18-20
TeSys F Contact Tips, etc.	18-13

Wiring Systems

GV-Line Bus Bars	18-37
TeSys D Quickfit	18-38
AK5	18-39

Dimensions

Dimensions	18-40
------------	-------

For more information on lighting, definite purpose (DP), and elevator ratings for TeSys D and TeSys F contactors, refer to catalog 8502CT9901.

For more information on machine safety applications using TeSys D and TeSys F contactors, refer to catalog MKTED208051EN-US.

See our website, www.schneider-electric.us, for UL 508A short circuit ratings (SCCR).

Table 18.1: TeSys D Contactors—Interpretation of the Catalog Number

LC	D				
Full Voltage, Non-Reversing	1				
Full Voltage, Reversing	2				
TeSys D 3 Pole Contactors, 9–150 A					
Contactor AC-3 Full Load Amperes (FLA)					
9 A FLA			09		
12 A FLA			12		
18 A FLA			18		
25 A FLA			25		
32 A FLA			32		
40 A FLA			40		
50 A FLA			50		
65 A FLA			65		
80 A FLA			80		
115 A FLA			115		
150 A FLA			150		
Everlink Power Connection (40–65 A only)				A	
No Everlink Power Connection (9–32 A, 80–150 A)				Blank	
Termination Options (choose one)					
Screw Termination				Blank	
Spring Terminations †				3	
Ring Tongue Terminations •				6	
Slip-on Terminations (9–12 A only)				9	
Coil Voltage (choose one)					
AC Coils (50/60 Hz)		DC Coils (standard)		DC Coils low consumption available for 9–38 A only	
12 V	J7	12 V	JD	5 V	AL
21 V	Z7	21 V	ZD	12 V	JL
24 V	B7	24 V	BD	21 V	ZL
36 V	C7	36 V	CD	24 V	BL
42 V	D7	48 V	ED	48 V	EL
		60			
48 V	E7		ND	72 V	SL
60 V	EE7	72 V	SD	96 V	DL
100 V	K7	110 V	FD	110 V	FL
110 V	F7	125 V	GD	220 V	ML
115 V	FE7	220 V	MD	250 V	UL
120 V	G7	250 V	UD		
127 V	FC7	440 V	RD		
200 V	L7				
208 V	LE7				
220 V	M7				
230 V	P7				
240 V	U7				
277 V	W7				
380 V	Q7				
400 V	V7				
415 V	N7				
440 V	R7				
480 V	T7				
500 V	S7				
575 V	SC7				
600 V	X7				
660 V	Y5 (50 Hz only)				

† For spring terminal versions of LC1D09–LC1D65A, add 3 to the catalog number prior to adding the voltage code (for example, LC1D12G7 becomes LC1D123G7, and LC1D40AG7 becomes LC1D40A3G7. Note that 40–65 A spring terminals are only on the control terminations and not on power terminations). There is no charge for this modification.

• For ring tongue versions of LC1D09–LC1D65A and LC1DT20–LC1DT80A, add 6 to the catalog number prior to adding the voltage code (for example, LC1D09G7 becomes LC1D096G7, and LC1D50AG7 becomes LC1D50A6G7). There is no charge for this modification.

Note: Use this table **only** to interpret current catalog numbers. Some combinations are not available.

Table 18.2: TeSys F Contactors—Interpretation of the Catalog Number

LC	F		
Full Voltage, Non-Reversing	1		
Full Voltage, Reversing	2		
TeSys F 2, 3, and 4 Pole Contactors 115–800 A			
Contactor AC-3 Full Load Amperes (FLA)			
115 A FLA			115
150 A FLA			150
185 A FLA			185
225 A FLA			225
265 A FLA			265
330 A FLA			330
400 A FLA			400
500 A FLA			500
630 A FLA			630
780 A FLA			780
800 A FLA			800
Number of Poles			
2 Poles (400 A, 500 A, and 630 A only)			2
3 Poles (all sizes)			Blank
4 Poles (all sizes except 800 A)			4
Termination Options—Purchase Lugs Separately			
			Blank

Coil Voltage (choose one, noting the contactor size it can be used on)

AC Coils	For use on:	AC Coils	For use on:
24 V (50 Hz)	B5 LC1F115–F225	230 V	P7 LC1F1700, F2100
24 V (60 Hz)	B6 LC1F115–F225	240 V (50 Hz)	U5 LC1F115–F225
24 V (40-400 Hz)	B7 LC1F225–F400	240 V (60 Hz)	U6 LC1F115–F225
42 V (50 Hz)	D5 LC1F115–F225	240 V (40-400 Hz)	U7 LC1F115–F780
48 V (50 Hz)	E5 LC1F115–F225	240 V	U7 LC1F1700, F2100
48 V (60 Hz)	E6 LC1F115–F225	277 V (50 Hz)	W5 LC1F115–F225
48 V (40-400 Hz)	E7 LC1F115–F630	277 V (40-400 Hz)	W7 LC1F115–F780
110 V (50 Hz)	F5 LC1F115–F225	277 V	W7 LC1F1700, F2100
110 V (60 Hz)	F6 LC1F115–F225	380 V (50 Hz)	Q5 LC1F115–F225
110 V	F7 LC1F1700, F2100	380 V (60 Hz)	Q6 LC1F115–F225
110 V (40-400 Hz)	F7 LC1F115–F780	380 V (40-400 Hz)	Q7 LC1F115–F780
115 V (50 Hz)	FE5 LC1F115–F225	380 V	Q7 LC1F1700, F2100
115 V (40-400 Hz)	FE7 LC1F115–F780	400 V (50 Hz)	V5 LC1F115–F225
120 V (60 Hz)	G6 LC1F115–F225	400 V (40-400 Hz)	V7 LC1F115–F800
120 V	G7 LC1F1700, F2100	400 V	V7 LC1F1700, F2100
120 V (40-400 Hz)	G7 LC1F115–F400	415 V (50 Hz)	N5 LC1F115–F225
120 V (40-400 Hz)	F7 LC1F500–F780	415 V (40-400 Hz)	N7 LC1F115–F780
127 V (60 Hz)	G6 LC1F115–F225	415 V	N7 LC1F1700, F2100
127 V (40-400 Hz)	G7 LC1F115–F780	440 V (50 Hz)	R5 LC1F115–F225
200/208 V (60 Hz)	L6 LC1F115–F225	440 V (40-400 Hz)	R7 LC1F115–F780
200/208 V (40-400 Hz)	L7 LC1F265–F780	440 V	R7 LC1F1700, F2100
208 V (40-400 Hz)	L7 LC1F115–F225	460/480 V (60 Hz)	Q6 LC1F115–F225
220 V (50 Hz)	M5 LC1F115–F225	480 V (40-400 Hz)	N7 LC1F780
220 V (60 Hz)	M6 LC1F115–F225	500 V (50 Hz)	S5 LC1F115–F225
220 V (40-400 Hz)	M7 LC1F115–F780	500 V (40-400 Hz)	S7 LC1F115–F780
220 V	M7 LC1F1700, F2100	500 V	S7 LC1F1700, F2100
230 V (50 Hz)	P5 LC1F115–F225	600 V (40-400 Hz)	X7 LC1F500–F630
230 V (40-400 Hz)	P7 LC1F115–F800	660 V (60 Hz)	Y6 LC1F115–F225

DC Coils	For use on:
24 V	BD LC1F115–F400
48 V	ED LC1F115–F630
110 V	FD LC1F115–F780
110 V	FD LC1F1700, F2100
110 V	FW LC1F800
125 V	GD LC1F115–F780
125 V	GD LC1F1700, F2100
220 V	MD LC1F265–F780
250 V	UD LC1F1700, F2100
220/240 V	MW LC1F800
250 V	UD LC1F115–F780
380/400 V	QW LC1F800
440 V	RD LC1F1700, F2100
440 V	RD LC1F115–F780

Table 18.3: TeSys D Contactors—3 or 4 Pole, Screw Terminal Connections

Maximum Horsepower Ratings						Maximum Current Utilization Categories		No. of Poles		Instantaneous Auxiliary Contacts		Catalog Number ▲	\$ Price	
Single-Phase		Three-Phase				Inductive AC3 (A)	Resistive AC1 (A)	N.O.	N.C.	N.O.	N.C.		AC Coils	DC Coils
115 V hp	230 V hp	200 V hp	230 V hp	460 V hp	575 V hp									
0.5	1	2	2	5	7.5	9	—	3	0	—	—	LC1D09 ◆◆◆	94.00	119.00
—	—	—	—	—	—	—	20	4	—	1	1	LC1DT20 ◆	94.00	119.00
—	—	—	—	—	—	—	—	2	2	—	—	LC1D098 ◆	94.00	119.00
1	2	3	3	7.5	10	12	—	3	—	—	—	LC1D12 ◆◆◆	119.00	149.00
—	—	—	—	—	—	—	25	4	0	1	1	LC1DT25 ◆	119.00	149.00
—	—	—	—	—	—	—	—	2	2	—	—	LC1D128 ◆	119.00	149.00
1	3	5	5	10	15	18	—	3	—	—	—	LC1D18 ◆◆	136.00	160.00
—	—	—	—	—	—	—	32	4	0	1	1	LC1DT32 ◆	149.00	183.00
—	—	—	—	—	—	—	—	2	2	—	—	LC1D188 ◆	149.00	183.00
2	3	7.5	7.5	15	20	25	—	3	—	—	—	LC1D25 ◆◆	151.00	181.00
—	—	—	—	—	—	—	40	4	0	1	1	LC1DT40 ◆	193.00	240.00
—	—	—	—	—	—	—	—	2	2	—	—	LC1D258 ◆	193.00	240.00
2	5	10	10	20	30	32	—	3	0	1	1	LC1D32 ◆◆	172.00	213.00
3	5	10	10	30	30	40	—	3	0	1	1	LC1D40A ◆	218.00	275.00
—	—	—	—	—	—	—	60	4	0	0	0	LC1DT60A ◆	296.00	353.00
3	7.5	15	15	40	40	50	—	3	0	1	1	LC1D50A ◆	234.00	291.00
5	10	20	20	40	50	65	—	3	0	1	1	LC1D65A ◆	322.00	379.00
—	—	—	—	—	—	—	80	4	0	0	0	LC1DT80A ◆	446.00	503.00
7.5	15	25	30	60	60	80	—	3	0	1	1	LC1D80	363.00	420.00
—	—	—	—	—	—	—	125	4	—	—	—	LC1D80004 ■	489.00	524.00
—	—	—	—	—	—	—	—	2	2	0	0	LC1D80008 ■	489.00	524.00
—	—	30	40	75	100	115	—	3	—	—	—	LC1D115	479.00	479.00
—	—	40	50	100	125	150	—	3	0	1	1	LC1D150	696.00	696.00
—	—	—	—	—	—	—	200	4	—	0	0	LC1D115004	630.00	630.00

- ▲ Complete the catalog number by adding the coil voltage code from Table 18.11 on page 18-6 (for example, LC1D09G7).
- For DC version of these devices, replace the **C** with a **P** (for example, LC1D80004** becomes LP1D80004**). This applies only to 80 A, 4-pole devices.
- ◆ For ring tongue versions of LC1D09–LC1D65A and LC1DT20–LC1DT80A, add 6 to the catalog number prior to adding the voltage code (for example, LC1D09G7 becomes LC1D096G7 and LC1D50AG7 becomes LC1D50A6G7). There is no charge for this modification.
- ★ For spring terminals versions of LC1D09–LC1D65A, add 3 to the catalog number prior to adding the voltage code (for example, LC1D12G7 becomes LC1D123G7 and LC1D40AG7 becomes LC1D40A3G7. Note that 40–65 A spring terminals are only on the control terminations and not on power terminations). Ring tongue terminations have a 10% adder to list price.
- ▼ For slip-on connector versions of LC1D09 and LC1D12 only, add 9 to the catalog number prior to adding the voltage code (for example, LC1D09G7 becomes LC1D099G7). There is no charge for this modification.

Table 18.4: TeSys D Overload Relays—Ambient Compensated, Bimetallic, Direct Mounting

Current Setting Range (A)	For Direct Mounting to LC1...	Class 10 with Single-Phase Sensitivity	Class 10 without Single-Phase Sensitivity	Class 20 with Single-Phase Sensitivity	Class 20 without Single-Phase Sensitivity	\$ Price
0.10–0.16	D09–D32	LRD01	LR3D01	—	—	60.00
0.16–0.25		LRD02	LR3D02	—	—	
0.25–0.40		LRD03	LR3D03	—	—	
0.40–0.63		LRD04	LR3D04	LRD04L	LR3D04L	
0.63–1		LRD05	LR3D05	LRD05L	LR3D05L	
1–1.6		LRD06	LR3D06	LRD06L	LR3D06L	
1.6–2.5		LRD07	LR3D07	LRD07L	LR3D07L	
2.5–4		LRD08	LR3D08	LRD08L	LRD08L	
4–6		LRD10	LR3D10	LRD10L	LRD10L	
5.5–8		D09–D32	LRD12	LR3D12	LRD12L	
7–10	D09–D32	LRD14	LR3D14	LRD14L	LR3D14L	
9–13	D12–D32	LRD16	LR3D16	LRD16L	LR3D16L	
12–18	D18–D32	LRD21	LR3D21	LRD21L	LR3D21L	
17–24	D25–D32	—	—	LRD22L	LR3D22L	
23–32	D25–D32	LRD32	LR3D32	LRD32L	LR3D32L	73.00
30–38	D32	LRD35	LR3D35	—	—	
9–13	D40A–D65A ▲	LRD313	LR3D313	LRD313L	—	107.00
12–18	D40A–D65A ▲	LRD318	LR3D318	LRD318L	—	
16–25	D40A–D65A ▲	LRD325	LR3D325	LRD325L	—	
23–32	D40A–D65A ▲	LRD332	LR3D332	LRD332L	—	
30–40	D40A–D65A ▲	LRD340	LR3D340	LRD340L	—	
37–50	D40A–D65A ▲	LRD350	LR3D350	LRD350L	—	
48–65	D40A–D65A ▲	LRD365	LR3D365	LRD365L	—	
17–25	D40–D80 □	LRD3322	LR3D3322	LRD3322L	LR3D3522	107.00
23–32	D40–D80 □	LRD3353	LR3D3353	LRD3353L	LR3D3553	
30–40	D40–D80 □	LRD3355	LR3D3355	LRD3355L	LR3D3555	
37–50	D50–D80 □	LRD3357	LR3D3357	LRD3357L	LR3D3557	
48–65	D50–D80 □	LRD3359	LR3D3359	LRD3359L	LR3D3559	
55–70	D65–D80	LRD3361	LR3D3361	LRD3361L	LR3D3561	
63–80	D65–D80	LRD3363	LR3D3363	LRD3363L	LR3D3563	127.00
80–104	D80	LRD3365	—	—	—	
80–104	D115–D150	LRD4365	—	—	—	
95–120	D115–D150	LRD4367	—	—	—	362.00
110–140	D150	LRD4369	—	—	—	

- ▲ Overload relays with Everlink termination—direct mount to D40A to D65A only.
 - Direct mount to old D2 style D40 to D65 (no Everlink terminations) and to D80 only.
- NOTE: For Stand Alone Adapter order LAD7B205.

NOTE: To add ring tongue terminations, add '6' to end of part number. Only devices 0.4 A–32 A.

TeSys D contactor accessories pages 18-8 to 18-11
 TeSys D overload relay accessories page 18-16
 TeSys D replacement coils page 18-19
 Dimensions pages 18-40 to 18-46
 TeSys T pages 16-91



LC1D09



LC1D093



LC1D40A



LC1D115



LRD22



LRD3



E164862
CCN NLDX



LR43364
Class 3211 04



Table 18.5: TeSys D Overload Relays—Solid State

Current Setting Range (A)	For Direct Mounting Beneath Contactor LC1	Class 10	Class 20	\$ Price
60–100	D115–D150	LR9D5367	LR9D5567	298.00
90–150	D115–D150	LR9D5369	LR9D5569	298.00

Table 18.6: TeSys F Contactors—2, 3, and 4 Pole

Standard power ratings of 3-phase motors 50/60 Hz in category AC-3				Maximum Current		Number of Poles	Catalog Number ▲	\$ Price
200 V / 208 V	220 V / 240 V	460 V / 480 V	575 V / 600 V	AC-3	AC-1			
HP	HP	HP	HP	A	A			
30	40	75	100	115	200	3	LC1F115	479.00
						4	LC1F1154	630.00
40	50	100	125	150	250	3	LC1F150	696.00
						4	LC1F1504	825.00
50	60	125	150	185	275	3	LC1F185	938.00
						4	LC1F1854	1439.00
Current Rated				225	315	3	LC1F225	1059.00
						4	LC1F2254	1935.00
60	75	150	175	265	350	3	LC1F265	1179.00
						4	LC1F2654	1646.00
75	100	200	250	330	400	3	LC1F300	1621.00
						4	LC1F3004	1846.00
100	125	250	300	400	500	2	LC1F4002	1521.00
						3	LC1F400	1874.00
150	200	400	500	500	700	4	LC1F4004	2133.00
						2	LC1F5002	4324.00
250	300	600	800	630	1000	3	LC1F500	4970.00
						4	LC1F5004	5617.00
Current Rated				780	1600	2	LC1F6302	5917.00
						3	LC1F630	6474.00
—				450	800	4	LC1F6304	7582.00
						3	LC1F780	7788.00
Current Rated				800	1000	4	LC1F7804	9940.00
						3	LC1F800	6676.00
—				900	1700	3	LC1F1700	10,000.00
						2100	3	LC1F2100



LC1F115



LC1F1700, F2100

▲ Complete the part number by adding the coil voltage code from Table 18.8 (for example, LC1F115G7). All contactors except F780 include 1 N.O. coil interlock contact.

Table 18.7: TeSys F 3-Phase Overload Relays—Solid State, Separate Mounting ■

Current Setting Range A	For Direct Mounting to Contactor LC1●●●●	Class 10 Trip ◆ Catalog Number	Class 20 ◆ Catalog Number	\$ Price
30–50	F115–F185	LR9F5357	LR9F5557	298.00
48–80	F115–F185	LR9F5363	LR9F5563	298.00
60–100	F115–F185	LR9F5367	LR9F5567	298.00
90–150	F115–F185	LR9F5369	LR9F5569	298.00
132–220	F185 ★–F265	LR9F5371	LR9F5571	298.00
200–330	F265–F500	LR9F7375 ■	LR9F7575 ■	333.00
300–500	F265–F500	LR9F7379 ■	LR9F7579 ■	737.00
380–630	F400–F630	LR9F7381 ■	LR9F7581 ■	905.00

- When mounting overload relays LR9F5357–LR9F5571 directly beneath the contactor, supporting the relays with a mounting plate is recommended. With overload relays LR9F7375–LR9F7381, use of a support mounting plate is mandatory.
- ◆ IEC standard 60947-4 specifies the following trip times when the overload relay senses 7.2 times the setting current: Class 10—between 4 and 10 seconds; Class 20—between 6 and 20 seconds.
- ★ Interconnection kit LA7F407 is required to mount an LR9F7371 to an LC1F185.

Table 18.8: Coil Voltage Codes ◆

Contactor	Hz	24 V	48 V	110 V	120 V	208 V	220 V	240 V	440 V	480 V	500 V	600 V
AC												
D09–D150	50/60	B7	E7	F7	G7	LE7	M7	U7	—	T7 ▼	—	X7 ▼△
LC1D80–LC1D150 only	60	B6	E6	F6	G6	LE6	M6	U6	—	T6	—	X6 △
	50	B5	E5	F5	—	—	M5 ▼	U5	—	—	—	—
F115, F150, and F185	50	B5	E5	F5	—	—	M5	U5	—	—	—	—
	60	B6	E6	F6	G6	L6	M6	U6	—	Q5	—	S7
F265, and F330	40–400	B7	E7	F7	G7	L7	M7	U7	—	S7★	—	X7
F400—F780	40–400	—	E7	F7	G7	L7	M7	U7	—	N7	—	X7 □
F1700—F2100	40–400	—	—	F7	G7	—	M7	U7	R7	—	S7	—
DC ▼												
D09–D32, DT20–D258 Low Consumption	—	BL	EL	FL	—	ML	UL	—	—	—	—	—
D09–D150	—	BD	ED	FD	GD	MD	UD	RD	—	—	—	—
F115–F330	—	BD	ED	FD	GD	MD	UD	RD	—	—	—	—
F400–F780	—	—	ED	FD	GD	MD	UD	RD	—	—	—	—
F1700—F2100	—	—	—	FD	GD	MD	UD	RD	—	—	—	—

- ▼ Not available for LC1D80.
- △ Not available for LC1D115 or LC1D150.
- Not available for LC1F780. The 600 V coils for LC1F400–LC1F630 do not include an auxiliary contact for holding circuits.
- ◆ For additional voltage codes refer to the IEC Contactor and Starter Catalog 8502CT9901.
- ★ For use with F265–F330 only.
- ▼ DC coils 3-pole contactors are fitted with built-in surge suppression as standard.

Table 18.9: Coil Voltage Codes for AC and DC Voltages for F800 (includes built-in surge suppressor)

Vac/Vdc	110	120	127	220	240	380	415	440
50/60 HZ	FW	FW	FW	MW	MW	QW	QW	QW

TeSys F contactor accessories page 18-11
 TeSys F overload relay accessories page 18-16
 TeSys F replacement coils and parts pages 18-13, 18-18, 18-20
 Dimensions pages 18-42 to 18-49

UL E164862
CCN NLDX

SP LR43364
Class 3211 04



Each 3-pole device is prewired with line and load side power wiring for reversing applications.
Each 4-pole device is prewired with load side power wiring.

Table 18.10: 3-Pole and 4-Pole Mechanically Interlocked Contactors



LC2D09

Maximum Horsepower Ratings						Maximum Current		No. of N.O. Power Poles	Built In Auxiliary Contacts (per contactor)		Catalog Number ▲	\$ Price	
Single Phase		Three Phase				Inductive AC3 (A)	Resistive AC1 (A)		N.O.	N.C.		AC Control	DC Control
115 V hp	230 V hp	200 V hp	230 V hp	460 V hp	575 V hp								
0.5	1	2	2	5	7.5	9	20	3	1	1	LC2D09♦	234.00	317.00
—	—	—	—	—	—	—		4	1	1	LC2DT20	234.00	317.00
1	2	3	3	7.5	10	12	25	3	1	1	LC2D12♦	317.00	368.00
—	—	—	—	—	—	—		4	1	1	LC2DT25	317.00	368.00
1	3	5	5	10	15	18	35	3	1	1	LC2D18♦	344.00	400.00
—	—	—	—	—	—	—		4	1	1	LC2DT32	419.00	443.00
2	3	7.5	7.5	15	20	25	40	3	1	1	LC2D25♦	374.00	436.00
—	—	—	—	—	—	—		4	1	1	LC2DT40	456.00	477.00
2	5	10	10	20	30	32	50	3	1	1	LC2D32♦	415.00	503.00
3	5	10	10	30	30	40		60	3	1	1	LC2D40A	565.00
3	7.5	15	15	40	40	50	70		3	1	1	LC2D50A	596.00
5	10	20	20	50	50	65		80	3	1	1	LC2D65A	778.00
7.5	15	30	30	60	60	80	125		3	1	1	★	—
—	—	—	—	—	—	—		4	—	—	—	★	—
—	—	30	40	75	100	115	200	3	1	1	LC2D115 ▼	1165.00	1165.00
—	—	—	—	—	—	—		4	—	—	—	LC2D115004 ▼	1391.00
—	—	40	50	100	125	150	200	3	1	1	LC2D150 ▼	1598.00	1598.00

- ▲ Use voltage codes from Table 18.11 to complete the catalog number (for example, LC2D09G7).
- Includes mechanical interlock without electrical contacts. Installer to complete wiring for electronically interlocking contactor operating coils by using a N.C. auxiliary contact integrated in the contactor or optional LADN or LAD8N auxiliary contact block.
- ♦ For LC2D09–LC2D32, electrical interlock can be included by adding a V to the end of the catalog number (for example LC2D09B7V). List price adder: \$5.00.
- ★ For these items, order two non-reversing contactors and one mechanical interlock separately. See page 18-4 and 18-14 for selection.
- ▼ Includes mechanical interlock (LA9D11502) with prewired electrical contacts for interlocking contactor operating coils.

Table 18.11: Coil Voltage Codes ☆

Contactor	Hz	24 V	48 V	110 V	120 V	125 V	208 V	220 V	240 V	250 V	440 V	480 V	600 V
AC													
D09–D150	50/60	B7	E7	F7	G7	—	LE7	M7	U7	—	—	T7 Δ	X7 Δ
LC1D80–LC1D150	50	B5	E5	F5	—	—	—	M5 Δ	U5	—	—	—	—
	60	B6	E6	F6	G6	—	L6	M6	U6	—	—	T6	X6 □Δ
F115, F150, F185	50 Hz	B5	E5	F5	—	—	—	M5	U5	—	—	—	—
	60 Hz	B6	E6	F6	G6	—	L6	M6	U6	—	—	Q5	SC
F265, F330	40–400 Hz	B7	E7	F7	G7	—	L7	M7	U7	—	—	S7 ▽	X7
F400–F780	40–400 Hz	—	E7	F7	F7	—	L7	M7	U7	—	—	N7	X7 ◇
DC													
D09–D32, DT20–D258 Low Consumption	—	BL	EL	FL	—	—	—	ML	—	UL	—	—	—
D09–D150	—	BD	ED	FD	—	GD	—	MD	—	UD	RD	—	—
F115–F330	—	BD	ED	FD	—	GD	—	MD	—	UD	RD	—	—
F400–F780	—	—	ED	FD	—	GD	—	MD	—	UD	RD	—	—

- Δ Not available for LC1D80–LC1D150.
- Not available for LC1D115 or LC1D150.
- ◇ Not available for LC1F780. The 600 V coils for LC1F400–LC1F630 do not include an auxiliary contact for holding circuits.
- ☆ For additional voltage codes refer to the IEC Contactor and Starter catalog, 8502CT9901.
- ▽ For use with F265–F330 only.

Table 18.12: Coil Voltage Codes for AC and DC Coil Voltages for F800 (includes built-in surge suppressor)

Vac/Vdc	24	48	110	120	127	208	220	240	277	380	415	440	480	575	600	660
50/60 Hz	—	—	FW	FW	FW	—	MW	MW	—	QW	QW	QW	—	—	—	—

TeSys D contactor accessories pages 18-8 to 18-11
 TeSys D overload relay accessories page 18-16
 TeSys D replacement coils pages 18-17 to 18-19
 Dimensions pages 18-40 to 18-46



E164862
CCN NLDX



LR43364
Class 3211 04



How to Order:

Components are available for customer assembly of TeSys F reversing contactors. For example, the following components must be ordered to build a reversing contactor, 75 hp @ 460 V, with a 120 V / 60 Hz coil:



LC1F265

Table 18.13: Example of Components

Description	Quantity	Catalog Number
Contactors	2	LC1F115G6
Lugs (page 18-12)	6	DZ2FF1
Auxiliary contacts	2	LADN11
Power connections	1	LA9FF976
Mechanical interlock	1	LA9FF970

Table 18.14: 3-Pole Contactors

Maximum Horsepower Ratings				Maximum Current		Holding Circuit Contact Built Into Coil		Catalog Number ▲	\$ Price
Three Phase				Inductive AC3 (A)	Resistive AC1 (A)	N.O.	N.C.		
200 V hp	230 V hp	460 V hp	575 V hp						
30	40	75	100	115	200	1	0	LC1F115	479.00
40	50	100	125	150	250	1	0	LC1F150	696.00
50	60	125	150	185	275	1	0	LC1F185	938.00
60	75	150	200	265	350	1	0	LC1F265	1179.00
75	100	200	250	330	400	1	0	LC1F330	1621.00
100	125	250	300	400	500	1	0	LC1F400	1874.00
150	200	400	500	500	700	1	0	LC1F500	4970.00
250	300	600	800	630	1000	1	0	LC1F630	6872.00
Current rated				780	1600	0	0	LC1F780	7788.00
—	450	800	900	800	1000	0	0	LC1F800	6676.00

▲ Use coil voltage codes from the Voltage Codes table on page 18-6 to complete the contactor catalog number.

Table 18.15: Auxiliary Contact (Electrical Interlocking)—2 must be purchased

For use with	Number of Contacts	Maximum Number of Blocks Per Contactor	Contact Arrangement		Catalog Number	\$ Price
			N.O.	N.C.		
LC1F to be ordered separately	1	1	1	—	LADN10	13.10
			—	1	LADN01	13.10
	2	2	1	1	LADN11	20.70
			2	—	LADN20	20.70
	4	2	2	2	LADN22	41.50
			1	3	LADN13	41.50
			4	—	LADN40	41.50
			—	4	LADN04	41.50
			3	1	LADN31	41.50
			2	2 ■	LADC22	41.50

■ including 1 N.O. + 1 N.C. make-before-break

Table 18.16: Accessories—For the Assembly of 3-Pole Reversing Contactors (Horizontal Mounting)

With 2 Identical Contactors ♦	Set of Power Connections Catalog Number	\$ Price	Horizontal Mounting Mechanical Interlock Kit Catalog Number	\$ Price
LC1F115	LA9FF976	106.00	LA9FF970	53.00
LC1F150	LA9F15076	96.00	LA9FF970	53.00
LC1F185	LA9FG976	113.00	LA9FG970	53.00
LC1F265	LA9FH976	151.00	LA9FJ970	76.00
LC1F330	LA9FJ976	225.00	LA9FJ970	76.00
LC1F400	LA9FJ976	198.00	LA9FJ970	76.00
LC1F500	LA9FK976	306.00	LA9FJ970	76.00
LC1F630, F800	LA9FL976	568.00	LA9FL970	76.00

♦ For two contactors of different size, refer to pages 18-15.

TeSys F contactor accessories page 18-11
 TeSys F overload relay accessories page 18-16
 TeSys F replacement coils and parts pages 18-13, 18-18, 18-20
 Dimensions page 18-42

Table 18.17: Definite Purpose Ratings, 3-Phase, Breaking All Lines (Hermetic Refrigeration Compressor)

Device	FLA	LRA		
		240V	480V	600V
LC1D09 (AC coil only)	9	54	45	36
LC1D12 (AC coil only)	12	72	60	48
LC1D18 (AC coil only)	18	108	90	72
LC1D25 (AC coil only)	25	150	125	100
LC1D32 (AC coil only)	32	192	160	128
LC1D40A	40	240	200	160
LC1D50A	50	300	250	200
LC1D65A	65	390	325	260
LC1D80	75	450	375	300
LC1D95	—	—	—	—
LC1D115	115	690	575	460
LC1D150	150	900	750	600





Front Mounted Auxiliary Blocks

Table 18.18: Standard, Instantaneous Auxiliary Contact Blocks

Snap-On Mounting	Number of Contacts	Composition		Catalog Number ▲	\$ Price
		N.O.	N.C.		
To front of LC●DT20–D258 (4P), LC●D09–D150▲ or To right side of LC●F	4 ▲	2	2	LADN22 ■	41.50
		1	3	LADN13 ■	41.50
		4	0	LADN40 ■	41.50
		0	4	LADN04 ■	41.50
		3	1	LADN31 ■	41.50
		2 ♦	2 ♦	LADC22 ■ ♦	41.50
	2	1	1	LADN11 ■	20.70
		2	0	LADN20 ■	20.70
		0	2	LADN02 ■	20.70
	To front of LC●D80 and D115 or To left side of LC●F	1	1	0	LADN10 ★
0			1	LADN01 ★	13.10
To side of LC●D09 to D150 only (not for use on TeSys F)	2	1	1	LAD8N11 ▼	20.70
		2	0	LAD8N20 ▼	20.70

- ▲ For low consumption coils (LC1D09–D32 only), only one front-mounted two-contact block allowed. No side-mounted contact blocks allowed.
- For spring terminal versions of these blocks, add a 3 to the end of the catalog number (for example, LADN223). There is no charge for this modification. For slip-on versions, add 9 to the end of the catalog number (for example, LADN229).
- ♦ Including 1 N.O. + 1 N.C. make-before-break overlapping contacts.
- ★ This block cannot be added to the LC1D 09–D32 contactors; a maximum of 2 blocks can be mounted on the LC1D40A–LC1/LP1D80 contactors only.
- ▼ 1 block may be added to the left side of LC1D09–D32, AC coils only; only 1 block may be added to either side of the LC1D40A–D80 contactors, AC coils only. Cannot be installed on TeSys D contactors with DC coils.

Table 18.19: Instantaneous Blocks with Dust-Tight Auxiliary Contacts (IP54) NEMA 12

Snap-On Mounting	Standard Contacts		Dust-Tight Contacts		Catalog Number	\$ Price
	N.O.	N.C.	N.O.	N.C.		
To front of LP●D40–D80, LC●DT20–D258 (4P), LC●D09 to D80 or To right side of LC●F	—	—	2	—	LA1DX20	65.00
	2	—	2	—	LA1DZ40	82.00
	1	1	2	—	LA1DZ31	82.00
	—	—	2	—	LA1DY20Δ	77.00

Δ Device supplied with 4 ground terminal points.

Table 18.20: Pneumatic Time Delay Contact Blocks

Snap-On Mounting	Time Delay Contacts		Type	Range of Time Delay	Catalog Number ◇	\$ Price
	N.O.	N.C.				
To front of LP●D40–D80, LC●DT20–D258 (4P), LC●D09 to D150 or To right side of LC●F	1	1	On energization (on delay)	0.1 to 3 s □	LADT0	131.00
				0.1 to 30 s	LADT2	131.00
				10 to 180 s	LADT4	131.00
				1 to 30 s ★	LADS2	131.00
	1	1	On de-energization (off-delay)	0.1 to 3 s □	LADR0	131.00
				0.1 to 30 s	LADR2	131.00
				10 to 180 s	LADR4	131.00

- Scale range is expanded between 0.1 and 0.6 seconds on the dial for more accurate settings at the lower end of the range.
- ◇ For spring terminal versions of these blocks, add a 3 to the end of the catalog number (for example, LADT23). There is no charge for this modification.
- ★ Switching time between the opening of the N.C. contact and the closing of the N.O. contact: 40 ms ± 15 ms.

Table 18.21: Mechanical Latch Blocks with Manual or Electrical Unlatch (TeSys D only)

Front snap-on mounting onto	Application	Catalog Number ◊	\$ Price
LC●D09 to D65A	For silent operation and energy conservation	LAD6K10◊◊*	77.00
LC1 D80 to D150 LP1 D80	For silent operation and energy conservation	LA6DK20◊◊	77.00

- ▼ Does not include internal coil clearing contact.
- ◊ Complete the catalog number by adding the coil voltage code (for example, LAD6K10F).
- * Low consumption DC contactors (and relays) (code coil xL) are not compatible with the LAD6K10x mechanical latching blocks.

Table 18.22: Coil Voltage Codes for LA6DK Mechanical Latch Blocks

Volts	12	24	32/36	42/48	60/72	100	110/127	200/208	220/240	380/415	440/480	500/600
AC or DC	J	B	C	E	EN	K	F	L	M	Q	R	S

TeSys D contactors pages 18-4, 18-6
 TeSys D overload relay accessories page 18-16
 TeSys D replacement coils pages 18-18 to 18-19
 Dimensions pages 18-40 to 18-46



E164862
CCN NLDX



LR43364
Class 3211 04



RC Coil Suppressor



LA4DA1U

- Limitation of transient voltage to 300% of nominal voltage maximum.
- Oscillating frequency limited to 400 Hz maximum. Slight increase in drop-out time (1.2 to 2 times normal).

Table 18.23: Resistor/Capacitor Circuit (RC) for Reduction of Electrical Noise in AC Contactor Coils

Installed by	Mounting on	Operating Voltage 50/60 Hz	Catalog Number	\$ Price
Snapping into the cavity on the right side without tools ◊	LC1D09 to LC1D32 (3P) LC●DT20 to DT40 (4P),	24–28 V	LAD4RCE	26.20
		50–127 V	LAD4RCG	26.20
		110–240 V	LAD4RCU	26.20
Snap-on mounting, and connection without tools to the contactor coil terminals	LC1D40A to LC1D65A (3P), LC1DT60A to LC1DT80A (4P)	24–48 V	LAD4RC3E	26.20
		50–127 V	LAD4RC3G	26.20
		110–240 V	LAD4RC3U	26.20
		380–415 V	LAD4RC3N	26.20
Screw connection to the contactor coil terminals	LC●D80 to D150 (3P or 4P) LC●D80 to D115 (4P)	24–48 V	LA4DA2E	26.20
		50–127 V	LA4DA2G	26.20
		110–240 V	LA4DA2U	26.20
		380–415 V	LA4DA2N	26.20

Varistor Coil Suppressor

- Limitation of transient voltage value to 200% of nominal voltage maximum.
- Maximum reduction of transient voltage peaks. Slight increase in drop-out time (1.1 to 1.5 times normal).

Table 18.24: Varistor (Peak Limiting) for Reduction of Electrical Noise in AC Contactor Coils

Installed by	Mounting on	Operating Voltage 50/60 Hz	Catalog Number	\$ Price
Snapping into the cavity on the right side without tools ◊	LC●D09 to D32 TeSys D contactors	24–48 V	LAD4VE	26.20
		50–127 V	LAD4VG	26.20
		110–250 V	LAD4VU	26.20
Snap-on mounting, and connection without tools to the contactor coil terminals	LC1D40A to LC1D65A (3P), LC1DT60A to LC1DT80A (4P)	24–48 V	LAD4V3E	26.20
		50–127 V	LAD4V3G	26.20
		110–250 V	LAD4V3U	26.20
		24–48 Vac	LA4DE2E	26.20
Screw connection to the contactor coil terminals	LC●D80 to D115 (3P or 4P) LC●D12, D25 (4P)	50–127 Vac	LA4DE2G	26.20
		110–250 Vac	LA4DE2U	26.20
		24–48 Vdc	LA4DE3E	26.20
Screw connection to the contactor coil terminals	LC●D80 (3P or 4P)	50–127 Vdc	LA4DE3G	26.20
		110–250 Vdc	LA4DE3U	26.20

Diode Coil Suppressor



LA4DC3U

- No overvoltage or oscillating frequency.
- Polarized component. Increased drop-out time (6–10 times normal).

Table 18.25: Diode for Reduction of Electrical Noise in DC Contactor Coils

Installed on the upper part by	Mounting on	Operating Voltage, DC	Catalog Number	\$ Price
Snap-on mounting and connection w/o tools to the contactor coil terminals	LC●D09–D32	24–250 Vdc	LAD4DDL	26.20
		Clip-on front mounting	LC●D40A to D65, D65A to DT80A	24–250 Vdc
Screw connection of wire to the contactor coil terminals	D80 (3P) D80 (4P)	24–250 Vdc		LA4DC3U

Bidirectional Diode Coil Suppressor

- Protection provided by limiting the transient voltage to 2 Uc max.
- Maximum reduction of transient voltage peaks


Table 18.26: Bidirectional Peak Limiting Diode

Installed by	Mounting on	Operating Voltage 50/60 Hz and DC	Catalog Number	\$ Price
Snapping into the cavity on the right side of the contactor ◊	LC●D09 to LC●D32 (3P) ◊ DT20 to DT40 (4P)	24 (AC only)	LAD4TB	26.20
		72 (AC only)	LAD4TS	26.20
		12–24 V	LAD4T3B	26.20
Clip-on front mounting and connection without tools to the contactor coil terminals ◊	LC1D40A to LC1D65A (3P), LC1DT60A to LC1DT80A (4P)	25–72 V	LAD4T3S	26.20
		73–125 V	LAD4T3G	26.20
		126–250 V	LAD4T3U	26.20
		251–440 V	LAD4T3R	26.20
		24 (AC only)	LA4DB2S	56.00
Screw mounting ◊	LC●D80	72 (AC only)	LA4DB2S	26.20
		24 (DC only)	LA4DB3B	56.00
		72 (DC only)	LA4DB3S	56.00

- ◊ Installing the suppressor into the cavity makes the electrical connection. Overall width of the contactor remains the same.
- ◊ For LC●D09–LC●D65A with DC or low consumption DC coils, 3-pole contactors are fitted with built-in bidirectional diode suppression as standard.
- ◊ Mounting at the top of the contactor on coil terminals A1 and A2.

Table 18.27: Cabling Accessories

Usage	Mounting on	Operating Voltage 50/60 Hz	Catalog Number	\$ Price
For adapting existing wiring to a new product or for use with top-mounting accessory.	LC1D09 to D38 LC1DT20 to DT60 AC only	Without coil suppression	LAD4BB	23.00
		24–48 V	LAD4BBVE	23.00
		50–127 V	LAD4BBVG	23.00
		110–250 V	LAD4BBVU	23.00
For adapting existing wiring to a new product or for use with top-mounting accessory	LC1D40A to LC1D65A (with no coil suppressor)	—	LAD4BB3	26.20



LAD4BB**

TeSys D contactors pages 18-4, 18-6
 TeSys D overload relay accessories page 18-16
 TeSys D replacement coils pages 18-18 to 18-19
 Dimensions pages 18-40 to 18-46

The following accessories require use of cabling accessories (LAD4BB●●) for proper mounting. See page 18-9 for illustration.

Table 18.28: Electronic Serial Timer Modules

These solid state modules delay the energizing of the contactor coil, and feature built-in varistor surge suppression.

Type	Operational Voltage ▲		Time Delay	Catalog Number	\$ Price
	24–250 Vac	100–250 Vac			
On-delay	LC1D09–D65A	LC1D80–D150	0.1–2 s	LA4DT0U	82.
			1.5–30 s	LA4DT2U	82.
			25–500 s	LA4DT4U	82.

▲ For 24 V operation, the contactor must be fitted with a 21 V coil: coil voltage code Z5 for 50 Hz; Z6 for 60 Hz; and ZD for DC.

Table 18.29: Interface Modules ■

These modules allow the contactor coils to be energized from low voltage and low current level signals. They come in mechanical relay and solid state versions. The relay plus manual operation versions include a lever for manually turning the contactor on and off. When a module receives a low level signal, it allows the separate-sourced control voltage to flow to the contactor coil. It saves space and wiring time compared to conventional interposing relays.



LA4DFB


Interface Type	Operational Voltage		Input Voltage	Catalog Number	\$ Price
	24–250 Vac	100–250 Vac			
Relay	LC1D09–D150	—	24 Vdc	LA4DFB	55.
	LC1D09–D150	—	48 Vdc	LA4DFE	55.
Relay Plus Manual Operation	LC1D09–D150	—	24 Vdc	LA4DLB	71.
	LC1D09–D150	—	48 Vdc	LA4DLE	71.
Solid State	LC1D09–D65	LC1D80–D115	24 Vdc	LA4DWB	71.

■ Adapter required for D09–D65A, see table 18.27.


Table 18.30: Automatic-Manual-Stop Control Modules

These modules allow for local and/or remote operation of the contactor coil. Each module includes a lever to switch from automatic to manual operation and a dial to turn the contactor on and off.

Operational Voltage		Catalog Number	\$ Price
24–100 Vac	100–250 Vac		
LC1D09–D150	—	LA4DMK	35.



LA9D3260




LA9D2561



LA9D80962



LA9D11567



LA9D511

Table 18.31: For Power Pole or Control Connection

Description		For use with contactors LC1/LP1	Sold in lots of	Catalog Number	\$ Price each
Connectors for larger cable sizes	4 poles	#8 AWG (10 mm ²)	D09, D12	LAD92560	8.70
	3 poles	#4 AWG (25 mm ²)	D09-D32	LA9D3260	12.00
Everlink™ terminal block	3 poles		D40A-D65A	LA9D6560	10.00
			D09-D32	LA9D2561	26.20
	2 poles		D40A-D65A	LAD9P32	6.00
			D80	LA9D80961	6.50
			F115	LA9FF602	55.00
			F150, F185	LA9FG602	65.00
			F265, F330, F400	LA9FH602	169.00
			F500	LA9FK602	228.00
			F630, F800	LA9FL602	278.00
			D09-D32	LAD9P3	10.00
	3 poles (wye-delta shorting strap)		D40A-D65A	LAD9P33	25.00
			D80	LA9D80962	6.50
			F115	LA9FF601	6.80
			F150, F185	LA9FG601	8.20
		F265, F330, F400	LA9FH601	12.00	
		F500	LA9FK601	21.80	
		F630, F800	LA9FL601	38.20	
		DT20, DT25	LA9D1263	8.70	
4 poles		D80	LA9D80963	17.50	
		LP1D40-D80	LA9D09966	2.20	
Second coil connection			D115, D150	LA9D11567	4.00
Control circuit take-off from main pole			D80	LA9D8067	5.50
Spreaders for increasing pole pitch to 45 mm			D115, D150	GV7AC03	31.10
Replacement power terminal block			D115, D150	LA9D115603	55.00

Table 18.32: For Marking

Description	For use with contactors LC1/LP1	Sold in lots of	Catalog Number	\$ Price each
Reference label holder snap-on 8 x 22 mm	4-pole contactors D80-D115	100	LA9D92	.06
Reference label holder snap-on 8 x 18 mm 3 poles	D09-D65A, DT20-DT80A, LADN, LADT, LADR	100	LAD90	.06
Sheet of 300 labels self adhesive 7 x 21 mm	For holder LA9D92	1	LA9D93	4.30

Table 18.33: For Mounting

Description	For use with contactors LC1/LP1	Sold in lots of	Catalog Number	\$ Price each
Set of shims for mounting LAD8N and LA8DN	D80	1	LA9D511	9.80
Retrofit plate for replacement of LC1D40-D65 with LC1D40A-D65A	D40A-D65A	1	LAD7X3	25.00
35 mm DIN Rail – 2 meters long	LC1D09 to D80	10	AM1DP200	5.20

Table 18.34: Replacement Contacts


	For use with contactors		Catalog Number	\$ Price
Three-pole	LC1D115	3 poles	LA5D1158031	239.00
	LC1D150	3 poles	LA5D115803	239.00
Four-pole	LC1D115	4 poles	LA5D115804	318.00

Table 18.35: Arc Chambers

	For use with contactors		Catalog Number	\$ Price
Three-pole	LC1D115	3 poles	LA5D11550	90.00
	LC1D150	3 poles	LA5D115050	90.00
Four-pole	LC1D115	4 poles	LA5D115450	119.00

TeSys D contactors pages 18-4, 18-6
 TeSys D overload relay accessories page 18-16
 TeSys D replacement coils pages 18-18 to 18-19
 Dimensions pages 18-40 to 18-47
 TeSys F contactors pages 18-5, 18-7
 TeSys F replacement coils and parts pages 18-13, 18-18, 18-20

Table 18.36: Suppressor Blocks



Operating limit: up to 220 V, 50/60 Hz coils				
Description	For Use		Catalog Number	\$ Price
Suppressor block (clip-on mounting to coil)	With coils	LX1FF, FG, FH, F115, F150, F185, F225, F265, F330	LA9F980	21.80
	With coils	LX1FJ, FK, FL, FX, F400, F500, F630, F780, LX9FF, FG, FH, F115, F150, F185, F225, F265, F330	LA9D09980	20.70
Mounting bracket (for 35 mm DIN rail or panel mounting) for suppressor block			LA9D09981	5.50

Table 18.37: Lugs and Lug Kits ▲

Contactor Type LC1	Lug Kit Catalog Number Contactor Only	Cable Size AWG range	Overload Relay	Directly mounted to contactor	Lugs Required		Cable size AWG range	
					Line side of contactor	Load side of overload	Line side of contactor	Load side of overload
—	—	—	—	LC1*	Line side of contactor	Load side of overload	Line side of contactor	Load side of overload
F115	DZ2FF6	14 to 2/0	LR9F5*57 to F5*69	F115	3 each DZ2FF1	3 each DZ2FG1	14 to 2/0	6 to 3/0
F150, F185	DZ2FG6	6 to 3/0	LR9F5*57 to F5*71	F150 to F185	1 each DZ2FG6	—	6 to 3/0	—
—	—	—	LR9F5*71	F225, F265	1 each DZ2FH6	—	6 to 300 MCM	—
F225, F265, F330	DZ2FH6	6 to 300 MCM	LR9F7*75 to F7*79	F265 or F330	3 each DZ2FH1	—	6 to 300 MCM	4 to 500 MCM
F400	DZ2FJ6	4 to 500 MCM	LR9F7*75 to F7*81	F400	3 each DZ2FJ1	—	4 to 500 MCM	4 to 500 MCM
F500	DZ2FK6	2 x 2 to 600 MCM	LR9F7*75 to F7*81	F500	3 each DZ2FK1	—	2x2 to 600 MCM	4 to 500 MCM
F630, F800	DZ2FL6	3 x 2 to 600 MCM	LR9F7*81	F630	1 each DZ2FL1 DZ2FL2 DZ2FL3	1 each DZ2FR1	3x2 to 600 MCM	4 to 500 MCM
F780	DZ2FX6	4 x 1/0 to 750 MCM	—	—	—	—	—	—

▲ Lug kits ending in the number 6 include 6 identical lugs. In some cases the LR9F overload relay mounted directly on the load side of an LC1F contactor will require a different size lug for your choice of contactor and overload. If the two sizes are different, order 3 of each size lug. Mounting hardware (screws, washers, and nuts) are provided with the contactors and overload relays, not with the lugs. See Table 18.39 for pricing.

Table 18.38: Lugs, 2- and 4-Pole ♦

Contactor Type LC1	Lug Kit Catalog Number	Qty. Required		AL/CU Cable Size
		2-Pole	4-Pole	
F115	DZ2FF1	4	8	14 to 2/0
F150, F185	DZ2FG1	4	8	6 to 3/0
F225, F265, F330	DZ2FH1	4	8	6 to 300 MCM
F400	DZ2FJ1	4	8	4 to 500 MCM
F500	DZ2FK1	4	8	2 X 2 to 600 MCM
F630	DZ2FL	■	■	3 X 2 to 600 MCM
F780	DZ2FX1	4	8	4 X 1/0 to 750 MCM

■ For 2-pole F630 contactors, order two DZ2FL1 (L1 and T2), and two DZ2FL3 (L2 and T1). For 4-pole F630, order two DZ2FL1 (L1 and T4), four DZ2FL2 (L2, T2, L3, T3) and two DZ2FL3 (L4 and T1).
♦ Lugs for LC1F contactors and overload relays must be ordered separately. Each kit consists of one lug. Mounting hardware (screws, washers, nuts) are provided with the contactors, not the lugs. See Table 18.39 for pricing.

Table 18.39: Lugs Pricing

Lug Catalog Number	\$ Price	Lug Catalog Number	\$ Price
DZ2FF6	39.30	DZ2FH1	11.00
DZ2FG6	65.00	DZ2FJ1	11.00
DZ2FH6	65.00	DZ2FK1	21.80
DZ2FJ6	65.00	DZ2FL1	27.30
DZ2FK6	131.00	DZ2FL2	55.00
DZ2FL6	164.00	DZ2FL3	27.30
DZ2FX6	163.80	DZ2FR1	173.30
DZ2FF1	6.50	DZ2FX1	27.30
DZ2FG1	11.00		

These clear plastic protective shrouds are an effective means to meet international touch-safe requirements for power terminals. They are designed to be used with power cables that have been bolted to the terminal.

NOTE: The protection shrouds do not attach to contactors or overloads using DZ2F lug kits.

Table 18.40: Power Terminal Protection Shrouds

For Use With 2-, 3-, And 4-pole Contactors	Number of Shrouds Per Set	Catalog Number	\$ Price
LC1F115	6	LA9F701	42.40
LC1F150, F185	6	LA9F702	61.00
LC1F225, F265, F330, F400 and F4002, F500 and F5002	6	LA9F703	82.00
LC1F630, F6302 and F800	6	LA9F704	93.00
LC1F1154	8	LA9F706	58.00
LC1F1504 and F1854	8	LA9F707	80.00
LC1F2254, F2654, F3304, F4004, F5004	8	LA9F708	111.00
LC1F6304	8	LA9F709	120.00

For contactors LC1F115, LC1F150, and LC1F185, an available touch-safe terminal block may be used in place of lugs for power connections.

Table 18.41: Insulated Terminal Blocks

For contactor type LC1	For overload relay LR9	Maximum Cable Size	Catalog Number	\$ Price
F115, F150, F185	F5*57, F5*63, F5*67, F5*69	300 MCM	LA9F103	55.00

TeSys F contactors pages 18-5, 18-7
TeSys F overload relay accessories page 18-16
TeSys F replacement coils and parts pages 18-18, 18-18, 18-20
Dimensions pages 18-40 to 18-47






Table 18.42: Replacement Contact Sets ▲



	For use on contactors	Number of Poles	Catalog Number	\$ Price
Two-pole	LC1F4002	2 poles	LA5F400802	717.
	LC1F5002	2 poles	LA5F500802	1111.
	LC1F6302	2 poles	LA5F630802	1651.
Three-pole	LC1F115, F150	3 poles	LA5FF431	239.
	LC1F185	3 poles	LA5FG431	418.
	LC1F265	3 poles	LA5FH431	793.
	LC1F330, F400	3 poles	LA5F400803	1076.
	LC1F500	3 poles	LA5F500803	1589.
	LC1F630	3 poles	LA5F630803	2488.
	LC1F780	1 pole	LA5F780801★	1651.
	LC1F800	3 poles	LA5F800803	2488.
Four-pole	LC1F1504, F1154	4 poles	LA5FF441	318.
	LC1F1854	4 poles	LA5FG441	549.
	LC1F2654	4 poles	LA5FH441	966.
	LC1F3304, F4004, F4004	4 poles	LA5F400804	1435.
	LC1F5004	4 poles	LA5F500804	2461.
	LC1F6304	4 poles	LA5F630804	3304.
	LC1F7804	1 pole	LA5F780801★	1651.

Table 18.43: Arc Chambers



	For use on contactors	Number of Poles	Catalog Number	\$ Price
Two-pole	LC1F4002	2 poles	LA5F400250	280.
	LC1F5002	2 poles	LA5F500250	305.
	LC1F6302	2 poles	LA5F630250	431.
Three-pole	LC1F115	3 poles	LA5F11550	90.
	LC1F150	3 poles	LA5F15050	101.
	LC1F185	3 poles	LA5F18550	179.
	LC1F265	3 poles	LA5F26550	269.
	LC1F330	3 poles	LA5F33050	287.
	LC1F400	3 poles	LA5F40050	305.
	LC1F500	3 poles	LA5F50050	341.
	LC1F630	3 poles	LA5F63050	646.
	LC1F780	1 pole	LA5F780150★	431.
	LC1F800	3 poles	LA5F80050	750.
Four-pole	LC1F1154	4 poles	LA5F115450	119.
	LC1F1504	4 poles	LA5F150450	131.
	LC1F1854	4 poles	LA5F185450	248.
	LC1F2654	4 poles	LA5F265450	299.
	LC1F3304	4 poles	LA5F330450	414.
	LC1F4004	4 poles	LA5F400450◆	573.
	LC1F5004	4 poles	LA5F500450◆	610.
	LC1F6304	4 poles	LA5F630450■	861.
LC1F7804	1 pole	LA5F780150★	431.	

- ▲ Supplied per pole are: 2 fixed contacts, 1 moving contact, 2 deflectors, 1 backplate, mounting screws and washers.
- Comprises single-pole components.
- ◆ Comprises 2-pole components.
- ★ 2 identical components per pole are supplied.

TeSys F contactors pages 18-5, 18-7
 TeSys F overload relay accessoriespage 18-16
 TeSys F replacement coils and parts pages 18-13, 18-18, 18-20
 Dimensions pages 18-42 to 18-47

Table 18.44: AC and DC Coil Part Numbers for LC1F1700 and LC1F2100


Control Circuit Voltage of the Contactor	Voltage Code	Spare Coil Part Number	Quantity
AC Coils			
110 V	F7	LX1FK065	2
120 V	G7	LX1FK070	2
220 V	M7	LX1FK110	2
230 V	P7	LX1FK110	2
240 V	U7	LX1FK127	2
277 V	W7	LX1FK140	2
380 V	Q7	LX1FK200	2
400 V	V7	LX1FK200	2
415 V	N7	LX1FK220	2
440 V	R7	LX1FK220	2
500 V	S7	LX1FK240	2
DC Coils			
110 V	FD	LX4FK055	2
125 V	GD	LX4FK065	2
220 V	MD	LX4FK110	2
250 V	UD	LX4FK125	2
440 V	RD	LX4FK220	2

Note: These coils are standard parts included when a voltage code is added to the contactor part number LC1F1700 or LC1F2100.


Table 18.45: Contactors

Reversing contactors comprising two identical, horizontally mounted contactors:	Mechanical interlock		Set of power connections					
	Without electrical interlock	With incorporated electrical interlock (2 N.C. contacts)	Reversing contactors for motor control		Four pole contactors			
	Catalog Number	\$ Price	Catalog Number	\$ Price	Catalog Number	\$ Price	Catalog Number	\$ Price
LC1D09, LC1D12, LC1D18, LC1D25, LC1D32	LAD9R1▲	32.10	LAD9R1V▲	45.50	Included with kit		—	
LC1DT20, LC1DT25, LC1DT32, LC1DT40	LADT9R1▲	36.90	LADT9R1V▲	45.50	—		Included with kit	
▲ Kit including mechanical interlock and wiring.								
LC1D40, LC1D50, LC1D/LP1D65	LA9D50978	31.70	LA9D4002	45.90	LA9D6569	53.00	LA9D6570	63.00
LC1D40A, D50A, D65A	LAD4CM	45.00	—	—	LA9D65A69	75.00	—	—
	<i>New!</i> LAD9R3 ■	65.00	—	—	—	—	—	—
■ Kit combines both LAD4CM and LA9D65A69								
LC1D80 AC coil	LA9D50978	31.70	LA9D4002	45.90	LA9D8069	65.00	LA9D8070	79.00
LC1D80 DC coil	LA9D80978	31.70	LA9D8002	65.00	LA9D8069	65.00	LA9D8070	79.00
LC1D115 and LC1D150	Not Available	—	LA9D11502	78.00	LA9D11569	129.00	LA9D11571 (3P)	53.00
	—						LA9D11570 (4P) (D115 only)	53.00


TeSys D contactorspages 18-4, 18-6
 TeSys D overload relay accessories page 18-16
 TeSys D replacement coils pages 18-17 to 18-19
 Dimensionspages 18-40 to 18-46

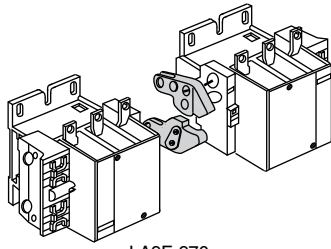


LA9F•970




LA9F•976




LA9F•977




LA9F•4

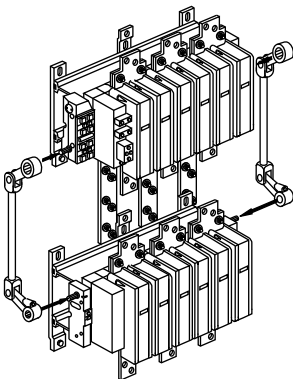

LA9FX970



Reversing (motors) Application



Transfer/Changeover Applications

Table 18.46: Component Parts for the Assembly of F-Line 3-pole Reversing Contactors

With 2 Identical Contactors ▲	Set of Power Connections Catalog Number	\$ Price	Mechanical Interlock Kit Catalog Number	\$ Price
Horizontal Mounting				
LC1F115	LA9FF976	106.00	LA9FF970	53.00
LC1F150	LA9F15076	96.00	LA9FF970	53.00
LC1F185	LA9FG976	113.00	LA9FG970	53.00
LC1F265	LA9FH976	151.00	LA9FJ970	76.00
LC1F330	LA9FJ976	225.00	LA9FJ970	76.00
LC1F400	LA9FJ976	225.00	LA9FJ970	76.00
LC1F500	LA9FK976	306.00	LA9FJ970	76.00
LC1F630 or F800	LA9FL976	568.00	LA9FL970	76.00
Vertical Mounting				
LC1F115 or F150	★	—	LA9FF4F	97.00
LC1F185	★	—	LA9FG4G	113.00
LC1F265	★	—	LA9FH4H	126.00
LC1F330	★	—	LA9FJ4J	149.00
LC1F400	★	—	LA9FJ4J	149.00
LC1F500	★	—	LA9FK4K	149.00
LC1F630 or F800	★	—	LA9FL4L	149.00
LC1F780	■	—	LA9FX970 ■	508.00

Table 18.47: Component Parts for the Assembly of TeSys F 3-pole or 4-pole Transfer Contactors

Horizontal Mounting	Set of Power Connections		\$ Price	Mechanical Interlock Kit Catalog Number	\$ Price
	Three-Pole	Four-Pole			
Horizontal Mounting					
LC1F115/4	LA9FF982	LA9FF977	53.00	LA9FF970	53.00
LC1F150/4	LA9F15082	LA9F15077	53.00	LA9FF970	53.00
LC1F185/4	LA9FG982	LA9FG977	53.00	LA9FG970	53.00
LC1F265/4	LA9FH982	LA9FH977	83.00	LA9FJ970	76.00
LC1F330/4	LA9FJ982	LA9FJ977	113.00	LA9FJ970	76.00
LC1F400/4	LA9FJ982	LA9FJ977	113.00	LA9FJ970	76.00
LC1F500/4	LA9FK982	LA9FK977	154.00	LA9FJ970	76.00
LC1F630/4	LA9FL982	LA9FL977	233.00	LA9FL970	76.00
Vertical Mounting					
LC1F115/4	★	★	—	LA9FF4F	97.00
LC1F185/4	★	★	—	LA9FG4G	113.00
LC1F265/4	★	★	—	LA9FH4H	149.00
LC1F330/4	★	★	—	LA9FJ4J	149.00
LC1F400/4	★	★	—	LA9FJ4J	149.00
LC1F500/4	★	★	—	LA9FK4K	149.00
LC1F630/4	★	★	—	LA9FL4L	149.00
LC1F780/4	■	◆	—	LA9FX970 ◆	508.00

Table 18.48: Vertical Mounting of 2 Contactors of Different Ratings ▲

Upper Contactor	Lower Contactor ▼	Mechanical Interlock Kit Catalog Number	\$ Price
LC1F185 or 185A	LC1F115/150 or 1154/1504	LA9FG4F	113.00
LC1F265 or 265A	LC1F115/150 or 1154/1504	LA9FH4F	126.00
LC1F330 or 330A	LC1F185/185A or 265/265A	LA9FH4G	126.00
LC1F400 or 400A	LC1F115/150 or 1154/1504	LA9FJ4F	126.00
	LC1F185 or 185A	LA9FJ4G	126.00
	LC1F265/265A or 330/330A	LA9FJ4H	149.00
LC1F500 or 500A	LC1F115/150 or 1154/1504	LA9FK4F	149.00
	LC1F185 or 185A	LA9FK4G	126.00
	LC1F265/265A or 330/330A	LA9FK4H	149.00
	LC1F400 or 400A	LA9FK4J	149.00
LC1F630, 630A or LC1F800	LC1F115/150 or 1154/1504	LA9FL4F	116.00
	LC1F185 or 185A	LA9FL4G	126.00
	LC1F265/265A or 330/330A	LA9FL4H	149.00
	LC1F400 or 400A	LA9FL4J	149.00
	LC1F500 or 500A	LA9FL4K	149.00

- ▲ With identical or different numbers of poles.
- Double mechanical interlock with 2 mechanical links and 3 power connection bars.
- ◆ Double mechanical interlock with 2 mechanical links and 4 power connection bars.
- ★ Power connection to be assembled by the customer, except for contactors LC1F780 and F7804.
- ▼ Lower contactor must have equal or lower current rating.

TeSys F contactors	pages 18-5, 18-7
TeSys F overload relay accessories	page 18-16
TeSys F replacement coils and parts	pages 18-18 to 18-20
Dimensions	pages 18-42 to 18-47

TeSys D Overload Relay Accessories

Table 18.49: Mounting Kits and Plates▲



LA7D901

Description	For use with overload relays:	Catalog Number	\$ Price
Separate mounting kits for mounting to 35 mm DIN rail or for panel mounting with screws	LRD01–35 and LR3D01–35	LAD7B10	8.70
	LRD01–35 and LRD01–35 for ring tongue terminals	LAD7B106	8.70
	LRD15**	LAD7B105	10.40
	LR2D15**, LR3D15	LA7D1064	8.70
	LR2D25**	LA7D2064	13.10
Mounting plates for screw mounting at 110 mm (4.3 in.) centers	LRD3***, LR3D3***, LR2D35**	LA7D3064	17.50
	LRD01–35, LR3D01–35, LR2D15**	DX1AP25	11.00
	LR2D25**	DX1AP26	12.00
	LRD3***, LR3D3**, LR2D35**	LA7D902	16.40

▲ When using mounting plates, separate mounting kits are also required.

Table 18.50: Accessories



LA7D03

Description	For use with	Standard Packaging	Catalog Number	\$ Price
Prewiring kit allows direct connection of the N.C. contact of relay LRD01–D32 or LR3D01–D32 to the contactor	LC1D09 through D18	10	LAD7C1	8.70
	LC1D25, D32	10	LAD7C2	8.70
Stop button locking device	All relays except LRD01–D32, LR3D01–D32 and LR9D	10	LA7D901	2.20
Remote stop/tripping or electrical reset◆	LRD01-D32, LRD3, LR3D01-D32, LR3D3	1	LAD703■	43.70
	All relays except LRD01–D32, LR3D01–D31	1	LA7D03■	43.70
Reset by flexible cable 500 mm (19.6 in.)	LRD01-D32, LRD3, LR3D3	1	LAD7305	100.00

■ Part number to be completed by adding coil voltage code, (for example, LAD703F).

Table 18.51: Control Circuit Voltages for LA7D03 and LAD703

Volts	12	24	48	110	220/230	380/400	415/440
AC 50/60 Hz	J★	B	E	F	M	Q	N
DC	J	B	E	F	M	—	—

◆ The time that the LA7D03 can remain energized depends on its rest time; 1 s pulse with 9 s rest time; 5 s pulse with 30 s rest time; 10 s pulse with 90 s rest time; maximum pulse duration of 20 s with rest time of 300 s. Consumption on inrush and sealed: < 100 VA
★ Not available for LRD01–D32, LR3D01–D32.

TeSys F Overload Relay Accessories

Table 18.52: Mounting Plate for Overload Relay




LA7F90•

For use with relays	Catalog Number	\$ Price
LR9F5•57, F5•63, F5•67, F5•69 and F5•71	LA7F901	27.30
LR9F7•75, F7•79 and F7•81	LA7F902	38.20

These clear plastic protective shrouds are an effective means to meet international finger-safe requirements for power terminals. They are designed to be used with power cables that have been bolted to the terminal.

NOTE: The protection shrouds do not attach to contactors or overloads utilizing DZ2F lug kits.

Table 18.53: Power Terminal Protection Shrouds, Single-Pole



LA9F70•

For use with relays	Catalog Number	\$ Price
LR9F5•57	LA9F701	42.40
LR9F5•63, F5•67, F5•69	LA9F702	61.00
LR9F5•71	LA9F705	86.00
LR9F7•75, F7•79, F7•81	LA9F703	82.00

Table 18.54: Power Terminal Protection Shrouds, 3-Pole

For use with relays	Catalog Number	\$ Price
LR9F5•57, F5•63, F5•67, F5•69	LA7F701	27.30
LR9F5•71	LA7F702	38.20
LR9F7•75, F7•79, F7•81	LA7F703	49.20

Table 18.55: Connection Accessories (for Mounting Overload Relays Beneath Reversing Contactors)▼



LA7F701

Application	For relays	For contactor	Set of 3 Bars Catalog Number	\$ Price
LR9F5•57, F5•63, F5•67, F5•69	LR9F5•57, F5•63	LC1F115	LA7F401	19.70
		LC1F150 and F185	LA7F402	21.80
LR9F5•71	LR9F5•71	LC1F265	LA7F403	27.30
LR9F7•75, F7•79	LR9F7•75, F7•79	LC1F265...F400	LA7F404	30.50
LR9F7•81	LR9F7•81	LC1F400	LA7F405	30.50
LR9F7•75, F7•79, F7•81	LR9F7•75, F7•79, F7•81	LC1F500	LA7F404	38.20
LR9F7•81	LR9F7•81	LC1F630	LA7F406	43.70

▼ Mounting plate required.


Table 18.56: Marking Accessories

Description	Sold in units of:	Catalog Number	\$ Price
Marker holder, snap-in	100	LA7D903	0.03 each

Main overload selection pages 18-2, 18-3
Dimensions pages 18-45 to 18-47
TeSys T pages 16-91

Table 18.57: For LC1D09–D32, LC1DT20–40 (TeSys D) Contactors and CAD Relays

Rated Nominal Voltage	Catalog Number 50/60 Hz	\$ Price
12	LXD1J7	26.20
21▲	LXD1Z7	
24	LXD1B7	
32	LXD1C7	
36	LXD1CC7	26.20
42	LXD1D7	
48	LXD1E7	
60	LXD1EE7	
100	LXD1K7	26.20
110	LXD1F7	
115	LXD1FE7	
120	LXD1G7	
127	LXD1FC7	26.20
200	LXD1L7	
208	LXD1LE7	
220/230	LXD1M7	
230	LXD1P7	26.20
230/240	LXD1U7	
277	LXD1W7	
380/400	LXD1Q7	
400	LXD1V7	26.20
415	LXD1N7	
440	LXD1R7	
480	LXD1T7	
575	LXD1SC7	26.20
600	LXD1X7	
Specifications	50/60 Hz	
Average consumption - Inrush (inductance 0.75) - Sealed (inductance 0.3)	70 VA 7 VA	
Operating range @ 60° C	80–110% of nominal @ 50 Hz, 85–110% of nominal @ 60 Hz	

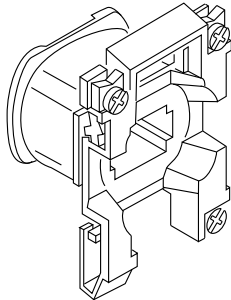

LX1D2

▲ Voltage for special coils fitted in contactors with serial timer modules, with 24 V supply.

Table 18.58: For LC1D09, D12, D18—For old D2 style contactors where the catalog number includes the auxiliary contact arrangement

Rated Nominal Voltage V	Catalog Number 50 Hz	Catalog Number 60 Hz	Catalog Number 50/60 Hz	\$ Price
21■	LX1D2Z5	LX1D2Z6	LX1D2Z7	52.40
24	LX1D2B5	LX1D2B6	LX1D2B7	
32	LX1D2C5	—	—	
42	LX1D2D5	—	LX1D2D7	
48	LX1D2E5	LX1D2E6	LX1D2E7	52.40
110	LX1D2F5	LX1D2F6	LX1D2F7	
120	—	LX1D2G6	LX1D2G7	
127	LX1D2G5	—	—	
208	—	LX1D2L6	—	52.40
220	LX1D2M5	LX1D2M6	LX1D2M7	
230	LX1D2P5	—	LX1D2P7	
240	LX1D2U5	LX1D2U6	LX1D2U7	
256	LX1D2W5	—	—	52.40
277	—	LX1D2W6	—	
380	LX1D2Q5	LX1D2Q6	LX1D2Q7	
400	LX1D2V5	—	LX1D2V7	
415	LX1D2N5	—	LX1D2N7	52.40
440	LX1D2R5	LX1D2R6	LX1D2R7	
480	—	LX1D2T6	—	
500	LX1D2S5	—	—	
575	—	LX1D2S6	—	52.40
600	—	LX1D2X6	—	
660	LX1D2Y5	—	—	
Specifications	50 Hz	60 Hz	50/60 Hz	
Average consumption Inrush (inductance .75)	60 VA	70 VA	70 VA at 50 or 60 Hz	
Sealed (inductance .3)	7 VA	7.5 VA	8 VA at 50 or 60 Hz	
Operating range at $\theta \leq 55^{\circ}\text{C} / 131^{\circ}\text{F}$	80–110 % of nominal voltage	80–110% of nominal voltage	85–110% of nominal voltage	

Table 18.59: For LC1D25, D32—For old D2 style contactors where the catalog number includes the auxiliary contact arrangement

Rated Nominal Voltage (V)	Catalog Number 50 Hz	Catalog Number 60 Hz	Catalog Number 50/60 Hz	\$ Price
21■	LX1D4Z5	LX1D4Z6	LX1D4Z7	72.00
24	LX1D4B5	LX1D4B6	LX1D4B7	
32	LX1D4C5	—	—	
42	LX1D4D5	—	LX1D4D7	
48	LX1D4E5	LX1D4E6	LX1D4E7	72.00
110	LX1D4F5	LX1D4F6	LX1D4F7	
120	—	LX1D4G6	LX1D4G7	
127	LX1D4G5	—	—	
208	—	LX1D4L6	—	72.00
220	LX1D4M5	LX1D4M6	LX1D4M7	
230	LX1D4P5	—	LX1D4P7	
240	LX1D4U5	LX1D4U6	LX1D4U7	
256	LX1D4W5	—	—	72.00
277	—	LX1D4W6	—	
380	LX1D4Q5	LX1D4Q6	LX1D4Q7	
400	LX1D4V5	—	LX1D4V7	
415	LX1D4N5	—	LX1D4N7	72.00
440	LX1D4R5	LX1D4R6	LX1D4R7	
480	—	LX1D4T6	—	
500	LX1D4S5	—	—	
575	—	LX1D4S6	—	72.00
600	—	LX1D4X6	—	
660	LX1D4Y5	—	—	
Specifications	50 Hz	60 Hz	50/60 Hz	
Average consumption - Inrush (inductance .75) - Sealed (inductance .3)	90 VA 7.5 VA	100 VA 8.5 VA	100 VA at 50 or 60 Hz 8.5 VA at 50 or 60 Hz	
Operating range at $\theta \leq 55^{\circ}\text{C} / 131^{\circ}\text{F}$	80–110% of nominal voltage	80–110% of nominal voltage	85–110% of nominal voltage	

■ For use in 24 V applications involving serial timer modules refer to page 18-10.

TeSys D contactors pages 18-4, 18-6
 TeSys D overload relay accessories page 18-16
 TeSys D replacement coils pages 18-17 to 18-19
 Dimensions pages 18-40 to 18-46

Table 18.60: For Old D2 Style LC1D40, D50, D65, D80

Rated Nominal Voltage V	Catalog Number 50 Hz	Catalog Number 60 Hz	Catalog Number 50/60 Hz	\$ Price
24	LX1D6B5	LX1D6B6	LX1D6B7	41.50
32	LX1D6C5	—	—	41.50
42	LX1D6D5	—	LX1D6D7	41.50
48	LX1D6E5	LX1D6E6	LX1D6E7	41.50
110	LX1D6F5	LX1D6F6	LX1D6F7	41.50
120	—	LX1D6G6	LX1D6G7	41.50
127	LX1D6G5	—	—	41.50
208	—	LX1D6L6	LX1D6L7	41.50
220	LX1D6M5	LX1D6M6	LX1D6M7	41.50
230	LX1D6P5	—	LX1D6P7	41.50
240	LX1D6U5	LX1D6U6	LX1D6U7	41.50
256	LX1D6W5	—	—	170.00
277	—	LX1D6W6	—	41.50
380	LX1D6Q5	LX1D6Q6	LX1D6Q7	41.50
400	LX1D6V5	—	LX1D6V7	41.50
415	LX1D6N5	—	LX1D6N7	41.50
440	LX1D6R5	LX1D6R6	LX1D6R7	41.50
480	—	LX1D6T6	—	41.50
500	LX1D6S5	—	—	170.00
575	—	LX1D6S6	—	41.50
600	—	LX1D6X6	—	41.50
660	LX1D6Y5	—	—	41.50

For old style and new TeSys style contactors where the catalog number may or may not include the auxiliary contact arrangement.

Specification	50 Hz	60 Hz	50/60 Hz
Average consumption: -inrush (inductance 0.75) -sealed (inductance 0.3)	200 VA 20 VA	220 VA 22 VA	245 VA 26 VA
Operating range at $\theta \leq 55^\circ\text{C} / 131^\circ\text{F}$	80–110% of nominal voltage	85–110% of nominal voltage	85–110% of nominal voltage

Table 18.61: For TeSys D LC1D40A, D50A, D65A, DT60A, DT80A

Rated Nominal Voltage V	Catalog Number 50 Hz	Catalog Number 60 Hz	Catalog Number 50/60 Hz	\$ Price
12	LXD3J5	—	—	41.50
24	—	—	LXD3B7	41.50
32	—	—	LXD3C7	41.50
42	—	—	LXD3D7	41.50
48	—	—	LXD3E7	41.50
100	—	—	LXD3K7	41.50
110	—	—	LXD3F7	41.50
115	—	—	LXD3FE7	41.50
120	—	—	LXD3G7	41.50
127	—	—	LXD3FC7	41.50
200	—	—	LXD3L7	41.50
208	—	—	LXD3LE7	41.50
220	—	—	LXD3M7	41.50
230	—	—	LXD3P7	41.50
240	—	—	LXD3U7	41.50
277	—	—	LXD3W7	41.50
380	—	—	LXD3Q7	41.50
400	—	—	LXD3V7	41.50
415	—	—	LXD3N7	41.50
440	—	—	LXD3R7	41.50
480	—	—	LXD3T7	41.50
500	—	—	LXD3S7	41.50
575	—	—	LXD3SC7	41.50
600	—	—	LXD3X7	41.50
660	—	—	LXD3YC7	41.50
690	—	—	LXD3Y7	41.50

Table 18.62: For TeSys D LC1D115, D150

Rated Nominal Voltage V	Catalog Number 50 Hz	Catalog Number 60 Hz	Catalog Number 50/60 Hz	\$ Price
24	LX1D8B5	LX1D8B6	LX1D8B7	78.00
32	LX1D8C5	—	LX1D8C7	78.00
42	LX1D8D5	—	LX1D8D7	78.00
48	LX1D8E5	LX1D8E6	LX1D8E7	78.00
110	LX1D8F5	LX1D8F6	LX1D8F7	78.00
115	LX1D8FE5	—	LX1D8FE7	78.00
120	—	LX1D8G6	LX1D8G7	78.00
127	LX1D8FC5	—	LX1D8FC7	78.00
208	—	LX1D8L6	LX1D8L7	78.00
220/230	LX1D8M5	LX1D8M6	LX1D8M7	78.00
230	LX1D8P5	—	LX1D8P7	78.00
240	LX1D8U5	LX1D8U6	LX1D8U7	78.00
277	—	LX1D8W6	LX1D8W7	78.00
380/400	LX1D8Q5	LX1D8Q6	LX1D8Q7	78.00
400	LX1D8V5	—	LX1D8V7	78.00
415	LX1D8N5	—	LX1D8N7	78.00
440	LX1D8R5	LX1D8R6	LX1D8R7	78.00
480	—	LX1D8T6	LX1D8T7	78.00
500	LX1D8S5	—	LX1D8S6	78.00

For old style and new TeSys style contactors where the catalog number may or may not include the auxiliary contact arrangement.

Specification	50 Hz	60 Hz	50/60 Hz
Average consumption: -inrush (inductance 0.8) -sealed (inductance 0.3)	300 VA 22 VA	300 VA 22 VA	350 VA (Inductance: 0.9) 18 VA (Inductance: 0.9)
Operating range at $\theta \leq 55^\circ\text{C} / 131^\circ\text{F}$	85–110% of nominal voltage	85–110% of nominal voltage	80–115% of nominal voltage

Table 18.63: For LC1F115, F150, F185, F265, F330, F400, F500, F630, F780, F800

LX1 coils are the standard coils that are included when a voltage code is added to the contactor part number. The LX9 coils may be ordered separately for special applications. LX9 coils do not include a built-in normally open holding circuit contact; a separate auxiliary contact block with a N.O. contact should be added to the contactor. Both the LX1 and LX9 coils can be used on the previous F-line contactors.

Device Type	Hz	Catalog Number	Catalog Number Suffix □													\$ Price
			24 V	48 V	110 V	120 V	208 V	220 V	240 V	277 V	380 V	415 V	440 V	480 V	600 V	
F115–F150	50	LX1FF*	024	048	110	127	200	220	240	264	380	415	415	500	600	78.00
	60	LX1FF*	020	040	092	095	162	184	187	220	316	340	360	380	475	78.00
	40–400	LX9FF*	—	048	110	127	200	220	220	260	380	415	415	500	—	78.00
F185 F225	50	LX1FG*	024	048	110	127	200	220	240	264	380	415	415	450	600	108.00
	60	LX1FG*	020	040	092	095	162	184	187	220	316	340	360	380	475	108.00
	40–400	LX9FG*	—	048	110	127	200	220	220	260	380	415	415	500	—	108.00
F265–F330	40–400	LX1FH*	0242	0482	1102	1272	2002	2202	2402	2772	3802	3802	4402	5002	6002	138.00
	40–400	LX9FH*	—	0482	1102	1272	2002	2202	2402	2772	3802	3802	...	5002	—	138.00
	40–400	LX1FJ*	—	048	110	110	200	220	240	280	380	415	415	415	600	287.00
F400*	40–400	LX9FJ* Δ	910	917	925	925	930	931	932	932	936	936	937	937	—	287.00
	40–400	LX1FK*	—	048	110	110	200	220	240	280	380	415	415	415	600	360.00
F500*	40–400	LX9FK* Δ	910	917	925	925	930	931	932	932	936	936	937	937	—	360.00
	40–400	LX1FL*	—	048	110	110	200	220	240	260	380	415	415	415	600	398.00
F630*	40–400	LX9FL* Δ	910	917	924	925	930	930	931	932	935	936	936	937	—	483.00
	40–400	LX1FX*	—	—	110	110	200	220	220	280	380	415	415	415	—	795.00
F800	50/60	LX4F8* ▼	—	—	FW	FW	—	MW	MW	—	QW	QW	QW	—	—	725.00

- ♦ LC1F780 contactors operate on 2 coils as a set. The LX1FX part number includes both coils.
- ★ The 600 V coils for the F400, F500 and F630 do not include an auxiliary contact for holding circuits. If required, select appropriate contacts from page 18-8.
- ▼ Also requires rectifier DR5TE4U for 110–240 V coils, DR5TE4S for 380–440 V coils. See Table 18.64 for pricing.
- Δ Coil circuit requires a separately mounted rectifier. Order from Table 18.64.
- Complete the catalog number by adding the suffix (for example, LX1FF024).

Application Note on Contactor Drop-out Times:

Contactors using LX1, FH, FJ, FK, FL, and FX coils have longer drop-out times. For critical applications such as emergency stop functions:

- Select a fast drop-out coil (LX9), or
- Use a maintained contact Stop button, or
- Use an interposing relay.

TeSys D contactors	pages 18-4, 18-6
TeSys F contactors	pages 18-5, 18-7
TeSys D overload relay accessories	page 18-16
TeSys D replacement coils	pages 18-17 to 18-19
Dimensions	pages 18-40 to 18-47

Table 18.64: Rectifier Table

Coil	Rectifier Catalog Number	\$ Price
LX9F*910	DR5TF4V	75.00
LX9F*917	DR5TF4V	75.00
LX9F*925	DR5TE4U	75.00
LX9F*926	DR5TE4U	75.00
LX9F*931	DR5TE4U	75.00
LX9F*936	DR5TE4S	75.00
LX9F*937	DR5TE4S	75.00
LX9F*938	DR5TE4S	75.00

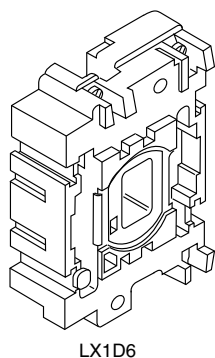


Table 18.65: For Old D2 LP1D09, D12, D18 ▲♦

Rated Nominal Voltage V	Catalog Number	Catalog Number Wide Range	\$ Price
12	LX4D2JD	LX4D2JW	79.00
21 ■	LX4D2ZD	—	79.00
24	LX4D2BD	LX4D2BW	79.00
36	LX4D2CD	LX4D2CW	79.00
48	LX4D2ED	LX4D2EW	79.00
60	LX4D2ND	—	79.00
72	LX4D2SD	LX4D2SW	79.00
110	LX4D2FD	LX4D2FW	79.00
125	LX4D2GD	—	79.00
220	LX4D2MD	LX4D2MW	79.00
250	LX4D2UD	—	79.00
440	LX4D2RD	—	79.00
600	LX4D2XD	—	79.00

Specifications		
Average consumption	9 W	11 W
Operating range at 0–55 °C / 131 °F	80–110% of nominal voltage	70–125% of nominal voltage

Table 18.66: For Old D2 LP1D25, D32 ▲♦

Rated Nominal Voltage V	Catalog Number	Catalog Number Wide Range	\$ Price
12	LX4D4JD	LX4D4JW	110.00
21 ■	LX4D4ZD	—	110.00
24	LX4D4BD	LX4D4BW	110.00
36	LX4D4CD	LX4D4CW	110.00
48	LX4D4ED	LX4D4EW	110.00
60	LX4D4ND	—	110.00
72	LX4D4SD	LX4D4SW	110.00
110	LX4D4FD	LX4D4FW	110.00
125	LX4D4GD	—	110.00
220	LX4D4MD	LX4D4MW	110.00
250	LX4D4UD	—	110.00
440	LX4D4RD	—	110.00
600	LX4D4XD	—	110.00

Specifications		
Average consumption	11 W	13 W
Operating range at 0–55 °C / 131 °F	80–110% of nominal voltage	70–125% of nominal voltage

- ▲ For old style contactors where the catalog number includes the auxiliary contact arrangement (for example, LP1D2510). The new style TeSys DC controlled contactors (for example, LC1D25BD) do not have replaceable coils.
- For use in 24 V applications with serial timer modules. Refer to page 18-10.
- ♦ No replacement DC coils for TeSys D contactors.

TeSys DC Coil Specifications		
	Average consumption	Operating range
LC1D09-D32, LC1DT20–LC1DT40	Inrush 5.4 W	70–125% @ 60°C
	Sealed 5.4 W	
LCID**A	Inrush 19 W	75–125% @ 60°C
	Sealed 7.4 W	
LC1D09-D32, LC1DT20–LC1DT40	Inrush 2.4 W	70–125% @ 60°C
	Sealed 2.4 W	

Note: DC coils for LC1D09–D32, LC1DT20–LC1DT40, and LCID**A contactors are not replaceable.

Table 18.67: For Old D2 LP1D40, D50, D65 ▲♦

Rated Nominal Voltage V	Catalog Number	Catalog Number Wide Range	\$ Price
12	LX4D6JD	LX4D6JW	124.00
24	LX4D6BD	LX4D6BW	
36	LX4D6CD	LX4D6CW	
48	LX4D6ED	LX4D6EW	
60	LX4D6ND	—	124.00
72	LX4D6SD	LX4D6SW	
110	LX4D6FD	LX4D6FW	
125	LX4D6GD	—	
220	LX4D6MD	LX4D6MW	124.00
250	LX4D6UD	—	
440	LX4D6RD	—	
600	LX4D6XD	—	

Specifications		
Average consumption	22 W	23 W
Operating range at 0–55 °C / 131 °F	80–110% of nominal voltage	75–120% of nominal voltage

Table 18.68: For Old D2 LP1D80 and LC1D80▲

Rated Nominal Voltage V	Catalog Number	Catalog Number Wide Range *	\$ Price
12	LX4D7JD	LX4D7JW	134.00
24	LX4D7BD	LX4D7BW	
36	LX4D7CD	LX4D7CW	
48	LX4D7ED	LX4D7EW	
60	LX4D7ND	—	134.00
72	LX4D7SD	LX4D7SW	
110	LX4D7FD	LX4D7FW	
125	LX4D7GD	—	
220	LX4D7MD	LX4D7MW	134.00
250	LX4D7UD	—	
440	LX4D7RD	—	
600	LX4D7XD	—	

Specifications		
Average consumption	22 W	23 W
Operating range at 0–55 °C / 131 °F	80–110% nominal voltage	70–120% nominal voltage

- * Wide range coils cannot be used with contactors using both front- and side-mounting auxiliaries.

Table 18.69: For TeSys D LC1D115, 150

Rated Nominal Voltage V	Catalog Number	\$ Price
24	LX4D8BD	78.00
48	LX4D8ED	
60	LX4D8ND	
72	LX4D8SD	
110	LX4D8FD	78.00
125	LX4D8GD	
220	LX4D8MD	
250	LX4D8UD	
440	LX4D8RD	

Average Consumption	Inrush 365 W, Sealed 5 W
Operating range at 0–55 °C / 131 °F	70%–120% of nominal voltage

TeSys D contactors pages 18-4, 18-6
 TeSys D overload relay accessoriespage 18-16
 TeSys D replacement coils pages 18-17 to 18-19
 Dimensions pages 18-40 to 18-46

TeSys F DC Coils

LX4 coils are the standard coils when a voltage code is added to the part number. The LX9 coils may be ordered separately for special applications. LX9 coils do not include a built-in normally open holding circuit contact; a separate auxiliary contact block with a N.O. contact should be added to the contactor. Both the LX4 and LX9 coils can be used on previous F-line devices.

Table 18.70: LX4 Coils for LC1F115, F150, F185, F265, F400, F500, F630, F780, F800

Device Type	Catalog Number	Catalog Number Suffix										\$ Price
		24 V	36V	48 V	60 V	72 V	110 V	125 V	220 V	250 V	440 V	
F115, F150	LX4FF●	024	035	048	060	070	110	125	220	250	440	78.00
F185, F225	LX4FG●	024	035	048	060	070	110	125	220	250	440	108.00
F265, F330	LX4FH●	024	035	048	060	070	110	125	220	250	440	138.00
F400	LX4FJ●	—	—	048	060	070	110	125	220	250	440	287.00
	LX9FJ●◆	—	—	918	—	—	926	927	932	—	938	287.00
F500	LX4FK●	—	—	048	060	070	110	125	220	250	440	360.00
	LX9FK●◆	—	—	918	—	—	926	927	932	—	938	360.00
F630	LX4FL●	—	—	048	060	070	110	125	220	250	440	398.00
	LX9FL●◆	—	—	918	—	—	926	927	932	—	938	398.00
F780	LX4FX●▲	—	—	—	—	—	110	125	220	250	440	795.00
F800	LX4F8●■	—	—	—	—	—	FW	FW	MW	—	QW	725.00

- ▲ LC1F780 contactors operate on 2 coils as a set. The LX4FX part number includes both coils.
- Also requires rectifier DR5TE4U, \$72.00 list price.
- ◆ Coil circuit requires a separately mounted resistor. Order from Table 18.71 below.

Table 18.71: LX9 Coils and Resistors

Coil	Resistor Catalog Number	Qty. Required	\$ Price	Coil	Resistor Catalog Number	Qty. Required	\$ Price	Coil	Resistor Catalog Number	Qty. Required	\$ Price
LX9FJ918	DR2SC0047	1	13.70	LX9FK918	DR2SC0039	1	13.70	LX9FL918	DR2SC0047	2	13.70
LX9FJ926	DR2SC0030	1	13.80	LX9FK926	DR2SC0220	1	13.70	LX9FL925	DR2SC0270	2	13.70
LX9FJ927	DR2SC0390	1	13.70	LX9FK927	DR2SC0330	1	13.70	LX9FL926	DR2SC0330	2	13.70
LX9FJ932	DR2SC1200	1	13.70	LX9FK932	DR2SC1000	1	13.70	LX9FL931	DR2SC1000	2	13.70
LX9FJ938	DR2SC4700	1	13.70	LX9FK938	DR2SC3300	1	13.70	LX9FL937	DR2SC3900	2	13.70

TeSys F contactorspages 18-5, 18-7
 TeSys F overload relay accessories page 18-16
 TeSys F replacement coils and partspages 18-18, 18-18, 18-20
 Dimensionspages 18-42 to 18-47

TeSys D enclosed full-voltage starters are available in Type 1 and Type 12/3R enclosures through 50 hp at 460 V. The enclosed D-line accepts standard D-Line accessories and all Insta-Kits™ control units and control power transformer kits. Standard capacity control power transformers with built-in fuse block can be installed in the standard enclosure. For extra capacity, please refer to your local distributor or Schneider Electric sales office.


Table 18.72: Enclosed Full Voltage Non-Reversing Starters

Max. Horsepower Ratings (AC3)						Auxiliary Contacts		Current Rating of Contactor	Catalog Number	\$ Price	Catalog Number	\$ Price
1 Phase		3 Phase				N.O.	N.C.					
115	230	200 V	230 V	460 V	575V							
0.333	1	2	2	5	7.5	1	1	9	LE1D093A62****	109.	LE1D093A72****	175.
0.5	2	3	3	7.5	10	1	1	12	LE1D123A62****	137.	LE1D123A72****	202.
1	3	5	5	10	15	1	1	18	LE1D183A62****	153.	LE1D183A72****	219.
2	3	5	7.5	15	20	1	1	25	LE1D253A62****	170.	LE1D253A72****	235.
2	5	7.5	10	20	25	1	1	32	LE1D323A62****	191.	LE1D323A72****	245.
3	5	10	10	30	30	1	1	40	LE1D403A62****	273.	LE1D403A72****	393.
3	7.5	12	15	40	40	1	1	50	LE1D503A62****	300.	LE1D503A72****	420.
5	10	20	20	40	50	1	1	65	LE1D653A62****	393.	LE1D653A72****	514.
7.5	15	30	30	60	60	1	1	80	LE1D803A62****	473.	LE1D803A72****	610.

Table 18.73: Enclosed Full Voltage Reversing Starters

Max. Horsepower Ratings (AC3) 3 Phase				Auxiliary Contacts On Each Contactor		Current Rating of Contactor	Catalog Number	\$ Price	Catalog Number	\$ Price
200V	230 V	460 V	575 V	N.O.	N.C.					
2	2	5	7.5	1	1	9	LE2D093A62****	305.	LE2D093A72****	382.
3	3	7.5	10	1	1	12	LE2D123A62****	355.	LE2D123A72****	453.
5	5	10	15	1	1	18	LE2D183A62****	385.	LE2D183A72****	483.
5	7.5	15	20	1	1	25	LE2D253A62****	415.	LE2D253A72****	513.
7.5	10	20	25	1	1	32	LE2D323A62****	464.	LE2D323A72****	573.
10	10	30	30	1	1	40	LE2D403A62****	655.	LE2D403A72****	819.
12	15	40	40	1	1	50	LE2D503A62****	710.	LE2D503A72****	874.
20	20	40	50	1	1	65	LE2D653A62****	900.	LE2D653A72****	1030.
30	30	60	60	1	1	80	LE2D803A62****	1248.	LE2D803A72****	1412.

Table 18.74: Catalog Number Nomenclature

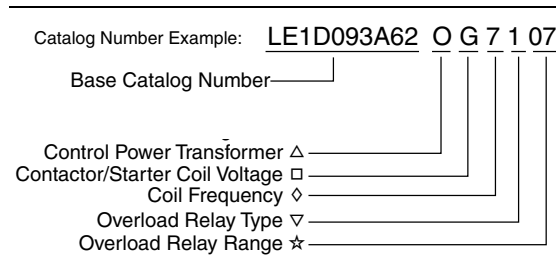

Δ Control Power Transformer

Add price from page 18-23. Select letter for primary voltage of CPT:

Voltage	No Transformer used	208	240	480	600
Code	O ▲	L	M	T	X

▲ Letter O, not zero.
Note: If control transformer is used, the only options available are 24 or 120 V as the secondary of the transformer. Also, DC voltages are not available when control power transformer is used.

□ Contactor/Starter Coil Voltage

Select coil voltage from table:

Voltage	24	120	208	240	480	600
AC	B	G	L	U	T	X
DC	B	—	—	—	—	—

◇ Coil Frequency

Select:
7 = dual frequency coils (50/60 Hz.)
6 = 60 Hz.
D=DC

Note: For 9 to 65 A contactors, only dual frequency coils are available; 80 A contactors, the 24–240 V coils are dual frequency only (50/60 Hz.). The 480–600 V coils are 60 Hz. only. See catalog 8502CT9901 for other restrictions.

▽ Overload relay type

Select:
0 = No overload relay
1 = Class 10 Trip
2 = Class 20 Trip

Table 18.75: ☆ Overload Relay Range

(Select code from the table below)

Code	Range	For use on Contactors	\$ Price Adder
01	0.1–0.16	D09–D32 ■	60.
02	0.16–0.25	D09–D32 ■	60.
03	0.25–0.40	D09–D32 ■	60.
04	0.40–0.63	D09–D32 ■	60.
05	0.63–1.0	D09–D32 ■	60.
06	1.0–1.6	D09–D32 ■	60.
07	1.6–2.5	D09–D32 ■	60.
08	2.5–4	D09–D32	60.
10	4–6	D09–D32	60.
12	5.5–8	D09–D32	60.
13	9–13	D40, D50, D65	107.
14	7–10	D09–D32	62.
16	9–13	D12–D32	62.
18	12–18	D40, D50, D65	107.
21	12–18	D18–D32	62.
22	16–24	D25–D32 ■	62.
	17–25	D25–D32 ◆	62.
	17–25	D80	107.
25	17–25	D40, D50, D65	107.
30	23–28	D25–D32 ◆	73.
32	23–32	D25–D32	73.
32	23–32	D40, D50, D65	107.
40	30–40	D40, D50, D65	107.
50	37–50	D40, D50, D65	107.
53	30–38	D80	107.
55	30–40	D80	107.
57	37–50	D80	107.
59	48–65	D80	107.
61	55–70	D65–D80	107.
63	63–80	D65–D80	107.
65	48–65	D40, D50, D65	107.

■ Available for Class 10 only.
◆ Available for Class 20 only.
Note: If no overload relay is required, leave this portion of the catalog blank. Add appropriate price adder to the base price of the starter.

Dimensionspage 18-48

IEC combination starters combine the requirements of motor overload and short circuit protection in one convenient compact package. All devices provide Type 2 Coordination through 30 hp at 460 V. Devices are available in Type 1 and Type 12/3R enclosures. The IEC combination starter line accepts standard TeSys D accessories and all Insta-Kits™ pilot devices and control power transformer kits. Standard capacity control power transformers with built-in fuse block can be installed in the standard enclosure. For extra capacity, please refer to your local distributor or nearest Square D/Schneider Electric sales office.

NOTE: Use tables and notes from page 18-21 to complete the catalog numbers.

Table 18.76: Enclosed Full Voltage Non-Reversing Fusible Combination Starters

Max. Horsepower Ratings (AC3)				Fuse Clip Rating		Auxiliary Contacts		Current Rating of Contactor	Catalog Number	\$ Price	Catalog Number		\$ Price
3 Phase				Amperes	UL Class	N.O.	N.C.				Type 1	Type 12/3R	
200 V	230 V	460 V	575 V										
2	2	5	7.5	30 A	CC	1	1	9	LE1D096B62****	426.	LE1D096B72****	551.	
3	3	7.5	10	30 A	CC	1	1	12	LE1D126B62****	468.	LE1D126B72****	592.	
5	5	10	15	30 A	J	1	1	18	LE1D186B62****	484.	LE1D186B72****	607.	
5	7.5	15	20	30 A	J	1	1	25	LE1D256B62****	500.	LE1D256B72****	623.	
7.5	10	20	25	60 A	J	1	1	32	LE1D326C62****	653.	LE1D326C72****	829.	
10	10	30	30	60 A	J	1	1	40	LE1D406C62****	708.	LE1D406C72****	877.	

Table 18.77: Enclosed Full Voltage Reversing Fusible Combination Starters

Max. Horsepower Ratings (AC3)				Fuse Clip Rating		Aux. Contacts Each Contactor		Current Rating of Contactor	Catalog Number	\$ Price	Catalog Number		\$ Price
3 Phase				Amperes	UL Class	N.O.	N.C.				Type 1	Type 12/3R	
200 V	230 V	460 V	575 V										
2	2	5	7.5	30 A	CC	1	1	9	LE2D096B62****	712.	LE2D096B72****	837.	
3	3	7.5	10	30 A	CC	1	1	12	LE2D126B62****	778.	LE2D126B72****	915.	
5	5	10	15	30 A	J	1	1	18	LE2D186B62****	808.	LE2D186B72****	950.	
5	7.5	15	20	30 A	J	1	1	25	LE2D256B62****	833.	LE2D256B72****	980.	
7.5	10	20	25	60 A	J	1	1	32	LE2D326C62****	1089.	LE2D326C72****	1281.	
10	10	30	30	60 A	J	1	1	40	LE2D406C62****	1179.	LE2D406C72****	1371.	

Table 18.78: Enclosed Full Voltage Non-Reversing Circuit Breaker Combination Starters

Max. Horsepower Ratings (AC3)				Auxiliary Contacts		Circuit Breaker Maximum Current Rating	Current Rating of Contactor	Catalog Number	\$ Price	Catalog Number		\$ Price
3 Phase				N.O.	N.C.					Type 1	Type 12/3R	
200 V	230 V	460 V	575 V									
2	2	5	7.5	1	1	15 A	9	LE1D097D62****	569.	LE1D097D72****	730.	
3	3	7.5	10	1	1	15 A	12	LE1D127D62****	622.	LE1D127D72****	789.	
5	5	10	15	1	1	30 A	18	LE1D187E62****	647.	LE1D187E72****	808.	
5	7.5	15	20	1	1	30 A	25	LE1D257E62****	668.	LE1D257E72****	834.	
7.5	10	20	25	1	1	50 A	32	LE1D327F62****	870.	LE1D327F72****	1088.	
10	10	30	30	1	1	50 A	40	LE1D407F62****	944.	LE1D407F72****	1179.	

Table 18.79: Enclosed Full Voltage Reversing Circuit Breaker Combination Starters

Max. Horsepower Ratings (AC3)				Auxiliary Contacts Each Contactor		Circuit Breaker Maximum Current Rating	Current Rating of Contactor	Catalog Number	\$ Price	Catalog Number		\$ Price
3 Phase				N.O.	N.C.					Type 1	Type 12/3R	
200 V	230 V	460 V	575 V									
2	2	5	7.5	1	1	15 A	9	LE2D097D62****	836.	LE2D097D72****	972.	
3	3	7.5	10	1	1	15 A	12	LE2D127D62****	944.	LE2D127D72****	1096.	
5	5	10	15	1	1	30 A	18	LE2D187E62****	1010.	LE2D187E72****	1174.	
5	7.5	15	20	1	1	30 A	25	LE2D257E62****	1075.	LE2D257E72****	1251.	
7.5	10	20	25	1	1	50 A	32	LE2D327F62****	1403.	LE2D327F72****	1631.	
10	10	30	30	1	1	50 A	40	LE2D407F62****	1522.	LE2D407F72****	1770.	

Table 18.80: Enclosed Full Voltage Non-Reversing Non-Fused Combination Starters

Max. Horsepower Ratings (AC3)				Auxiliary Contacts		Current Rating of Contactor	Catalog Number	\$ Price	Catalog Number		\$ Price
3 Phase				N.O.	N.C.				Type 1	Type 12/3R	
200 V	230 V	460 V	575 V								
2	2	5	7.5	1	1	9	LE1D096A62****	416.	LE1D096A72****	541.	
3	3	7.5	10	1	1	12	LE1D126A62****	458.	LE1D126A72****	532.	
5	5	10	15	1	1	18	LE1D186A62****	474.	LE1D186A72****	597.	
5	7.5	15	20	1	1	25	LE1D256A62****	490.	LE1D256A72****	613.	
7.5	10	20	25	1	1	32	LE1D326A62****	643.	LE1D326A72****	819.	
10	10	30	30	1	1	40	LE1D406A62****	698.	LE1D406A72****	867.	

Table 18.81: Enclosed Full Voltage Reversing Non-Fused Combination Starters

Max. Horsepower Ratings (AC3)				Aux. Contacts Each Contactor		Current Rating of Contactor	Catalog Number	\$ Price	Catalog Number		\$ Price
3 Phase				N.O.	N.C.				Type 1	Type 12/3R	
200 V	230 V	460 V	575 V								
2	2	5	7.5	1	1	9	LE2D096A62****	702.	LE2D096A72****	827.	
3	3	7.5	10	1	1	12	LE2D126A62****	768.	LE2D126A72****	905.	
5	5	10	15	1	1	18	LE2D186A62****	798.	LE2D186A72****	940.	
5	7.5	15	20	1	1	25	LE2D256A62****	823.	LE2D256A72****	970.	
7.5	10	20	25	1	1	32	LE2D326A62****	1079.	LE2D326A72****	1271.	
10	10	30	30	1	1	40	LE2D406A62****	1169.	LE2D406A72****	1361.	

Factory Modifications and Insta-Kits™ Selection

Add the factory modification code to the end of the catalog number created from page 18-21. With the use of Insta-Kits™, only one operator scheme is allowed. Only the combinations of operators and pilot lights shown below can be ordered.

Pilot lights will be at the coil voltage indicated in the catalog number for the starter.

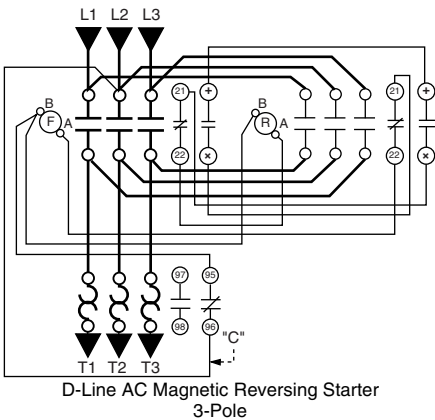
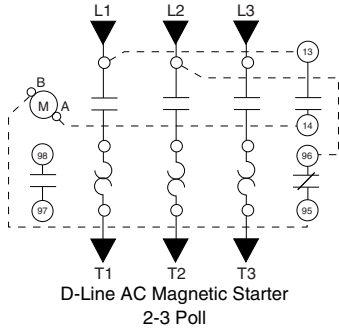





Table 18.82: Factory Modifications

Description	Factory Modification Code▲	\$ Price	Insta-Kits (for field installation)	\$ Price
Control Units Only				
For-Rev-Stop Push Button	A06L	131.	LA9CA06LT	71.00
Start/Stop Push Button	A06G	65.	LA9CA06GT	32.80
I/O (Start/Stop) Push Button	N/A	—	N/A	—
I/O Push Button (double touch)	A06I	83.	LA9CA06IO	41.50
Emergency Stop	N/A	—	N/A	—
Hand-Off-Auto Selector Switch	A06E	65.	LA9CA06ET	32.80
On/Off Selector Switch	A06D	65.	LA9CA06DT	41.50
Start/Mushroom Head Stop Push Button	A06X	65.	LA9CA06XT	63.00
Pilot Lights only				
LED Pilot light, 24, 120 or 240 V	A16S	134.	LA9CA16ST★	66.00
Green-Red Pilot Light, Direct Supply, 24 or 120 V ■	A06S	112.	LA9CA06ST★	62.00
Green-Red Transformer Pilot Light, 120, 208/240, 480 or 600 V ■	A06F	207.	LA9CA06FT★	113.00
Available Combination of Control Units and Pilot Lights				
Hand-Off-Auto Selector Switch w/24, 120, or 240 V LED Pilot Light	A16U	213.	LA9CA16UT★	177.00
Start/Stop Push Button w/ 24, 120 or 240 V LED Pilot Light	A16V	213.	LA9CA16VT★	177.00
On/Off Selector w/ 24, 120 or 240 V LED Pilot Light	A16W	213.	LA9CA16WT★	177.00
Start/Stop Push Button w/ Green-Red Transformer Pilot Light	A06N	177.	LA9CA06NT★	95.00
Start/Stop Push Button w/Green-Red Pilot Light	A06V	177.	LA9CA06VT	95.00
Hand-Off-Auto Selector Switch w/Green-Red Pilot Light	A06U	273.	LA9CA06UT	97.00
Hand-Off-Auto Selector Switch w/Green-Red Transformer Pilot Light	A06J	273.	LA9CA06JT★	147.00
On/Off Selector w/Green-Red Pilot Light	A06W	177.	LA9CA06WT	95.00
On/Off Selector w/Green-Red Transformer Pilot Light	A06H	273.	LA9CA06HT★	147.00
Control Power Transformer				
Standard VA, 2 Fuses in Primary, 1 Fuse in Secondary	A206P	260.	◆	—
50 VA extra, 2 Fuses in Primary, 1 Fuse in Secondary	A207P	456.	◆	—
100 VA extra, 2 Fuses in Primary, 1 Fuse in Secondary	A208P	634.	◆	—

- ▲ Add these forms to the catalog number selected on page 18-21. The numbers as shown are for use in NEMA 1 Enclosures. For uses in NEMA 12/3R change the 6 to a 7 (ex A06U becomes A07U). Price remains the same. The change DOES NOT apply to control power transformer forms.
- Pilot lights are wired such that the light is on when the contactor is energized. For non-LED type pilot lights, a green lens is installed on the unit when shipped. A red lens is included for use as applicable.
- ◆ Select Insta-Kits™ from table below.

Table 18.83: Insta-Kits™ Selection

Total VA	Insta-Kits™ Catalog Number	\$ Price
50	LA9TFD32★	140.00
100	LA9TFD80★	246.00
150	LA9TFD15★	343.00

★ Complete the part number for the Insta-Kits™ by selecting the voltage code from the appropriate tables below.

Table 18.84: Voltage Codes for Pilot Lights

Voltage (Vac)	24	120	208/240	480	600
Code	B	G	M	T	X

Table 18.85: Voltage Codes for Control Power Transformers

Primary Voltage	120	208	240	480	600	208	240	480	600
Secondary Voltage	24					120			
Code	E	D	C	B	A	L	M	T	X

3-Pole Non-Reversing Mini-Contactors

Table 18.86: AC Operating Coils

Maximum Horsepower Ratings						Maximum Current		Type of Connection	Auxiliary Contacts		Catalog Number	\$ Price
1 Ø		3 Ø				Inductive AC3 (A)	Resistive AC1 (A)		N.O.	N.C.		
115 V hp	230 V hp	200 V hp	230 V hp	460 V hp	575 V hp							
0.5	1.5	1.5	1.5	3	3	6	15	Screw-clamp	1	—	LC1K0610 ▲ ■	57.
									—	1	—	LC1K0601 ▲ ■
0.5	1.5	2	3	5	5	9	20	Screw-clamp	1	—	LC1K0910 ▲ ■	75.
									—	1	—	LC1K0901 ▲ ■
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	1	—	LC1K1210 ▲ ■	86.
									—	1	—	LC1K1201 ▲ ■



LC1K09●

Table 18.87: Coil Voltage Codes for AC Contactors

Up to and including 240 V coil with integral suppression device available. Add 2 to the code required (for example, J72). Price adder \$10.00.

Vac 50/60 Hz	12	24	42	48	110	120	127	200/208	220/230	230	230/240	277	380/400	400/415	440	480	660/690
Code	J7	B7	D7	E7	F7	G7	FC7	L7	M7	P7	U7	UE7	Q7	N7	R7	T7	Y7

Table 18.88: DC Operating Coils

0.5	1.5	1.5	1.5	3	3	6	15	Screw-clamp	1	—	LP1K0610 ▲ ■	75.
									—	1	—	LP1K0601 ▲ ■
0.5	1.5	2	3	5	5	9	20	Screw-clamp	1	—	LP1K0910 ▲ ■	92.
									—	1	—	LP1K0901 ▲ ■
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	1	—	LP1K1210 ▲ ■	106.
									—	1	—	LP1K1201 ▲ ■

- ▲ See Table 18.89: For TeSys K contactors with spring terminal clamps, add a 3 before the coil voltage code (for example, LC1K06103G7). For TeSys K contactors with solder pin terminals, add a 5 before the coil voltage code (for example, LC1K09105B7). For TeSys K contactors with slip-on terminals, add a 7 before the coil voltage code (for example, LC1K12107M7).
- Complete the catalog number with the appropriate coil voltage code (for example, LC1K0610G7).

Table 18.89: Coil Voltage Codes for DC Contactors

Coil with integral suppression device available. Add 3 to the code required (for example, JD3). Price adder \$10.00 ▲

Vdc	12	20	24	36	48	60	72	100	110	125	200	220	230	240	250
Code	JD	ZD	BD	CD	ED	ND	SD	KD	FD	GD	LD	MD	MPD	MUD	UD

- ▲ 3 W inrush.

Table 18.90: DC—Low Consumption Operating Coils (devices have built-in transient suppression)

0.5	1.5	1.5	1.5	3	3	6	15	Screw-clamp	1	—	LP4K0610 ▲ ■	92.
									—	1	—	LP4K0601 ▲ ■
0.5	1.5	2	3	5	5	9	20	Screw-clamp	1	—	LP4K0910 ▲ ■	110.
									—	1	—	LP4K0901 ▲ ■
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	1	—	LP4K1210 ▲ ■	126.
									—	1	—	LP4K1201 ▲ ■

- ▲ See Table 18.91: For TeSys K contactors with spring terminal clamps, add a 3 before the coil voltage code (for example, LC1K06103G7). For TeSys K contactors with solder pin terminals, add a 5 before the coil voltage code (for example, LC1K09105B7). For TeSys K contactors with slip-on terminals, add a 7 before the coil voltage code (for example, LC1K12107M7).
- Complete the catalog number with the appropriate coil voltage code (for example, LC1K0610G7).

Table 18.91: Coil Voltage Codes for DC Contactors—Low Consumption ▲

Vdc	12	24	48	72
Code	JW3	BW3	EW3	SW3

- ▲ 1.8 inrush sealed.

Table 18.92: Overload Relays for 3-Pole Contactors with Screw-Clamp Terminals

Class 10, Relay setting range—A	Catalog Number	\$ Price
0.1 to 0.16	LR2K0301	59.
0.16 to 0.23	LR2K0302	59.
0.23 to 0.36	LR2K0303	59.
0.36 to 0.54	LR2K0304	59.
0.54 to 0.8	LR2K0305	59.
0.8 to 1.2	LR2K0306	59.
1.2 to 1.8	LR2K0307	59.
1.8 to 2.6	LR2K0308	59.
2.6 to 3.7	LR2K0310	59.
3.8 to 5.5	LR2K0312	59.
5.5 to 8	LR2K0314	59.
8 to 11.5	LR2K0316	59.
10 to 14	LR2K0321	59.

LR2K overload relays:

- AC or DC protection
- Ambient compensated bimetallic
- Class 10
- Single phase sensitivity
- Manual or auto reset
- Full load current dial

Accessories page 18-27
Dimensions page 18-49



LP4K09●



LR2K0316



E164862
CCN NLDX
(screw terminals)



LR43364
Class 3211 04




E164862
CCN NLDX2
(slip-on & solder-pin terminals)



3-Pole Reversing Mini-Contactors

Table 18.93: AC Operating Coils



LC2K09107


Maximum Horsepower Ratings						Maximum Current		Type of Connection	Auxiliary Contacts		Catalog Number	\$ Price
1 Ø		3 Ø				Inductive AC3 A	Resistive AC1 A		N.O.	N.C.		
115V hp	230V hp	200V hp	230V hp	460V hp	575V hp							
0.5	1.5	1.5	1.5	3	3	6	15	Screw-clamp	1	—	LC2K0610 ▲■ LC2K0601 ▲■	130. 130.
0.5	1.5	2	3	5	5	9	20	Screw-clamp	1	—	LC2K0910 ▲■ LC2K0901 ▲■	167. 167.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	1	—	LC2K1210 ▲■ LC2K1201 ▲■	191. 191.

Table 18.94: Coil Voltage Codes for AC Contactors

Up to and including 240 V coil with integral suppression device available. Add **2** to the code required. Example: J72. Price adder \$20.00.

Vac 50/60 Hz	12	24	42	48	110	120	127	200/208	220/230	230	230/240	277	380/400	400/415	440	480	660/690
Code	J7	B7	D7	E7	F7	G7	FC7	L7	M7	P7	U7	UE7	Q7	N7	R7	T7	Y7

Table 18.95: DC Operating Coils



LP2K0910

0.5	1.5	1.5	1.5	3	3	6	15	Screw-clamp	1	—	LP2K0610 ▲■	167.	
										—	1	LP2K0601 ▲■	167.
0.5	1.5	2	3	5	5	9	20	Screw-clamp	1	—	LP2K0910 ▲■	202.	
										—	1	LP2K0901 ▲■	202.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	1	—	LP2K1210 ▲■	232.	
										—	1	LP2K1201 ▲■	232.

Table 18.96: Coil Voltage Codes for DC Contactors

Coil with integral suppression device available. Add **3** to the code required. Example: JD3. Price adder \$20.00.

Vdc	12	20	24	36	48	60	72	100	110	125	200	220	230	240	250
Code	JD	ZD	BD	CD	ED	ND	SD	KD	FD	GD	LD	MD	MPD	MUD	UD

Table 18.97: DC—Low Consumption Operating Coils (devices have built-in transient suppression)

0.5	1.5	1.5	1.5	3	3	6	15	Screw-clamp	1	—	LP5K0610 ▲■	202.	
										—	1	LP5K0601 ▲■	202.
0.5	1.5	2	3	5	5	9	20	Screw-clamp	1	—	LP5K0910 ▲■	238.	
										—	1	LP5K0901 ▲■	238.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	1	—	LP5K1210 ▲■	274.	
										—	1	LP5K1201 ▲■	274.

Table 18.98: Coil Voltage Codes for DC Contactors—Low Consumption

Vdc	12	24	48	72
Code	JW3	BW3	EW3	SW3

- ▲ For TeSys K contactors with spring terminal clamps, add a **3** before the coil voltage code (for example, LP2K09103BD). For TeSys K contactors with solder pin terminals, add a **5** before the coil voltage code (for example, LP5K09105BW3). For TeSys K contactors with slip-on terminals, add a **7** before the coil voltage code (for example, LC2K06107B7).
- Complete the catalog number with the appropriate coil voltage code (for example, LC1K0610G7).

Overload Relays page 18-24
Accessories page 18-27
Dimensions page 18-49



LC2K090045

Table 18.99: AC Operating Coils

Maximum Horsepower Ratings						Maximum Current		Type of Connection	Power Poles		Catalog Number	\$ Price
1 Ø		3 Ø				Inductive AC3 (A)	Resistive AC1 (A)		N.O.	N.C.		
115 V hp	230 V hp	200 V hp	230 V hp	460 V hp	575 V hp							
4-Pole Mini Contactor												
0.5	1.5	2	3	5	5	9	15	Screw-clamp	4	—	LC1K09004 ▲■	75.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	2	2	LC1K09008 ▲■	81.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	4	—	LC1K12004 ▲■	86.
4-Pole Mechanically Interlocked Contactors												
0.5	1.5	2	3	5	5	9	20	Screw-clamp	4	—	LC2K09004 ▲■	167.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	4	—	LC2K12004 ▲■	191.

Table 18.100: Coil Voltage Codes for AC Contactors

Up to and including 240 V coil with integral suppression device available. Add 2 to the code required. Example: J72. Price adder \$10.00 (\$20.00 for mechanically interlocked contactors)

Vac 50/60 Hz	12	24	42	48	110	120	127	200/208	220/230	230	230/ 240	277	380/400	400/415	440	480	660/690
Code	J7	B7	D7	E7	F7	G7	FC7	L7	M7	P7	U7	UE7	Q7	N7	R7	T7	Y7

Table 18.101: DC Operating Coils

4-Pole Mini Contactor												
0.5	1.5	2	3	5	5	9	15	Screw-clamp	4	—	LP1K09004 ▲■	92.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	2	2	LP1K09008 ▲■	98.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	4	—	LP1K12004 ▲■	106.
4-Pole Mechanically Interlocked Contactors												
0.5	1.5	2	3	5	5	9	20	Screw-clamp	4	—	LP2K09004 ▲■	202.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	4	—	LP2K12004 ▲■	232.

Table 18.102: Coil Voltage Codes for DC Contactors

Coil with integral suppression device available. Add 3 to the code required. Example: JD3. Price adder \$10.00 (\$20.00 for mechanically interlocked contactors)

Vdc	12	20	24	36	48	60	72	100	110	125	200	220	230	240	250
Code	JD	ZD	BD	CD	ED	ND	SD	KD	FD	GD	LD	MD	MPD	MUD	UD

Table 18.103: DC—Low Consumption Operating Coils (devices have built-in transient suppression)

4-Pole Mini Contactor												
0.5	1.5	2	3	5	5	9	15	Screw-clamp	4	—	LP4K09004 ▲■	110.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	2	2	LP4K09008 ▲■	116.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	4	—	LP4K12004 ▲■	126.
4-Pole Mechanically Interlocked Contactors												
0.5	1.5	2	3	5	5	9	20	Screw-clamp	4	—	LP5K09004 ▲■	238.
0.5	1.5	3	3	7.5	10	12	20	Screw-clamp	4	—	LP5K12004 ▲■	274.

Table 18.104: Coil Voltages for DC Contactors—Low Consumption

Vdc	12	24	48	72
Code	JW3	BW3	EW3	SW3

- ▲ For TeSys K contactors with spring terminal clamps, add a 3 before the coil voltage code (for example, LC1K09103L7). For TeSys K contactors with solder pin terminals, add a 5 before the coil voltage code (for example, LP4K06015JW3).
- For TeSys K contactors with slip-on terminals, add a 7 before the coil voltage code (for example, LP2K090047BD).
- Complete the catalog number with the appropriate coil voltage code (for example, LC1K0610G7).

Overload Relays page 18-24
 Accessories page 18-27
 Dimensions page 18-49



LA1KN11



LA1KN22

Table 18.105: Instantaneous Auxiliary Contact Blocks

Clip-on front mounting, 1 block per contactor and 2 blocks per pair of mechanically interlocked contactors.					
Type of connection	Auxiliary Contacts		Catalog Number	\$ Price	
	N.O.	N.C.			
Screw clamp	2	—	LA1KN20	14.20	
	—	2	LA1KN02	14.20	
	1	1	LA1KN11	14.20	
	4	—	LA1KN40 ▲	27.30	
	3	1	LA1KN31 ▲	27.30	
	2	2	LA1KN22 ▲	27.30	
	1	3	LA1KN13 ▲	27.30	
	—	4	LA1KN04 ▲	27.30	
	Slip-on 1 x 0.250 in. or 2 x 0.110 in.	2	—	LA1KN207	14.20
		—	2	LA1KN027	14.20
1		1	LA1KN117	14.20	
4		—	LA1KN407 ▲	27.30	
3		1	LA1KN317 ▲	27.30	
2		2	LA1KN227 ▲	27.30	
1		3	LA1KN137 ▲	27.30	
—		4	LA1KN047 ▲	27.30	

▲ Block of 4 contacts cannot be used with LP4K or LP5K contactors.

Table 18.106: Electronic Time Delay Auxiliary Contact Blocks

Clip-on front mounting, 1 block per contactor and 2 blocks per pair of mechanically interlocked contactors.					
Voltage (V)	Type	Timing Range (S)	Contacts	Catalog Number	\$ Price
24–48 Vac or Vdc	On-delay	1–30	SPDT	LA2KT2E	32.80
110–240 Vac	On-delay	1–30	SPDT	LA2KT2U	32.80

Note: Relay outputs, with single pole double throw. 240 Vac/Vdc, 2 A max.
Maximum switching capacity 250 VA / 150 W
Operating temperature: –10 to +60°C (14 to 140°F)
Reset time: 1.5 s during time delay, 0.5 after time delay

Table 18.107: Suppressor Module with Incorporated LED Indicator

Clip-on front mounting				
Voltage range	Type	Sold in lots of	Catalog Number	\$ Price each
12–24 Vac/Vdc	Varistor	5	LA4KE1B ■	9.80
32–48 Vac/Vdc	Varistor	5	LA4KE1E ■	9.80
50–129 Vac/Vdc	Varistor	5	LA4KE1FC ■	9.80
130–250 Vac/Vdc	Varistor	5	LA4KE1UG ■	9.80
12–24 Vdc	Diode + Zener	5	LA4KC1B ◆	9.80
32–48 Vdc	Diode + Zener	5	LA4KC1E ◆	9.80
220–250 Vac	RC	5	LA4KA1U ★	9.80

- Protection by limitation of the transient voltage to 2 Uc maximum. Maximum reduction of the transient voltage peaks. Slight time delay on drop-out (1.1–1.5 times normal).
- ◆ No overvoltage or oscillation frequency. Polarized component. Slight time delay on drop-out (1.1–1.5 times normal).
- ★ Protection by limitation of the transient voltage to 3 Uc maximum and limitation of the oscillation frequency. Slight time delay on drop-out (1.2 times normal).



LA2KT2U

Table 18.108: Paralleling Links

Description	Sold in lots of	Catalog Number	\$ Price each
For 2 poles with screw-clamp terminals	4	LA9E01	2.20
For 4 poles with screw-clamp terminals	2	LA9E02	3.50

Table 18.109: Power Connectors

Description	Sold in lots of	Catalog Number	\$ Price each
Set of 6 power connections for reversing contactors with screw-clamp terminals	100	LA9K0969	6.20
Set of 4 power connections for changeover contactors with screw-clamp terminals	100	LA9K0970	6.20

Table 18.110: Marking Strips

Description	Sold in lots of	Catalog Number	\$ Price each
Clips onto front of the contactor	100	LA9D90	.06

Table 18.111: Accessories for Overload Relays

Description	Type of Connection	Catalog Number	\$ Price
Terminal block for separate clip-on mounting of the overload relay onto 35 mm omega rail (AM1DP200)	Screw-clamp	LA7K0064	11.90



E164862
CCN NLDX



LR43364
Class 3211 04



The TeSys U motor starter is integrated, making it simple to choose and install. It consists of a control unit snapped in a power base. TeSys U can be configured to fit specific applications as well. Optional accessories include a reverser, a current limiter, predictive maintenance options, and communication options.

For detailed information about TeSys U, visit our website.



Selecting TeSys U Motor Starters in Three Steps

Table 18.112: Step 1. Select Power Base (Only two different bases up to 32 A)

Control Connection	Max. Current (A)	Three Phase (HP max.)				Single Phase (HP max.)		Self-Protected Power Base	
		200/208 V	220/240 V	460 V	575/600 V	120 V	240 V	Catalog Number	\$ Price
With screw terminations	12	3	3	7.5	10	1.5	2	LUB12	246.00
	32	10	10	20	25	2	5	LUB32	345.00
Without screw terminations	12	3	3	7.5	10	1.5	2	LUB120*	276.00
	32	10	10	20	25	2	5	LUB320*	375.00

* For use with reversing modules or communication modules with prewired connector

Table 18.113: Step 2. Select Control Unit □

Setting Range (A)	Standard 3-phase Class 10 trip ▼	\$ Price	Advanced 3-phase Class 10 trip ▼	\$ Price	Advanced single-phase Class 10 trip ▼	\$ Price	Advanced 3-phase Class 20 trip ▼	\$ Price
0.15–0.6	LUCAX6**	120.00	LUCBX6**	150.00	LUCCX6**	150.00	LUCDX6**	150.00
0.3–1.4	LUCA1X**	120.00	LUCB1X**	150.00	LUCC1X**	150.00	LUCD1X**	150.00
1.25–5.0	LUCA05**	120.00	LUCB05**	150.00	LUCC05**	150.00	LUCD05**	150.00
3–12	LUCA12**	120.00	LUCB12**	150.00	LUCC12**	150.00	LUCD12**	150.00
4.5–18	LUCA18**	120.00	LUCB18**	150.00	LUCC18**	150.00	LUCD18**	150.00
8–32	LUCA32**	120.00	LUCB32**	150.00	LUCC32**	150.00	LUCD32**	150.00

▼ Complete the catalog number by adding appropriate code from voltage code table below (for example, LUCAX6FU).

△ The control unit contains solid-state overload relay and control power source for TeSys U. For more details on the different control units, their functions, and placement on the power base, see 18-29

Table 18.114: Voltage Codes

Volts	24	48–72	110–240
DC	BL□	—	—
AC	B	—	—
DC or AC	—	ES◇	FU

□ DC voltage with range of 0.90 to 1.10 of nominal.
◇ 48–72 Vdc; 48 Vac

Table 18.115: Step 3. Select Auxiliary Contacts (optional)

Terminals	Contact Indicates	Contact Normal Status	Contact State for Each Mode▲						Catalog Number	\$ Price
			Off	Ready	Run	Short Circuit Trip	Overload Trip (Manual Reset)	Overload Trip (Remote/ Auto Reset)■		
Auxiliary Contact Blocks										
Screw	Ready condition	N.O.	O	I	I	O	O	I	LUA1C11	34.5
	Fault condition	N.C.	I	I	I	O	O	I		
Screw	Ready condition	N.O.	O	I	I	O	O	I	LUA1C20	
	Fault condition	N.O.	O	O	O	I	I	O		
Auxiliary Contact Function Modules										
Screw	Pole state	2 N.O.	O	O	I	O	O		LUFN20	34.5
Screw	Pole state	1 N.O. and 1 N.C.	O	I	O	I	O	I	LUFN11	
Screw	Pole state	2 N.C.	1	I	O	I	I		LUFN02	

▲ I indicates closed contact; O indicates open contact

■ Requires multifunction or advanced control unit plus fault differentiation module LUFDA10.

Table 18.116: Accessories

Accessory	Quick Description	For details & selection, see:
Current limiter	Increases the breaking capacity to 130kA @ 460 V	Table 18.123
Reverser	Stacked or side mounted (LU6MB0*** only)	Table 18.119
Line phase barrier	Required for use as a self-protected combination starter (UL508E)	Table 18.118
Multifunction control unit	Has functions for monitoring and predictive maintenance	Table 18.124
Function modules	Fault differentiation, thermal overload, motor load indication	Table 18.125
Communication modules	Integrates into existing networks, major protocols are available	Table 18.126
Soft starter + TeSys U	Use Altistart U01 soft starter with TeSys U	Table 18.132
Powerbus	Use TeSys U with a prewired system	Table 18.128
Configuration and connection accessories	PowerSuite software, busbar, external handle	Table 18.129

Accessories pages 18-29 to 18-31
Dimensions page 18-50



Power Base



Control Unit



Auxiliary Contact






E164862
CCN NLDX



LR43364
Class 3211 08

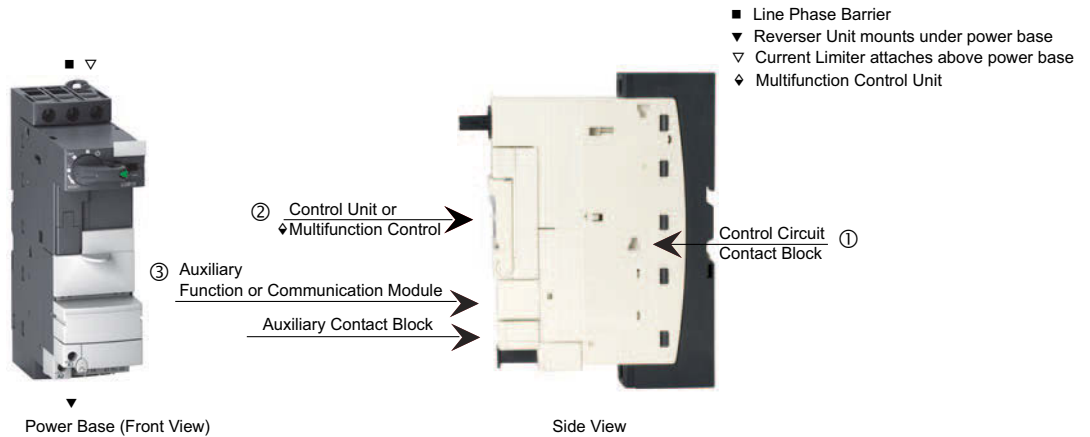


Table 18.117: Control Units and Functions

					
	Standard	Advanced			Multifunction
Reference	LUCA	LUCB	LUCC	LUCD	LUCM
Protection type					
Class 10					
Class 20					
Class 5–30					
Single Phase: LUCC Class 10 only					
Protection functions					
Short circuit					
Over current					
Thermal overload					
Phase loss					
Phase imbalance					
Ground fault					
Underload, long start, jam					
Control functions					
Manual reset					
Automatic or local/remote reset					
Fault differentiation					
Thermal alarm					
Motor load display					
Fault history					
Alarm threshold adjustment					
Tripping test					
		= built-in the control unit			
		= works with the related function modules (see Table 18.119 on page 30)			

Power Base and Plug-in Accessories

See below where to install accessories on the power base. Only one accessory can be installed in each location.





Line Phase Barrier

Table 18.118: Line Phase Barrier (optional) ▲

Description	Catalog Number	\$ Price
Incoming line phase barrier to allow the TeSys U to be used as a self protected combination starter according to UL508E	LU9SP0	15.00

▲ See page 18-29 for placement on the power base.

Table 18.119: Reverser

Control Connection	Max. Current (A)	Three Phase (HP max.)				Self-Protected Starter Base	
		200/208 V	220/240 V	460 V	575 V	Catalog Number	\$ Price
With screw terminations	12	3	3	7.5	10	LU2B12■	488.00
	32	10	10	20	25	LU2B32■	720.00

■ Voltage code required.

Table 18.120: Select Control Unit Options★▼

Setting Range (A)	Standard 3-phase Class 10 trip ♦	\$ Price	Advanced 3-phase Class 10 trip ♦	\$ Price	Advanced single-phase Class 10 trip ♦	\$ Price	Advanced 3-phase Class 20 trip ♦	\$ Price
0.15–0.6	LUCAX6**	120.00	LUCBX6**	150.00	LUCCX6**	150.00	LUCDX6**	150.00
0.3–1.4	LUCA1X**	120.00	LUCB1X**	150.00	LUCC1X**	150.00	LUCD1X**	150.00
1.25–5.0	LUCA05**	120.00	LUCB05**	150.00	LUCC05**	150.00	LUCD05**	150.00
3–12	LUCA12**	120.00	LUCB12**	150.00	LUCC12**	150.00	LUCD12**	150.00
4.5–18 ♦	LUCA18**	120.00	LUCB18**	150.00	LUCC18**	150.00	LUCD18**	150.00
8–32 ♦	LUCA32**	120.00	LUCB32**	150.00	LUCC32**	150.00	LUCD32**	150.00

- ♦ Complete the catalog number by adding the appropriate code from Table 18.121 (for example, LUCAX6FU).
- ★ Control units for 4.5–18 and 8–32 can be used **only** with 32 A rated power bases (LUB32 / LU2B32).
- ▼ The control unit contains solid-state overload relay and control power source for TeSys U. For more details on the different control units, their functions, and placement on the power base see page 18-29.

Table 18.121: Voltage Codes

Volts	24	48–72	110–240
DC	BLΔ□	—	—
AC	B	—	—
DC or AC	—	ES◇	FU

- Δ Voltage code to use for a power base with a communication module.
- DC voltage with range of 0.90 to 1.10 of nominal.
- ◇ 48–72 Vdc; 48 Vac

Table 18.122: Reversing Modules for Field Addition

Mounting	Catalog No.	\$ Price	Wiring Adapter	\$ Price
Beneath	LU2MB0	192.00	LU9MR1C	31.50
Beside	LU6MB0	222.00	LU9MR1	15.00

Note: For LU2MB0 and LU6MB0, voltage code required; must match control unit.

Table 18.123: Current Limiter ☆▽

Accessory	Application	Technical Data	Mounting	Catalog Number	\$ Price
Current limiter/isolator	Additional current limiting aspects for the starter	130 kA at 460 V 60 kA at 575 V	Direct mounting to LUB* and LU2B*	LUALB1	171.00
Limiter cartridge	Replacement cartridge for LUALB1	130 kA at 460 V 65 kA at 575 V	—	LUALF1	78.00

- ☆ Increases the breaking capacity of the motor starter.
- ▽ See page 18-29 for placement on the power base.

Table 18.124: Control Unit Multifunction ♦*

Setting Range (A)	Multifunction programmable	\$ Price
0.15–0.6	LUCCM6BL	615.00
0.3–1.4	LUCCM1XBL	
1.25–5.0	LUCCM05BL	
3–12	LUCCM12BL	
4.5–18	LUCCM18BL	
8–32	LUCCM32BL	

- ♦ Offers motor management system capabilities. For more details see the LUCM on page 18-31.
- * See page 18-29 for placement on the power base.

Table 18.125: Function Modules ♦♦

Module	Description	For use with:	Operation Requirements	Catalog Number	\$ Price
Fault differentiation with manual reset (thermal overload)	Provides indication between an overload trip and a short circuit trip.	Advanced control units only	24–250 Vac or Vdc (power from control unit)	LUFDH11	156.00
Fault differentiation with auto reset				LUFDA10	156.00
Thermal overload pre-alarm	Signals when the motor current reaches 1.05 of the full load setting on the control unit.	Advanced control units only	24–250 Vac or Vdc (power from control unit)	LUFW10	156.00
Motor load indication	Provides a signal proportional to the average currents in the three phases divided by the full load current setting of the control unit. The output corresponds to a load status of 0–2 times the full load setting of the control unit.	Advanced or multi-function control units	4–20 mA (requires separate 24 Vdc power supply)	LUFV2	188.00
Parallel wiring	Provides a convenient way to reduce control wiring and allow for connecting starters to a communications network by providing 24 Vdc for the starters.	Advanced or multi-function control units(24 Vdc only) and LU9BN11C or LU9MRC prewired connector	LU9G02 splitter box and PLC network	LUFC00	57.00

- ♦♦ Offers customization for specific application requirements.
- ♦ See page 18-29 for placement on the power base.



Reverser Unit Assembled under the Power Base



Control Unit Multifunction



Alarm Differentiation



Parallel Wiring



Motor Load Indicator



AS-Interface



Modbus



DeviceNet



Profibus



CANopen

Table 18.126: Communication Modules

Module	Description	For use with:	Operation Requirements	Catalog Number	\$ Price
AS-Interface Communication	Allows the TeSys U starter to be connected directly to the network using AS-Interface protocols.	Advanced or multi-function control units (24 Vdc only) and LU9BN11C or LU9MRC prewired connector	Requires separate 24 Vdc power supply and AS-Interface network	ASILUFC5	188.00
AS-Interface V2 Communication	Allows the TeSys U starter to be connected directly to the network using AS-Interface V2 protocols.	Advanced or multi-function control units (24 Vdc only) and LU9BN11C or LU9MRC prewired connector	Requires separate 24 Vdc power supply and AS-Interface V2 network	ASILUFC51	188.00
Modbus™ Communication Protocol	Allows the TeSys U starter to be connected directly to the network using Modbus protocols.	Advanced or multi-function control units (24 Vdc only) and LU9BN11C or LU9MRC prewired connector	Requires separate 24 Vdc power supply	LULC033	218.00
Advantys™ STB Communication	Allows the TeSys U starter to be connected to the network using the Advantys STB protocol	Advanced or multi-function control units (24 Vdc only) and LU9BN11L or LU9MRL prewired connector	Requires separate 24 Vdc power supply	LULC15	218.00
CANopen Communication	Allows the TeSys U starter to be connected to the network using the CANopen protocol	Advanced or multi-function control units (24 Vdc only) and LU9BN11L or LU9MRL prewired connector	Requires separate 24 Vdc power supply	LULC08	218.00
Beckoff Communication	Allows the TeSys U starter to be connected to the network using the Beckoff protocol	Advanced or multi-function control units (24 Vdc only) and LU9BN11L or LU9MRL prewired connector	Requires separate 24 Vdc power supply	LULC14	218.00
Profibus Communication	Allows the TeSys U starter to be connected to the network using the Profibus protocol	Advanced or multi-function control units (24 Vdc only) and LU9BN11L or LU9MRL prewired connector	Requires separate 24 Vdc power supply	LULC07	218.00
DeviceNet™ Communication	Allows the TeSys U starter to be connected to the network using the Device Net protocol	Advanced or multi-function control units (24 Vdc only) and LU9BN11L or LU9MRL prewired connector	Requires separate 24 Vdc power supply	LULC09	218.00

⊕ Communication capabilities can be integrated into existing automation architecture via a variety of protocols.
 ▣ See 18-29 for placement on the power base.

Configuration and Connection Accessories

Table 18.127: Control Circuit Accessories

Accessory	Application	Technical Data	Mounting	Catalog Number	\$ Price	
Control circuit contact block	Switches control circuit power via LUB* handle (NEC430-74 compliance)	5 A at 600 Vac 5 A at 250 Vdc	Side mounting to LUB* and LU2B* only	LUA8E20	71.00	
Through-the-door operating mechanism	Use to enclose TeSys LUB* only.	NEMA 1, 12 Black w/ trip indication	Kit	LU9APN21	140.00	
		NEMA 1, 12 Red/Yellow w/ trip indication	Kit	LU9APN22	140.00	
		NEMA 3R, 4, 4X Red/Yellow without trip indication	Kit	LU9APN24	161.00	
Control circuit filters	Use with electronic or triac output controllers	Up to 150 Vac max.	Directly to coil terminals	Non-reversing Reversing	LUA4F11 LUA4F12	39.30 39.30
Angle bracket	Support shaft, for use with LUB*	—	—	GVAPK12	19.00	

⊕ See page 29 for placement on the power base.

Table 18.128: PowerSuite Configuration Software and Accessories

Item ▲	Catalog Number	\$ Price ■
PowerSuite software	VW3A8104	225.00
PC connection kit	VW3A8106	113.00
Pocket PC connection kit	VW3A8111	143.00

▲ For complete details on all components included with each item, refer to catalog 8502CT0201.
 ■ Items under discount schedule CP4C.

Powerbus

Table 18.129: GV2 Cabling Accessories—Bus Bars

Description	Application	Pitch	Standard Pack	Catalog Number	\$ Price Each
3-Pole, 63 A Bus Bar	For feeding 2 GV2 starters or TeSys U controllers	45	1	GV2G245	23.30
		54	1	GV2G254	23.30
		72	1	GV2G272	23.30
	For feeding 3 GV2 starters or TeSys U controllers	45	1	GV2G345	28.70
		54	1	GV2G354	28.70
		45	1	GV2G445	34.20
	For feeding 4 GV2 starters or TeSys U controllers	54	1	GV2G454	34.20
		72	1	GV2G472	34.20
		For feeding 5 GV2 starters or TeSys U controllers	54	1	GV2G554

Additional accessories and components are available, including:

- Mounting accessories
- Gateways
- Cabling accessories
- Magelis™ remote display unit

For the complete line of TeSys U-Line motor starter accessories and all technical details (specifications, wiring diagrams, etc.) pertaining to the product line, refer to Catalog 8502CT0201.

Altistart Drive and TeSys U Motor Starter

Table 18.130: Soft Start / Soft Stop Unit for 0.75 to 15 kW Motors (can be combined with the TeSys U starter)

Motor		Starter		
Motor Power ▲		Nominal Current	Catalog Number	\$ Price
230 V	460 V			
HP	HP	A		
3-phase supply voltage: 200 ... 480 V 50/60 Hz				
1	2	6	ATSU01N206LT	133.00
1.5	3			
2	5	9	ATSU01N209LT	152.00
3	7.5	12	ATSU01N212LT	175.00
5	10			
7.5	15	22	ATSU01N222LT	219.00
10	20	32	ATSU01N232LT	300.00

▲ Standard motor power ratings, HP power ratings indicated according to standard UL 508.

Table 18.131: Accessories

Description	Used for Starter	Catalog Number	\$ Price
Power connector between ATSU 01N2●●LT and TeSys U	ATSU01N2●●T	VW3G4104	10.00

Table 18.132: TeSys U Starter and Soft Start Unit Combinations

Motor Power		Soft Starter	TeSys U	
Voltage			Power Base	Control Unit ■
200 V	460 V			
HP	HP			
1	2	ATSU01N206LT	LUB 12	LUC●05BL
1.5	3	ATSU01N206LT		LUC●12BL
2	5	ATSU01N209LT		LUC●12BL
3	—	ATSU01N212LT		LUC●12BL
—	7.5	ATSU01N212LT		LUC●18BL
5	10	ATSU01N222LT		LUC●18BL
7.5	15	ATSU01N222LT	LUB 32	LUC●32BL
10	20	ATSU01N232LT		LUC●32BL

■ Depending on the configuration of the chosen TeSys U starter, replace the ● with **A** for standard, **B** for advanced, and **M** for multifunction. See page 18-28 for a complete list of available control units. Control voltage must be 24 Vdc.

ATSU01●●

E231693
CCN NLDXLR96921
Class 3211 06

The GV family of products are 3-pole, horsepower rated, UL 508 listed manual starters. They include a manual disconnect, class 10 ambient-compensated thermal overload relay, and instantaneous, magnetic trip mechanism in one compact unit.

Any GV manual starter can be used alone for local manual control of a motor with individual full-load currents up to 220 A. The GV products may also be used in group motor installations in accordance with National Electric Code article 430-53. Group motor installations give you greater panel density for smaller size and require fewer parts and less wiring for installation when compared to conventional panel designs.

The GV2P and GV3P products also have an additional UL 508 type E rating as a stand-alone, self-protected manual combination starter. The UL 508 type E rating requires the addition of line side insulating barrier GV2GH7 for the GV2P, or GV3G66 for the GV3P. The GV2P and GV3P self-protected manual combination starters may also be combined with specific size contactors from the LC1D product family for a UL 508 Type F combination starter construction. These products have a UL-listed short circuit current rating from 10–100 kA depending on application size and voltage. See the Schneider Electric website for more information.

How to Order

To order a basic motor starter, select the model number (GV2ME**, GV2P**, or GV3P**) with the appropriate thermal setting from the table below. The thermal trip range and setting should be determined from the motor nameplate full-load current.

Table 18.133: GV2, GV3

Thermal Setting (A)	Maximum Horsepower Ratings								Group Motor Applications Max. Fuse or Circuit Breaker	GV2/3M push button		GV2/3P rotary handle	
	1 Ø			3 Ø						Catalog Number	\$ Price	Catalog Number	\$ Price
	120 V hp	208 V hp	240 V hp	120 V hp	208 V hp	240 V hp	480 V hp	600 V hp					
0.11–0.16	—	—	—	—	—	—	—	—	450 A	GV2ME01▲	159.	GV2P01	212.
0.16–0.25	—	—	—	—	—	—	—	—	450 A	GV2ME02▲	159.	GV2P02	212.
0.25–0.40	—	—	—	—	—	—	—	—	450 A	GV2ME03▲	159.	GV2P03	212.
0.40–0.63	—	—	—	—	—	—	—	—	450 A	GV2ME04▲	180.	GV2P04	233.
0.63–1	—	—	—	—	—	—	—	0.5	450 A	GV2ME05▲	180.	GV2P05	233.
1–1.6	—	—	1/10	—	—	—	0.75	0.75	450 A	GV2ME06▲	180.	GV2P06	233.
1.6–2.5	—	1/6	1/6	—	0.5	0.5	1	1.5	450 A	GV2ME07▲	180.	GV2P07	233.
2.5–4	1/8	0.25	1/3	—	0.75	0.75	2	3	450 A	GV2ME08▲	180.	GV2P08	233.
4–6.3	0.25	0.5	0.5	0.75	1	1.5	3	5	450 A	GV2ME10▲	180.	GV2P10	233.
6–10	0.5	1	1.5	1	2	3	5	7.5	450 A	GV2ME14▲	180.	GV2P14	233.
9–14	0.75	2	2	2	3	3	10	10	450 A	GV2ME16▲	224.	GV2P16	278.
13–18	1	2	3	2	5	5	10	15	450 A	GV2ME20▲	224.	GV2P20	278.
17–23	1.5	3	3	3	5	7.5	15	20	450 A	GV2ME21▲	224.	GV2P21	278.
20–25	2	—	—	—	7.5	7.5	15	20	450 A	GV2ME22▲	224.	GV2P22	278.
24–32	2	5	5	5	7.5	10	20	25	450 A	GV2ME32	224.	GV2P32	278.
9–13	0.5	—	1.5	—	3	3	7.5	10	—	—	—	GV3P13	404.
12–18	0.75	—	2	—	5	5	10	15	—	—	—	GV3P18	404.
17–25	1.5	—	3	—	5	7.5	15	20	—	—	—	GV3P25	404.
23–32	2	—	5	—	7.5	10	20	25	—	—	—	GV3P32	404.
30–40	3	—	—	—	10	—	25	30	—	—	—	GV3P40	504.
37–50	—	—	7.5	—	10	15	30	40	—	—	—	GV3P50	504.
48–65	5	—	10	—	15	20	40	50	—	—	—	GV3P65	504.

▲ For spring terminals add 3 to the catalog number (for example, GV2ME013). GV2ME32 is not available with spring terminals. For ring terminals, add 6.

Table 18.134: GV7

Thermal Setting (A)	Maximum Horsepower Ratings						Toggle Operator			
	1 Ø		3 Ø				Standard Interrupt		High Interrupt	
	115 V hp	230 V hp	200 V hp	230 V hp	460 V hp	575 V hp	Catalog Number	\$ Price	Catalog Number	\$ Price
12–20	—	—	—	5	10	15	GV7RE20	417.	GV7RS20	813.
15–25	—	—	—	7.5	15	20	GV7RE25	417.	GV7RS25	813.
25–40	—	—	—	10	30	30	GV7RE40	417.	GV7RS40	813.
30–50	—	—	—	15	30	40	GV7RE50	417.	GV7RS50	813.
48–80	—	—	—	30	60	75	GV7RE80	417.	GV7RS80	813.
60–100	—	—	—	30	75	100	GV7RE100	456.	GV7RS100	891.
90–150	—	—	—	50	100	150	GV7RE150	502.	GV7RS150	978.
132–220	—	—	—	75	150	200	GV7RE220	502.	GV7RS220	978.

Specifications: page 18-36
Accessories: pages 18-34 to 18-35
Dimensions: pages 18-52 to 18-55

Motor Protector Circuit Breakers

Motor protector circuit breakers provide built-in thermal and magnetic protection. They are used in two-device motor feeder solutions to provide protection against short circuits, overloads, and phase imbalance.

Table 18.135: Two-Device Solutions—Electronic Motor Protector Circuit Breakers with UL Ratings: H-Frame (150A), J-Frame (250 A), and L-Frame (600 A) ■ (refer to discount schedule DE2)

Electronic Trip Unit Type	Frame	Sensor Rating	Trip Unit	Full Load Ampere Rating (FLA)	Isd (x FLA)	G Interrupting		J Interrupting		L Interrupting	
						Cat. No.	\$ Price	Cat. No.	\$ Price	Cat. No.	\$ Price
Standard ♦	H-Frame	30	2.2 M	14-25	5-13 x FLA	HGL36030M38X	1608.	HJL36030M38X	1658.	HLL36030M38X	1812.
				14-42	5-13 x FLA	HGL36050M38X	1938.	HJL36050M38X	1998.	HLL36050M38X	2191.
				30-80	5-13 x FLA	HGL36100M38X	2229.	HJL36100M38X	2298.	HLL36100M38X	2506.
				58-130	5-13 x FLA	HGL36150M38X	2701.	HJL36150M38X	2785.	HLL36150M38X	3057.
				114-217	5-13 x FLA	JGL36250M38X	3105.	JJL36250M38X	3201.	JLL36250M38X	3253.
	L-Frame	600	2.3 M	190-348	5-13 x FLA	LGL36400M38X	6041.	LJL36400M38X	6160.	LLL36400M38X	6468.
				312-520	5-13 x FLA	LGL36600M38X	8429.	LJL36600M38X	8604.	LLL36600M38X	9156.

■ Two-device solutions (these electronic motor protector circuit breakers include short circuit and overload protection):

- 1 contactor, plus
- 1 electronic motor circuit protector with a Micrologic 2.2 M

♦ The standard trip unit offers Class 5, 10, and 20 and phase unbalance or phase loss protection.

UL E164864
CCN NLRV

SF LR81630
Class 3211 05



Table 18.136: Voltage Trips

Only one trip or fault signaling contact can be installed per GV2/GV3 device.

Description	Characteristics	Voltage	Frequency	Catalog Number ▲	\$ Price
Voltage trips GV2 & GV3P	Undervoltage or Shunt trip (external mounting, 1 block right side only)	24 V	50 Hz 60 Hz	GVA•025 GVA•026	81.00
		48 V	50 Hz 60 Hz	GVA•055 GVA•056	
		100–110 V	50/60 Hz	GVA•107	
		110–115 V	50 Hz 60 Hz	GVA•115 GVA•116	
		120–127 V	50 Hz	GVA•125	
		127 V	60 Hz	GVA•115	
		200 V	50 Hz	GVA•207	
		200–220 V	60 Hz	GVA•207	
		220–240 V	50 Hz 60 Hz	GVA•225 GVA•226	
		380–400 V	50 Hz 60 Hz	GVA•385 GVA•386	
		415–440 V	50 Hz	GVA•415	
		415 V	60 Hz	GVA•416	
		440 V	60 Hz	GVA•385	
		480 V	60 Hz	GVA•415	
		500 V	50 Hz	GVA•505	
		600 V	60 Hz	GVA•505	

▲ To order an undervoltage trip: replace the bullet (•) with a U (for example, GVAU025).
To order a shunt trip: replace the bullet (•) with an S (for example, GVAS025).

Table 18.137: Auxiliary Contact Blocks

Description	Mounting Location	Max. No. of Blocks	Contact Type	Sold in lots of	Catalog Number	\$ Price
Instantaneous auxiliary contacts GV2 + GV3P	Front ■ □	1	N.O. or N.C. ♦	1	GVAE1	21.80
			N.O. + N.C.	10	GVAE11 ▼	35.70
			N.O. + N.O.	1	GVAE20 ▼	35.70
	Left Hand Side	2	N.O. + N.C.	1	GVAN11 ▼	35.70
			N.O. + N.O.	1	GVAN20 ▼	35.70
Fault signaling contact + instantaneous auxiliary contact GV2 + GV3P	Left Hand Side ★	1	N.O. (fault) + N.O.	1	GVAD1010	54.00
			N.O. (fault) + N.C.	1	GVAD1001	54.00
			N.C. (fault) + N.O.	1	GVAD0110	54.00
			N.C. (fault) + N.C.	1	GVAD0101	54.00
Short circuit signaling contact GV2 + GV3P	Left Hand Side	1	SPDT	1	GVAM11	35.70

- Mounting of a GVAE contact block or a GV2AK00 visible isolation block on GV2P.
- ♦ Choice of N.C. or N.O. contact operation, depending on which way the reversible block is mounted.
- ★ The GVAD is always mounted next to the starter.
- ▼ For spring terminals, add 3 to the catalog number (for example, GVAE113).
- ▲ One trip or one fault signaling can be fitted per GV3.
- Cannot be used with GV2GH7 insulator.

Table 18.138: Voltage Trips—Technical Data (GV2AU, GV2AS)

Rated Voltage—660 Vac					
Model	Inrush	Sealed	Pick-Up Voltage	Drop-Out Voltage	Operating Time ◇
GVAU	12 VA / 8 W	3.5 VA / 1.1 W	0.8–1.1	0.35–0.7	10–15 ms
GVAS	14 VA / 10.5 W	5 VA / 1.6 W	0.7–1.1	0.2–0.75	10–15 ms

◇ From the loss of voltage at the trip terminals to the opening of the starter contacts.

Table 18.139: GV3P Accessories

Accessory	Application / Use With	Catalog Number	\$ Price
Through-the-door operating mechanism (Qty: 1)	NEMA 1, 12, Black with trip indication, for use with GV3P	GV3APN01	136.00
	NEMA 1, 12, Red/Yellow, with trip indication, for use with GV3P	GV3APN02	136.00
	NEMA 3R, 4, 4X Red/Yellow without trip indication, for use with GV3P	GV3APN04	149.00
Angle bracket (Qty: 1)	Support shaft, for use with GV2P and GV3P	GVAPK12	19.00
Hard bracket (Qty: 1)	—	GVAPH03	30.00
Set of 3-pole 115 A busbars (tap-offs: 2, pitch: 64 mm)	GV3P••	GV3G264	25.00
Set of 3-pole 115 A busbars (tap-offs: 3, pitch: 64 mm)	GV3P••	GV3G364	45.00
Cover "Larger Spacing" UL 508 type E (Only one cover required on supply side)	GV3P••	GV3G66	18.00
IP 20 cover (Two covers required per starter)	GV3P••	LAD96570	12.00
Padlocking device (For use with up to 4 padlocks (not supplied) Ø 6 mm shank maximum)	GV3P•• GV3P•••	GV2V03	15.00



GVAU116



GVAE11



GVAD0101



GVAN11



GV7AC01

Table 18.140: Auxiliary Contact Blocks (auxiliary contact functions depends on location inside the device)

Description	Mounting Location	Max. No. of Blocks	Contact Type	Catalog Number	\$ Price
Standard					
Instantaneous	Inside Device	2 per device	N.O. + N.C.	GV7AE11	35.70
Trip Indication		1 per device	N.O. + N.C.		
Fault Indication		1 per device	N.O. + N.C.		
Low Level					
Instantaneous	Inside Device	2 per device	N.O. + N.C.	GV7AB11	35.70
Trip Indication		1 per device	N.O. + N.C.		
Fault Indication		1 per device	N.O. + N.C.		

Table 18.141: Voltage Trips

Description	Mounting Location	Max. No. of Blocks	Voltage	Catalog Number	\$ Price	
Undervoltage Trip	Inside Device	1 per device	48 Vac	50 Hz	GV7AU055	64.00
			110–130 Vac	50/60 Hz	GV7AU107	
			200–240 Vac	50/60 Hz	GV7AU207	
			380–440/480 Vac	50/60 Hz	GV7AU387	
			525 Vac	50 Hz	GV7AU525	
Shunt Trip	Inside Device	1 per device	48 Vac	50 Hz	GV7AS055	64.00
			110–130 Vac	50/60 Hz	GV7AS107	
			200–240 Vac	50/60 Hz	GV7AS207	
			380–440/480 Vac	50/60 Hz	GV7AS387	
			525 Vac	50 Hz	GV7AS525	
Fault Indication	Inside Device	1 per device	24–130		GV7AD111	72.00
			110–415		GV7AD112	

Table 18.142: Wiring Accessories

Description	Application	Catalog Number	\$ Price
Box Lugs	Sold in lots of 3 for GV7R*20–150*	GV7AC021	19.70 each
	Sold in lots of 3 for GV7R*220*	GV7AC022	24.90 each
Phase Barriers, Bus Bars & Shrouds			
Terminal Extension Kit	Increases center distance between phases to 45 mm	GV7AC03	46.70
Terminal Shroud Kit	Covers terminal connections for touch safe protection	GV7AC01	41.90
Phase Barriers	Provides maximum phase separation at connection points	GV7AC04	31.10
Insulating Barriers	Provides insulation between connectors and backplate	GV7AC05	24.90
Busbars and Covers	Connect to LC1F115–185 contactor	GV7AC06	46.70
	Connect to LC1F225–265 contactor	GV7AC07	46.70
Operating Handles and Accessories			
Black rotary operating handle with black legend plate (mounts directly on device)		GV7AP03	86.00
Red rotary operating handle with yellow legend plate (mounts directly on device)		GV7AP04	86.00
Conversion accessory to mount the device directly on panel door		GV7AP05	14.00
Black rotary operating handle with black legend plate and extension kit (185–600 mm)		GV7AP01	102.00
Red rotary operating handle with yellow legend plate and extension kit (185–600 mm)		GV7AP02	102.00
Padlocking device for toggle handle (max. 38 mm padlocks)		GV7V01	14.00

* Wire size: GV7AC021 = 14 to 3/0 AWG; GV7AC022 = 14 AWG to 350 kcmil.

Table 18.143: Operating Handles

For use with GV2, GV3, and TeSys U through-the-door operating mechanisms

Accessory	Description	Catalog Number	\$ Price
Operating Handle (Qty: 1)	NEMA 1, 12, Black with trip indication	GVAPB54	31.00
	NEMA 1, 12, Red/Yellow, with trip indication	GVAPR54	31.00
	NEMA 3R, 4, 4X Red/Yellow without trip indication	GVAPR65	37.00

Dimensions pages 18-52 to 18-55



GV7AP03



GVAPB54



GVAPR54



GV7AC021



GV7V01



GV7AE11

- 45 mm wide (same dimensions as GV2ME)
- Available with screw clamp and spring type terminals
- Mounts directly to LC1D09–D32 contactors (with use of GV2AF3 or GV2AF4)
- Meets application needs for fusible starter
- Uses GV2AE instantaneous contact blocks to open control circuits
- DIN rail mounted

Table 18.144: LS1 Fuseholders

Description	Fuse Type	Dimensions		Use In	Catalog Number	\$ Price
		in.	mm			
Spring terminals, 3-pole	CC, KTK-R	0.41 x 1.5	10.3 x 38	US Markets	LS1D303	86.
Screw clamp terminals, 3-pole	CC, KTK-R	0.41 x 1.5	10.3 x 38	US Markets	LS1D30	86.
Spring terminals, 3-pole	aM, gG	0.39 x 1.5	10 x 38	European Markets	LS1D323	101.
Screw clamp terminals, 3-pole	aM, gG	0.39 x 1.5	10 x 38	European Markets	LS1D32	86.
Auxiliary main pole adder	aM, gG	0.39 x 1.5	10 x 38	European Markets	LA8D324▲	65.

▲ Can be mounted on left-hand or right-hand side of the 3-pole LS1D32 block.

Table 18.145: Specifications

Type	LS1D30, LS1D303	LS1D32, LS1D323, LS1DT32
Max. voltage	600 V 3 Phase	
Max. current	30 A	
Conforming to standards	IEC 60947-1, 60947-2, 60947-4-1, EN60204, BS4841, UL 508, CSA 222.2 No. 14, NFC 63-650, 63-120, 79-130, VDE 0113, 0660	
Product approvals	UL, CSA	BV
Protective treatment	"TH"	"TH"
Ambient air temperature—operation	-58 to 158° F (-50 to +70° C)	
Wiring	Number of conductors and cross sectional area (c.s.a.)	
Solid cable	2 x 16–8 AWG (1–6 mm ²)	
Flexible cable without cable end	2 x 14–8 AWG (1–6 mm ²)	
Flexible cable with cable end	2 x 16–10 AWG (1–4 mm ²)	
Resistance to mechanical impact conforming to IEC 60947-1 §7-1-6	0.5 J	
Tightening torque	15 in-lb (1.7 N•m)	
Sensitivity to phase failure	No	
Operating Positions		
Rated voltage—600 V	600 V	
Rated thermal current	25 A (GV2), 63 A (GV3)	
Mechanical life (varies by application)	GV2: 100,000 operations	

Table 18.146: Environmental Specifications and Approvals

Shock resistance	30 g (conforming to IEC 600 68-2-27)
Vibration resistance	5 g (5 to 150 Hz) (IEC 600 68-2-26)
Ambient temperature	-40 to 176 °F (-40 to +80 °C) for storage -4 to 140 °F (-20 to +60 °C) open operation -4 to 104 °F (-20 to +40 °C) enclosed operation
Maximum operating rate	25 operations per hour
Operating current of magnetic trip	Approximately 13 times the maximum thermal trip (non-adjustable setting)



File E164864
CNN NLRV



File LR81630
Class 3211 05



LS1D30



GV2GH7

Table 18.147: GV2 Mounting Accessories

Description	Application	Standard Pack ■	Catalog Number	\$ Price
Common mounting plate	For GV2 plus any 3-pole LC1D09 thru LC1D25 contactor. (supplied with GV1G02 connector)	1	GK2AF01	21.60
Adapter plate	For screw mounting of GV2M	10	GV2AF02	7.10
Combination block	Interconnect for GV2 plus any 3-pole LC1K or LP1K contactor	10	GV2AF01	14.00
	Interconnect GV2 and LC1D09 thru D32	10	GV2AF3	3.20
7.5 mm compensation plate	Interconnect GV2 and LC1D09 thru D32 mounted on LAD31	10	GV2AF4	3.20
	To allow mounting of GV2M and GV2P on a common bus bar	10	GV1F03	5.40
Mounting plate	For mounting GV2ME or GV2P and contactor LC1D09 thru D32	10	LAD31	6.20
		10	LAD311	12.30

Table 18.148: GV2 Cabling Accessories—Bus Bars

Description	Application	Pitch	Standard Pack ■	Catalog Number	\$ Price
3-Pole, 63 A Bus Bar	For feeding 2 GV2 starters	45	1	GV2G245	23.30
		54	1	GV2G254	23.30
		72	1	GV2G272	23.30
	For feeding 3 GV2 starters	45	1	GV2G345	28.70
		54	1	GV2G354	28.70
		72	1	GV2G372	28.70
For feeding 4 GV2 starters	45	1	GV2G445	34.20	
	54	1	GV2G454	34.20	
	72	1	GV2G472	34.20	
For feeding 5 GV2 starters	54	1	GV2G554	34.20	

Table 18.149: GV2 Other Cabling Accessories

Description	Application	Standard Pack ■	Catalog Number	\$ Price
Terminal blocks	Top feed for use with bus bars	1	GV1G09	34.20
	Bottom feed, to be used with bus bars; can be fitted with GV1L3 current limiter	1	GV2G05	34.20
Protective end cover	To cover unused bus bar outlets	5	GV1G10	3.60
3-pole flexible connector	For connecting a GV2 to an LC1D09 thru D25 contactor	10	GV1G02	14.30
Conduit adapter (1/2" NPT)	—	1	GV2AK1	16.20
Incoming line insulator	For GV2P when used in UL 508 Type E applications▲	10	GV2GH7	15.00

▲ Cannot be used with front-mounted auxiliary contact block.



LAD31

Table 18.150: GV2 Other Accessories

Description	Application	Standard Pack ■	Catalog Number	\$ Price
Visible isolation block—GV2P	Front mounting, 3-pole visible isolation on incoming side of GV2P	1	GV2AK00	71.40
Current limiter—GV2M	Increases interrupt capacity when attached to GV2M	1	GV1L3	117.00
Through-the-door operating mechanism	NEMA 1, 12, Black with trip indication, for use with GV2P	1	GV2APN01	131.00
	NEMA 1, 12, Red/Yellow with trip indication, for use with GV2P	1	GV2APN02	131.00
	NEMA 3R, 4, 4X, Red/Yellow without trip indication, for use with GV2P	1	GV2APN04	144.00
Angle bracket	Support shaft, for use with GV2P	1	GVAPK11	19.00
Hard bracket	—	1	GVAPH02	30.00


Table 18.151: GV2 Enclosures

Description	Mounting	Rating	Catalog Number	\$ Price
Enclosures for GV2M with or without accessories (maximum of 1 accessory on right and left) Enclosures are not UL or CSA listed.	Surface mounting	NEMA 1, IP41	GV2MC01	54.00
		IP55	GV2MC02	78.00
	Flush mounting	NEMA 1, IP41	GV2MP01	31.10
		IP55	GV2MP02	54.00
Flush mounting reduced width (max. of 1 accessory on right)	NEMA 1, IP41	IP55	GV2MP03	27.90
		IP55	GV2MP04	49.70

Table 18.152: GV2 Enclosures Accessories

Description	Type	Standard Pack ■	Catalog Number	\$ Price	
Padlocking device for GV2M (when padlocked, starter is automatically in Off position)	—	1	GV2V01	26.90	
Mushroom head stop push button (40 mm, red) ♦	Spring return	1	GV2K011	35.90	
	Latching	Key release (Ronis key no. 455)	1	GV2K021	104.00
		Turn to Release	1	GV2K031	52.00
	Latching / Padlockable Turn to Release	1	GV2K04	117.00	
Sealing kit	For enclosures GV2MC01 and GV2MP01	10	GV2E01	18.00	
Pilot Light (neon)	110 V	Green	GV2SN13	26.90	
	110 V	Red	GV2SN14		
	110 V	Orange	GV2SN15		
	110 V	White	GV2SN17		
	220/240 V	Green	GV2SN23		
	220/240 V	Red	GV2SN24		
	220/240 V	Orange	GV2SN25		
	220/240 V	White	GV2SN27		
	380/440 V	Green	GV2SN33		
	380/440 V	Red	GV2SN34		
	380/440 V	Orange	GV2SN35		
	380/440 V	White	GV2SN37		


■ Orders must specify multiples of quantities listed.
♦ Supplied with IP55 sealing kit.




GV2AF3 / GV2AF4

Table 18.153: Splitter Boxes


A total of up to eight starters is permissible after extensions. Use multiple quantities of the same catalog number to create the desired line-up.




APP2R4H1




LAD35



LAD3B



LAD33

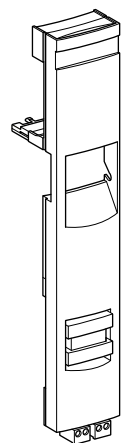

APP2D1•

Description	Type of Control-Command Connection on Control System Side	No. of I/O per Starter	No. of Starters per Unit	Catalog Number	\$ Price	
50 A power splitter box	—	—	2	LAD322	52.00	
			4	LAD324	93.00	
50 A power and control splitter box	1 x HE10 8I/8O	1I/1O	4	APP2R4H1	124.00	
	1 x HE10 16I and 1 x HE10 8O	2I/1O	4	APP2R4H2	124.00	
	via module APP1C*** ▲	—	2	APP2R2E	124.00	
			4	APP2R4E	124.00	
	AS-Interface	—	2I/1O	2	APP2R2AS	124.00
			1I/1O	4	APP2R4AS	124.00

▲ Connection to an APP1C*** module via APP2CX adapter (LAD35).

Table 18.154: Power Connection Components for One Starter

Description	Kit Consists Of:	Catalog Number	\$ Price
Assembly and power connection kit	One LAD31 plate for GV2ME and two LAD34 power connection modules	LAD351	21.00
Reversing kit ■	One set of bus bars and one mechanical interlock	LAD32	20.70

■ To create a TeSys D reverser, use two LC1D contactors, one assembly and power connection kit, and one reversing kit.

Table 18.155: Power Connection Accessories for One Starter

Description	Max. Connection Cross-Section	Use	Catalog Number	\$ Price
Upstream terminal block (50 A max)	16 mm ² (6 AWG)	Power supply for one or two power splitter boxes	LAD3B	83.00
Downstream terminal block (50 A max)	6 mm ² (10 AWG)	Connection of motor cables	LAD331	5.00

Table 18.156: Control Connection Module for One Starter

Description	D-Line Coil Voltage	Type of Coil Control Relay	Type of Starter	Catalog Number	\$ Price
Control connection module (integrating contact block GVAE20)	12–240 Vac or 24–125 Vdc	Electromechanical ♦	Non-reversing	APP2D1	41.40
			Reversing	APP2D2	72.00
	24–48 Vdc	Without relay ★	Non-reversing	APP2D1D	31.10
			Reversing	APP2D2D	31.10

♦ Relay supplied mounted on the front panel of the control connection.

★ The use of TeSys D low consumption contactors is recommended.

Table 18.157: Spare or Replacement Parts

Description	Type of Control-Command Connection on Control System Side	No. of I/O per Starter	No. of Starters	Sold in Lots of	Catalog Number	\$ Price	
Plate for mounting a GV2ME manual starter	—	—	1	10	LAD31	6.20	
			1	10	LAD311	12.30	
Power connection module	—	—	1	10	LAD341	7.50	
			1 x HE10 8I/8O	1I/1O	4	1	APP2R4H3
Control-command splitter box (single, for mounting on a power splitter box)	1 x HE10 16I and 1 x HE10 8O	2I/1O	4	1	APP2R4H4	11.30	
	Per module APP1C*** ▼	—	2	1	APP2R2C	11.30	
			4	1	APP2R4C	11.30	
	AS-Interface	—	2I/1O	2	1	APP2R2A	11.30
			1I/1O	4	1	APP2R4A	11.30
Replacement electromechanical relay (for control connection module)	—	—	1	10	APP2ER	7.50	

▼ Connection to an APP1C*** module via APP2CX adapter (LAD35).


The AK5 pre-fabricated bus bar system provides a quick and easy method of mounting control devices. All components are finger safe, UL Listed, CSA approved and CE marked. Although the AK5 system can be screw mounted onto any type of support, it **must be mounted** on the AM1DL201 DIN rail when component mounting plates incorporating a tap-off are used. When using tap-offs, the nominal operating current of the bus bar (160 A @ 35°) must not be exceeded.

Table 18.158: 160 A, 3-Phase Busbar System


Maximum number of mounting plates						Length		Catalog Number	\$ Price
Tap-off		Standard Width Plate		Extension Plate		in.	mm		
1.42 in.	36 mm	2.13 in.	54 mm	2.80 in.	71 mm				
6		4		2		13.39	344	AK5JB143	210.00
9		6		3		17.64	452	AK5JB144	266.00
12		8		4		21.85	560	AK5JB145	286.00
15		10		5		26.05	668	AK5JB146	345.00
24		16		8		38.69	992	AK5JB149	393.00
27		18		9		42.90	1100	AK5JB1410	540.00



AK5JB143



AK5PA231



AK5PA232S



AK5PC33



AM1DL201

Table 18.159: Mounting Plate Tap-off (plugs into busbar mounted on AM1DL201 DIN rail)

Width		Thermal Current Amperes	Application	Catalog Number	\$ Price
in.	mm				
2.13	54	25 A	GV2 with LUS or LUB 12 and 32 contactor	AK5PA231	98.00
2.13	54	25 A		AK5PA232	120.00
4.25	108	25 A		AK5PA232S	206.00

Table 18.160: Bus Tap-off (plugs into busbar for wiring to a separately mounted device)

Width		Thermal Current Amperes	Length of Leads		Catalog Number	\$ Price
in.	mm		in.	mm		
1.42	36	32 A	9.84	250	AK5 PC33	23.00
1.42	36	32 A	39.37	1000	AK5 PC33L	37.80

Table 18.161: Extension Plates

Used to mount wider components. Bolt to standard mounting plates (after DIN rails are removed).

Width		Application	Catalog Number	\$ Price
in.	mm			
2.80	71	GV & Reversing contactor	AK5PE27	26.30

Table 18.162: Mounting Rail (must be used for mounting plates with tap-offs)

Description	Depth	Length	Catalog Number	\$ Price
	mm	mm		
75 mm Omega Rail	15	2000	AM1DL201	41.10

Table 18.163: Approvals: IEC 439, UL, CSA, DNV, LROS





File E161251
CCN NMTR





File LR 89150
Class 6228-01

Table 18.164: TeSys D Contactors AC Control Circuits

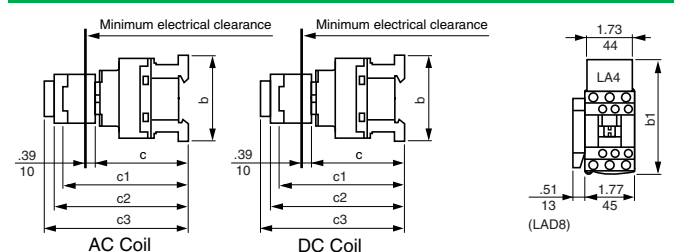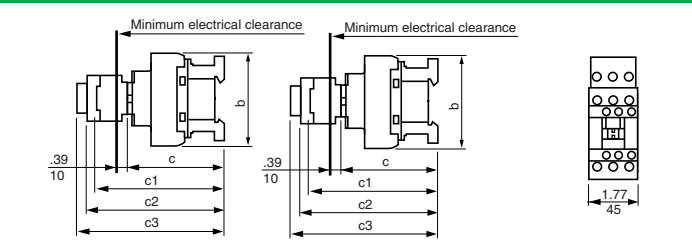LC1D09 to D18 (3-pole) and LC1DT12 to LC1DT40 (4 pole)				LC1D25 to D38 (3-pole)						
										
b	AC coil, without add-on accessories	3.03 (77)	3.89 (99)	3.14 (80)	3.36 (85)	3.89 (99)	3.34 (85)	3.89 (99)	3.58 (91)	4.13 (105)
	DC coil	—	—	—	—	—	—	—	—	—
b1	AC coil, with LAD4BB ■	3.70 (94)	4.21 (107)	3.75 (95.5)	3.85 (98)	4.21 (107)	3.85 (98)	—	—	—
	AC coil, with LA4D*2 ■	4.33 (110) ▲	4.84 (123) ▲	4.30 (111.5) ▲	4.48 (114) ▲	4.84 (123) ▲	4.48 (114)	—	—	—
	AC coil, with LA4DF, DT ■	4.68 (119) ▲	5.19 (132) ▲	4.76 (120.5) ▲	4.84 (123) ▲	5.19 (132) ▲	5.02 (129)	—	—	—
c	AC coil, with LA4DR, DW, DL ■	4.96 (126) ▲	5.67 (139) ▲	5.0 (127.5) ▲	5.11 (130) ▲	5.47 (139) ▲	7.48 (190)	—	—	—
	AC coil, without cover or add-on blocks	3.30 (84)	3.30 (84)	3.30 (84)	3.54 (90)	3.54 (90)	3.54 (90)	3.54 (90)	3.85 (98)	3.85 (98)
	AC coil, with cover, without add-on blocks	3.38 (86)	3.38 (86)	3.38 (86)	3.62 (92)	3.62 (92)	3.62 (92)	3.62 (92)	3.93 (100)	3.93 (100)
c1	DC coil, without cover or add-on blocks	3.66 (93)	3.66 (93)	3.66 (93)	3.89 (99)	3.89 (99)	—	—	—	—
	DC coil, with cover, without add-on blocks	3.76 (95)	3.76 (95)	3.76 (95)	3.97 (101)	3.97 (101)	3.90 (99)	3.90 (99)	4.21 (107)	4.21 (107)
	AC coil, with LADN or C (two or four contacts)	4.60 (117)	4.60 (117)	4.60 (117)	4.84 (123)	4.84 (123)	4.84 (123)	4.84 (123)	5.15 (131)	5.15 (131)
c2	DC coil, with LADN or C (two or four contacts)	4.96 (126)	4.96 (126)	4.96 (126)	5.19 (132)	5.19 (132)	4.84 (123)	4.84 (123)	5.15 (131)	5.15 (131)
	AC coil, with LAD6K10	5.07 (129)	5.07 (129)	5.07 (129)	5.31 (135)	5.31 (135)	5.31 (135)	5.31 (135)	5.62 (143)	5.62 (143)
	DC coil, with LAD6K10	5.43 (138)	5.43 (138)	5.43 (138)	5.66 (144)	5.66 (144)	5.31 (135)	5.31 (135)	5.62 (143)	5.62 (143)
c3	AC coil, with LADT,R,S	5.39 (137)	5.39 (137)	5.39 (137)	5.62 (143)	5.62 (143)	5.62 (143)	5.62 (143)	5.94 (151)	5.94 (151)
	AC coil, with LADT,R,S and sealing cover	5.55 (141)	5.55 (141)	5.55 (141)	5.78 (147)	5.78 (147)	5.78 (147)	5.78 (147)	6.10 (155)	6.10 (155)
	DC coil with LADT,R,S	5.76 (146)	5.76 (146)	5.76 (146)	5.98 (152)	5.98 (152)	5.62 (143)	5.62 (143)	5.94 (151)	5.94 (151)
	DC coil with LADT,R,S and sealing cover	5.90 (150)	5.76 (146)	5.76 (146)	6.14 (156)	6.14 (156)	5.78 (147)	5.78 (147)	6.10 (155)	6.10 (155)

- ▲ Including LAD4BB
- Not applicable to devices with DC coils

Table 18.165: AC Coil

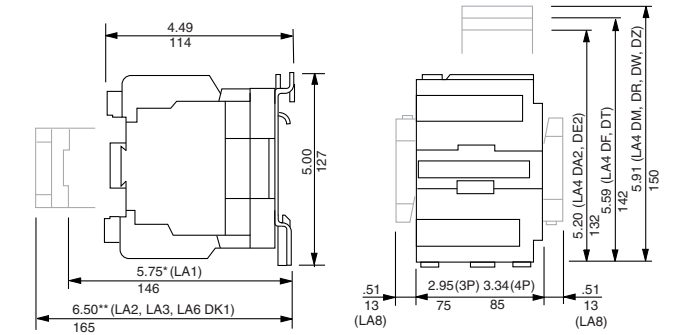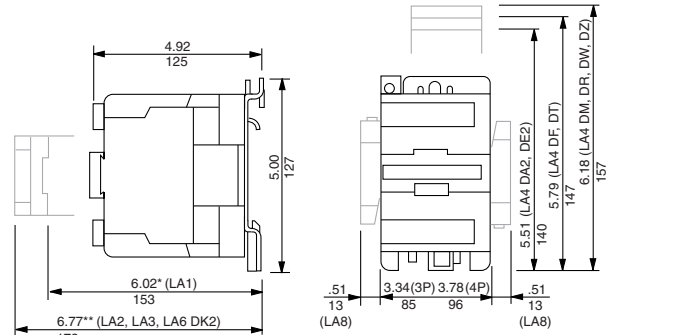LC1D40, D50, D65 (3P), LC1D65004 (4P)		LC1D80004 (4P)	
			

*except LA1DN10, DN01 = 136
** +4 mm with lead sealing device

*except LA1DN10, DN01 = 136
** +4 mm with lead sealing device

LC1 D40A–D65A (3P), LC1 DT60A–DT80A (4P) AC OR DC	LC1	D40A–D65A	DT60A–DT80A	D40008
		in. (mm)	in. (mm)	in. (mm)
a		2.17 (55)	2.76 (70)	3.35 (85)
	with LA4 D*2	—	—	5.31 (135)
	with LA4 DB3 or LAD 4BB3	5.35 (136)	—	—
b1	with LA4 DF, DT	6.18 (157)	—	5.59 (142)
	with LA4 DM, DW, DL	6.54 (166)	—	5.91 (150)
c	without cover or add-on blocks	4.65 (118)	4.65 (118)	4.92 (125)
	with cover, without add-on blocks	4.72 (120)	4.72 (120)	—
c1	with LAD N (1 contact)	—	—	5.47 (139)
	with LAD N or C (2 or 4 contacts)	5.91 (150)	5.91 (150)	5.79 (147)
c2	with LAD 6K10 or LA6 DK	6.42 (163)	6.42 (163)	6.26 (159)
	with LAD T, R, S	6.73 (171)	6.73 (171)	6.57 (167)
c3	with LAD T, R, S and sealing cover	6.89 (175)	6.89 (175)	6.73 (171)


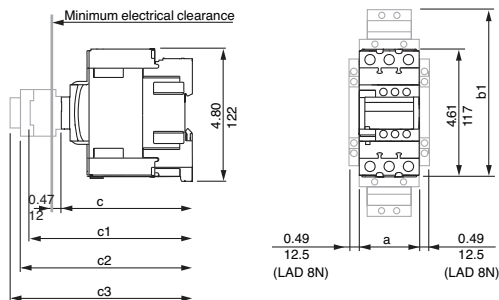


Table 18.166: DC Coil


LC1D40, D50, D65 (3P), LC1D650004, (4P)	LC1D80 (3P), LC1D800004(4P)
<p>*except LA1DN10, DN01 = 136 □ + 4 mm with lead sealing device</p>	<p>*except LA1DN10, DN01 = 143 □ + 4 mm with lead sealing device</p>

LC1D115, D150

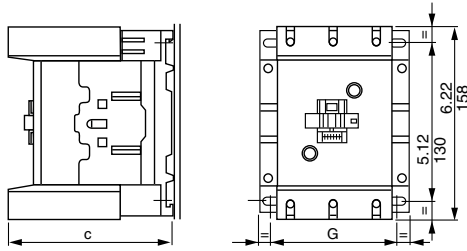


	LC1	D115	D1156	D150	D1506
c	5.12 (132)	4.53 (115)	5.12 (132)	4.53 (115)	4.53 (115)
G (3-poles)	3.78/4.33 (96/110)	3.78/4.33 (96/110)	3.78/4.33 (96/110)	3.78/4.33 (96/110)	3.78/4.33 (96/110)
G (4-poles)	5.12/5.67 (130/144)	5.12/5.67 (130/144)	—	—	—

LC1D115, D150

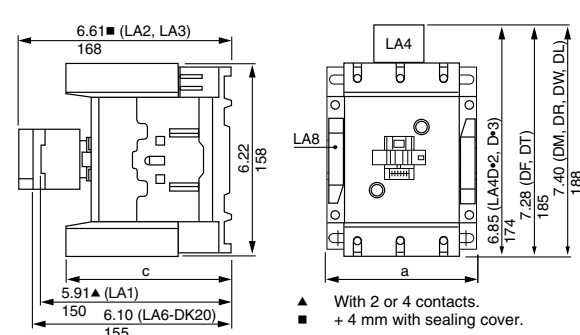


	LC1	C	A
D115, D150		5.12 (132)	4.72 (120)
D115004		5.12 (132)	6.10 (155)
D1156, D1506		4.53 (115)	4.72 (120)
D1150046		4.53 (115)	6.10 (155)

LR2D4 bimetallic overload relay
Direct mounting beneath contactors
LC1D115 and D150

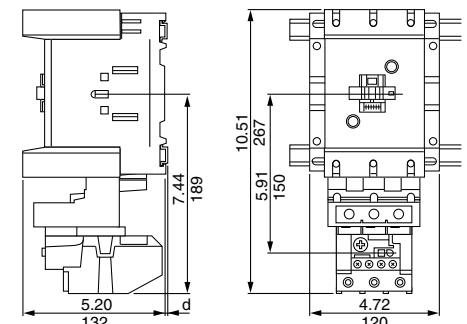

35 mm DIN rail dimensions		
d	AM1DP200 and DR200 0.10 (2.5)	AM1DE*** and ED*** .41 (10.5)

LR9D solid-state overload relay
Direct mounting beneath contactors
LC1D115 and D150

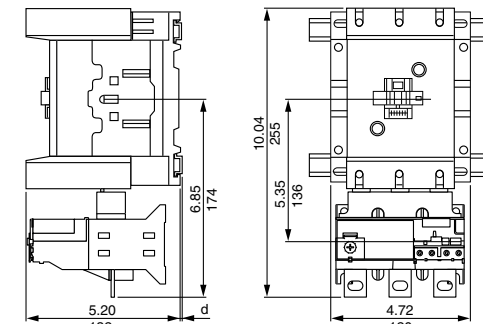


35 mm DIN rail dimensions		
d	AM1DP200 and DR200 0.10 (2.5)	AM1DE*** and ED*** .41 (10.5)

Note: All dimensions are in Inches (mm).

LC1F115 to F330

All dimensions shown in mm.
To convert to inches, divide by 25.4.

Table 18.167: LC1F115–F330 Dimensions

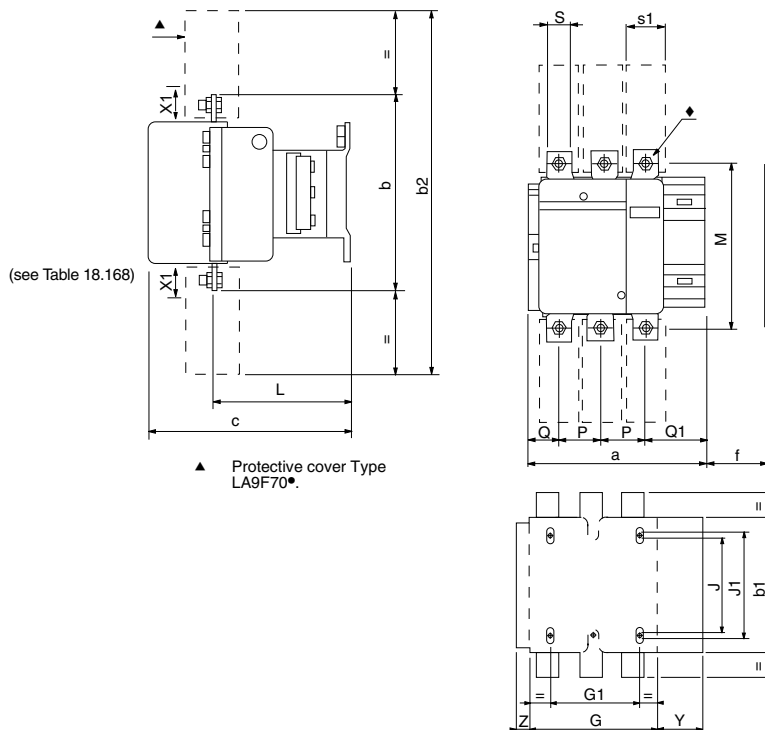

LC1	F115		F150		F185		F265		F330	
	3-Pole	4-Pole	3-Pole	4-Pole	3-Pole	4-Pole	3-Pole	4-Pole	3-Pole	4-Pole
a	163.5	200.5	163.5	200.5	168.5	208.5	201.5	243.5	213	261
b	162	162	170	170	174	174	203	203	206	206
b1	137	137	137	137	137	137	145	145	145	145
b2	265	265	301	301	305	305	370	370	375	375
c	165	165	165	165	176	176	207	207	219	219
f	131	131	131	131	130	130	147	147	147	147
G	106	143	106	143	111	151	142	190	154.5	202.5
G1	80	80	80	80	80	80	96	96	96	96
J	106	106	106	106	106	106	106	106	106	106
J1	120	120	120	120	120	120	120	120	120	120
L	107	107	107	107	113.5	113.5	141	141	145	145
M	147	147	150	150	154	154	178	178	181	181
P	37	37	40	40	40	40	48	48	48	48
Q	29.5	29.5	26.5	26.5	29	29	39	34	43	43
Q1	60	60	57.5	55.5	59.5	59.5	66.5	66.5	74	74
S	15	15	20	20	20	20	25	25	25	25
S1	27	27	34	34	34	34	38	38	44.5	44.5
Y	44	44	44	44	44	44	38	38	38	38
Z	13.5	13.5	13.5	13.5	13.5	13.5	21.5	21.5	20.5	20.5

■ +6 mm with time delay block (for F115 and F150).
◆ Optimal terminal shroud
f = minimum distance required for coil removal.


Table 18.168: LC1F115–F330 Voltage

	220/380 V	415/440 V	500 V	660 V	1000 V
LC1F115, F150	20	25	30	40	20
LC1F185	20	25	30	40	30
LC1F265	20	25	40	50	40
LC1F330	25	35	40	50	50

X1: Minimum clearance according to the operational voltage and the breaking capacity.

LC1F400 to F500

Table 18.169: LC1F400–F500 Dimensions

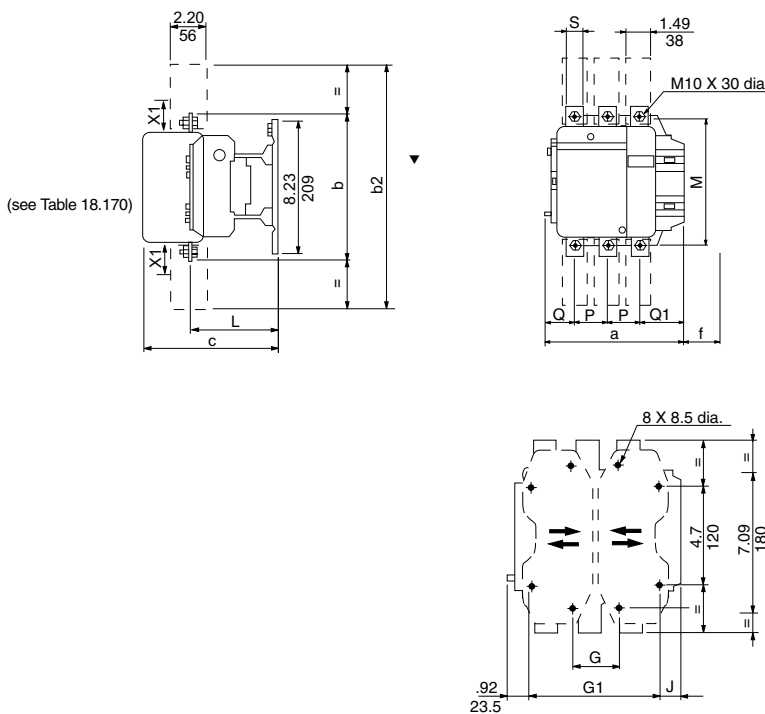

LC1	F400			F500		
	2-Pole	3-Pole	4-Pole	2-Pole	3-Pole	4-Pole
a	213	213	261	233	233	288
b	206	206	206	238	238	238
b2	375	375	375	400	400	400
c	213	213	213	226	226	226
f	119	119	119	141	141	141
G★	80	80	80	80	80	140
G min.	66	66	66	66	66	66
G max.	102	102	150	120	120	175
G1★	170	170	170	170	170	230
G1 min.	156	156	156	156	156	156
G1 max.	192	192	240	210	210	265
J	19.5	19.5	67.5	39.5	39.5	34.5
L	145	145	145	146	146	146
M	181	181	181	208	208	208
P	48	48	48	55	55	55
Q	69	43	43	76	46	46
Q1	96	74	74	102	77	77
S	25	25	25	30	30	30

★ Supplied
▼ Protective cover
f = Minimum distance required for coil removal.

Table 18.170: LC1F400–F500 Voltage


	220/230 V	415/440 V	500 V	660 V	1000 V
LC1F400	30	40	40	50	60
LC1F500	40	45	50	60	60

X1: Minimum clearance according to the operational voltage and the breaking capacity.

Dual Dimensions: INCHES
Millimeters

Table 18.171: LC1F Dimensions

LC1F630 and LC1F800

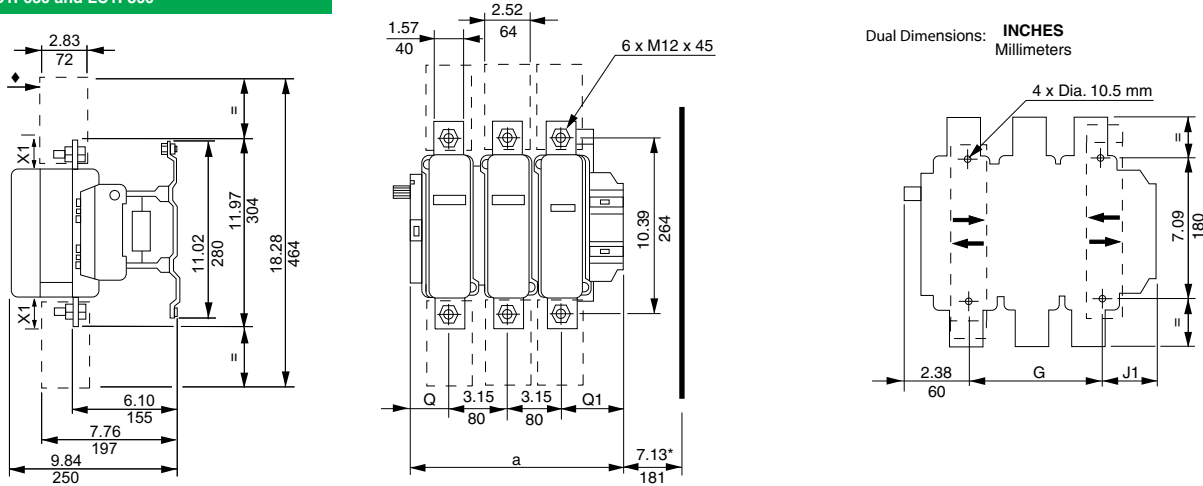


	LC1F630	a		G supplied		G min.		G max.		J1		Q		Q1	
		in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm
* = minimum distance required for coil removal.	2 P	12.17	309	7.09	180	3.94	100	7.68	195	2.70	68.5	4.02	102	5.00	127
◆ Protective terminal cover.	3 P	12.17	309	7.09	180	3.94	100	7.68	195	2.70	68.5	2.36	60	3.50	89
	4 P	15.31	389	9.45	240	5.91	150	10.83	275	2.70	68.5	2.36	60	3.50	89

X1: Minimum clearance according to the operational voltage and the breaking capacity.

Voltage (V)	380	415/440	500	660	1000
X1 in mm	60	60	60	70	80

LC1F780, F7804

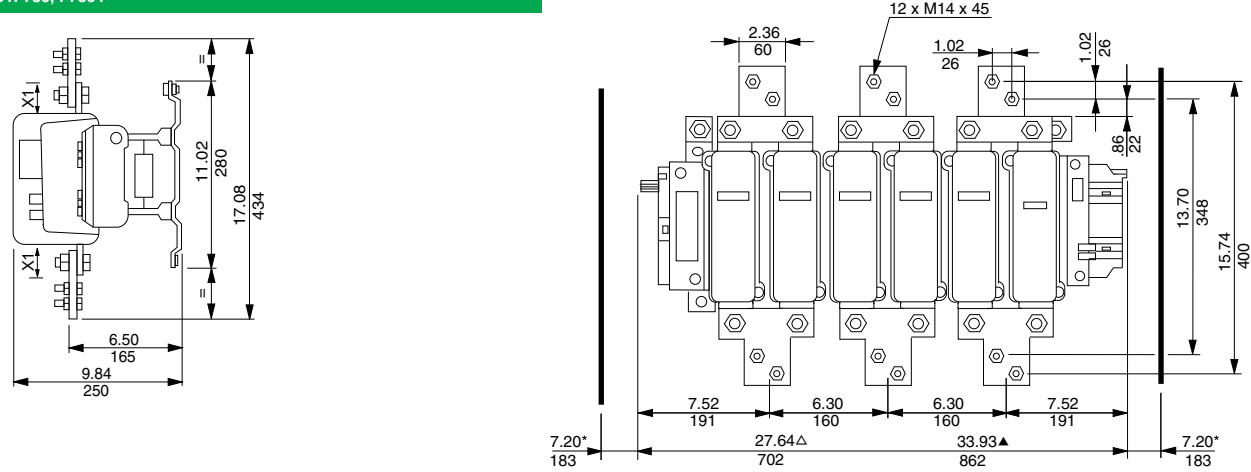

X1: Minimum clearance according to the operational voltage and the breaking capacity.

Voltage (V)	380	415/440	660	1000
X1 in mm	90	100	120	120

△ Overall length (3 poles)
▲ Overall length (4 poles)
*minimum distance required for coil removal.

LC1F780 mounting

LC1F804 mounting



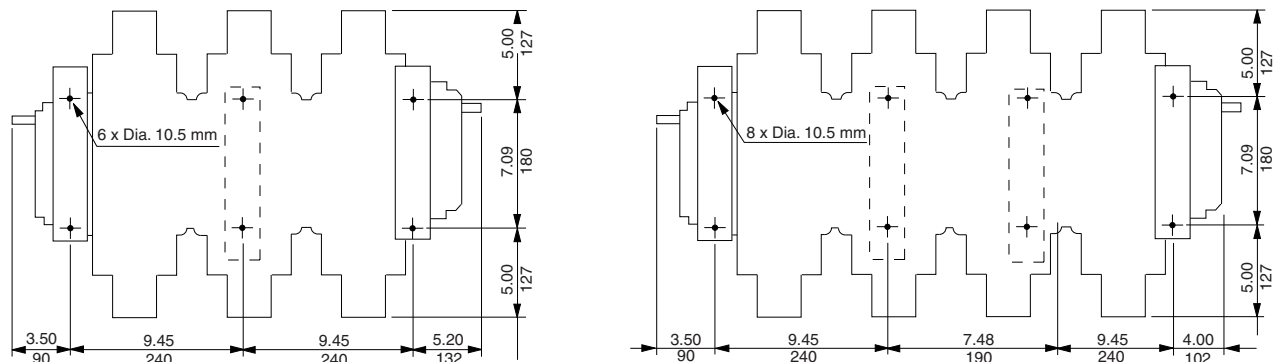


Table 18.172: Reversing Contactor Dimensions

LC2D09–D32
LC2DT20–DT60
2 x LC1DT20–DT60

2 x LP1D40, D65, D80, D95

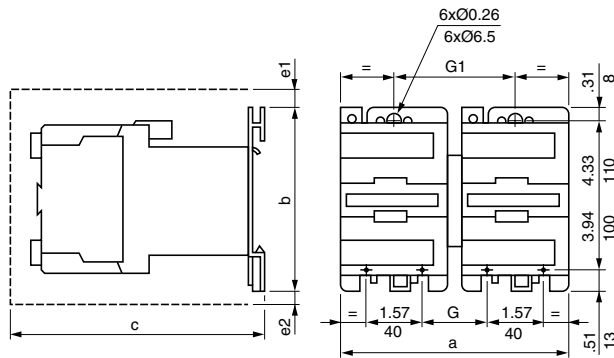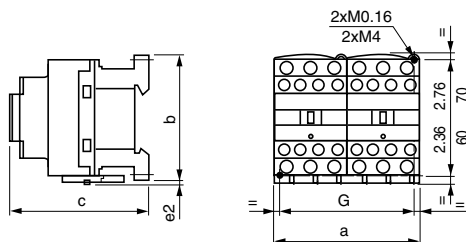

LC2 or 2 x LC1	a	b	c	G
	in. (mm)	in. (mm)	in. (mm)	in. (mm)
DT20 and DT25	3.54 (90)	3.34 (85)	3.54 (90)	3.14 (80)
DT32 to DT60	3.54 (90)	3.58 (91)	3.85 (98)	3.14 (80)

c, e2: includes cabling.


LC2 or 2 x LC1	a	b	c	e1	e2	G	G1
	in. (mm)	in. (mm)	in. (mm)	in. (mm)	in. (mm)	in. (mm)	in. (mm)
D40 to D65	7.16 (182)	5.0 (127)	7.4 (190)	1.19 (5)	0.43 (11)	2.2 (57)	3.8 (97)
D80 and D95	8.14 (207)	5.0 (127)	8.4 (215)	0.51 (13)	0.78 (20)	3.7 (96)	4.3 (111)

c, e1 and e2: includes cabling.

LC2D115 and D150
2 x LC1D115 and D150

Panel mounted with 1/4 in. screw

Dimensions shown in millimeters
(mm ÷ 25.4 = inches)

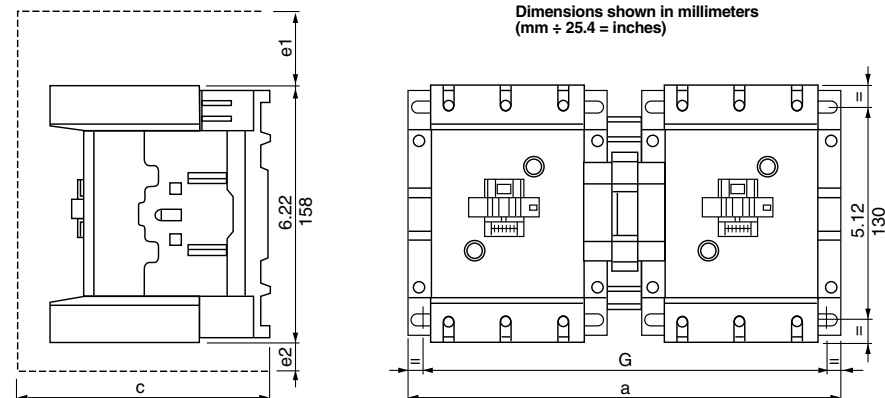


LC2 or 2 x LC1 (3-pole)	a	c	e1	e2	G
D115, D150	266	148	56	18	242/256
LC2 or 2 x LC1 (4-pole)	a	c	e1	e2	G
D115	334	148	—	60	310/324

c, e1 and e2 includes cabling


NOTE: For dimensions of TeSys F reversing contactors, please refer to catalog 8502CT9901.

Table 18.173: TeSys D Overload Relay Dimensions

LRD-01-35
Independent mounting on 50 mm centers or on rail AM1DP200 or DE200

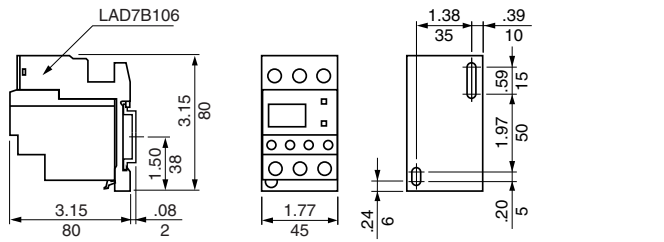


Remote tripping or electrical reset




▲ Can only be mounted on RH side of relay LRD-01 to 35


LRD3 ●●
Beneath LC1D ●● A contactor

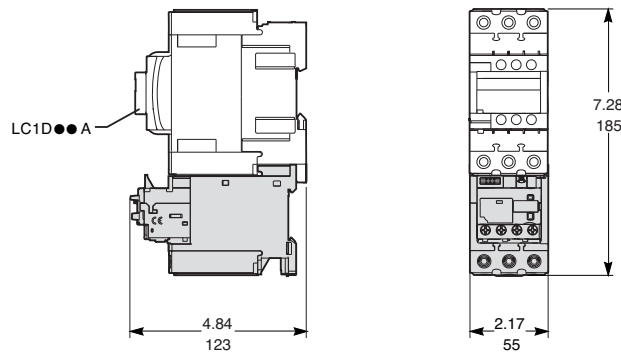


LR2D1, LR3D1
Separate mounting at 50 mm (1.97 in.) centers or on AM1DP200 or DE200 rail

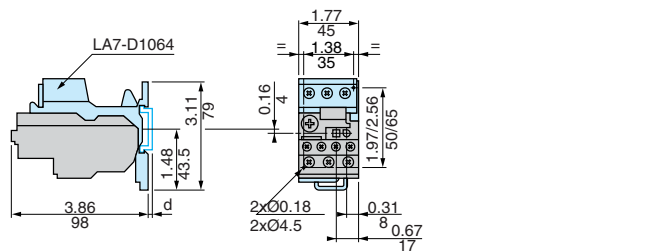

LR2D1, LR3D1
Separate mounting at 110 mm (4.33 in.) centers

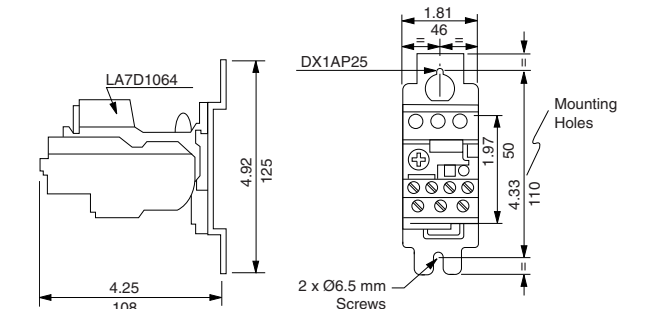


Independent mounting on 110 mm centers

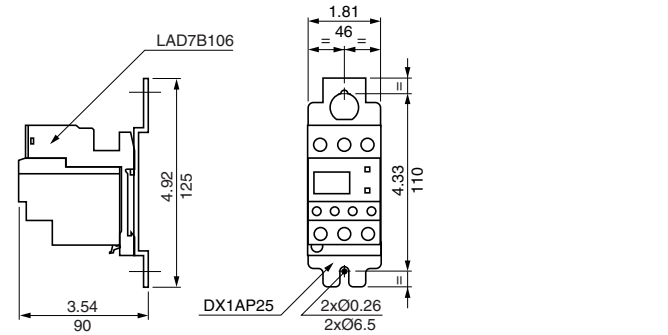


LRD, LR2D and LR9D
Reset by flexible cable LA7D305 and LAD7305
Mounting with cable straight


Mounting with cable bent

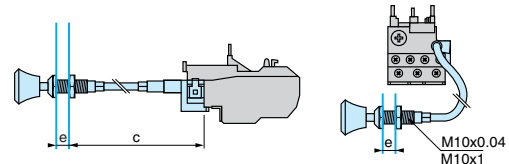

Separate mounting

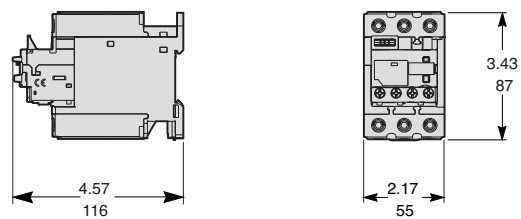

LR2D2, LR3D2
Separate mounting at 50 mm (1.97 in.) centers or on AM1DP200 or DE200 rail

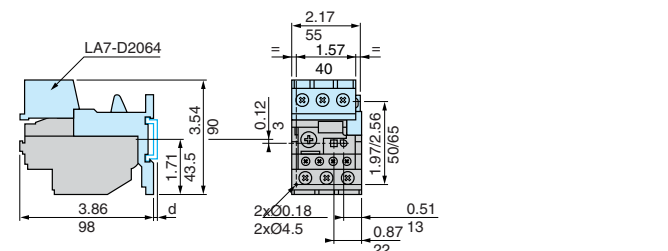

LR2D2, LR3D2
Separate mounting at 110 mm (4.33 in.) centers


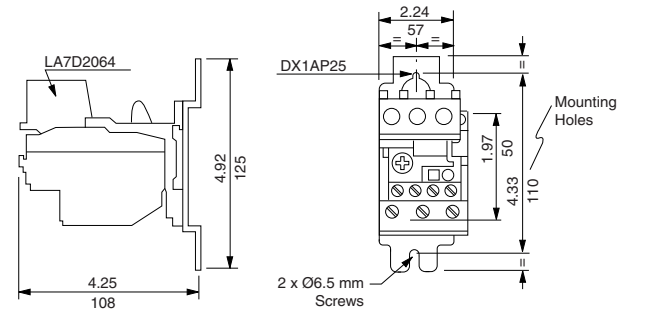



Table 18.174: TeSys D Thermal Overload Relay Dimensions, in. (mm)

LRD-01-35
Direct mounting beneath contactors with screw

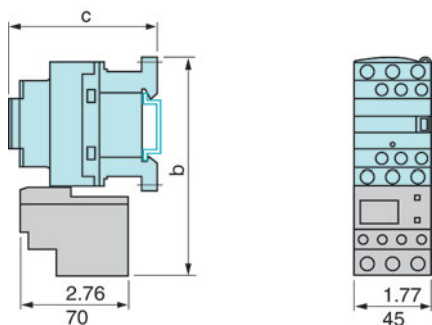


LC1*	D09–D18	D25–D38
b	4.84 (123)	5.39 (137)
c	See Catalog 8502CT9901 pages 122, 123.	

LRD-013-353
Direct mounting beneath contactors with spring terminal connections

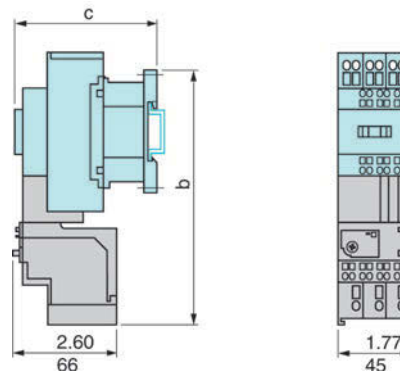


LC1*	D093–383
b	4.84 (123)
c	See Catalog 8502CT9901 pages 122, 123.

LRD-3***
Direct mounting beneath contactors LC1-D40 to D95 and LP1-D40 to D80

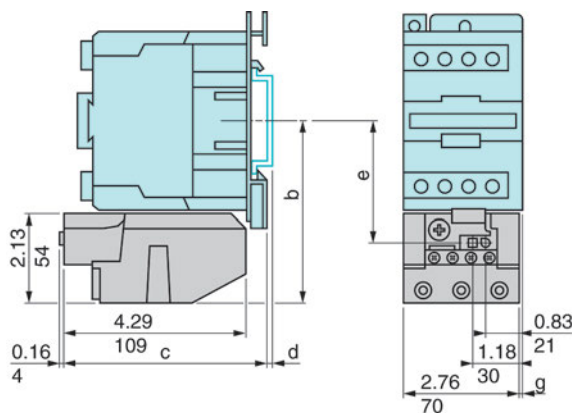


AM1*	DL201	DL200				
		0.67 (17)				
d	0.28 (7)	b	c	e	g(3P)	g(4P)
AC Control Circuit						
LC1D80	4.55 (115.5)	4.88 (124)	3.03 (76.9)	0.37 (9.5)	0.87 (22)	—
LC1D95	4.55 (115.5)	4.88 (124)	3.03 (76.9)	0.37 (9.5)	—	—
DC Control Circuit						
LC1D40, LP1D40	4.37 (111)	6.93 (176)	2.85 (72.4)	0.18 (4.5)	0.51(13)	—
LC1D50	4.37 (111)	6.93 (176)	2.85 (72.4)	0.18 (4.5)	—	—
LC1D65, LP1D65	4.37 (111)	6.93 (176)	2.85 (72.4)	0.18 (4.5)	0.51(13)	—
LC1D80, D95, LP1D80	4.55 (115.5)	7.06 (179.4)	3.03 (76.9)	0.37 (9.5)	0.87(22)	—

LRD4***
Direct mounting beneath contactors LC1D115 and D150

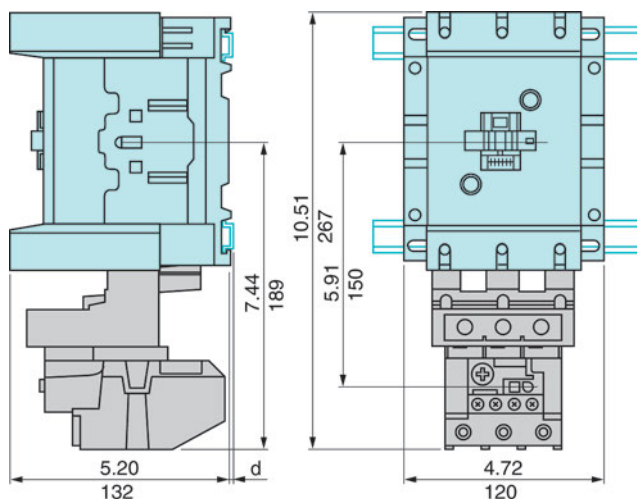

d	AM1DL200 and DR200	AM1DE200 and ED***
d	0.10 (2.5)	0.41 (10.5)


LR9D
Direct mounting beneath contactors LC1D115 and D150

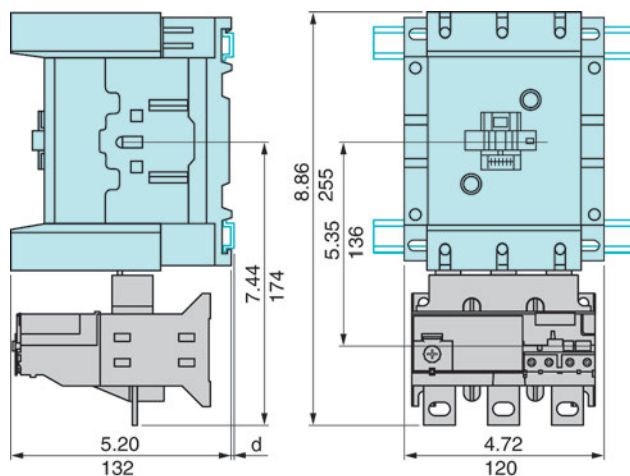




d	AM1DP200 and DR200	AM1DE200 and ED***
d	0.10 (2.5)	0.41 (10.5)

▲ For additional specifications and selection information, see catalog 8502CT9901

Table 18.175: TeSys F Overload Relay Dimensions

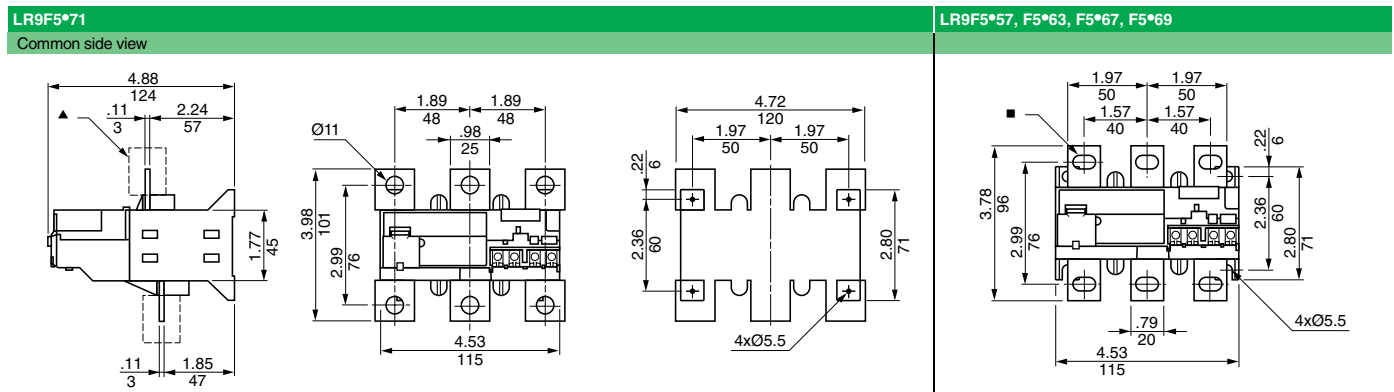

- ▲ Terminal shroud LA9F70*
- 6.5 x 13.5 for LR9F5*57 and 8.5 x 13.5 for LR9F5*63, F5*67, F5*69

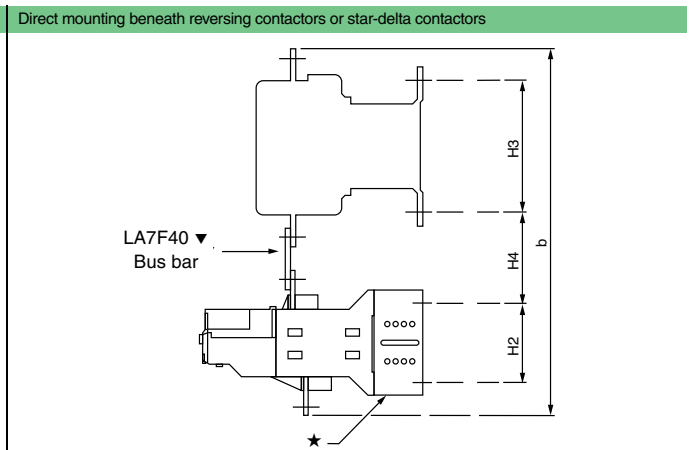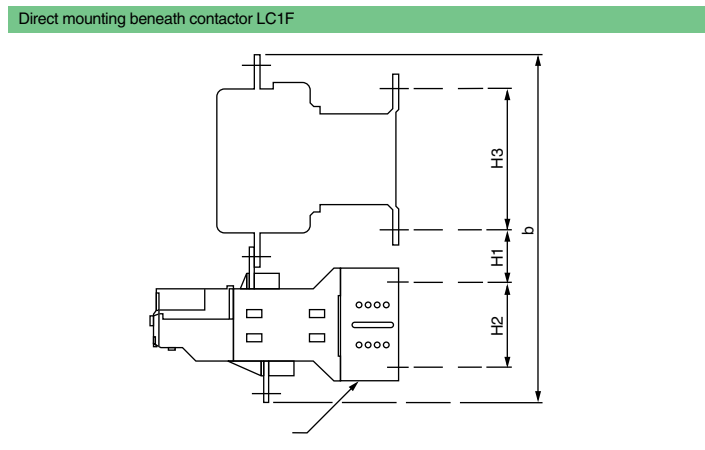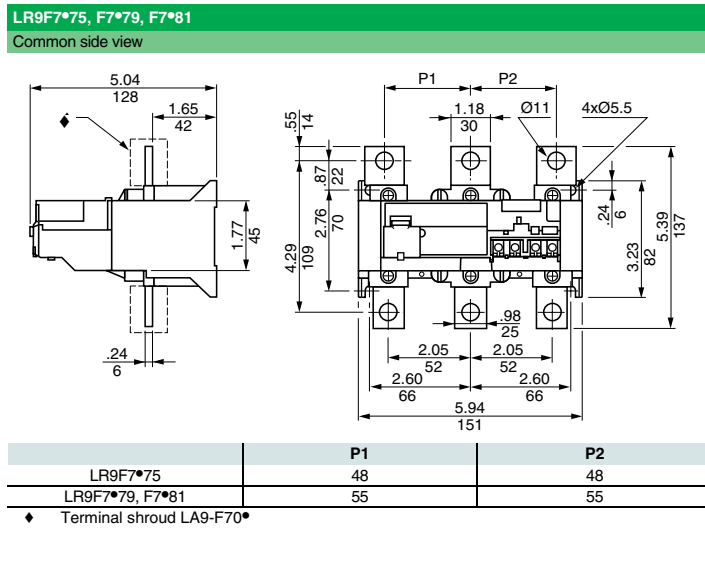

LC1 contactors	With LR9 relays	b	H1	H2	H3	LC1 contactors	With LR9 relays	b	H4	H2	H3
F115	F5*57, F5*63, F5*67, F5*69	240	30	76	120	F115	F5*57, F5*63, F5*67, F5*69	279	60	76	120
F150	F5*57, F5*63, F5*67, F5*69	246	30	76	120	F150	F5*57, F5*63, F5*67, F5*69	283	60	76	120
F185	F5*57, F5*63, F5*67, F5*69	250	30	76	120	F185	F5*57, F5*63, F5*67, F5*69	285	60	76	120
F225	F5*71	273	40	76	120	F225	F5*71	319	80	76	120
	F7*75, F7*79	308	50	108.8	120		F7*75, F7*79	360	100	108.8	120
F265	F5*71	279	40	76	120	F265	F5*71	332	90	76	120
	F7*75, F7*79	314	60	108.8	120		F7*75, F7*79	363	100	108.8	120
F330	F7*75, F7*79	317	60	108.8	120	F330	F7*75, F7*79	364	100	108.8	120
F400	F7*75, F7*79, F7*81	317	60	108.8	180	F400	F7*75, F7*79, F7*81	364	100	108.8	180
F500	F7*75, F7*79, F7*81	346	70	108.8	180	F500	F7*75, F7*79, F7*81	390	110	108.8	180
F630	F7*81	510	110	108.8	180	F630	F7*81	509	120	108.8	180

- ★ Relay mounting plate, see page 18-16.
- ▼ Connection accessories, see page 18-16.

Table 18.176: TeSys D Combination Starter Dimensions, Reversing and Non-Reversing


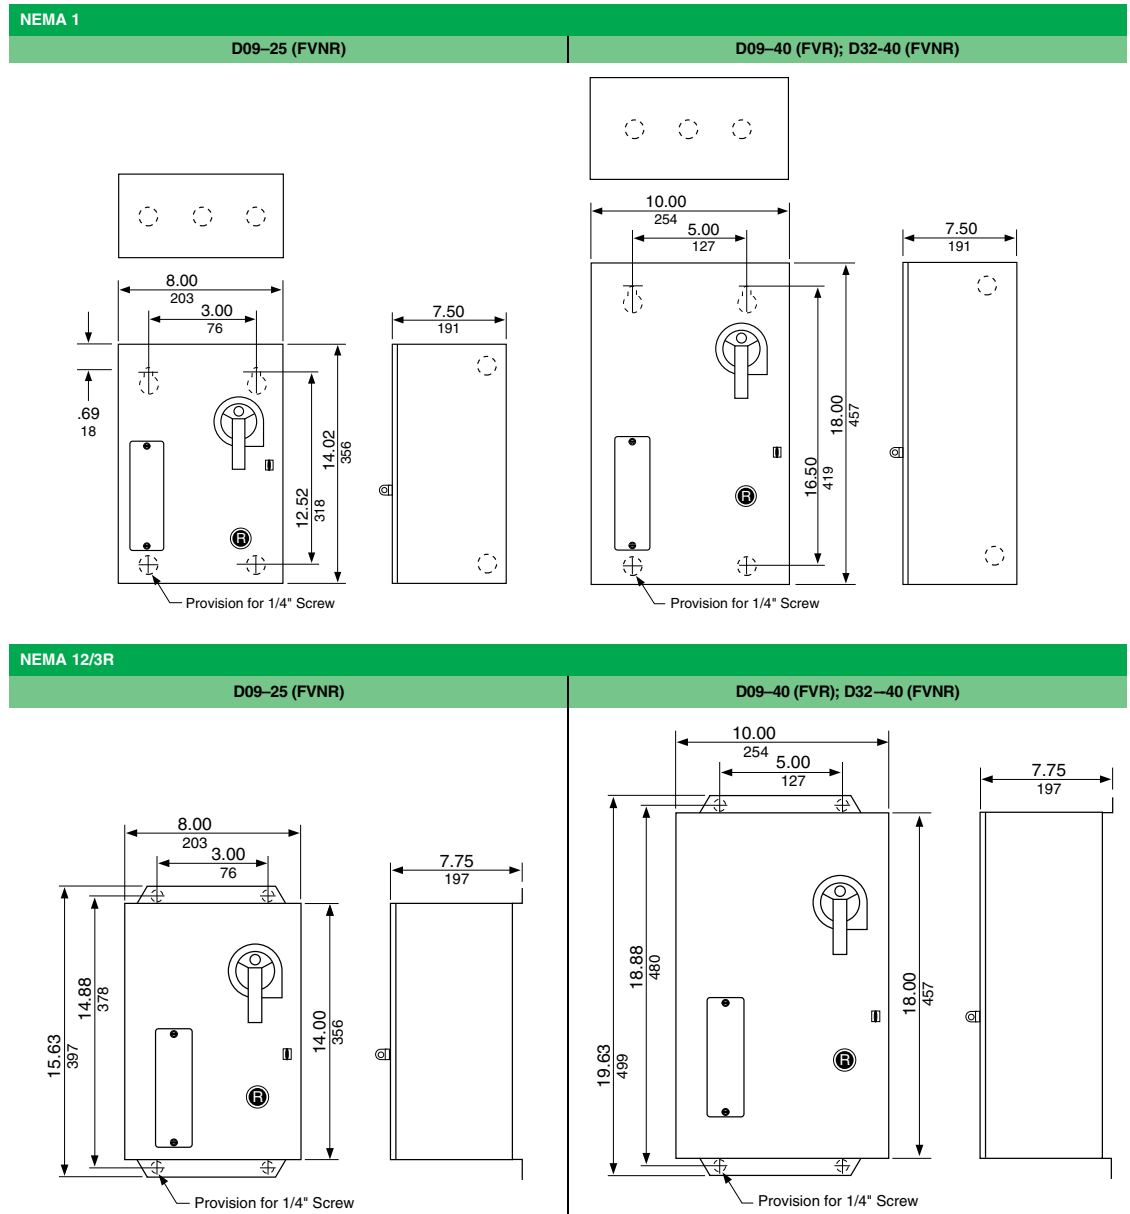


Table 18.177: Non-Combination Starter Dimensions

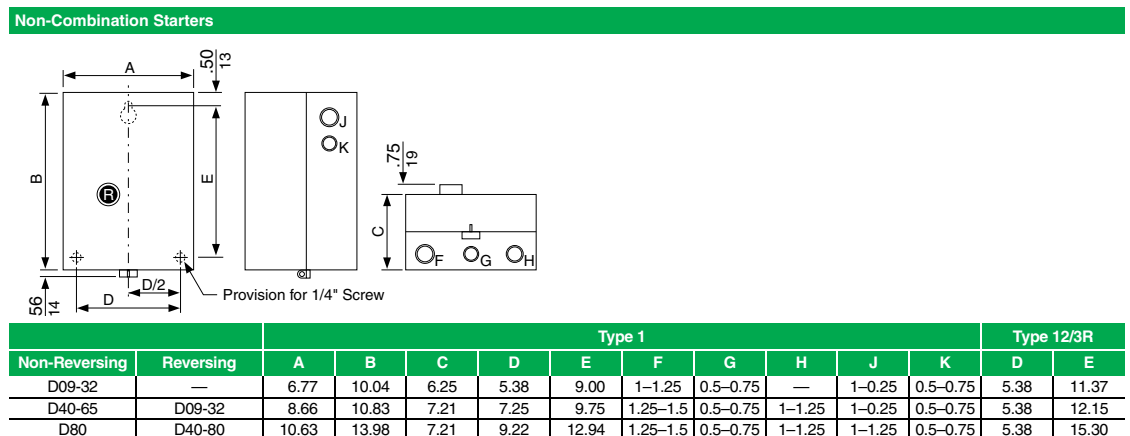

Note: All dimensions in inches.

Table 18.178: TeSys K Contactor Dimensions










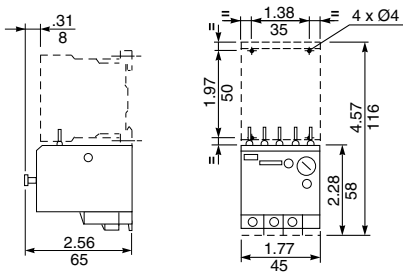


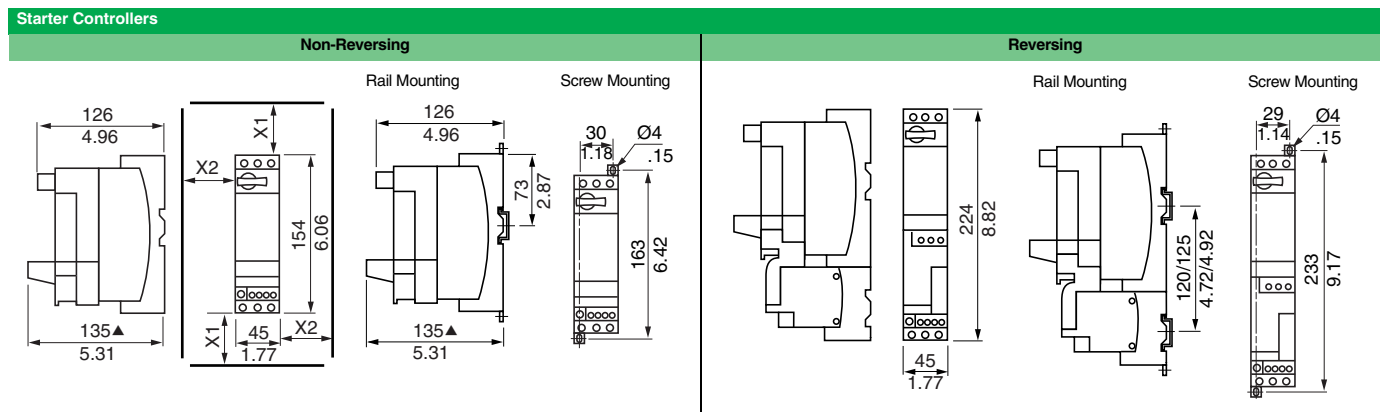
<p>LR2K Direct mounting under the contactor</p>	<p>Separate mounting with LA7-K0064 terminal block on 35 mm rail (AM1DP200 or AM1DE200)</p>
 <p>Technical drawing showing dimensions for LR2K direct mounting. Dimensions include: 31, 8, 2.56, 65, 1.97, 50, 1.38, 35, 4 x Ø4, 4.57, 116, 2.28, 58, 1.77, 45.</p>	 <p>Technical drawing showing dimensions for LR2K separate mounting. Dimensions include: 1.50, 38, 3.15, 80, 2.95, 75, 3.09 (DP200), 78, 3.38 (DE200), 86, 1.77, 45.</p>
<p>Three-phase</p>  <p>Wiring diagram for a three-phase motor. It shows three phases (1, 2, 3) connected to a motor. A test point is labeled 'Test' and a reset/stop point is labeled 'Reset/Stop'. Terminals are labeled A, H, J, 95, 96, 97, 98.</p>	<p>Wiring Scheme</p>  <p>Wiring scheme diagram showing terminal connections for a three-phase contactor. Terminals are labeled 1, 2, 3, 4, 5, 6, 13, 14, A1, A2, 95, 96, 97, 98. It also shows internal links and a control circuit with a stop button and a test button.</p>
<p>LC1, LP1, LP4K Mini-contactors On baseplate</p>	<p>LC2, LC8, LP2, LP5K Reversing mini-contactors On baseplate</p>
 <p>Technical drawing showing dimensions for LC1, LP1, LP4K mini-contactors on a baseplate. Dimensions include: LA1-K, 4 x Ø4, 2.28, 58, 1.97, 50, 1.22, 31, 2.24, 57, 1.38, 35, 1.77, 45.</p>	 <p>Technical drawing showing dimensions for LC2, LC8, LP2, LP5K reversing mini-contactors on a baseplate. Dimensions include: LA1-K, 8 x Ø4, 2.28, 58, 1.22, 31, 2.24, 57, 3.15, 80, 3.54, 90, 1.97, 50.</p>
<p>On AM1DP200 or DE200 rail (35 mm)</p>  <p>Technical drawing showing dimensions for LC1, LP1, LP4K mini-contactors on an AM1DP200 or DE200 rail. Dimensions include: 2.28, 58, 2.24, 57, 1.77, 45.</p>	<p>On AM1DP200 or DE200 rail (35 mm)</p>  <p>Technical drawing showing dimensions for LC2, LC8, LP2, LP5K reversing mini-contactors on an AM1DP200 or DE200 rail. Dimensions include: 2.28, 58, 2.24, 57, 3.54, 90.</p>
<p>On printed circuit board</p>  <p>Technical drawing showing dimensions for LC1, LP1, LP4K mini-contactors on a printed circuit board. Dimensions include: .34, 9, 2.28, 58, 1.97, 50, 2.05, 52, 10 x Ø.051, 10 x Ø1.3, 1.77, 45, A1, A2.</p>	<p>On printed circuit board for reversing contactors or 2 mini-contactors side-by-side</p>  <p>Technical drawing showing dimensions for LC2, LC8, LP2, LP5K reversing mini-contactors on a printed circuit board. Dimensions include: .34, 9, 2.28, 58, 1.97, 50, 2.05, 52, 20 x Ø.051, 20 x Ø1.3, 1.77, 45, A1, A2.</p>
<p>LA2KT Electronic time delay contact blocks</p>  <p>Technical drawing showing dimensions for LA2KT electronic time delay contact blocks. Dimensions include: 1.34, 34, 1.50, 38, 1.06, 27.</p> <p>Dual Dimensions: INCHES Millimeters</p>	<p>On mini-contactors or reversing mini-contactors</p>  <p>Technical drawing showing dimensions for LA2KT electronic time delay contact blocks mounted on mini-contactors or reversing mini-contactors. Dimensions include: LA2-KT, 2.28, 58, 1.34, 34, 2.24, 57.</p>


Table 18.179: TeSys U Starter Dimensions

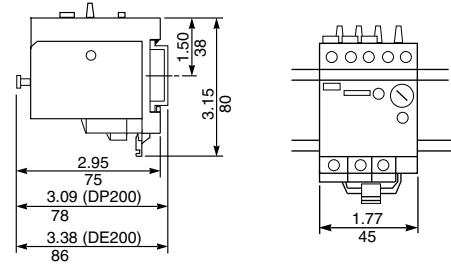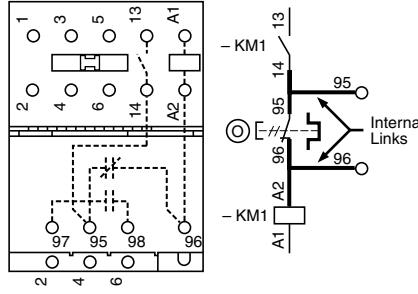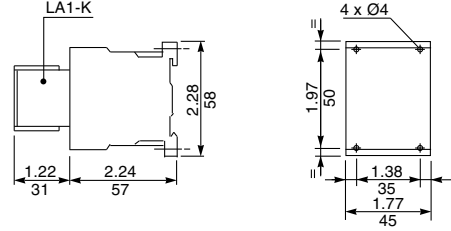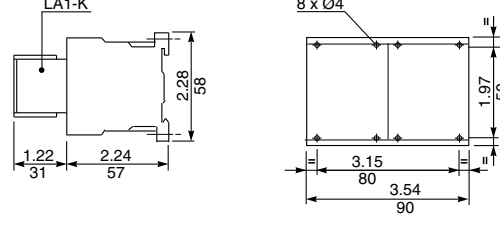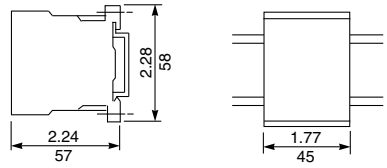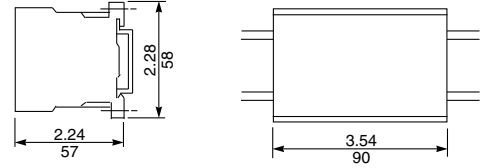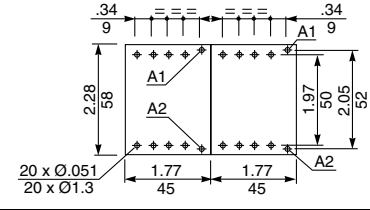


Note: Minimum electrical clearance:
X1: 35 mm for Ue = 440 V; and 70 mm for Ue = 500 and 690 V
X2: 0

▲ Maximum depth (with Modbus™ communication module)

Reversing Block for Mounting Separately from Power Base

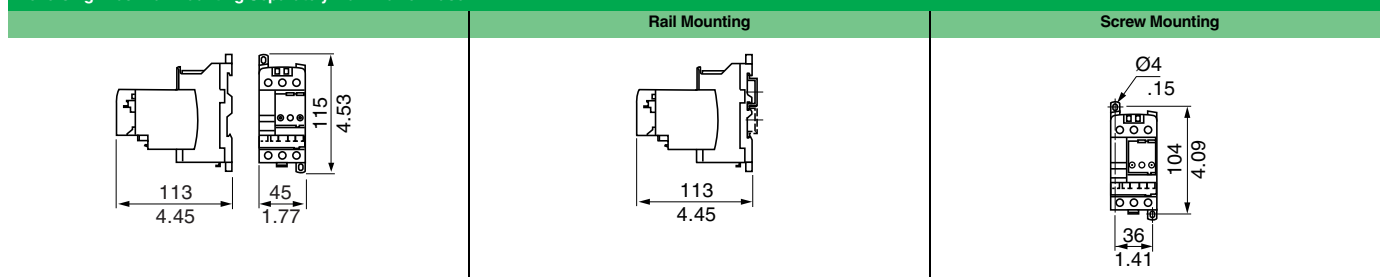

Limiter Disconnecter LUALB1

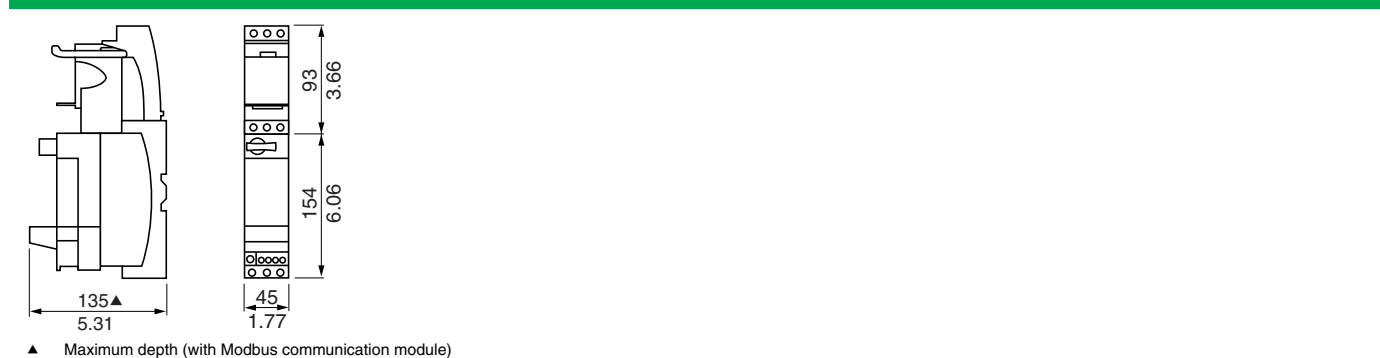

Door interlock Mechanisms



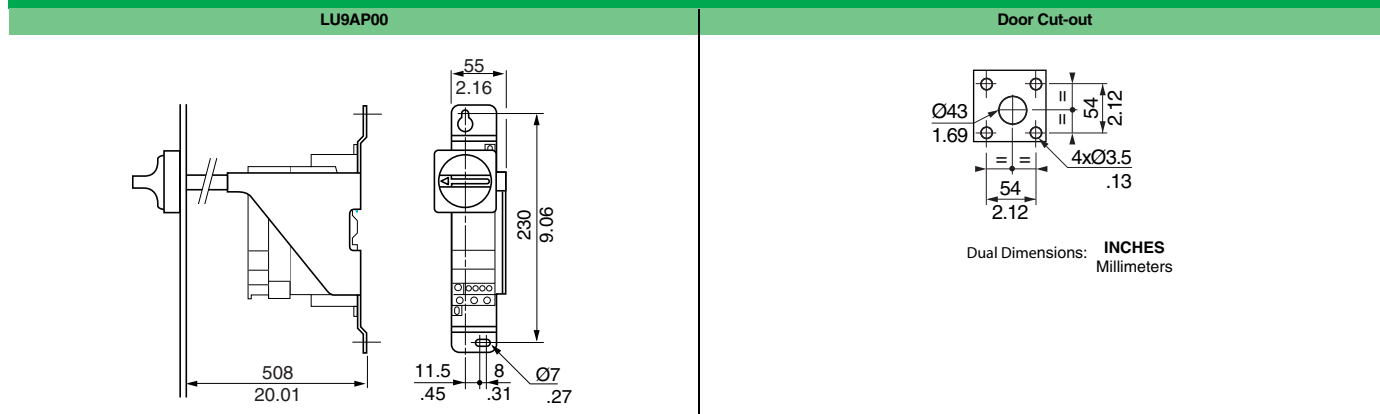


Table 18.180: Altistart U01 and TeSys U Soft Starters


**TeSys U Combination
(non-reversing power base) and
ATSU01N212LT**
Mounting on (35mm) rail with VW3 G4104 connector

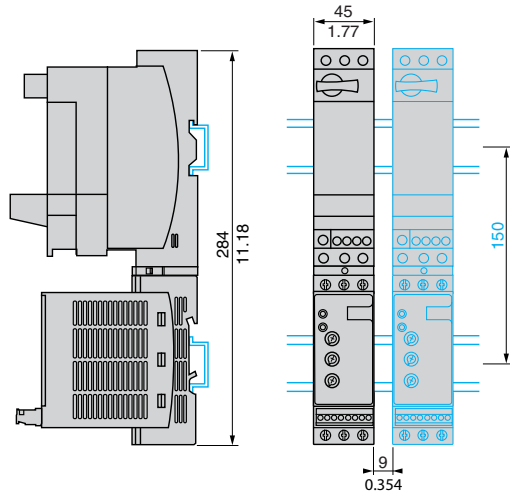


**TeSys U Combination
(non-reversing or reversing power base) and
ATSU01N2206LT to ATSU01N212LT**
Side-by-side mounting

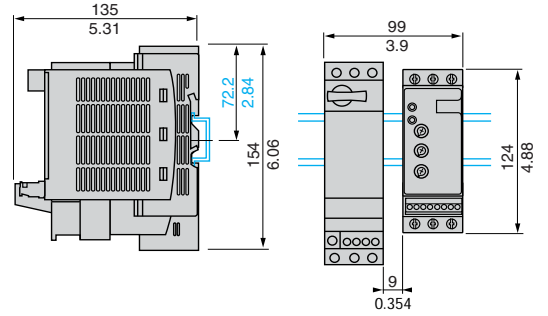

**TeSys U Combination
(non-reversing power base) and
ATSU01N222LT to ATSU01N232LT**
Mounting on (35mm) rail with VW3G4104 connector

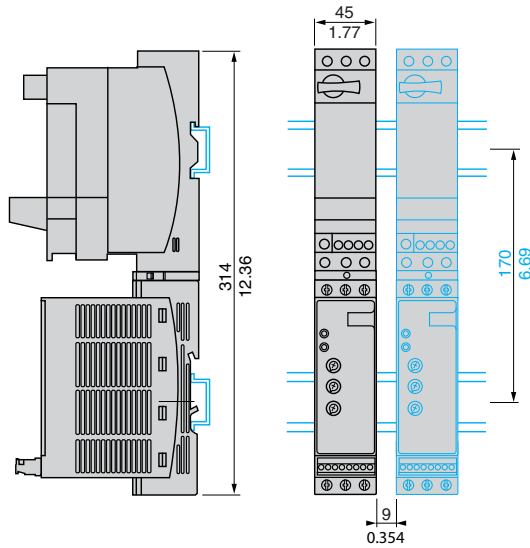

**TeSys U Combination
(non-reversing or reversing power base) and
ATSU01N222LT to ATSU01N232LT**
Side-by-side mounting

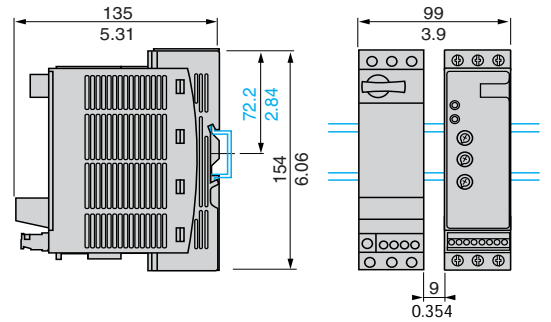

VW3G4104 Power Connector

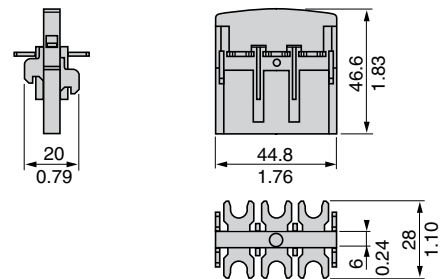


Table 18.181: TeSys GV2 and GV3 Manual Starter and Protector Dimensions

GV2M	GV2AD, AM, AN, AU, AS, AX	GV2AE	Mounting of GV2M
			<p>On 35 mm \perp rail C = 78.5 mm (3.09") on AM1DP200 (35 x 7.5 mm) C = 86 mm (3.39") on AM1DE200, ED200 (35 x 15 mm)</p>

GV2P	GV2AD, AM, AN, AU, AS, AX	GV2AK00	Mounting of GV2P
			<p>On 35 mm \perp rail C = 98.5 mm (3.88") on AM1DP200 (35 x 7.5 mm) C = 106 mm (4.17") on AM1DE200, ED200 (35 x 15 mm)</p>

GV2AF4 + LAD31 Combination GV2ME + TeSys D range contactor	GV2P + LAD31 Combination GV2P + TeSys D range contactor	GV2P + GV2GH7 for UL 508 Type E application	GV2P + GV2GH7 + TeSys D contactor for UL 508 Type E application

GV2ME +	LC2D09 to D18	LC2D25 and D32	GV2P +	LC2D09 to D18	LC2D25 and D32
b	7.4 (188.6)	7.8 (199)	b	6.61 (168.1)	7.9 (199.5)
c1	3.6 (92.7)	3.9 (99)	c1	4.6 (116.8)	4.6 (116.8)
c	3.9 (98.2)	4.11 (104.5)	c	4.8 (122.3)	4.8 (122.3)
d1	3.9 (98.3)	3.9 (98.3)	—	—	—
d	4.1 (103.8)	1.4 (103.8)	—	—	—


Surface mounting enclosure GV2MC0	Flush mounting enclosure GV2MP0 (bracket cut-out)
<p>▲ 4 knock-outs for 16 mm plastic cable glands or no. 16 conduit.</p>	

GV2	b		b1	
	in.	mm	in.	mm
MP01, MP02	5.51	140	5.00	127
MP03, MP04	5.24	133	4.61	117


Table 18.182: TeSys GV2 and GV3 Manual Starter and Protector Dimensions (cont'd)

GV2M with GK2AF01 and LC1K	GV2M with GV2AF01 and LC1K	GV2M with GV2AF01 and LC2K	Adapter Plate GK2AF01
----------------------------	----------------------------	----------------------------	-----------------------


Dimensions (mm)

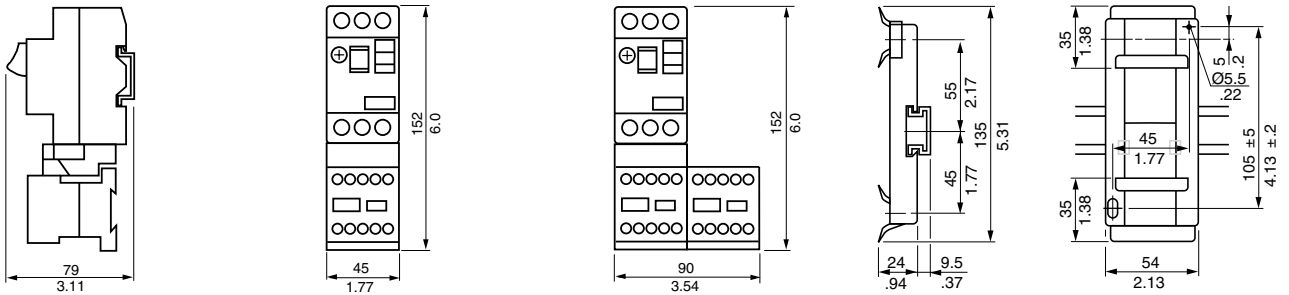

Mounting external operator GV2AP0*	Door cut-out	GV2M on panel with GV2AF02 adapter plate	7.5 mm height compensation plate GV1F03
------------------------------------	--------------	--	---

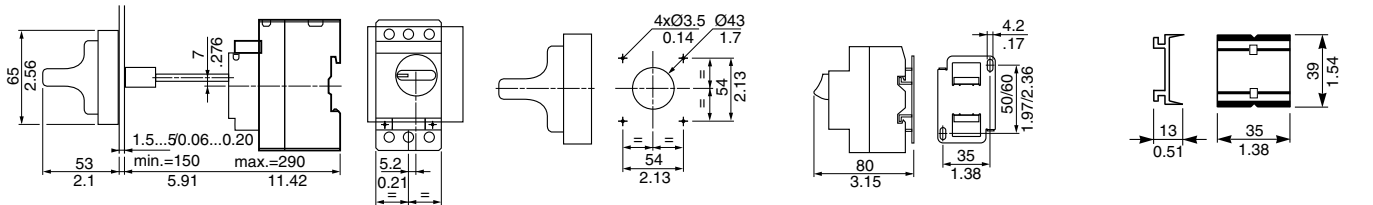


Sets of bus bars, GV2G445, GV2G454, GV2G472 with terminal block GV2G05	Sets of bus bars with terminal block GV1G09	Sets of bus bars GV2G245, GV2G254, GV2G272
--	---	--

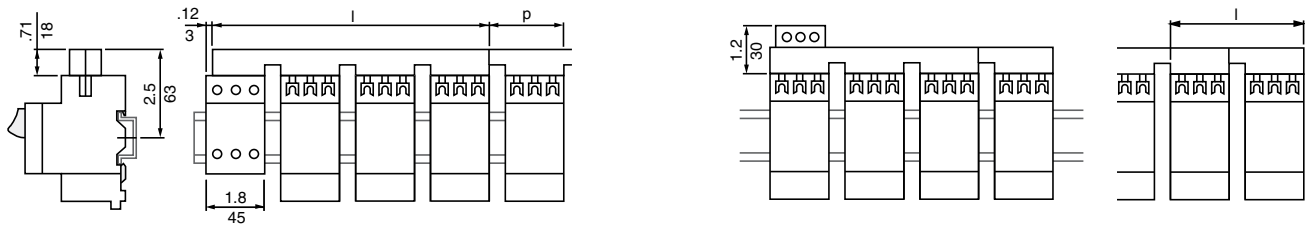

		I	P
GV2G445	0.16 x 1.8 in. (4 x 45 mm)	7.0 in. (179 mm)	1.8 in. (45 mm)
GV2G454	0.16 x 2.1 in. (4 x 54 mm)	8.1 in. (206 mm)	2.1 in. (54 mm)
GV2G472	0.16 x 1.8 in. (4 x 45 mm)	10.2 in. (260 mm)	2.8 in. (72 mm)

		I
GV2G245	0.08 x 1.8 in. (2 x 45 mm)	3.5 in. (89 mm)
GV2G254	0.08 x 2.1 in. (2 x 54 mm)	3.9 in. (98 mm)
GV2G272	0.08 x 2.8 in. (2 x 72 mm)	4.6 in. (116 mm)
GV2G354	0.12 x 2.1 in. (3 x 54 mm)	6.0 in. (152 mm)


GV3P	Dimensions	Mounting on rail AM1 DE200 or AM1 ED201
------	------------	---

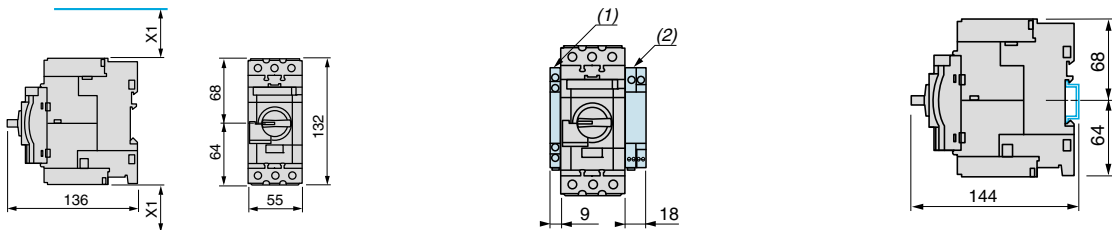

X1 = Electrical clearance (ISC max)
40 mm for Ue < 500 V; 50 mm for Ue < 690 V


Blocks GV AN**, GV AD**, GV AM11
Block GV3 AU** and GV3 AS**

Mounting on panel, using M4 screws	Mounting on pre-slotted mounting plate AM1PA
------------------------------------	--

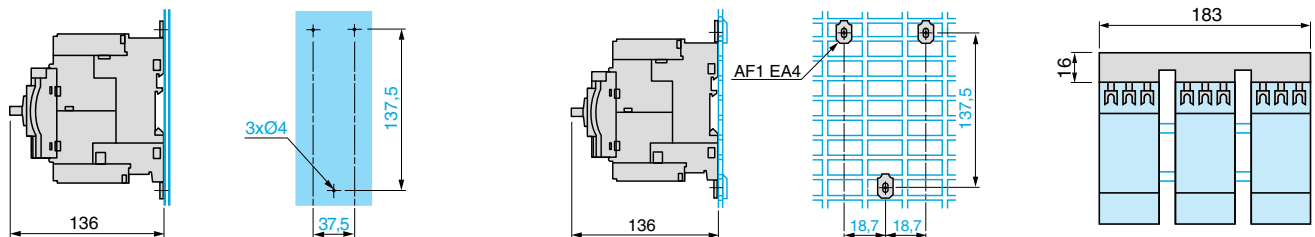


Note: Leave a space of 9 mm between 2 manual motor protectors: either an empty space or side-mounting add-on contact blocks. Horizontal mounting is possible: please consult your regional sales office.


Table 18.183: TeSys GV7 Manual Starter and Protector Dimensions

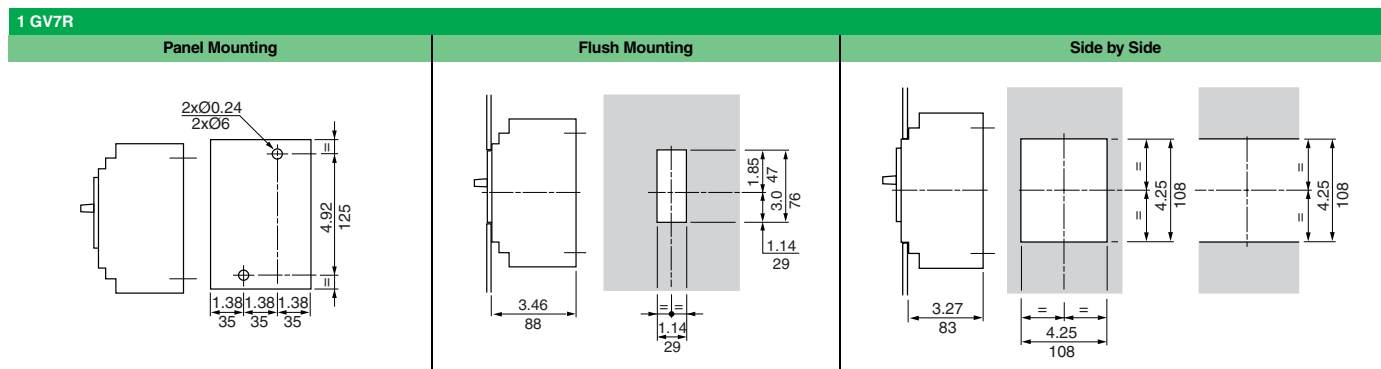

Minimum Clearance	x1		x2	
	in. (mm)		in. (mm)	
Painted or insulated metal plate, insulation or insulated bar	U ≤ 440 V		0 (0)	
	440 V < U < 600 V		0.20 (5)	
Bare metal plate	U ≤ 440 V		1.38 (35)	
	U ≥ 600 V		0.39 (10)	



Note: Minimum distance between 2 units mounted side by side = 0.

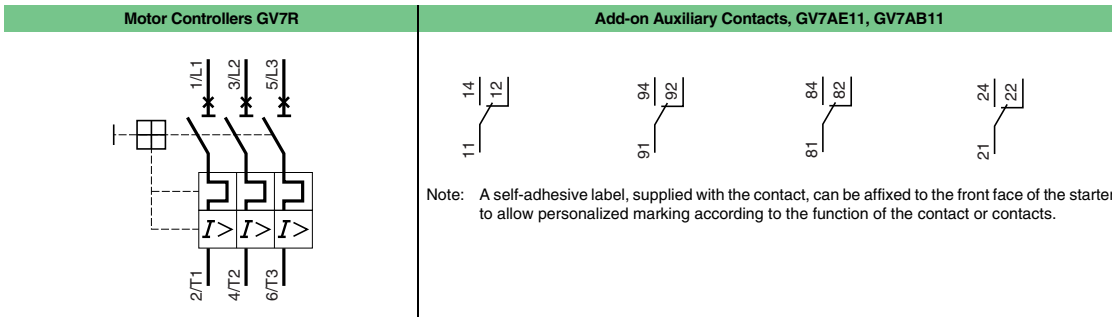

Note: A self-adhesive label, supplied with the contact, can be affixed to the front face of the starter to allow personalized marking according to the function of the contact or contacts.



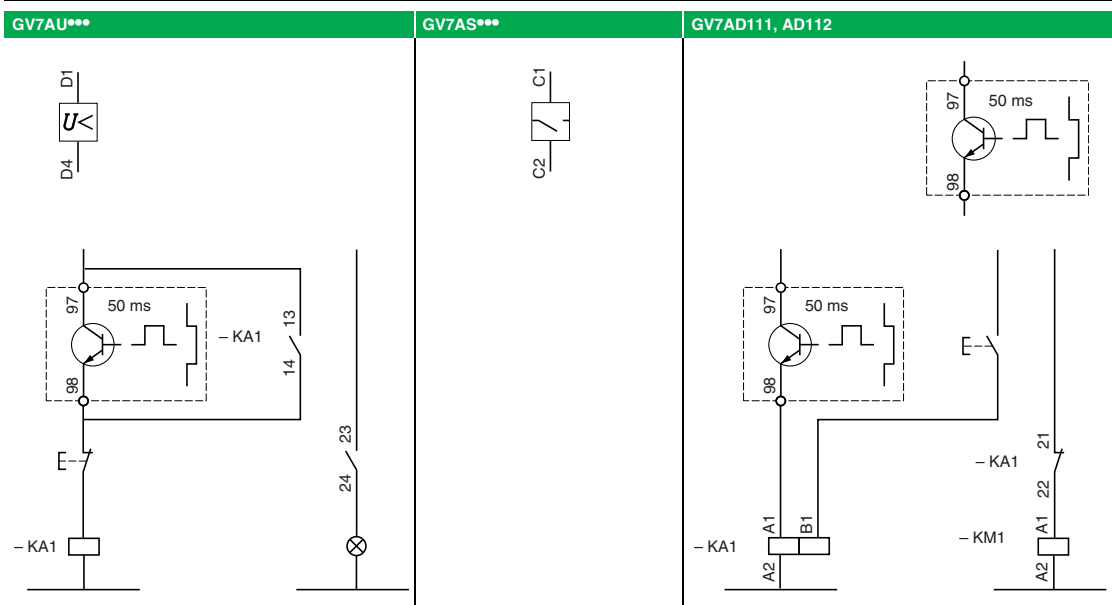


Table 18.184: TeSys GV7 Manual Starter and Protector Dimensions (cont'd)

GV7AC03							
Spreaders							
Cabling	Smooth Terminals						
<table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th colspan="2" style="background-color: #d9e1f2;">a (in./mm)</th> </tr> </thead> <tbody> <tr> <td>GV7R●</td> <td>0.77/19.5</td> </tr> <tr> <td>GV7R●220</td> <td>0.85/21.5</td> </tr> </tbody> </table>		a (in./mm)		GV7R●	0.77/19.5	GV7R●220	0.85/21.5
a (in./mm)							
GV7R●	0.77/19.5						
GV7R●220	0.85/21.5						
GV7AP03, GV7A04							
Direct Rotary Handle	Flush Mounting						

Table 18.185: TeSys GV7 Manual Starter and Protector Dimensions (cont'd)

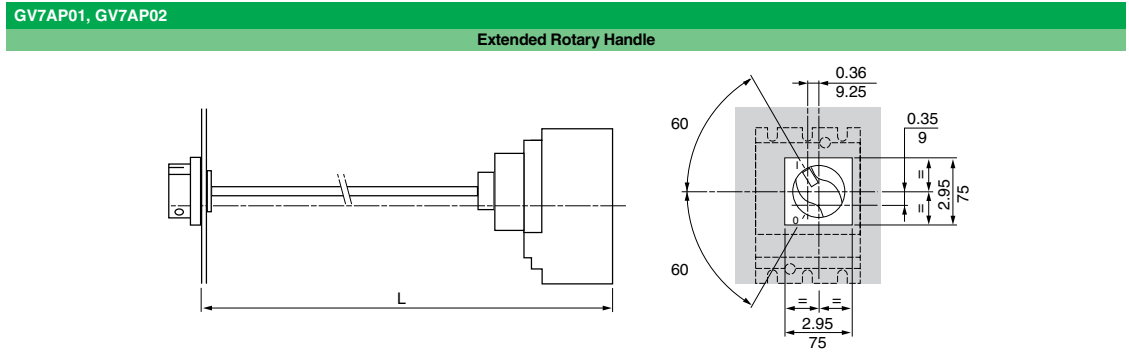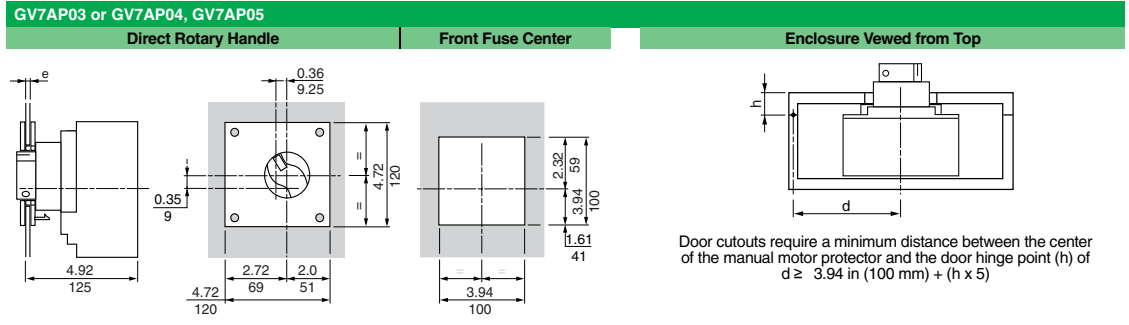

L: 7.28 in. (185 mm) minimum, 23.62 in. (600 mm) maximum.
The shaft of the extended rotary handle GV7AP01 or GV7AP02 must be cut to length: $L - 4.96 \text{ in. (126 mm)}$

TeSys U Self-Protected combination starters combine the requirements of motor overload and short-circuit protection into one compact package. These next-generation starters offer superior performance, efficiency, and a unique modular design to fit your needs with optional communication and predictive maintenance capabilities. They are UL listed, easy to install and maintain.

In order to select a TeSys U Self-Protected combination starter, follow the 5-step process described below.

1. Choose a base configuration

Table 18.186: Base Configurations

Motor Voltage (V)	Ratings		Max. Current (A)	Type 1/12/3R enclosure				Type 4/4X enclosure			
	Max. HP			Non-reversing starter		Reversing starter		Non-reversing starter		Reversing starter	
	Single phase	Three-phase		Base Configuration Number	\$ Price	Base Configuration Number	\$ Price	Base Configuration Number	\$ Price	Base Configuration Number	\$ Price
115	1.5		12	LE1U16	1917.00	LE2U16	2673.00	LE1U19	2112.00	LE2U19	2868.00
230	2										
200		3									
230		3									
460		7.5									
575		10									
115	2		32	LE1U36	2115.00	LE2U36	2871.00	LE1U39	2310.00	LE2U39	3066.00
230	5										
200		10									
230		10									
460		20									
575		25									



Type 1/12/3R enclosure



Type 4/4X enclosure

2. Choose Thermal Overload Relay (Plug-in Control Unit)



The thermal overload relay is a control unit that plugs into the TeSys U starter. No tool is needed to install or remove the control unit.

If you do not wish to select the thermal overload relay at this time, select Thermal Overload Relay Type codes N1 or N3 in function of the motor configuration (single phase or 3-phase) in Table 18.187. A thermal overload relay can be selected and ordered later on independently before installation.

In order to select a thermal overload relay, you must follow the next 2 steps. First, select the thermal overload protection type code in Table 18.187. Secondly, select the full load amperage code in Table 18.188.

2.1 Choose the thermal overload protection type.

Table 18.187: Thermal Overload Protection Types

	Advanced Control Unit			Multifunction Control Unit	No Control Unit (Ordered later on independently)	
					Single Phase	3-Phase
\$ Price	180.00			738.00	—	
Thermal Overload Protection Type Code	A▲	B▲	C▲	D▲	N1	N3
Protection Type						
Single phase, Class 10	■					
3-phase, Class 10		■				
3-phase, Class 20			■			
3-phase, Selectable Class 5–30				■		
Protection Functions						
Short circuit	■	■	■	■		
Over current	■	■	■	■		
Thermal overload	■	■	■	■		
Phase loss		■	■	■		
Phase imbalance		■	■	■		
Ground fault	■	■	■	■		
Underload, long start, jam	◆	◆	◆	■		
Control Functions						
Automatic or local/remote reset	◆	◆	◆	■		
Fault differentiation	◆	◆	◆	■		
Thermal alarm	◆	◆	◆	■		
Motor load display	◆	◆	◆	■		
Fault history				■		
Alarm threshold adjustment				■		
Tripping test	■	■	■	■		

▲ Complete the Thermal Overload Relay Selection by adding the full load amperage code after the thermal overload protection type code.
 ■ Built-in Control Unit.
 ◆ Available when combined with appropriate Function module.

2.2 Choose the Motor Full Load Amperage

Table 18.188: Full Load Amperage Code

Full Load Amperage Setting Range (A)	Full Load Amperage Code
0.15–0.6	A
0.3–1.4	B
1.25–5.0	C
3–12	D
4.5–18	E
8–32	F

3 Choose the Control Power Source

Table 18.189: Control Power Source Code

Control Circuit Source	System Type	Motor Voltage		Control Voltage		Control Power Source Code	\$ Price		
		Voltage	Voltage Type	Voltage	Voltage Type				
Common Control	Single Phase	120	AC	120	AC	G7	—		
		240	AC	240	AC	U7	—		
	Three-Phase	208	AC	208	AC	LE7	—		
		240	AC	240	AC	U7	—		
Separate Control	Single Phase	120	AC	24	AC	B7▲	—		
		120	AC	24	DC	BD▲	—		
		120	AC	120	AC	G7▲	—		
		240	AC	24	AC	B7▲	—		
		240	AC	24	DC	BD▲	—		
		240	AC	120	AC	G7▲	—		
	Three-Phase	208	AC	24	AC	B7▲	—		
		208	AC	24	DC	BD▲	—		
		208	AC	120	AC	G7▲	—		
		240	AC	24	AC	B7▲	—		
		240	AC	24	DC	BD▲	—		
		240	AC	120	AC	G7▲	—		
		480	AC	24	AC	B7▲	—		
		480	AC	24	DC	BD▲	—		
		480	AC	120	AC	G7▲	—		
		600	AC	24	AC	B7■	—		
		600	AC	24	DC	BD■	—		
		600	AC	120	AC	G7■	—		
		Factory Installed Control Power Transformer ♦	Single Phase	120	AC	24	AC	V89	698.
				240	AC	120	AC	V80	698.
240	AC			24	AC	V82	698.		
Three-Phase	208		AC	24	AC	V90	698.		
	208		AC	120	AC	V84	698.		
	240		AC	24	AC	V82	698.		
	240		AC	120	AC	V80	698.		
	480		AC	24	AC	V83	698.		
	480		AC	120	AC	V81	698.		
	600		AC	24	AC	V91	698.		
	600		AC	120	AC	V86	698.		
	Factory Installed Power Supply ★		Single Phase	120	AC	24	DC	BD1	698.
				240	AC	24	DC	BD2	827.
				208	AC	24	DC	BD2	827.
Three-Phase	240	AC	24	DC	BD2	827.			
	480	AC	24	DC	BD2	827.			
	600	AC	24	DC	BD6	1072.			

- ▲ Form S must be added at the end of the catalog number.
- Form S6 must be added at the end of the catalog number. Current limiter is provided and factory installed.
- ♦ Two fuses in primary and one fuse in secondary provided as standard.
- ★ Fuse holder with 2 fuses provided as standard.

4 Choose Communication Type

If you do not need communication capabilities, select communication code N.

If a Communication protocol is selected, Control Voltage must be 24 Vdc (Control Power Source Codes BD, BD1, BD2 or BD6 only. Refer to Table 18.189).

If additional I/O is needed with communication, select communication code N in Table 18.190 and choose between Forms W10, W11, W12, W13 and W14 in Table 18.204.

Table 18.190: Communication Code

Communication Protocol	Communication Code	\$ Price
Modbus	M	262.00
Modbus TCP/IP	E	712.00
CANopen	C	262.00
DeviceNet	D	262.00
Beckhoff	B	262.00
Profibus	P	262.00
Advantys STB	A	262.00
AS-interface	J	226.00
AS-interface V2	K	226.00
No Communication	N	—

5 Choose Factory Modifications

When choosing Factory modifications, the Form code must be added at the end of the catalog number. If several forms are selected, they must be arranged in alphabetical order. There are two types of Forms available: abbreviated forms and standard forms.

5.1 Abbreviated Forms

Abbreviated forms are defined combinations of the most commonly ordered standard forms and are part of the profiled configurations with short lead time. For example, abbreviated form CP1 is a combination of standard forms C and P51.

Abbreviated forms cannot be mixed with other standard forms, with the exceptions of forms S and S6. If your combination of forms is not available as an abbreviated form, use only standard forms and arrange them in alphabetical order. For example, LE1U16BDG7NCP1S is a valid catalog number with the abbreviated form CP1. If you want to add standard Form P68, the valid catalog number becomes LE1U16BDG7NCP51P68S. LE1U16BDG7NCP1P68S is invalid because abbreviated form CP1 cannot be used with standard form P68.

Table 18.191: Abbreviated Forms

Factory Modifications	Form	\$ Price
Hand/Off/Auto Selector Switch + Red ON LED Standard Pilot Light	CP1	344.00
Hand/Off/Auto Selector Switch + Green ON LED Standard Pilot Light	CP2	344.00
Hand/Off/Auto Selector Switch + Red ON LED Standard Pilot Light + Green OFF LED Standard Pilot Light	C12	516.00
Hand/Off/Auto Selector Switch + Green ON LED Standard Pilot Light + Red OFF LED Standard Pilot Light	C21	516.00
Start/Stop Push Buttons + Red ON LED Standard Pilot Light	AP1	344.00
Start/Stop Push Buttons + Green ON LED Standard Pilot Light	AP2	344.00
Start/Stop Push Buttons + Red ON LED Standard Pilot Light + Green OFF LED Standard Pilot Light	A12	516.00
Start/Stop Push Buttons + Green ON LED Standard Pilot Light + Red OFF LED Standard Pilot Light	A21	516.00
ON/OFF Selector Switch + Red ON LED Standard Pilot Light	C61	344.00
ON/OFF Selector Switch + Green ON LED Standard Pilot Light	C62	344.00
ON/OFF Selector Switch + Red ON LED Standard Pilot Light + Green OFF LED Standard Pilot Light	C66	516.00
ON/OFF Selector Switch + Green ON LED Standard Pilot Light + Red OFF LED Standard Pilot Light	C67	516.00
Red ON LED Standard Pilot Light + Green OFF LED Standard Pilot Light	P12	344.00
Green ON LED Standard Pilot Light + Red OFF LED Standard Pilot Light	P21	344.00

5.2 Standard Forms

Table 18.192: Push Button Forms

Factory Modifications	Form	\$ Price
Start/Stop	A	172.00
Forward/Reverse/Stop	A1	172.00
ON/OFF	A3	172.00
Miscellaneous	A11	172.00
Stop	A13	172.00
Start Push Button + Stop Mushroom Head	A22	172.00
Emergency Stop Mushroom Head	A31	172.00
Turn-To-Release Emergency Stop Mushroom Head	A32	172.00

Table 18.193: Selector Switch Forms

Factory Modifications	Form	\$ Price
Hand/Off/Auto	C	172.00
Start/Stop	C1	172.00
ON/Auto	C2	172.00
ON/OFF	C6	172.00
Hand/Auto	C8	172.00
Forward/OFF/Reverse	C14	172.00
Forward/Reverse	C20	172.00
Three position	C34	172.00
Two position	C35	172.00
Keyed Hand/Off/Auto	C36	376.00
Keyed Start/Stop	C37	376.00
Keyed ON/Auto	C38	376.00
Keyed ON/OFF	C39	376.00
Keyed Forward/Off/Reverse	C43	376.00
Keyed Forward/Reverse	C47	376.00

Table 18.194: 22mm Standard LED Pilot Light Forms

Factory Modifications	Form	\$ Price
Red ON	P51	172.00
Green OFF	P52	172.00
White — Not Factory wired	P54	172.00
Blue — Not Factory wired	P56	172.00
Amber Overload Trip	P68	172.00
Yellow SSC Trip	P69	172.00
Red OFF	P91	172.00
Green ON	P92	172.00
Green Forward/Reverse	P95	344.00
Red Forward/Reverse	P96	344.00

Table 18.195: 22mm Push-To-Test LED Pilot Light Forms

Factory Modifications	Form	\$ Price
Red ON	P42	223.00
Red OFF	P43	223.00
Green ON	P45	223.00
Green OFF	P46	223.00
Blue — Not Factory wired	P66	223.00
White — Not Factory wired	P67	223.00
Green Forward/Reverse	P79	446.00
Red Forward/Reverse	P80	446.00
Amber Overload Trip	P88	223.00
Yellow SSC Trip	P89	223.00

Table 18.196: Separate Control Forms

Factory Modifications	Form	\$ Price
Separate Control for starters with line voltage less or equal to 480 V	S	—
Separate Control for starters with line voltage equal to 600 V — Current Limiter is factory installed.	S6	205.00

Table 18.197: Additional Capacity Forms

NOTE: Fuses are provided. Two fuses in primary and one fuse in secondary.

Factory Modifications	Form	\$ Price
50VA additional capacity	T10	215.00
100VA additional capacity	T11	372.00

Table 18.198: Auxiliary Contact Forms

Factory Modifications	Form	\$ Price
2 N.O.	U8	41.00
1 N.O. and 1 N.C.	U9	41.00
2 N.C.	U10	41.00
1 N.C. fault signaling contact and 1 N.O. contact indicating starter is in "ready" state	U6	41.00
1 N.O. fault signaling contact and 1 N.O. contact indicating starter is in "ready" state	U7	41.00

Table 18.199: Auxiliary Relay Forms

NOTE: Auxiliary Relays are not factory wired.

Factory Modifications	Form	\$ Price
4 poles screw clamp Control Relay — 4 N.O.	R1740	485.00
4 poles screw clamp Control Relay — 3 N.O. and 1 N.C.	R1731	485.00
4 poles screw clamp Control Relay — 2 N.O. and 2 N.C.	R1722	485.00
Programmable Timer Relay	K1070	449.00

Table 18.200: Enclosure Forms

Factory Modifications	Form	\$ Price
Oversized enclosure — Only available for Type 1/12/3R	G28	\$425.00
Plain Blank Door — No covered pre-stamped holes	G30	TAG

Table 18.201: Miscellaneous Forms

Factory Modifications	Form	\$ Price
Nameplate — 2"x1/2" screwed	A241	43.00
Nameplate — 3"x1" screwed	A242	43.00
Unwired Terminal Block	G50▲	57.00
Wired Terminal Block	G56▲■	116.00
Wire markers	G105	675.00
Padlock attachment	G122	75.00
Transient suppressor	U11	47.00
Black IP65 Through the door Rotary Disconnect Handle	G40	50.00
Special factory orders	SPL	TAG
Custom control wiring	Y217	TAG
Solid neutral Terminal Block	N	116.00

- ▲ Add number of terminal block points required. Number must be in increments of 5.
- Wiring diagram must be provided by customer.

Table 18.202: Increase Short Circuit Current Rating Forms

Factory Modifications	Form	\$ Price
130 kA @480 V — Current Limiter factory installed	Y1261	205.00

Table 18.203: Soft Starter Forms

NOTE: Motor Voltage must be equal to or less than 480 Vac and Control Voltage must be 24 Vdc (Control Power Source Codes BD, BD1, or BD2 only. Refer to Table 18.189).

Factory Modifications	Form	\$ Price
Motor FLA ≤ 6A	H1	160.00
6 < Motor FLA ≤ 9A	H2	182.00
9 < Motor FLA ≤ 12A	H3	210.00
12 < Motor FLA ≤ 22A	H4	263.00
22 < Motor FLA ≤ 32A	H5	360.00

Table 18.204: Distributed 6 Input/6 Output Modicon STB with communication Forms

NOTE: Distributed I/O Modicon STB is factory wired.

Factory Modifications	Form	\$ Price
DeviceNet Bus	W10	1340.00
Modbus TCP Bus	W11	1417.00
Ethernet IP Bus	W12	1503.00
CANOpen Bus	W13	1298.00
Profibus Bus	W14	1251.00

Table 18.205: Starter Status Indication Forms

Factory Modifications	Form	\$ Price
Fault Differentiation Module — Manual Reset	U1	187.00
Fault Differentiation Module — Automatic or remote reset	U2	187.00
Thermal Overload Alarm Module	U3	187.00
Motor Load Indication Module	U4	226.00

