

DISCONNECT POWER CORD BEFORE SERVICING

IMPORTANT - RECONNECT ALL GROUNDING DEVICES

All parts of this appliance capable of conducting electrical current are grounded. If grounding wires, screws, straps, clips, nuts or washers used to complete a path to ground are removed for service, they must be returned to their original position and properly fastened.

IMPORTANT SAFETY NOTICE

This information is intended for use by individuals possessing adequate backgrounds of electrical, electronic and mechanical experience. Any attempt to repair a major appliance may result in personal injury and property damage. The manufacturer or seller cannot be responsible for the interpretation of this information, nor can it assume any liability in connection with its use.

ELECTRICAL SPECIFICATIONS

Thermistor calibration:
 kilo-ohm resistance@ 0°F (-18°C) 42.5k ohms
@ 37°F (3°C) 14.0k ohms
@ 77°F (25°C) 4.92k ohms
 Defrost Control Adaptive System
 Overtemperature Thermostat140°-110°F (60°-43°C)

ELECTRICAL RATING

Maximum Current Leakage0.75 mA
 Maximum Ground Path Resistance0.14 Ohms

NO LOAD PERFORMANCE

Control Position 5/5 and Ambient of 65°-90°F (21°-32°F)
 Fresh Food34°-41°F (1° to 5°C)
 Frozen Food.....-3° to 3°F (-19° to -16°C)
 Run Time, % @ 65°F (21°C) Ambient.....23 to 35
 Run Time, % @ 90°F (32°C) Ambient.....48 to 60
 Run Time, % @ 65°F (21°C) Ambient (Variable Speed).....<75
 Run Time, % @ 90°F (32°C) Ambient (Variable Speed).....75 to 100



REFRIGERATION SYSTEM

	25'	22'/20'
Refrigerant Charge	See Rating Plate	See Rating Plate
Compressor (Single Speed)	900-980 BTU/hr (Global 956 BTU/hr)	800 BTU/hr (Global 956 BTU/hr)
Compressor (Variable Speed)	833 BTU/hr @ 3000	833 BTU/hr @ 3000
Minimum Compressor Capacity	21"-26" Hg	21"-26" Hg
Minimum Equalized Pressure		
@ 65°F (21°C)	55 psig (370KPa)	55 psig (370KPa)
@ 90°F (32°C)	63 psig (434KPa)	63 psig (434KPa)
Minimum Equalized Pressure (Variable Speed)		
@ 70°F (21°C)	45-48 psig (310-331KPa)	45-48 psig (310-331KPa)
@ 90°F (32°C)	54-60 psig (372-413KPa)	54-60 psig (372-413KPa)

INSTALLATION

Clearance must be provided for air circulation
 At Top.....1" (25 mm)
 At Sides......013" (3.3 mm)
 At Rear.....1" (25 mm)

AIRFLOW

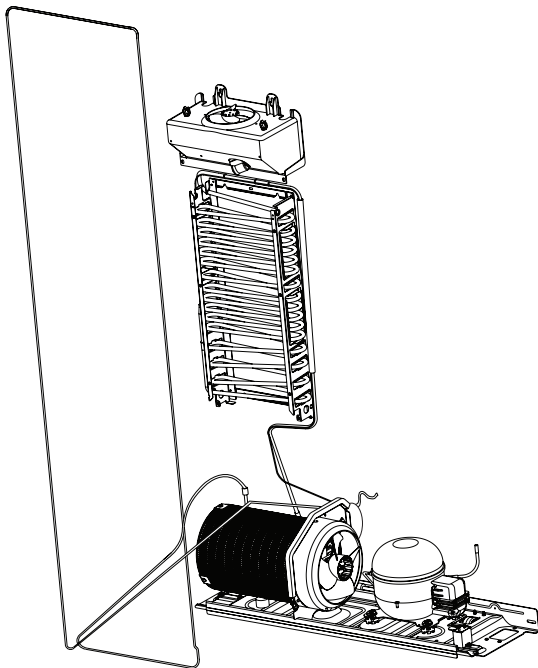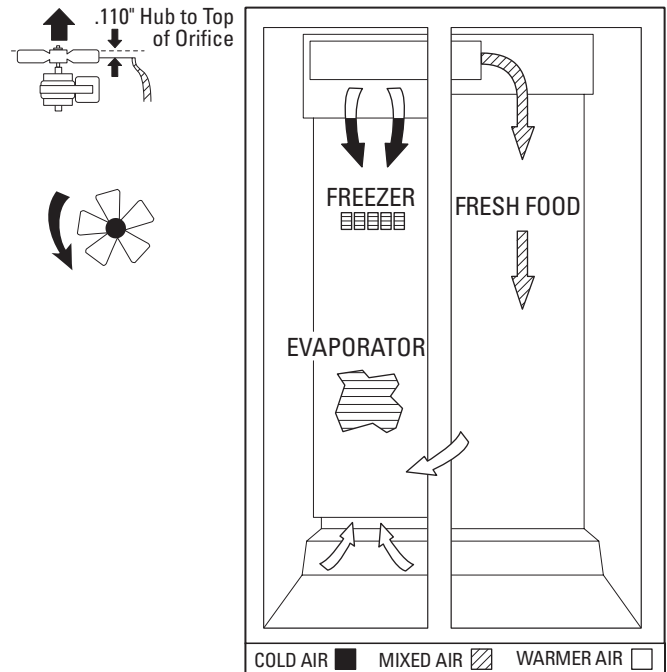

TAPE HERE
