
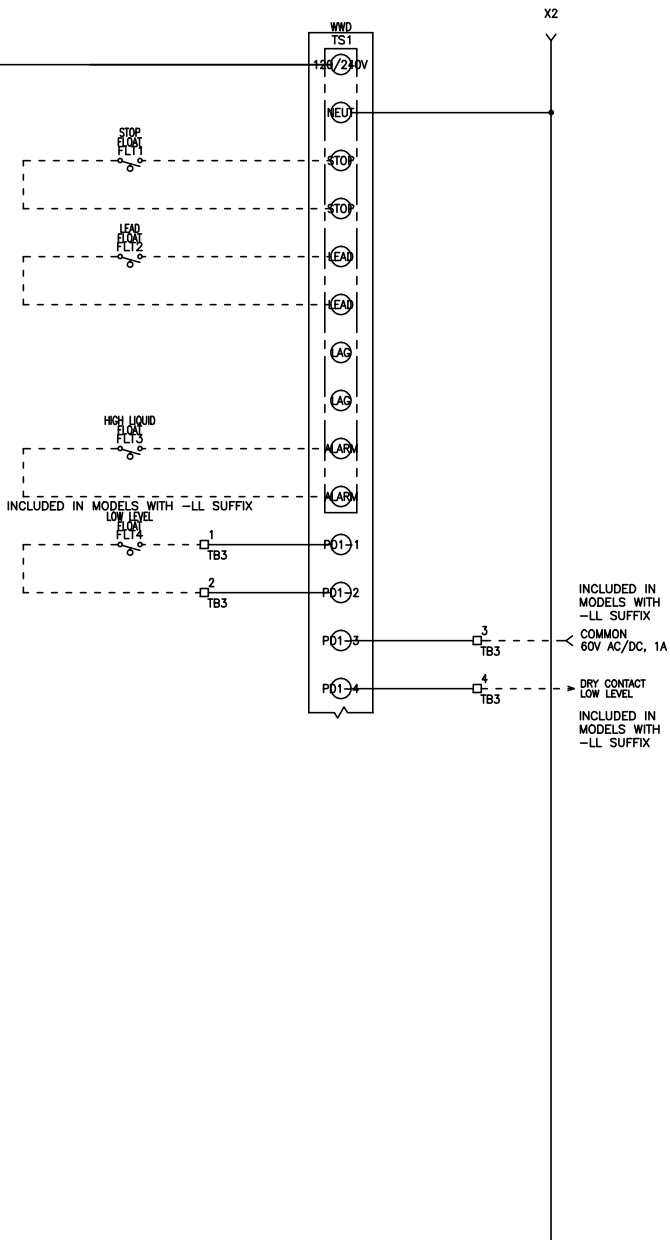


FRAME: WS3P-TP-300X

REVDATE: 0516

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	ADDITION OF OPTIONAL SEAL FAIL RELAY	1/11/15	
	B	ADDITION OF OPTIONAL LOW LEVEL ALARM	5/2/16	

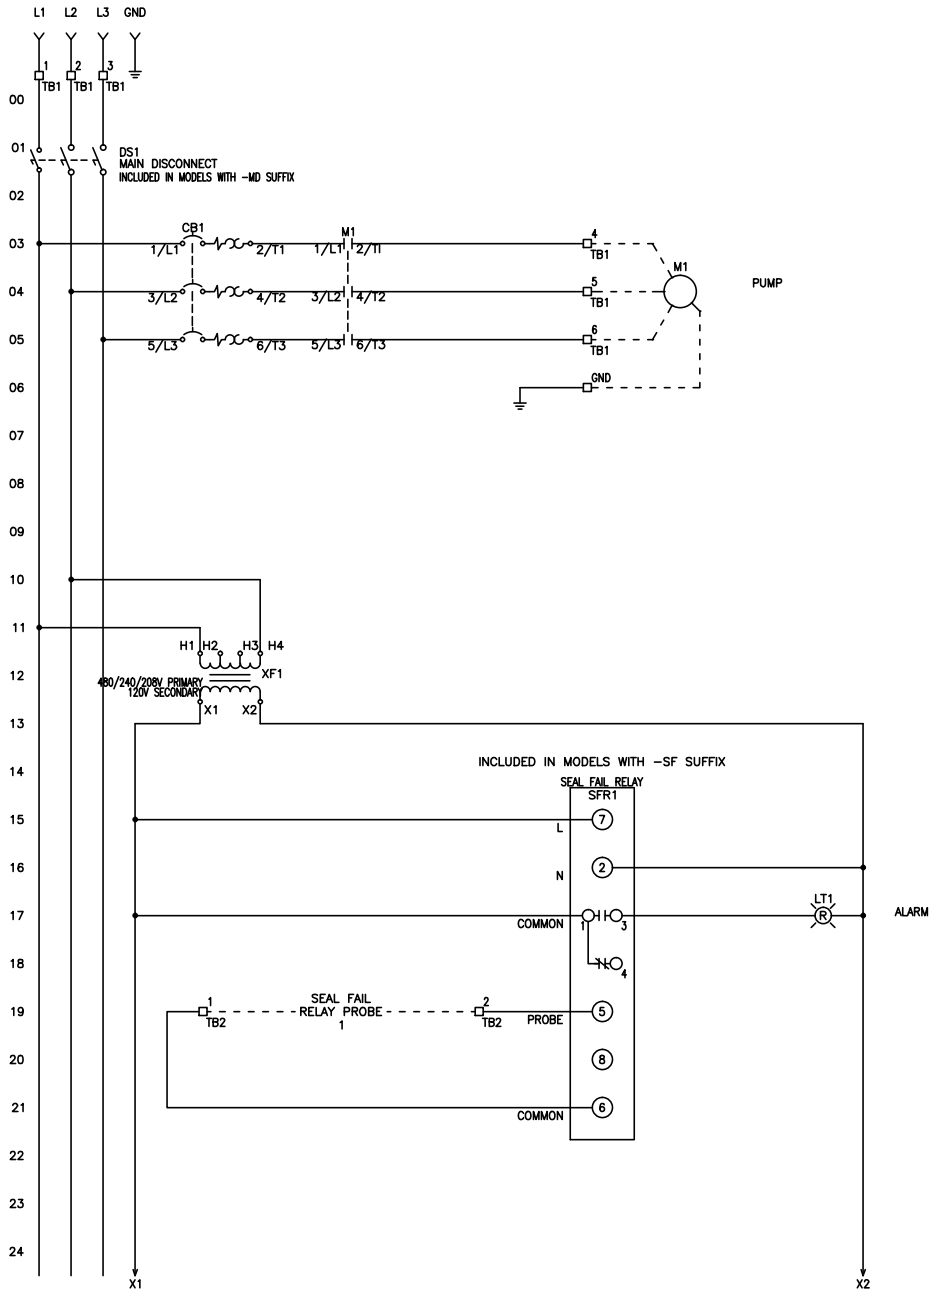

MULTI-TAP TRANSFORMER
CONNECT FACTORY TAGGED WIRES TO L1 & L2 ON TERMINAL BLOCK 3 AND CONNECT TO APPROPRIATE TRANSFORMER PRIMARY VOLTAGE TAP. SEE BELOW FOR CONNECTIONS:

FOR 208V OPERATION, CONNECT L1 & L2 TO TRANSFORMER TAPS H1 & H2.

FOR 240V OPERATION, CONNECT L1 & L2 TO TRANSFORMER TAPS H1 & H3.

FOR 480V OPERATION, CONNECT L1 & L2 TO TRANSFORMER TAPS H1 & H4.

DASHED LINE INDICATES FIELD WIRING.

USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.


VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

DRAWN BY:		DATE:					
MM		11/1/14					
APPROVED BY:		DATE:		TITLE: WS3P-TP-300X CONTROL SCHEMATIC			
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.							
				SIZE	DWG NO.	PART NO.	REV
				B	1524	WS3P-TP-300X	B
SCALE		NONE		SHEET		1 OF 3	

FNAME: WS3P-TP-300X

REVDATE: 0516

REVISIONS				
ZONE	REV	DESCRIPTION	DATE	APPROVED
	A	ADDITION OF OPTIONAL SEAL FAIL RELAY	1/11/15	
	B	ADDITION OF OPTIONAL LOW LEVEL ALARM	5/2/16	

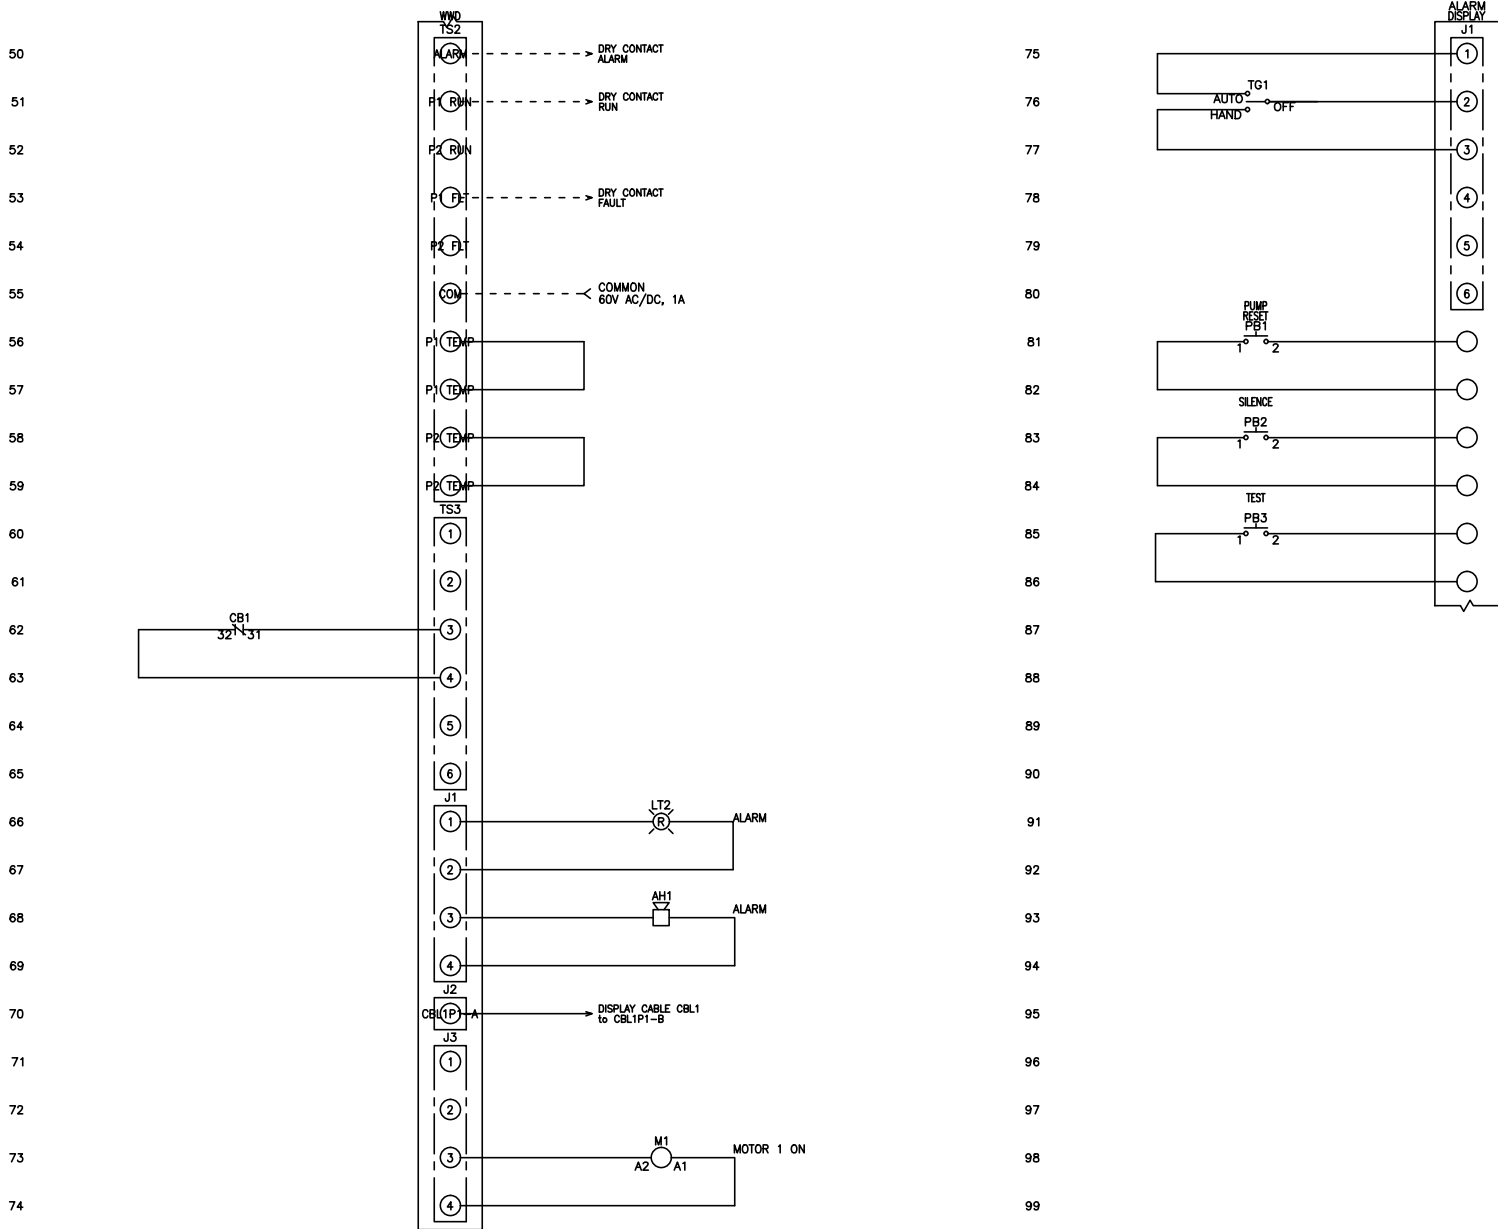

MULTI-TAP TRANSFORMER
CONNECT FACTORY TAGGED WIRES TO L1 & L2 ON TERMINAL
BLOCK 3 AND CONNECT TO APPROPRIATE TRANSFORMER
PRIMARY VOLTAGE TAP. SEE BELOW FOR CONNECTIONS:

FOR 208V OPERATION, CONNECT L1 & L2 TO TRANSFORMER
TAPS H1 & H2.

FOR 240V OPERATION, CONNECT L1 & L2 TO TRANSFORMER
TAPS H1 & H3.

FOR 480V OPERATION, CONNECT L1 & L2 TO TRANSFORMER
TAPS H1 & H4.

----- DASHED LINE INDICATES
FIELD WIRING.


USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE
INSTALLER: MUST BE SIZED ACCORDING TO PUMP/MOTOR
MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER
INSTALLATION IS COMPLETE.

DRAWN BY:	DATE:			
MM	11/1/14			
APPROVED BY:	DATE:	TITLE: WS3P-TP-300X CONTROL SCHEMATIC		
THIS DRAWING CONTAINS PROPRIETARY INFORMATION AND SHALL NOT BE USED OR DISCLOSED WITHOUT PRIOR WRITTEN AUTHORIZATION.		SIZE B	DWG NO. 1524	PART NO. WS3P-TP-300X
		SCALE NONE	REV B	
SHEET 2 OF 3				



USE COPPER CONDUCTORS ONLY.

TEMPERATURE RATING OF CONDUCTORS IS TO BE 60°C (167°F).

BRANCH CIRCUIT PROTECTION SHALL BE PROVIDED BY THE INSTALLER; MUST BE SIZED ACCORDING TO PUMP/MOTOR MANUFACTURING SPECIFICATIONS.

VERIFY CORRECT OPERATION OF CONTROL PANEL AFTER INSTALLATION IS COMPLETE.

