



RuggedSwitch® RSG2100P

Modular Power over Ethernet
Managed Ethernet Switch



Installation Guide

August 14, 2008

www.ruggedcom.com

Federal Communications Commission Radio Frequency Interference Statement

This equipment has been tested and found to comply with the limits for a Class A digital device pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

CAUTION

This product contains a laser system and is classified as a “**CLASS 1 LASER PRODUCT**”

CAUTION

Use of controls or adjustments or performance of procedures other than those specified herein may result in hazardous radiation exposure. This product contains no user serviceable parts.

Attempted service by unauthorized personnel shall render all warranties null and void.

Changes or modifications not expressly approved by RuggedCom Inc. could void the user's authority to operate the equipment.

Should this device require service see the “Warranty and Service” section of this guide.

IMPORTANT

The RSG2100 family of products should be installed in a **restricted access location** where access can only be gained by service personnel or users who have been instructed about the reasons for the restrictions applied to the location and about any precautions that shall be taken; and access is through the use of a tool or lock and key, or other means of security, and is controlled by the authority responsible for the location.

Trademarks:

Ethernet is a trademark of Xerox Corporation

RuggedRated, ROS and eRSTP are trademarks of RuggedCom® Inc.

RuggedSwitch® is a registered trademark of RuggedCom® Inc.

Table of Contents

1	Table of Figures	4
2	Table of Tables.....	4
3	Product Overview	6
3.1	Functional Overview.....	6
3.2	Feature Highlights.....	6
3.3	Display Panel Description.....	8
4	Installation	10
4.1	Mounting.....	10
4.1.1	Rack Mounting.....	11
4.1.2	Panel and DIN Rail Mounting	12
4.2	Power Supply Wiring and Grounding.....	13
4.2.1	AC Power Supply (PS1) Wiring Example.....	15
4.2.2	DC Power Supply (PS1) Wiring Example.....	16
4.3	Dielectric Strength (HIPOT) Testing.....	17
4.4	Failsafe Alarm Relay Wiring.....	18
4.5	Console Port Wiring	19
5	Ethernet Ports	20
5.1	RJ45 Twisted-Pair Ports	20
5.1.1	Data Ports.....	20
5.1.2	Data and Power Ports.....	21
5.1.3	Transient Suppression.....	21
5.2	Fiber Optic Ports.....	22
5.2.1	Gigabit Ethernet 1000Base-Tx Cabling Recommendations.....	24
5.2.2	Pluggable optics – Installation, removal, and precautions.....	25
6	Technical Specifications	27
6.1	Power Supply Specifications	27
6.2	Failsafe Relay Specifications.....	27
6.3	Networking Standards Supported	28
6.4	Twisted-Pair Port Specifications.....	29
6.5	Fiber Optical Specifications.....	30
6.5.1	Fast Ethernet (10/100 Mbps) Optical Specifications	31
6.5.2	Gigabit Ethernet (1000 Mbps) Optical Specifications.....	32
6.6	Type Test Specifications.....	34
6.7	Operating Environment.....	34
6.8	Mechanical Specifications	35
7	Agency Approvals	36
8	Warranty.....	36

1 Table of Figures

Figure 1: RSG2000 Series LED Display Panel	8
Figure 2: RSG2000 Series Rack mount chassis orientation options – Front and rear mount.....	10
Figure 3: RSG2000 Series 19” Rack Mount Adapters.....	11
Figure 4: Rack mount adapter mounting location.....	11
Figure 5: RSG2000 Series PANEL/DIN RAIL mounting diagram with	12
Figure 6: RSG2000 Series Philips Screw Terminal Block	13
Figure 7: RSG2000 Series Phoenix Plug Terminal Block.....	13
Figure 8: AC (PS1) & 48VDC (PS2) power supply wiring examples	15
Figure 9: DC (PS1) & 48VDC (PS2) power supply wiring examples	16
Figure 10: Dielectric Strength (HIPOT) Testing.....	17
Figure 11: Failsafe Alarm Relay Wiring.....	18
Figure 12: Console port location on display board	19
Figure 13: RSG200 Console cable.....	19
Figure 14: Ethernet panel LED description.....	20
Figure 15: RJ45 port pins configuration.	20
Figure 16: 10FL ST connector.....	22
Figure 17: 100FX MTRJ connector	22
Figure 18: 100FX / 1000LX LC connector.....	22
Figure 19: 100FX / 1000LX SC connector	22
Figure 20: 100FX / 1000LX ST connector.....	23
Figure 21: 1000LX GBIC Module and	23
Figure 22: 1000LX SFP (mini-GBIC) Module	23
Figure 23: SFP Orientation for top row and bottom row ports	25
Figure 24: Locking latch location on GBIC optical modules	26
Figure 25: SFP Bail Latch location	26
Figure 26: SFP Removal.....	26
Figure 27: Mechanical Specifications	35

2 Table of Tables

Table 1: LED Display – Device status LED behavior definition	8
Table 2: LED Display - Port LED behavior definition.....	9
Table 3: RSG2100P Series Power terminal block connection description	14
Table 4: RS232 over RJ45 console cable pin-out	19
Table 5: RJ45 Ethernet pin-out assignment	21
Table 6: RJ45 PoE pin-out assignment.....	21
Table 7: Cabling categories and 1000BaseTx compliance defined.....	24
Table 8: Power Supply Specifications	27
Table 9: PoE Power Supply Specifications	27
Table 10: Failsafe Relay Contact Ratings	27
Table 11: Networking Standards Supported.....	28

Table 12: Twisted-Pair Port Specifications.....	29
Table 13: Fast Ethernet optical specifications	31
Table 14: Gigabit Ethernet optical specifications.....	32
Table 15: Test Type Specifications	34
Table 16: Operating Environment	34
Table 17: Mechanical Specifications	35
Table 18: Agency Approvals	36

3 Product Overview

3.1 Functional Overview

The **RuggedSwitch® RSG2100P** is an industrially hardened, Power Over Ethernet (PoE) enabled, fully managed, modular, Ethernet switch specifically designed to operate reliably in electrically harsh and climatically demanding utility substation and industrial environments. The RSG2100P's superior ruggedized hardware design coupled with the RuggedSwitch® Operating System (ROS) provides improved system reliability and advanced networking features making it ideally suited for creating Ethernet networks for mission-critical, real-time, control applications.

The RSG2100P comes standard with 4 10/100BaseTX 802.3af compliant Ethernet ports (ports 17 – 20) and offers modular flexibility of up to 15 additional Ethernet ports including 10BaseFL /100BaseFX/ 1000BaseX fiber and 10/100/1000BaseTX copper port combinations. The RSG2100P is highly versatile and can support multiple fiber types and connectors (ST, MTRJ, LC, SC) without loss of port density.

The RSG2100P is an ideal solution to power and connect several Ethernet devices (such as IP phones, video cameras, and wireless access points) where AC power is not available or cost-prohibitive to provide locally.

3.2 Feature Highlights

Power Over Ethernet (PoE)

- 4 10/100BaseTx 802.3af compliant ports
- Data and power over a single Ethernet cable
- Powered from the internal 48VDC source
- No mid-span patch panel required
- Fully compatible with 802.3af powered devices
- Auto-sensing ports that provide power only to PoE end devices
- Power to port is turned off if cables are removed

Additional Ethernet Ports

- up to 3-Gigabit Ethernet ports - copper and/or fiber
- up to 12-Fast Ethernet ports - copper and/or fiber
- Many fiber and connector options

Cyber Security Features

- Multi-level user passwords
- SSH/SSL encryption
- Enable/disable ports, MAC based port security
- Port based network access control (802.1x)

- VLAN (802.1q) to segregate and secure network traffic
- Radius centralized password management
- SNMPv3 encrypted authentication and access security

RuggedRated™ for Reliability in Harsh Environments

- Immunity to EMI and heavy electrical surges
- Meets IEEE 1613 (electric utility substations)
- Exceeds IEC 61850-3 (electric utility substations)
- Exceeds IEEE 61800-3 (variable speed drive systems)
- Exceeds IEC 61000-6-2 (generic industrial)
- Exceeds NEMA TS-2 (traffic control equipment)
- -40 to +85°C operating temperature (no fans)
- Conformal coated printed circuit boards (optional)
- 18 AWG galvanized steel enclosure

Rugged Operating System (ROSTM) Features

- All the same features as the RSG2100
- Enhanced Rapid Spanning Tree (eRSTP™)
- Quality of Service (802.1p) for real-time traffic
- VLAN (802.1q) with double tagging and GVRP support
- Link aggregation (802.3ad)
- IGMP Snooping for multicast filtering

Management Tools

- Web-based, Telnet, CLI management interfaces
- SNMP v1/v2/v3
- Remote Monitoring (RMON)
- Rich set of diagnostics with logging and alarms

Universal Power Supply Options

- Fully integrated power supplies
- PoE power supply: 48VDC
- Unit power supply: 12 VDC, 24VDC, 48VDC, or 88-300VDC/85-264VAC
- Terminal blocks for reliable maintenance free connections
- CSA/UL 60950 safety approved to +85°C

3.3 Display Panel Description

The RSG2000 series products are equipped with a versatile display panel, shown in Figure 1, which is designed to provide quick status information for each port, as well as the entire device to allow for simple diagnostics and troubleshooting. It features:

- RS232 console port for 'out of band' console access and configuration
- Power supply and Alarm status indicators
- Convenient port status indicators conveying Link-Activity, Duplex, or Speed via push-button control.
- System reset via push-button if held for 5 seconds

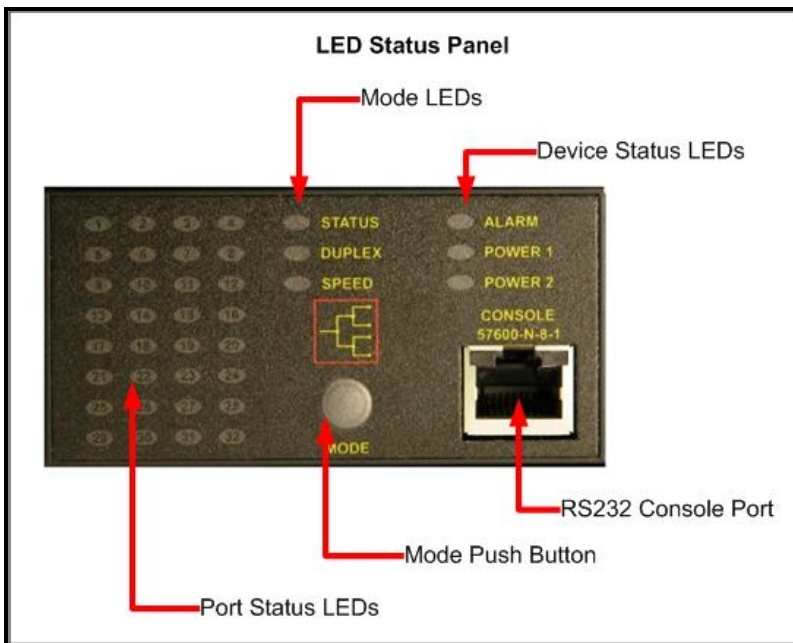


Figure 1: RSG2000 Series LED Display Panel

Device status LEDs exist to provide a quick visual indicator to operators for operational status of the unit. Table 1 defines the possible LED colours and the corresponding description.

LED	Colour	Description
PS1 (Main) / PS2 (PoE)	Green	Power supply operating normal
	Red	Power supply failure
Alarm	Red	Alarm exist – login to console to determine alarm code
	Off	No alarms exist

Table 1: LED Display – Device status LED behavior definition

The port-based LEDs can be cycled between three display modes: Status, Duplex, and Speed. Pushing the mode button causes the display mode to be cycled. Table 2 defines the possible port LED colours and the corresponding description.

Mode	Colour	Description
Status	Green (Solid)	Link
	Green (Blinking)	Activity
	Off	No link
Duplex	Green (Solid)	Full-Duplex operation
	Orange (Solid)	Half-Duplex operation
	Off	No link
Speed	Green (Blinking)	1000Mb/s
	Green (Solid)	100Mb/s
	Orange (Solid)	10Mb/s
	Off	No link

Table 2: LED Display - Port LED behavior definition

4 Installation

4.1 Mounting

The RSG2000 series of products have been designed with maximum mounting and display flexibility. Customers can order an RSG2000 series switch that can be mounted in a standard 19" rack, 1" DIN Rail, or directly onto a panel. For rack mount installations, the RSG2000 series can be ordered with connectors on the front of the unit, or located on the rear of the chassis to allow for all data and power cabling to be installed and connected at the rear of the rack. See Figure 2 for rack mount orientation examples.

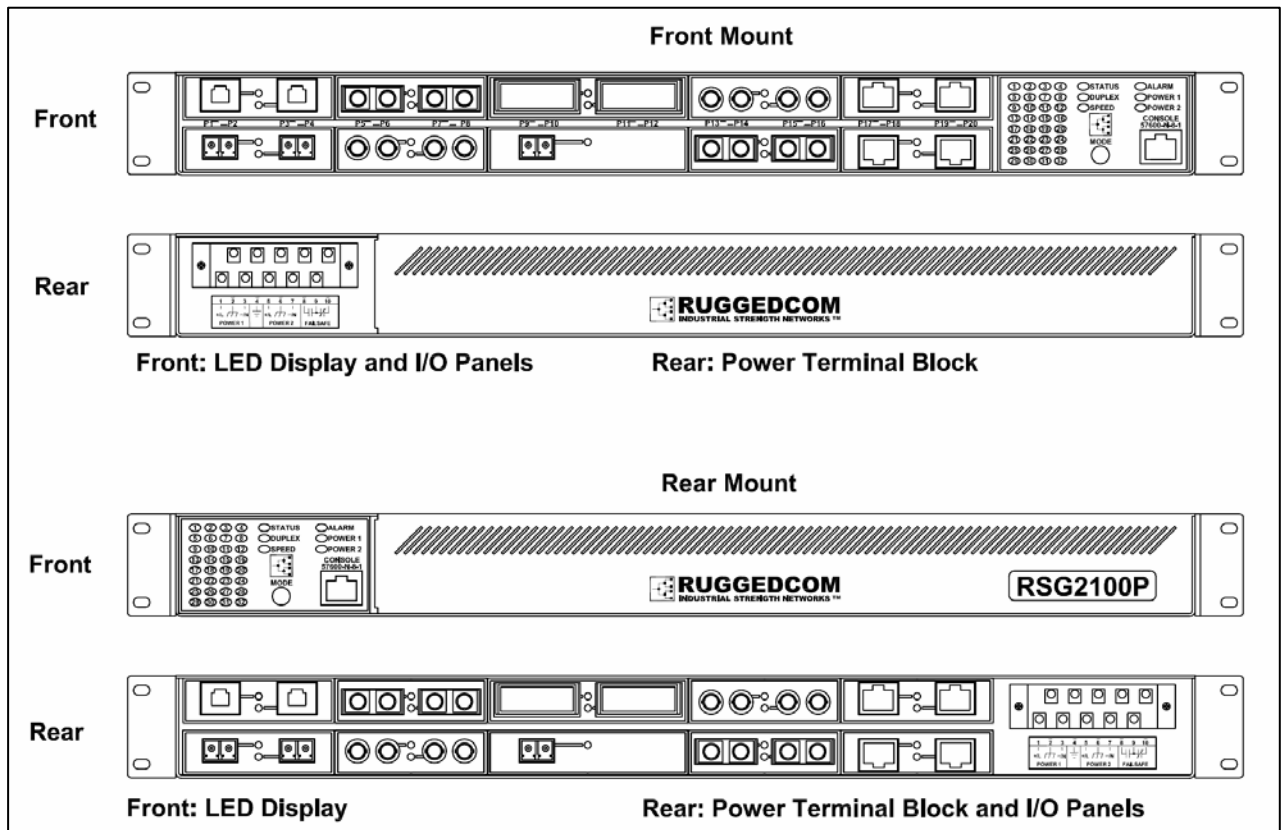


Figure 2: RSG2000 Series Rack mount chassis orientation options – Front and rear mount.

4.1.1 Rack Mounting

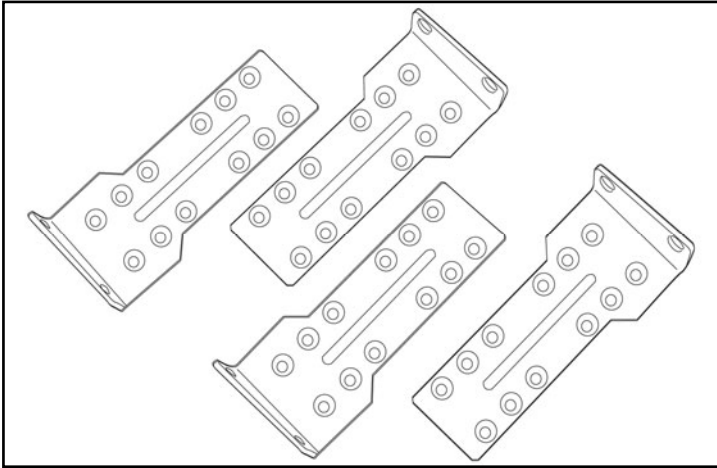


Figure 3: RSG2000 Series 19" Rack Mount Adapters

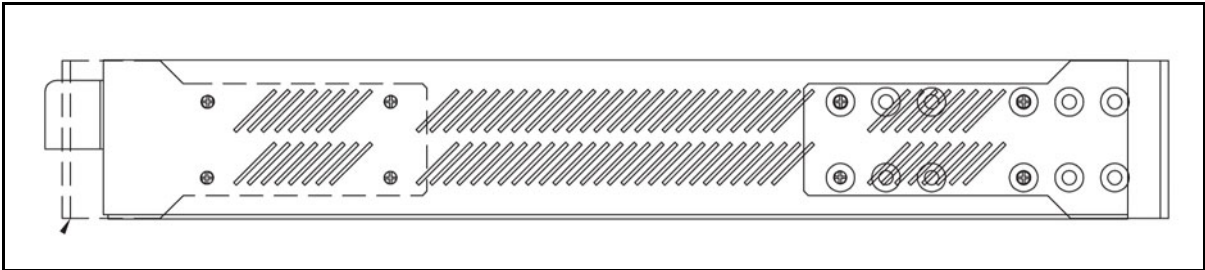


Figure 4: Rack mount adapter mounting location

The RSG2000 series family of products can be rack mounted using the included rack mount adapter assemblies shown in Figure 3. Secure the one rack mount adapter to the front of each side of the chassis using the included black PAN head Philips screws in the positions shown in Figure 5. The entire chassis can then be mounted to a standard 19" rack. An additional two rack mount adapters are included to optionally secure the rear of the chassis in high-vibration, or seismically active locations.

NOTE: Since heat within the RSG2100P is channeled to the enclosure, it is recommended that 1 rack unit of space (1.75") be kept unpopulated and free of equipment above each RSG2000 series product to allow for a small amount of convective airflow. Although forced airflow is not necessary, any increase in airflow will result in a reduction of ambient temperature that will improve long-term reliability of all equipment mounted within the rack space.

4.1.2 Panel and DIN Rail Mounting

The RSG2000 series products can be ordered as a Panel/DIN mount chassis. Both options involve the use of the panel/DIN adapters to be mounted on each side of the chassis enclosure. The adapter allows for the chassis to be mounted on the standard 1" DIN rail using the grooves in the adapter, secured using the included philips screw. See Figure 5 for a PANEL/DIN mount diagram.

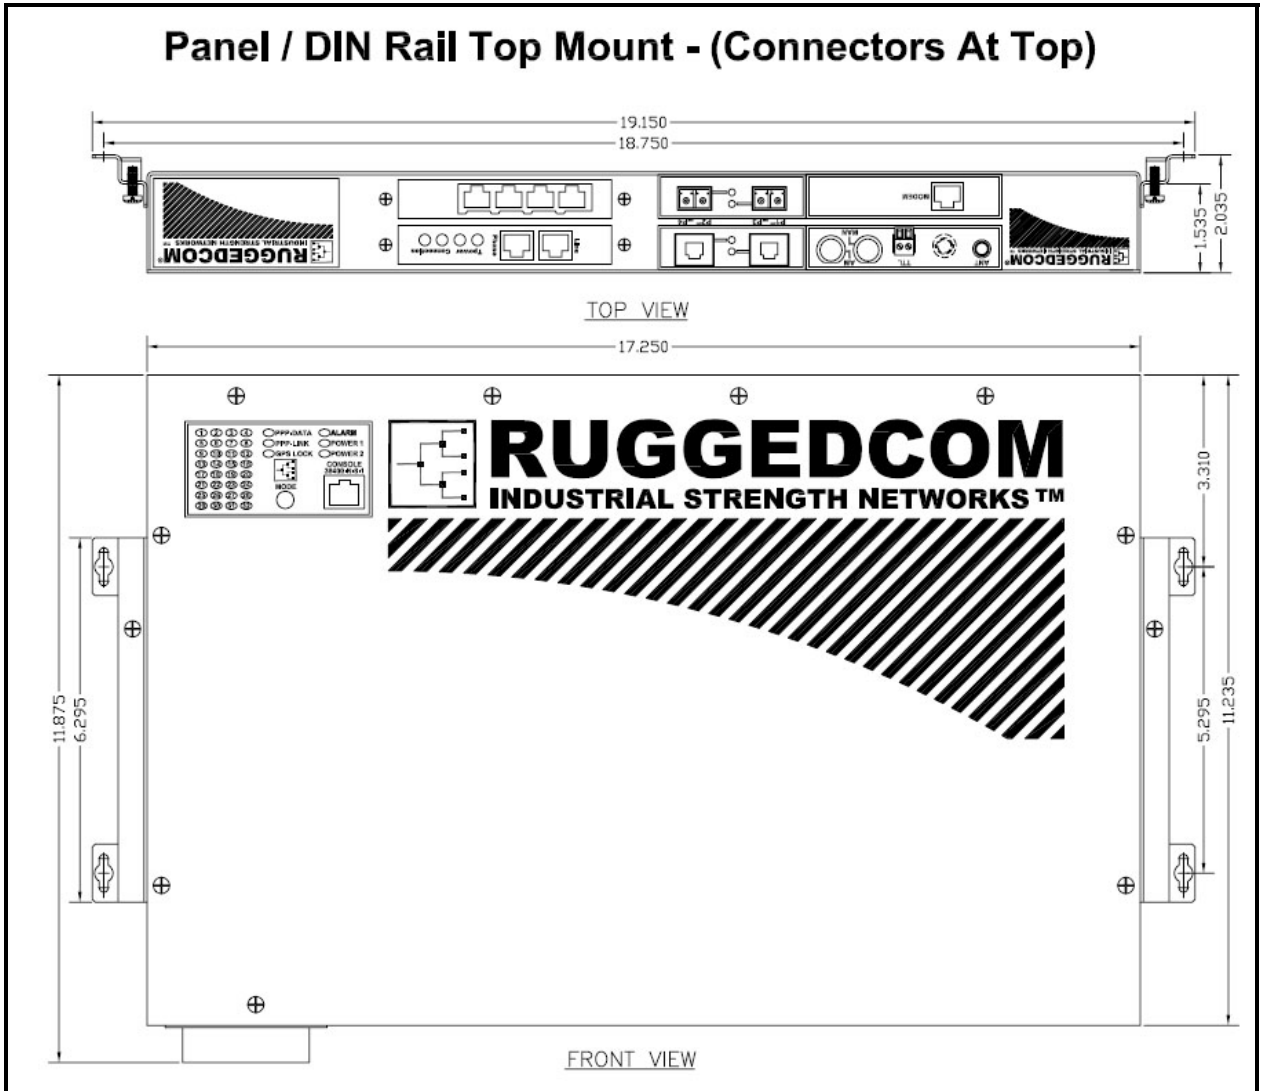


Figure 5: RSG2000 Series PANEL/DIN RAIL mounting diagram with

4.2 Power Supply Wiring and Grounding

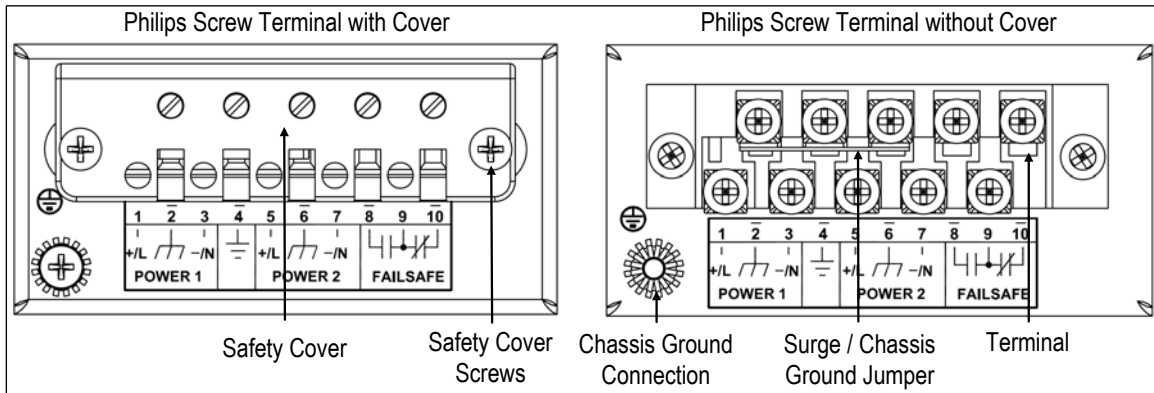


Figure 6: RSG2000 Series Philips Screw Terminal Block

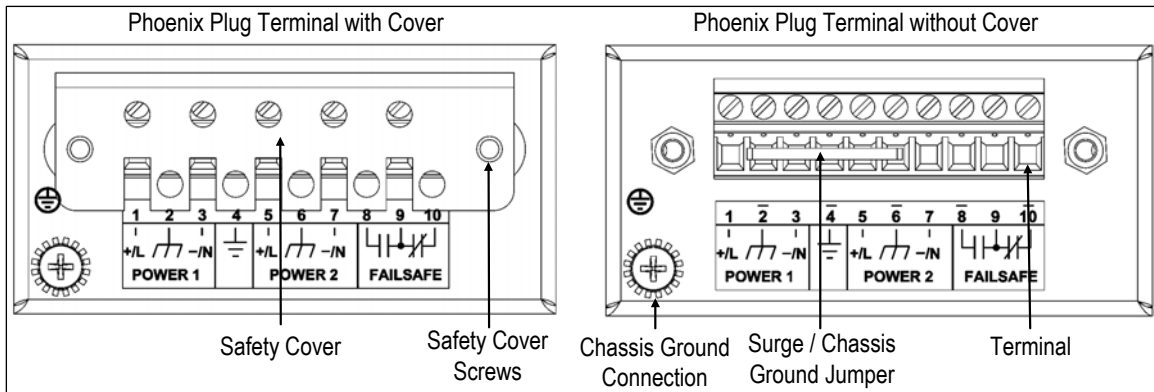


Figure 7: RSG2000 Series Phoenix Plug Terminal Block

The RSG2100P supports a single AC or DC power supply, “Power Supply 1 (PS1)” and a separate 48VDC power supply, “Power Supply 2 (PS2)” used to provide the power over Ethernet. The connections for PS1, PS2 and the fail-safe relay are located on the terminal block as shown in Figure 6 and Figure 7.

The RSG2000 Family chassis ground connection, shown in Figure 8, uses a #6-32 screw. It is recommended to terminate the ground connection in a #6 ring lug, and to use a torque setting not exceeding 15 in.lbs (1.7 Nm).

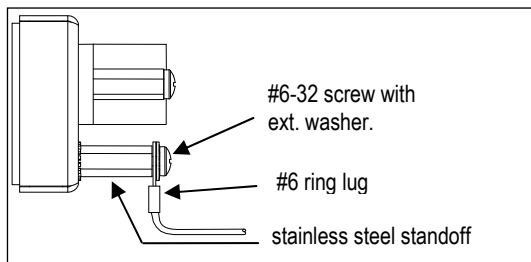


Figure 8: Chassis Ground Connection

The RSG2100P can be equipped with either a Philips Screw Terminal Block or a Phoenix Plug Terminal Block. The Philips Screw Terminal Block has Philips screws with a compression plate allowing either bare wire connections or crimped terminal lugs. We recommend the use of #6 size ring lugs to ensure secure, reliable connections under severe shock or vibration. Both terminal blocks have a safety cover which must be removed via two Phillips screws before connecting any wires. The safety cover must be re-attached after wiring to ensure personnel safety. Refer to Table 3 below for a description of each terminal as well as sections 4.2.1 through 4.2.2 for wiring examples.

Terminal #	Description	Usage
1	PS1 Live / +	PS1 Live / + is connected to the positive (+) terminal if the power source is DC or to the (Live) terminal if the power source is AC.
2	PS1 Surge Ground	PS1 Surge Ground is connected to the Chassis Ground via a jumper on the terminal block. Surge Ground is used as the ground conductor for all surge and transient suppression circuitry.
3	PS1 Neutral / -	PS1 Neutral / - is connected to the negative (-) terminal if the power source is DC or to the (Neutral) terminal if the power source is AC.
4	Chassis Ground	Chassis Ground is connected to the Safety Ground terminal for AC inputs or the equipment ground bus for DC inputs. Chassis ground connects to both power supply surge grounds via a removable jumper.
5	PS2 +	PS2 + is connected to the positive (+) terminal of the 48VDC power supply.
6	PS2 Surge Ground	PS2 Surge Ground is connected to the Chassis Ground via a jumper on the terminal block. Surge Ground is used as the ground conductor for all surge and transient suppression circuitry.
7	PS2 -	PS2 - is connected to the negative (-) terminal of the 48VDC power supply.
8	Relay NO Contact	Normally open, failsafe relay contact.
9	Relay Common	Failsafe relay common contact.
10	Relay NC Contact	Normally closed, failsafe relay contact.

Table 3: RSG2100P Series Power terminal block connection description

4.2.1 AC Power Supply (PS1) Wiring Example

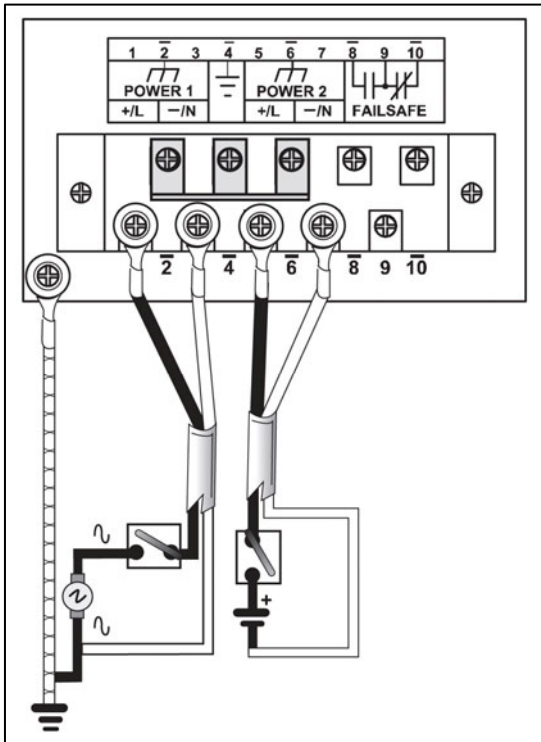


Figure 9: AC (PS1) & 48VDC (PS2) power supply wiring examples

NOTES:

1. 100-240VAC rated equipment: A 250VAC appropriately rated circuit breaker must be installed.
2. Equipment must be installed according to the applicable country wiring codes.

4.2.2 DC Power Supply (PS1) Wiring Example

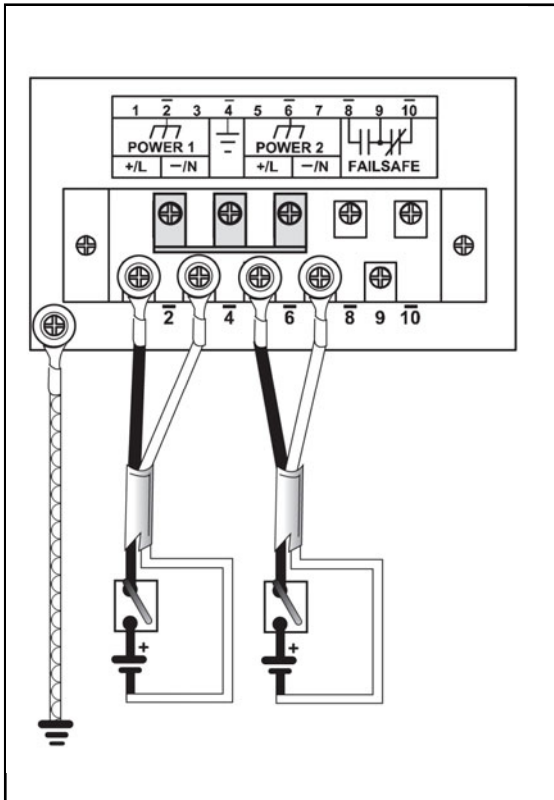


Figure 10: DC (PS1) & 48VDC (PS2) power supply wiring examples

NOTES:

1. 88-300VDC rated equipment: A 300VDC appropriately rated circuit breaker must be installed.
2. A circuit breaker is not required for 12, 24 or 48 VDC rated power supplies.
3. Equipment must be installed according to the applicable country wiring codes.

4.3 Dielectric Strength (HIPOT) Testing

For dielectric strength (HIPOT) testing in the field, users must remove the metal jumper located on terminal 2, 4, and 6 of the power supply terminal block. This metal jumper connects transient suppression circuitry to chassis ground and must be removed in order to avoid damage to transient suppression circuitry during HIPOT testing. Figure 11 shows the proper HIPOT test connections and should be followed to avoid damage to the device.

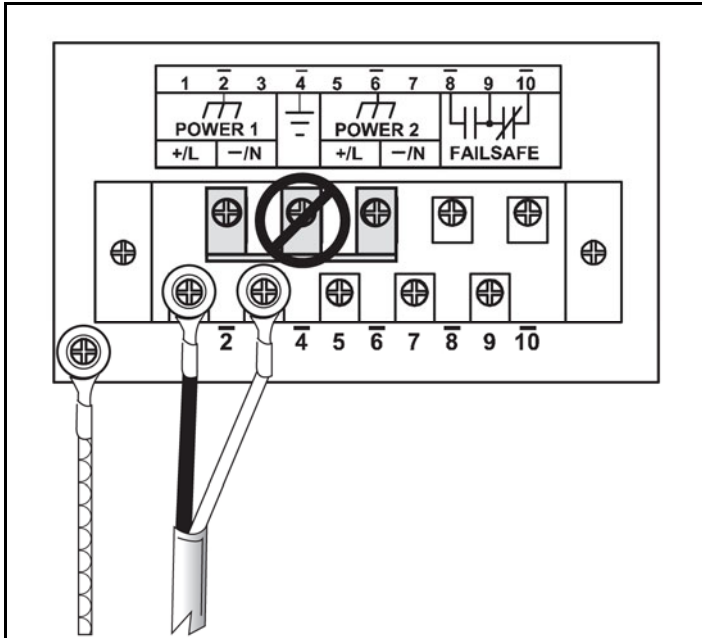


Figure 11: Dielectric Strength (HIPOT) Testing

4.4 Failsafe Alarm Relay Wiring

The “Failsafe” output relay is provided to signal critical error conditions that may occur on the RSG2000 series switches. The contacts are energized upon power up of the unit and remain energized until a critical error occurs. The proper relay connections are shown in Figure 12. Control of the output is user selectable and can be programmed via the Rugged Operating System (ROS). One common application for this output is to signal an alarm if a power failure or removal of control power occurs.

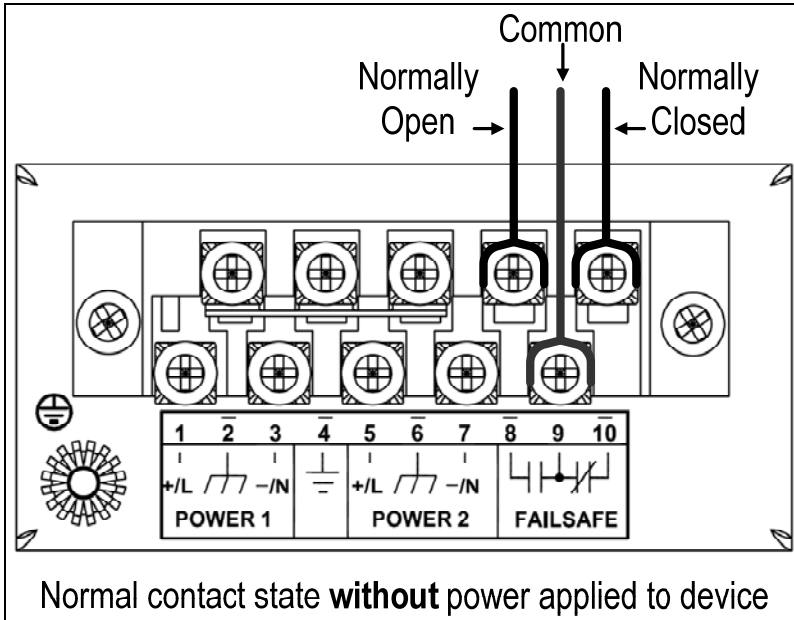


Figure 12: Failsafe Alarm Relay Wiring

4.5 Console Port Wiring

A RS232 console port for configuration and management of the device is located on the LED display module shown in Figure 13. This port is intended to be a temporary connection during initial configuration or troubleshooting and allows for direct access to the serial-based management console. The connection is made using the DB9-Female to RJ45 console cable included in the device packaging shown in Figure 14. Console connection settings are: 57600 baud, no parity bits, 8 data bits, and 1 stop bit.

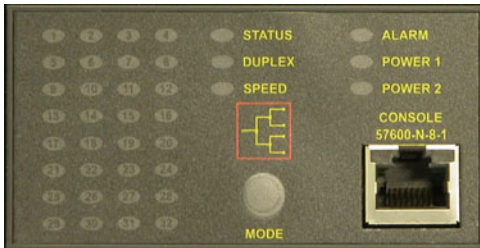


Figure 13: Console port location on display board




Figure 14: RSG200 Console cable

For user reference, the console cable pin-out is show in Table 5.

RuggedCom RS232 over RJ45 pin-out specification		
<i>Signal Name (PC is DTE)</i>	<i>DB9- Female</i>	<i>RJ45 Male</i>
DCD – Carrier detect	1	2
RxD – Receive data (to DTE)	2	5
TxD – Transmit data (from DTE)	3	6
DTR – Data terminal ready	4	3
Signal GND	5	4
DSR – Data set ready	6	1*
RTS – Ready to send	7	8
CTS – Clear to send	8	7
RI – Ring Indicator	9	1*

Table 4: RS232 over RJ45 console cable pin-out

After initial configuration, the RuggedSwitch device can be configured via a number of new mechanisms such as Telnet, and the built-in web server. Consult the RuggedSwitch ROS User Guide for further details.

NOTE: This port is not intended to be a permanent connection and the cable shall be less than 2m (6.5 ft) in length.

5 Ethernet Ports

Each Ethernet module is equipped with two LEDs that indicate link/activity status information. The LED will be solid for ports with link, and will blink for activity. The diagram in Figure 15 highlights the port and the associated link/activity LED.

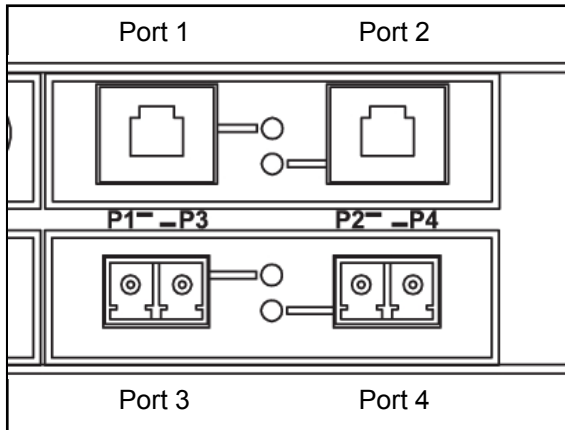


Figure 15: Ethernet panel LED description

5.1 RJ45 Twisted-Pair Ports

5.1.1 Data Ports

The RSG2100P may have several 10/100BaseTX ports that allow connection to standard CAT-5 UTP cable with RJ45 male connectors. All RSG2000 series RJ45 RuggedSwitch products feature auto-negotiating, auto-polarity, and auto-crossover functions. The RJ45 receptacles can also accept and take advantage of screened (commonly known as “shielded”) cabling. Figure 16 shows the RJ45 port pins configuration.

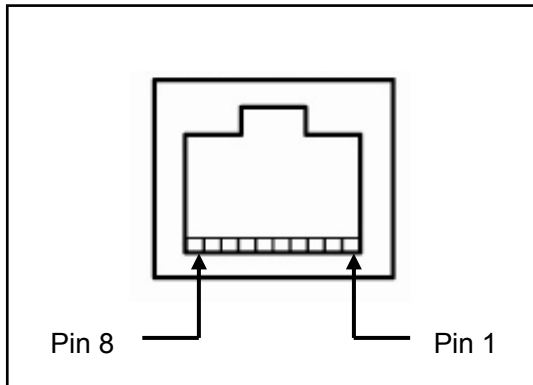


Figure 16: RJ45 port pins configuration.

10/100BaseTx Pin-out	
<i>Pin</i>	<i>Description</i>
1	RX +
2	RX -
3	TX +
6	TX -
4, 5, 7, 9	NC

Table 5: RJ45 Ethernet pin-out assignment

5.1.2 Data and Power Ports

The RSG2100P comes standard with 4 10/100BaseTX IEEE 802.3af (PoE) compliant Ethernet ports (ports 17 – 20). In addition to the 10/100BaseTX port features, the PoE ports provide nominal 48 VDC at 350 mA (max 15.4W/port), auto-sensing and automatic power off when cables are removed. Table 6 shows the RJ45 PoE pin-out assignment.

10/100BaseTx PoE Pin-out	
<i>Pin</i>	<i>Description</i>
1	RX + and Power -
2	RX - and Power -
3	TX + and Power +
6	TX - and Power +
4, 5, 7, 9	NC

Table 6: RJ45 PoE pin-out assignment

5.1.3 Transient Suppression

RuggedCom does not recommend the use of copper cabling of any length for critical real-time substation automation applications. However, transient suppression circuitry is present on all copper ports to protect against damage from electrical transients and to ensure IEC 61850-3 and IEEE 1613 Class 1 conformance. This means that during the transient event communications errors or interruptions may occur but recovery is automatic. RuggedCom also does not recommended to use these ports to interface to field devices across distances which could produce high levels of ground potential rise, (i.e. greater than 2500V) during line to ground fault conditions.

5.2 Fiber Optic Ports

Depending on the order code of the product, the RSG2000 series products can be equipped with several different types of fiber optic ports. The Transmit (TX) and Receive (RX) connections of each port must be properly connected and matched for proper link and operation. Modules populated on the top row of the device typically have locking mechanisms or tabs towards the top of the unit. Modules located on the bottom row of the device have locking mechanisms or tabs towards the bottom of the device.

The drawings in the following figures show each fiber optical connector style with a side and top view to allow the user to identify the proper cable connection orientation. If modules are populated on the bottom row of the device, the transceiver orientation will be reversed (i.e. RX and TX will be reversed).

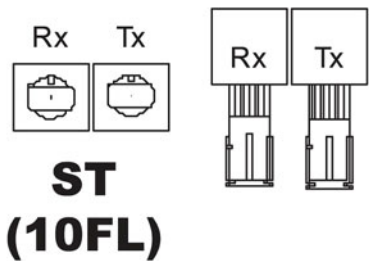


Figure 17: 10FL ST connector

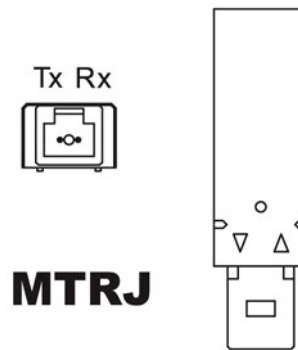


Figure 18: 100FX MTRJ connector

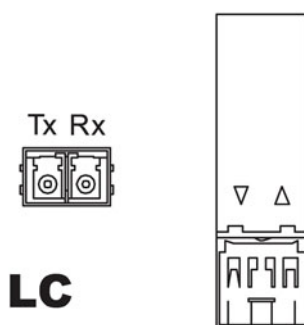


Figure 19: 100FX / 1000LX LC connector



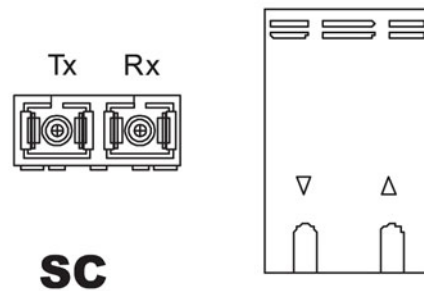


Figure 20: 100FX / 1000LX SC connector

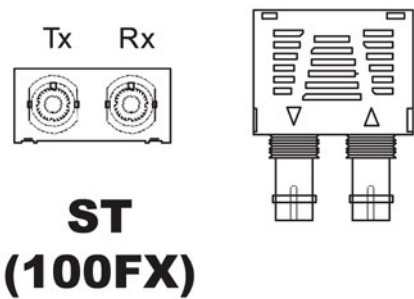


**ST
(100FX)**

Figure 21: 100FX / 1000LX ST connector

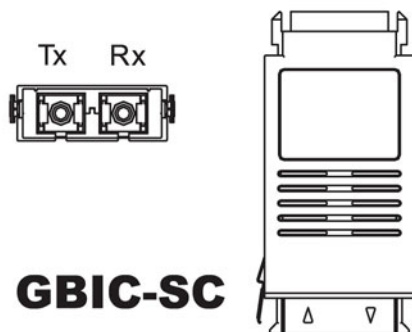

GBIC-SC

Figure 22: 1000LX GBIC Module and SC connector

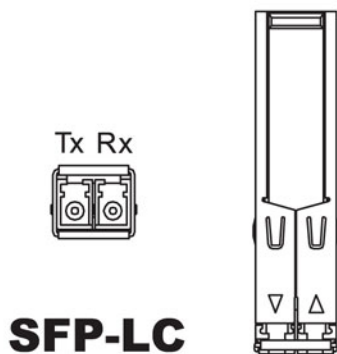

SFP-LC

Figure 23: 1000LX SFP (mini-GBIC) Module and LC connector

5.2.1 Gigabit Ethernet 1000Base-Tx Cabling Recommendations

The IEEE 802.3ab Gigabit Ethernet standard defines 1000Mbit/s Ethernet communications over distances of up to 100 meters using 4 pairs of category 5 (or higher) balanced unshielded twisted-pair cabling. For wiring guidelines, system designers and integrators should refer to the Telecommunications Industry Association (TIA) TIA/EIA-568-A wiring standard that characterizes minimum cabling performance specifications required for proper Gigabit Ethernet operation. To ensure reliable, error-free data communications, new and pre-existing communication paths should be verified for TIA/EIA-568-A compliance. Table 7 summarizes cabling standards available today.

Cabling Category	1000BaseTx Compliant	Required action
< 5	No	New wire infrastructure required
5	Yes	Verify TIA/EIA-568-A compliance
5e	Yes	No action required. New installations should be designed with Category 5e components or higher
6	Yes	No action required
> 6	Yes	Connector and cabling standards to be determined.

Table 7: Cabling categories and 1000BaseTx compliance defined.

In general the following recommendations should be followed for copper data cabling in high electrical noise environments:

- Data cable lengths should be as short as possible, ideally limited to 3m (10ft) in length. Copper data cables should not be used for inter-building communications.
- Power and data cables should not be run in parallel for long distances, and ideally should be installed in separate conduits. Power and data cables should intersect at 90° angles when necessary to reduce inductive coupling.
- Shielded/screened cabling can optionally be used. The cable shield should be grounded at one single point to avoid the generation of ground loops.

5.2.2 Pluggable optics – Installation, removal, and precautions

The RSG2000 series of products can be ordered with pluggable optic form factors such as SFP (Small Form-factor Pluggable) or GBIC (Gigabit Interface Converter) modules. These modules can be safely inserted and removed while the chassis is powered and operating – this feature is also known as “hot-swappable”. When inserting or removing optics there are several precautions that should be taken. They include:

1. Ensuring that dust caps are mounted on SFP cages at all times unless a user is in the process of inserting or removing an SFP module. The dust caps will prevent the accumulation of residue or particles that may inhibit proper operation.
2. Ensuring that the user has properly discharged any possible electrostatic build-up and electrostatic discharges (ESD). This can be accomplished by properly user ‘grounding’ via an ESD wrist strap, or by touching earth or chassis ground before performing installation or removal of optics. ESD can damage or shorten the life of optical modules when not plugged into a chassis.
3. SFP and GBIC optical modules should always be stored in an ESD safe bag or other suitable ESD safe environment, free from moisture and stored at proper storage temperature (–40 to +85°C).
4. Disconnect all cables from SFP or GBIC module before insertion or removal of module.
5. Only RuggedCom Inc. certified optics should be used on RuggedCom products. Damage can occur to optics and product if compatibility and reliability have not been properly assessed.

5.2.2.1 Module Insertion – GBICs and SFPs

To insert GBICs or SFPs, special attention should be taken into the proper module orientation. Refer to Figure 24 for proper module orientation, as ports on the upper row of the product require optics to be inserted topside-up, and ports on the lower row of the product require modules to be inserted topside-down. GBICs should be inserted with module dust cover in place. SFPs should be inserted with dust cover in place, and the bail-latch in the locked position. Module should gently slide into port and should lock in place when module is fully inserted. To protect optics, dust covers should always be installed when cables are not connected.

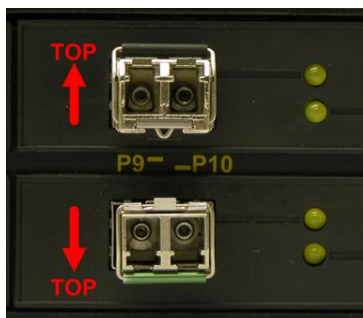


Figure 24: SFP Orientation for top row and bottom row ports

5.2.2.2 GBIC Module Removal

GBIC Modules have two locking latches on either side of the module shown in Figure 25. To remove GBIC module, disconnect any cable and replace with dust cover to protect the optics. User should depress both latches simultaneously and gently pull the module from the chassis. The module should be immediately stored in an ESD-safe environment.

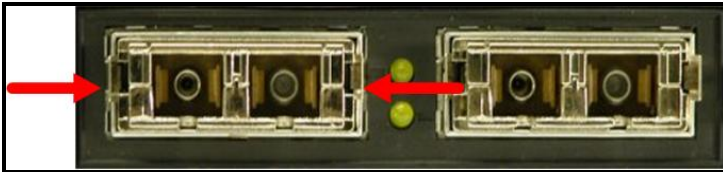


Figure 25: Locking latch location on GBIC optical modules

5.2.2.3 SFP Module Removal

SFP Modules are removed using the metal bail latch located on the top of the module shown in Figure 26. To remove the SFP module, disconnect any cable and replace with dust cover to protect the optics. User should grasp bail latch and gently pull outwards to unlock and remove the SFP module. Removal of the SFP module is shown further in Figure 27. The module should be immediately stored in an ESD-safe environment.



Figure 26: SFP Bail Latch location

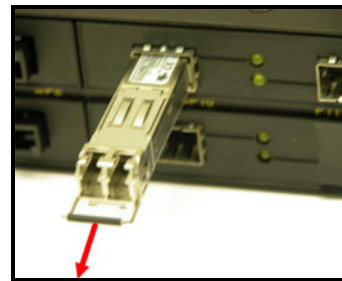


Figure 27: SFP Removal

6 Technical Specifications

6.1 Power Supply Specifications

Power Supply Type (PS1)	Input Range		Fuse Rating	Max. Power Consumption ³	
	Min	Max		10/100TX FE Ports	Worst Case
12 – 24 VDC	10 VDC	36 VDC	6.3A(F) ²	15 W	30 W
24 VDC	18 VDC	36 VDC	5A(F) ²		
48 VDC	36 VDC	59 VDC	2A(T) ²		
HI (125/250 VDC) ¹ HI (110/230 VAC) ¹	88 VDC 85 VAC	300 VDC 265 VAC	2A(T) ^{1,2}		

Table 8: Power Supply Specifications

Power Supply Type (PS2)	Input Range Min	Input Range Max	Fuse Rating	Max. Power Consumption
48 VDC	37 VDC	72 VDC	2A(T) ²	68 W

Table 9: PoE Power Supply Specifications

NOTES:

1. This is the same power supply for both AC and DC.
2. (F) Denotes fast-acting fuse, (T) denotes time-delay fuse
3. Power consumption varies based on configuration. 10/100Tx ports consume roughly 1W less than fiber optic ports
4. For continued protection against risk of fire, replace only with same type and rating of fuse.

6.2 Failsafe Relay Specifications

Parameter	Value (Resistive Load)
Max Switching Voltage	240VAC, 125VDC
Rated Switching Current	2A @ 240VAC 0.15A @ 125VDC, 2A @ 30VDC
Max Switching Capacity	150W, 500VA

Table 10: Failsafe Relay Contact Ratings

6.3 Networking Standards Supported

<i>Parameter</i>	<i>10Mbps Ports</i>	<i>100Mbps Ports</i>	<i>1000Mbps Ports</i>	<i>Notes</i>
IEEE 802.3	✓			10BaseT / 10BaseFL
IEEE 802.3u		✓		100BaseTX / 100BaseFX
IEEE 802.3z			✓	1000BaseSX/LX
IEEE 802.3ab			✓	1000BaseTx
IEEE 802.3x	✓	✓	✓	Full Duplex Operation
IEEE 802.1D	✓	✓	✓	MAC Bridges
IEEE 802.1Q	✓	✓	✓	VLAN (Virtual LAN)
IEEE 802.1p	✓	✓	✓	Priority Levels
IEEE 802.3af	✓	✓		Power over Ethernet Ports (17 – 20)

Table 11: Networking Standards Supported

6.4 Twisted-Pair Port Specifications

Parameter	Specification	Notes
Speed	10/100 Mbps	Auto-negotiating
Duplex	FDX / HDX	Auto-negotiating
Cable-Type	> Category 5	Shielded/Unshielded
Wiring Standard	TIA/EIA T568A/B	Auto-Crossover, Auto-polarity
Max Distance	100 m	
Connector	RJ45	
Isolation	1.5 kV	RMS 1-minute
PoE Voltage	44 – 57 V	PoE Ports 17 – 20
PoE Current	350 mA	PoE Ports 17 – 20

Table 12: Twisted-Pair Port Specifications

6.5 Fiber Optical Specifications

The following sections detail fiber optical specifications on ports that can be ordered with the RSG2000 series Ethernet switch. The user determines the type of optics at time of ordering, and can determine the modules installed on a particular unit by reading the factory data file via the RuggedSwitch ROSTM user interface. The following sections detail specifications of fiber optic modules in two general categories, Ethernet / Fast Ethernet (10/100Mbps) and Gigabit Ethernet (1000Mbps).

6.5.1 Fast Ethernet (10/100 Mbps) Optical Specifications

The dual-port fast Ethernet optical specifications for RSG2100P ports 1-8 and 13-20 are shown below organized by module order code. Module order codes are contained within each product's factory data when assembled and configured at the factory. Consult the RuggedCom ROS to determine the optical assemblies installed in a particular product.

Optics Order Code	Speed Standard	Mode / Connector	Tx (nm)	Cable Type (um)	Tx min (dBm)	Tx max (dBm)	Rx Sensitivity (dBm)	Rx Saturation (dBm)	Typical Distance (km)	Power Budget (dB)
12-11-0011	10FL	MM/ST	820	62.5/125 50/125	-16 -19.8	-9 -12.8	-34 -34	-11.2 -11.2	2 2	18 14.2
12-11-0012	10FL	SM/ST	1310	9/125	-27	-14	-35	-3	5	8
12-11-0007	100FX	MM/ST	1300	62.5/125 50/125	-19 -22.5	-14 -14	-33.9 -33.9	-14 -14	2 2	14.9 11.4
12-11-0009	100FX	MM/SC	1300	50/125 62.5/125	-22.5 -19	-14 -14	-33.9 -33.9	-14 -14	2 2	11.4 14.9
12-11-0008	100FX	MM/MTRJ	1300	50/125 62.5/125	-22.5 -19	-14 -14	-33.5 -33.5	-14 -14	2 2	11 14.5
12-11-0046	100FX	MM/LC	1310	62.5/125	-19	-14	-32	-14	2	13
12-11-0006	100FX	SM/ST	1310	9/125	-15	-7	-34	-3	20	19
12-11-0005	100FX	SM/SC	1300	9/125	-15	-8	-31	-7	20	16
12-11-0004	100FX	SM/LC	1300	9/125	-15	-8	-38	-3	20	23
12-11-0031	100FX	SM/SC	1310	9/125	-5	0	-34	-3	50	29
12-11-0032	100FX	SM/LC	1310	9/125	-5	0	-35	-3	50	30
12-11-0033	100FX	SM/SC	1310	9/125	5	0	-37	0	90	42
12-11-0034	100FX	SM/LC	1310	9/125	0	5	-37	0	90	37

Table 13: Fast Ethernet optical specifications

6.5.2 Gigabit Ethernet (1000 Mbps) Optical Specifications

For maximum flexibility RuggedCom Inc. offers a number of different transceiver choices for Gigabit fiber optical communications. The table below details fiber optic specifications based on the 2-port modules or pluggable transceivers selected at time of ordering.

Optics Order Code	Speed Standard	Mode / Connector	Tx (nm)	Cable Type (um)	Tx min (dBm)	Tx max (dBm)	Rx Sensitivity (dBm)	Rx Saturation (dBm)	Typical Distance (km)	Power Budget (dB)
12-11-0036	1000SX	MM/LC MM/LC	850 850	62.5/125 50/125	-9.5 -9.5	-4 -4	-20 -20	0 0	0.4 0.7	10.5 10.5
12-11-0027	1000LX	SM/LC	1310	9/125	-9.5	-3	-21	-3	10	11.5
12-11-0028	1000LX	SM/LC	1310	9/125	-5	0	-24	-3	25	19
12-11-0025	1000LX	SM/SC	1310	9/125	-10	-3	-20	-3	10	10
12-11-0026	1000LX	SM/SC	1310	9/125	-5	0	-20	-3	25	15
25-10-0111	1000SX	MM/LC	850 850	62.5/125 50/125	-9 -9	-2.5 -2.5	-20 -20	0 0	0.3 0.55	11 11
25-10-0100	1000LX	SM/LC	1310	9/125	-9.5	-3	-21	-3	10	11.5
25-10-0101	1000LX	SM/LC	1310	9/125	-3	2	-23	-3	25	20
25-10-0108 ⁵	1000LX	SM/LC	1550	9/125	-6	0	-23	-3	40	17
25-10-0109 ⁴	1000LX	SM/LC	1550	9/125	0	5	-23	-3	70	23
25-10-0202	1000BX	SM/SC	1310	SIMPLEX 9/125	-9	-3	-22	-3	10	13
25-10-0203 ⁴	1000BX	SM/SC	1490	SIMPLEX 9/125	-9	-3	-22	-3	10	13
25-10-0102	1000LX	SM/SC	1310	9/125	-9.5	-3	-21	-3	10	11.5
25-10-0103	1000LX	SM/SC	1310	9/125	-3	2	-23	-3	40	20
25-10-0113 ⁴	1000LX	SM/SC	1550	9/125	0	5	-23	-3	70	23

Table 14: Gigabit Ethernet optical specifications

NOTES:

1. Maximum segment length is greatly dependent on factors such as fiber quality, and number of patches and splices. Please consult RuggedCom sales associates when determining maximum segment distances.
2. All cabling is duplex type unless otherwise specified.
3. All optical power numbers are listed as dBm averages.
4. These transceivers utilize a distributed feedback (DFB) type laser and are rated for -20°C to +85°C operation only.
5. The 25-10-0108 SFP module is obsolete, and has been replaced with the 70km 25-10-0109 SFP module.

6.6 Type Test Specifications

Electrical Safety	Levels	Comments
Dielectric Withstand	2 kV rms for 1 minute	ANSI/IEEE C37.90 (1989) IEC 60255-5 (Section 6)
High Voltage Impulse	5 kV peak	IEC 60255-5 (Section 8)
Insulation Resistance	500 VDC for 1 minute	IEC 60255-5 (Section 6)

Electrical Environment	Levels	Comments
High Frequency Disturbance (Oscillatory)	2.5 kV @ 1MHz for 2s	ANSI/IEEE C37.90.1 IEC 60255-22-1
IEC Surge	4 kV / 2 kV	IEC 61000-4-5 (Level 4)
IEC Fast Transient	2 kV / 1 kV	IEC 61000-4-4 (Level 4)
ANSI/IEEE Fast Transient	4 kV	ANSI/IEEE C37.90.1
IEC Radiated RFI Immunity	10 V/m	IEC 61000-4-3
ANSI/IEEE Radiated RFI Immunity	35 V/m	ANSI/IEEE C37.90.2
ESD (Electrostatic Discharge)	15 kV (air discharge) 8 kV (contact)	IEC 61000-4-2 (Level 4)

Atmospheric Environment	Levels	Comments
Temperature (Dry Cold)	-40°C	IEC 60068-2-1 Test Ad: 16 hrs @ -40°C
Temperature (Dry Heat)	85°C	IEC 60068-2-2 Test Bd: 16 hrs @ 85°C
Humidity	95% non-condensing	IEC 60068-2-30 Test Db: 6 cycles, 55°C, 95% Humidity

Table 15: Test Type Specifications

6.7 Operating Environment

Parameter	Range	Comments
Ambient Operating Temperature	-40 to 85°C	Ambient Temperature as measured from a 30cm radius surrounding the center of the enclosure.
Ambient Relative Humidity	5% to 95%	Non-condensing
Ambient Storage Temperature	-40 to 85°C	

Table 16: Operating Environment

6.8 Mechanical Specifications

Parameter	Value	Comments
Dimensions	18.29 x 10.17 x 1.74 inches (464,57) x (258,32) x (44,20) mm	(Length x Width x Height) with mounting brackets installed
Weight	10 lb (4.5 Kg)	
Enclosure	18awg galvanized steel	

Table 17: Mechanical Specifications

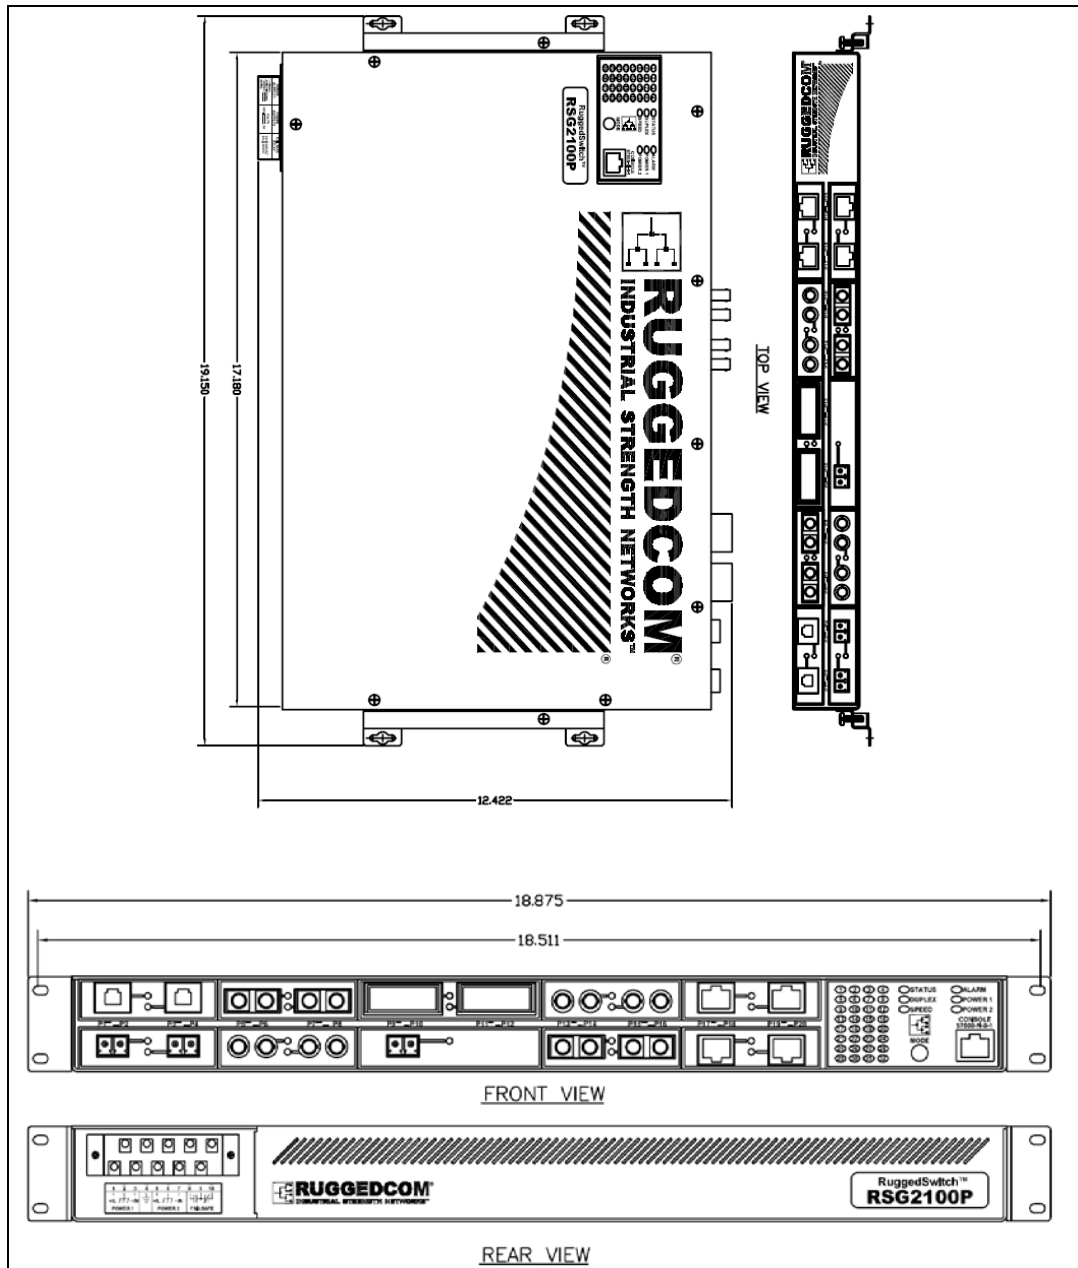


Figure 28: Mechanical Specifications

7 Agency Approvals

Agency	Standards	Comments
CSA	CSA C22.2 No. 60950, UL 60950	Approved
CE	EN 60950, EN 61000-6-2	Approved
FCC	FCC Part 15, Class A	Approved
CISPR	EN55022, Class A	Approved
FDA/CDRH	21 CFR Chapter 1, Subchapter J	Compliant
IEC/EN	EN60825-1:1994 + A11:1996 + A2:2001	Compliant

Table 18: Agency Approvals

8 Warranty

RuggedCom warrants this product for a period of five (5) years from date of purchase. For warranty details, visit <http://www.ruggedcom.com/> or contact your customer service representative.

Should this product require warranty or service contact the factory at:

RuggedCom Inc.
30 Whitmore Road,
Woodbridge, Ontario
Canada L4L 7Z4
Phone: (905) 856-5288
Fax: (905) 856-1995