




Scul-Com®

Electronic Automatic Reorder System

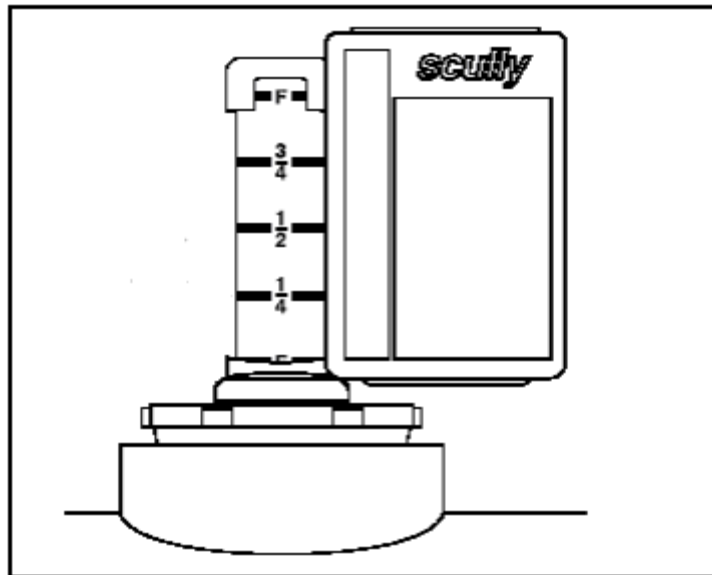

Sensor Installation

Materials list:

1. Scul-Com® Sensor
2. Two new Alkaline AAA batteries (customer provided)

Preliminary:

The Scul-Com® Sensor is designed to be installed on above-ground, indoor storage tanks equipped with either a Scully MagneLink Twis-Lok® or Ventalarm® gauge.

To test the gauge, unscrew the sight glass from the oil gauge. Slowly lift the gauge rod and let it drop. You should hear a light splash. Let the rod come to rest. Gently press down on the rod. It should slowly return to its original position. If the gauge does not react in this fashion, replace it with the proper Scully Twis-Lok® gauge.

If the existing Scully gauge is not factory equipped with a magnet, install a magnet upgrade kit (P/N 0063) per the instructions packaged with the upgrade kit.

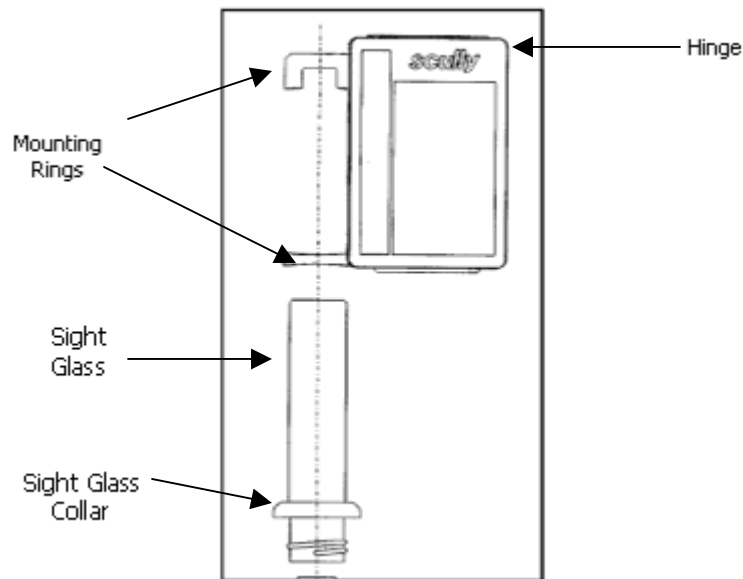


Figure 1 Transmitter Mounting Assembly



Procedure:

1. Ensure Base Unit has already been installed to receive transmission.
2. With mounting rings facing left, and hinge on Scul-Com® sensor up, slide rings over sight glass till bottom ring rests snugly on sight glass collar.
3. Open Scul-Com® Sensor Cover.
4. Following the polarity diagrams (match the battery + and – to those on the board), press batteries into battery holders.
5. With mounting rings facing left, and hinge on Scul-Com® sensor up, slide rings over sight glass until bottom ring rests snugly on site glass collar.
6. Press reset button and ensure that the red LED flashes brightly one time.
7. Close cover.
8. An LED will flash for 5 minutes on the base unit. Green flashing indicates a successful call to Autoreorder, red flashing indicates an unsuccessful call to Autoreorder.

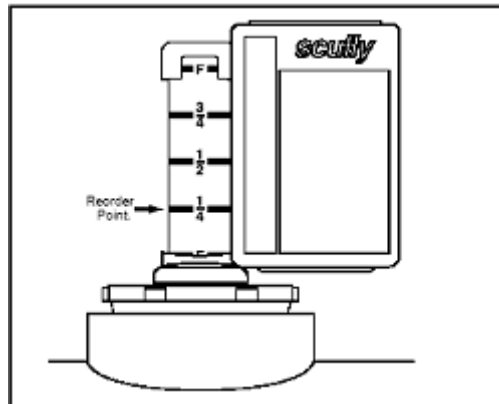


Figure 2: Transmitter reorder point.



FCC Compliance:

15.19(a)(3):

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

15.105(b)

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to Part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

Changes or Modifications:

Changes or modifications not expressly approved by Scully Signal Company could void the user's authority to operate the equipment.

For technical assistance, call 1-800-272-8559 or 1-617-692-8600 and request assistance for a Scully Scul-Com® installation.

P/N 61605 Rev A3

