



Heating and Air Conditioning

TECHNICAL GUIDE R-410A, 13 SEER LATITUDE™ SERIES 60 Hertz

Description

These York® Latitude™ packaged cooling/heating air conditioners are designed for outdoor installation. Only utility and duct connections are required at the point of installation.

Field-installed electric heater accessories are available to provide electric heat, if required. (Single phase only)



Tested in accordance with:



ISO 9001
Certified Quality
Management System

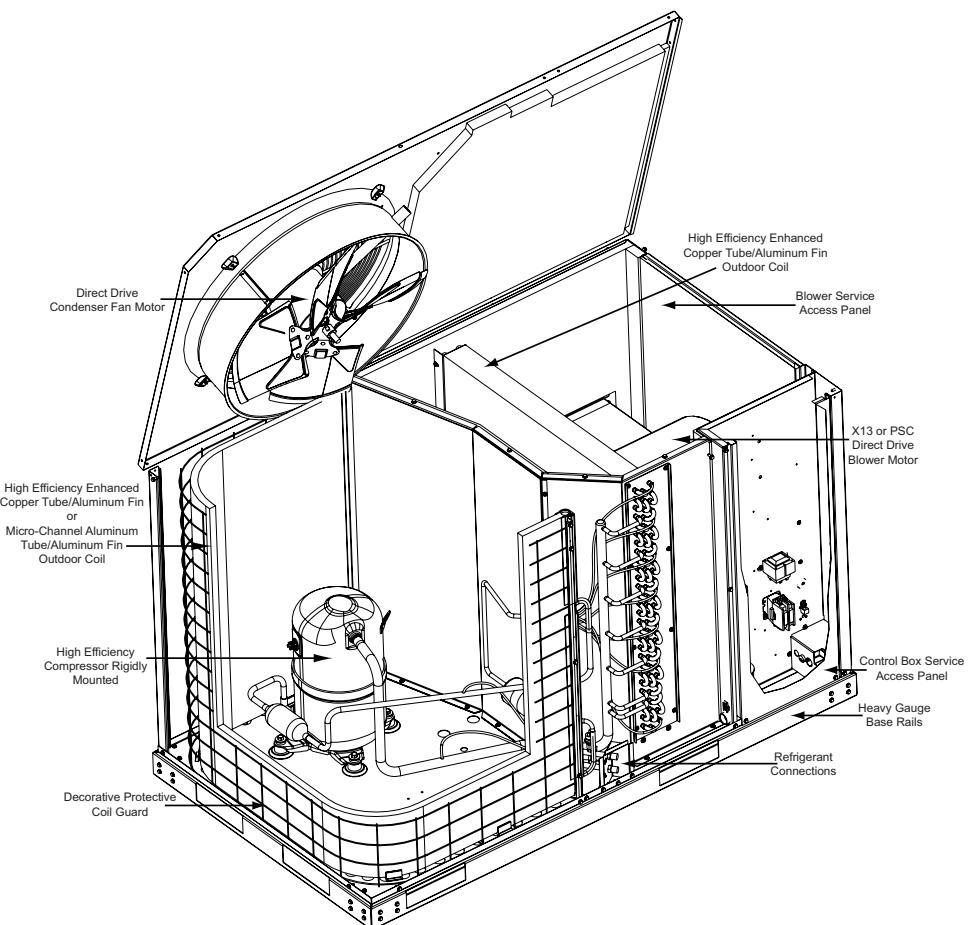


Table of Contents

| | |
|------------------------------|----|
| Description | 1 |
| Table of Contents | 2 |
| Component Location | 2 |
| Nomenclature | 3 |
| Features and Benefits | 3 |
| Guide Specifications | 4 |
| Physical Data | 6 |
| Capacity Performance | 9 |
| Airflow Performance | 35 |
| Sound Performance | 39 |
| Electrical Data | 39 |
| Weights and Dimensions | 49 |


Component Location

Cooling Unit and Heat Pump




Nomenclature

Cooling Unit

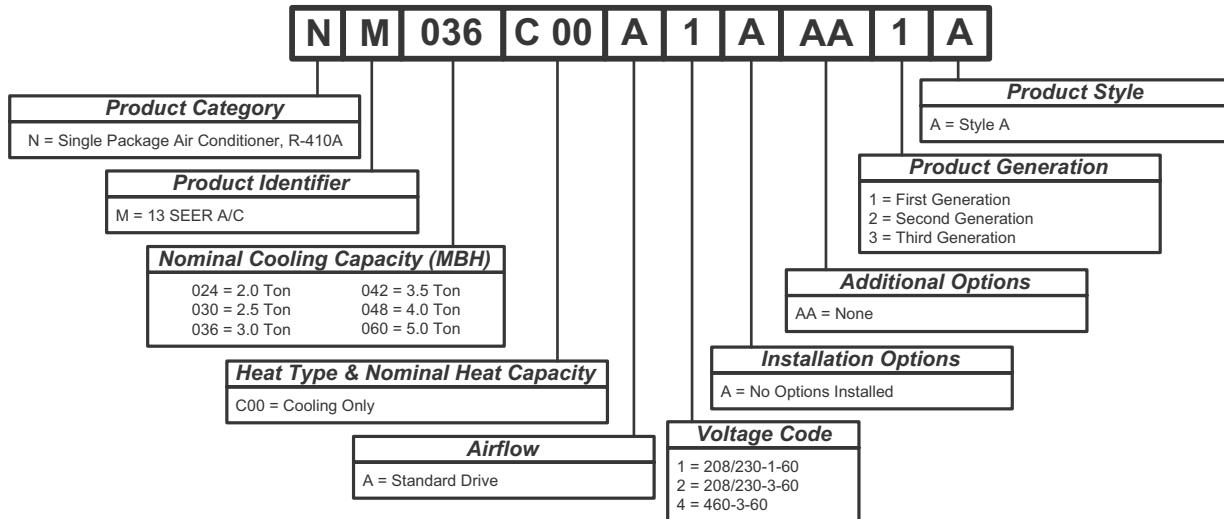

Heat Pump

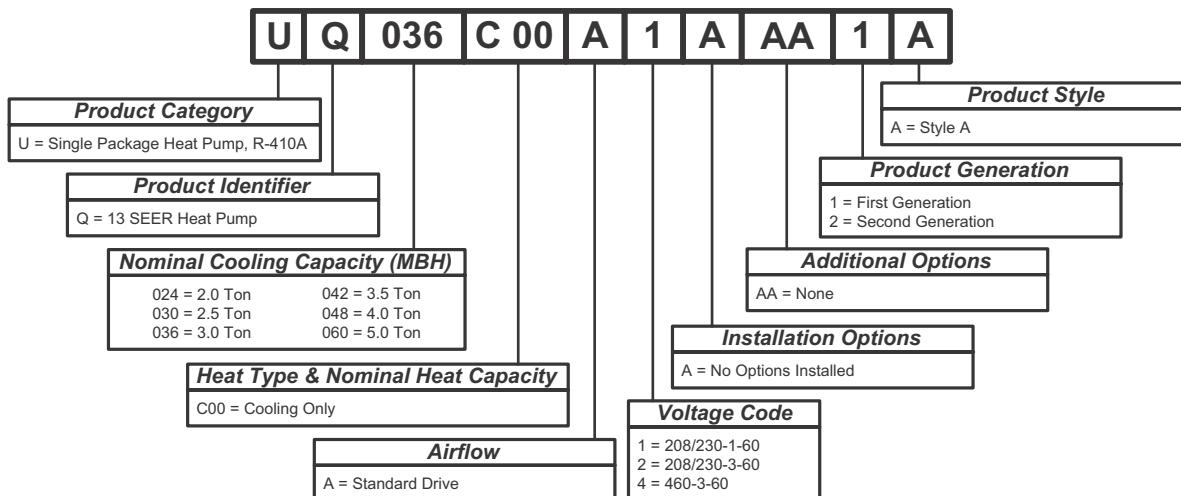

Features and Benefits

Standard Features

- Operating Efficiency** - All cooling units provide a SEER of 13.0.
- All heat pump units provide operating efficiency of 13.0 SEER and 7.7 HSPF. All efficiencies meet legislated minimum levels.
- Lower Installation Cost** - Installation time and costs are reduced by easy power and control wiring connections. The small base dimension means less space is required on the ground or roof, plus, the installer can fit this unit between the wheel wells of full size pick-up truck. All models are well under 400 pounds.
- All units are completely wired, charged with R-410A and tested prior to shipment. Unique test stations using a new

state of the art computerized process system are used to insure product quality. Refrigerant charge and component part numbers are verified via computers at assembly. Vital run test statistics such as system pressure, motor currents, air velocity and temperature, unit vibration, and gas system safeties are monitored and recorded by the system to insure unit performance.

Equal size, side supply and return duct connections allows easy hook-up of ducts to match low crawl spaces without transition pieces.

- Coil Technology** - All cooling units utilize Micro-Channel "all-aluminum" condensers which provide improved heat transfer capabilities, and reduced charge volumes. All evaporators utilize a conventional copper tube/aluminum fin design for proven reliability and performance.

- **Utility Connections Made Easy** - Electric utility knockouts are provided through the side of the unit. Utility connections can be made quickly and with a minimum amount of field labor. A field supplied and field installed electrical disconnect switch must be installed.
- **Round Duct Flanges** - (Factory Supplied - Field Installed) Equal size, side supply and return duct flanges allow easy hook-up of ducts.
- **Condensate Pan** - A non-corrosive, long-lasting, water-tight pan is positioned below the evaporator coil to collect and drain all condensate. Less collection of stagnant condensate will build-up. The condensate pan conforms to ASHRAE 62-89 standards (Ventilation for Acceptable Indoor Air Quality).
- **Condensate Drain** - The 3/4 inch NPTF connection is rigidly mounted to assure proper fit and leak tight seal.
- **Durable Finish** - The cabinet is made of pre-painted steel. The pre-treated galvanized steel provides a better paint to steel bond, which resists corrosion and rust creep. Special primer formulas and matted-textured finish insure less fading when exposed to sunlight.
- **Full Perimeter Base Rails** - The base rails provide a solid foundation for the entire unit and protects the unit during shipment. The rails provide fork lift access from all sides. On applications where the unit is placed on a pad, the base will keep the unit off the pad to deter corrosion.
- **More Attractive Appearance** - A single piece Water Shed top cover containing a top discharge condenser fan arrangement requires less square footage on installation and provides a wider variety of installations. The one piece design adds greater water integrity.
- **Top Discharge** - The top discharge condenser fan does not disrupt neighboring areas or dry-out vegetation surrounding the unit. The warm air from the top mounted fan is blown up away from the structure and any landscaping. This allows compact location on multi-unit applications.
- **Condenser Coil Grille** - All models utilize a decorative "Wire Form" coil guard to provide impact protection against large objects.
- **Low Operating Sound Level** - The upward air flow carries the normal operating noise up and away from the living area. The rigid top panel effectively isolates any motor sound. Isolator mounted compressor and the rippled fins of the condenser coil muffle the normal fan motor and compressor operating sounds.
- **Fan System** - 2, 2-1/2 and 3 Ton A/C models operate with a 3-speed PSC (Permanent Split Capacitor) fan motor. 4 and 5 Ton A/C and all Heat Pump models operate with a constant torque (X Motor) fan motor with 5 speed taps. All these units easily match all types of applications and provide greater on site flexibility to match comfort requirements.
- **Protected Compressor** - The compressor is internally protected against high pressure and temperature. This is accomplished by the simultaneous operation of high

pressure relief valve and a temperature sensor which protect the compressor if undesirable operating conditions occur.

- **Pressure Switches** - High pressure and low pressure/loss of charge switches standard in all units. On Heat Pump models, when abnormal conditions are sensed through the pressure switches, the unit will lock-out preventing further operation until reset or the problem is corrected.
- **Exclusive Coil Design** - Grooved copper tubes and enhanced aluminum fin construction on all indoor coils and heat pump outdoor coils improve heat transfer for maximum efficiency and durability or Micro-Channel aluminum tube, aluminum fin on all cooling outdoor coils for long lasting durability and efficient operation.
- **Low Maintenance** - Long life, permanently lubricated condenser and evaporator fan motor bearings need no annual maintenance adding greater reliability to the unit.
- **Secured Service Access Ports** - Protected, externally mounted, re-usable service access ports are provided on both the high and low lines for ease of evacuating and charging the system. No final field mounting required.
- **Easy Service Access** - A large, single panel covers the electrical controls makes servicing easy. The blower compartment has a large panel which when removed will allow the blower fan assembly to slide-out for ease of maintenance and trouble shooting.
- **Replacement Parts** - The installer requires no special training to replace any of the components of these units and does not need to maintain an inventory of unique parts.

Field Installed Accessories

- **Wall Thermostat** - The units are designed to operate with 24-volt electronic and electro-mechanical thermostats.
- **Electric Heat Kit** - Available in 4 different kW capacities (5, 7, 10 and 15 kW). (Single phase only)
- **Start Assist Kits** - Available for all models.
- **Outdoor Thermostat** - Available for all heat pump models.

Guide Specifications

GENERAL

Units shall be factory-assembled, single packaged, Electric Cooling units, designed for outdoor mounted installation. Units shall have minimum SEER ratings of 13.0. Heat pump 7.7 HSPF.

The units shall be factory wired, piped, charged with R-410A refrigerant and factory tested prior to shipment. All unit wiring shall be color coded.

All units shall be manufactured in a facility certified to ISO 9001 standards, and the cooling performance shall be rated in accordance with DOE and ARI test procedures. Units shall be certified to UL 1995/CAN/CSA C22.2 No. 236 standards.

UNIT CABINET

1. Unit cabinet shall be constructed of G-90, pre-paint textured steel, certified at 500 hours salt spray test per ASTM-B117 standards.
2. The unit top shall be a single piece "Water Shed" design.
3. Unit shall have a rigidly mounted condenser coil guard to provide protection from objects and personnel after installation.
4. Indoor blower section shall be insulated with up to 3/4" thick insulation.
5. Cabinet panels shall be "large" size, easily removable for servicing and maintenance.
6. Unit shall be built on a formed, "Super-Structure" design base pan, with embossments at critical points to add strength, rigidity and aid in minimizing sound.
7. Full perimeter base rails shall be provided to assure reliable transit of equipment.
8. Condensate pan shall be internally sloped and conform to ASHARE 62-89 self-draining standards, with 3/4" NPTF ridged mount connection.

INDOOR (EVAPORATOR) FAN ASSEMBLY

1. Fan shall be direct drive, either 3 speed PSC (Permanent Split Capacitor) or 5 speed constant torque (X Motor) design.
2. Fan wheel shall be double-inlet type with forward-curved blades, dynamically balanced to operate smoothly throughout the entire range of operation. Airflow design shall be constant air volume.
3. Bearings shall be sealed and permanently lubricated for longer life and no maintenance.
4. Fan assembly shall be accessible via removable inlet ring.

OUTDOOR (CONDENSER) FAN ASSEMBLY

1. The outdoor fan shall be of the direct-driven propeller type, discharge air vertically, have aluminum blades riveted to corrosion resistant steel spider bracket and shall be statically balanced for smooth operation.
2. The outdoor fan motor shall be totally enclosed with permanently lubricated bearings and internally protected against overload conditions.

REFRIGERANT COMPONENTS

Compressors:

- a. Shall be fully hermetic reciprocating, rotary or scroll type, direct drive, internally protected with internal high-pressure relief and over temperature protection. The hermetic motor shall be suction gas cooled and have a voltage range of + or - 10% of the unit nameplate voltage.

- b. Shall have internal isolation and sound muffling to minimize vibration and noise, and be externally isolated on a dedicated, independent mounting.

Coils:

- a. Evaporator coils shall have aluminum plate fins mechanically bonded to seamless internally enhanced copper tubes with all joints brazed.
- b. Evaporator coil shall be of the direct expansion, blow through design.
- c. Condenser coils shall have aluminum plate fins mechanically bonded to seamless internally enhanced copper tubes with all joints brazed or Micro-Channel aluminum tube, aluminum fins.
- d. Condenser coil shall be draw through design.

Refrigerant Circuit and Refrigerant Safety Components shall include:

- a. Independent fixed-orifice or TXV expansion devices.
- b. Filter,strainer to eliminate any foreign matter.
- c. Accessible service gage connections on both suction and discharge lines to charge, evacuate, and measure refrigerant pressure during any necessary servicing or troubleshooting, without losing charge and without disrupting condenser or evaporator air flow.

Unit Controls:

- a. Controls shall be mounted in a large control box, allowing easy access for trouble shooting and maintenance without affecting the normal system operation pressures.
- b. Unit shall have large, easily removable panels, covering electrical controls and compressor, allowing easy access for any necessary maintenance or servicing.

ELECTRIC HEATING SECTION

1. An electric heating section, with nickel chromium elements, shall be provided in a range of 5 thru 15 KW, single phase only.
2. The heating section shall have a primary limit control(s) and automatic reset, to prevent the heating element system from operating at an excessive temperature.
3. The heating section assembly shall slide out of the unit for easy maintenance and service.

UNIT OPERATING CHARACTERISTICS

1. Unit shall be capable of starting and running at 125° F outdoor temperature, exceeding maximum load criteria of ARI Standard 210/240.
2. The compressor, with standard controls, shall be capable of cooling operation down to 45° F outdoor temperature.

ELECTRICAL REQUIREMENTS

All unit power wiring shall enter unit cabinet at a single factory provided location.

Separate openings shall be provided for the control wiring.

Physical Data

NM024-060 Physical Data

| Component | Models | | | | | |
|------------------------------------|---------------------|---------------------|---------------------|---------------------|---------------------|---------------------|
| | NM024 | NM030 | NM036 | NM042 | NM048 | NM060 |
| Nominal Tonnage | 2.0 | 2.5 | 3.0 | 3.5 | 4.0 | 5.0 |
| ARI COOLING PERFORMANCE | | | | | | |
| Gross Capacity @ ARI A point (Btu) | 24000 | 31500 | 37000 | 41400 | 48100 | 57000 |
| ARI net capacity (Btu) | 23400 | 30200 | 35400 | 40200 | 46500 | 55500 |
| EER | 11 | 11.4 | 11 | 10.8 | 11.2 | 10.8 |
| SEER | 13 | 13 | 13 | 13 | 13 | 13 |
| Nominal CFM | 850 | 1000 | 1200 | 1150 | 1450 | 1700 |
| System power (KW) | 2.13 | 2.64 | 3.21 | 3.72 | 4.15 | 5.14 |
| Refrigerant type | R-410A | R-410A | R-410A | R-410A | R-410A | R-410A |
| Refrigerant charge (lb-oz) | | | | | | |
| System 1 | 4-0 | 4-6 | 4-8 | 4-8 | 4-12 | 4-11 |
| DIMENSIONS (inches) | | | | | | |
| Length | 47-1/4 | 47-1/4 | 47-1/4 | 47-1/4 | 57-9/16 | 57-9/16 |
| Width | 32-13/16 | 32-13/16 | 32-13/16 | 32-13/16 | 32-13/16 | 32-13/16 |
| Height | 30-15/16 | 30-15/16 | 30-15/16 | 30-15/16 | 34-15/16 | 34-15/16 |
| OPERATING WT. (lbs.) | 276 | 279 | 315 | 315 | 357 | 350 |
| COMPRESSORS | | | | | | |
| Type | Scroll | Recip | Recip | Recip | Recip | Scroll |
| Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| CONDENSER COIL DATA | | | | | | |
| Face area (Sq. Ft.) | 11.2 | 11.2 | 11.2 | 11.2 | 15.1 | 15.1 |
| Rows | 1 | 1 | 1 | 1 | 1 | 1 |
| Fins per inch | 23 | 23 | 23 | 23 | 23 | 23 |
| Tube diameter (in.) | .71/18 | .71/18 | .71/18 | .71/18 | .71/18 | .71/18 |
| Circuitry Type | 2-pass Microchannel |
| EVAPORATOR COIL DATA | | | | | | |
| Face area (Sq. Ft.) | 4.67 | 4.67 | 4.67 | 4.67 | 5.44 | 5.44 |
| Rows | 3 | 3 | 4 | 4 | 3 | 4 |
| Fins per inch | 13 | 13 | 13 | 13 | 13 | 13 |
| Tube diameter | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 |
| Circuitry Type | Intertwined | Intertwined | Intertwined | Intertwined | Intertwined | Intertwined |
| Refrigerant control | Orifice | Orifice | Orifice | Orifice | Orifice | TXV |
| CONDENSER FAN DATA | | | | | | |
| Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| Fan diameter (Inch) | 20 | 20 | 20 | 20 | 22 | 22 |
| Type | Prop | Prop | Prop | Prop | Prop | Prop |
| Drive type | Direct | Direct | Direct | Direct | Direct | Direct |
| No. speeds | 1 | 1 | 1 | 1 | 1 | 1 |
| Number of motors | 1 | 1 | 1 | 1 | 1 | 1 |
| Motor HP each | 1/4 | 1/4 | 1/4 | 1/3 | 1/3 | 1/3 |
| RPM | 1100 | 1100 | 1100 | 1100 | 1100 | 1100 |
| Nominal total CFM | 2800 | 2800 | 2800 | 3000 | 3200 | 3200 |
| DIRECT DRIVE EVAP FAN DATA | | | | | | |
| Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| Fan Size (Inch) | 10 x 7 | 10 x 7 | 10 x 7 | 10 x 7 | 11 x 10 | 11 x 10 |
| Fan type | Centrifugal | Centrifugal | Centrifugal | Centrifugal | Centrifugal | Centrifugal |
| Drive type | Direct | Direct | Direct | Direct | Direct | Direct |
| No. speeds | 3 | 3 | 3 | 5 | 5 | 5 |
| Number of Motors | 1 | 1 | 1 | 1 | 1 | 1 |
| Motor HP each | 1/2 | 1/2 | 1/2 | 1/2 | 1 | 1 |
| RPM | 1075 | 1075 | 1075 | 1100 | 1100 | 1100 |
| Frame size | 48 | 48 | 48 | 48 | 48 | 48 |
| FILTERS | | | | | | |
| Quantity - Size | - | - | - | - | - | - |

UQ024-060 Physical Data

| Component | Models | | | | | |
|------------------------------------|-------------|-------------|-------------|-------------|-------------|-------------|
| | UQ024 | UQ030 | UQ036 | UQ042 | UQ048 | UQ060 |
| Nominal Tonnage | 2.0 | 2.5 | 3.0 | 3.5 | 4.0 | 5.0 |
| ARI COOLING PERFORMANCE | | | | | | |
| Gross Capacity @ ARI A point (Btu) | 23220 | 28750 | 37000 | 44000 | 47500 | 54384 |
| ARI net capacity (Btu) | 22600 | 28000 | 35200 | 42000 | 46000 | 53000 |
| EER | 11.2 | 11.2 | 11.2 | 11.0 | 11.0 | 10.8 |
| SEER | 13 | 13 | 13 | 13 | 13 | 13 |
| Nominal CFM | 900 | 1000 | 1200 | 1450 | 1600 | 1650 |
| System power (KW) | 2.02 | 2.50 | 3.16 | 3.82 | 4.18 | 4.84 |
| Refrigerant type | R-410A | R-410A | R-410A | R-410A | R-410A | R-410A |
| Refrigerant charge (lb-oz) | | | | | | |
| System 1 | 7-7 | 9-4 | 9-10 | 12-8 | 13-0 | 12-8 |
| ARI HEATING PERFORMANCE | | | | | | |
| 47°F Capacity Rating (MBH) | 20000 | 26500 | 32000 | 38000 | 40000 | 50000 |
| System Power KW/COP | 1720/3.4 | 2386/3.25 | 2930/3.2 | 3480/3.20 | 3663/3.20 | 4523/3.25 |
| 17°F Capacity Rating (MBH) | 11000 | 14800 | 18400 | 22000 | 24000 | 29200 |
| System Power KW/COP | 1610/2.00 | 2122/2.04 | 2598/2.04 | 3224/2.0 | 3517/2.0 | 4057/2.10 |
| HSPF BTU/Watts-hr | 7.7 | 7.7 | 7.7 | 7.7 | 7.7 | 7.7 |
| DIMENSIONS (inches) | | | | | | |
| Length | 47-1/4 | 47-1/4 | 47-1/4 | 57-9/16 | 57-9/16 | 57-9/16 |
| Width | 32-13/16 | 32-13/16 | 32-13/16 | 32-13/16 | 32-13/16 | 32-13/16 |
| Height | 30-15/16 | 30-15/16 | 30-15/16 | 34-15/16 | 34-15/16 | 34-15/16 |
| OPERATING WT. (lbs.) | 325 | 340 | 340 | 372 | 382 | 390 |
| COMPRESSORS | | | | | | |
| Type | Scroll | Scroll | Scroll | Scroll | Scroll | Scroll |
| Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| CONDENSER COIL DATA | | | | | | |
| Face area (Sq. Ft.) | 11.1 | 11.28 | 11.28 | 16 | 16 | 20 |
| Rows | 1 | 2 | 2 | 2 | 2 | 2 |
| Fins per inch | 20 | 15 | 20 | 15 | 15 | 20 |
| Tube diameter (in.) | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 |
| Circuitry Type | Intertwined | Intertwined | Intertwined | Intertwined | Intertwined | Intertwined |
| Refrigerant Control | TXV | TXV | TXV | TXV | TXV | TXV |
| EVAPORATOR COIL DATA | | | | | | |
| Face area (Sq. Ft.) | 4.67 | 4.67 | 4.67 | 5.44 | 5.44 | 5.44 |
| Rows | 3 | 3 | 3 | 4 | 4 | 4 |
| Fins per inch | 13 | 13 | 16 | 13 | 13 | 13 |
| Tube diameter | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 | 3/8 |
| Circuitry Type | Intertwined | Intertwined | Intertwined | Intertwined | Intertwined | Intertwined |
| Refrigerant control | Orifice | Orifice | Orifice | Orifice | Orifice | TXV |
| CONDENSER FAN DATA | | | | | | |
| Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| Fan diameter (Inch) | 20 | 20 | 20 | 22 | 22 | 22 |
| Fan type | Prop | Prop | Prop | Prop | Prop | Prop |
| Drive type | Direct | Direct | Direct | Direct | Direct | Direct |
| No. speeds | 1 | 1 | 1 | 1 | 1 | 1 |
| Number of motors | 1 | 1 | 1 | 1 | 1 | 1 |
| Motor HP each | 1/4 | 1/4 | 1/4 | 1/3 | 1/3 | 1/3 |
| RPM | 850 | 850 | 1100 | 1100 | 1100 | 1100 |
| Nominal total CFM | 2500 | 2500 | 2850 | 3200 | 3200 | 3200 |
| DIRECT DRIVE EVAP FAN DATA | | | | | | |
| Quantity | 1 | 1 | 1 | 1 | 1 | 1 |
| Fan diameter (Inch) | 10 x 7 | 10 x 7 | 10 x 7 | 11 x 10 | 11 x 10 | 11 x 10 |
| Fan type | Centrifugal | Centrifugal | Centrifugal | Centrifugal | Centrifugal | Centrifugal |
| Drive type | Direct | Direct | Direct | Direct | Direct | Direct |
| No. speeds | 5 | 5 | 5 | 5 | 5 | 5 |
| Number of motors | 1 | 1 | 1 | 1 | 1 | 1 |
| Motor HP each | 1/2 | 1/2 | 1/2 | 1 | 1 | 1 |
| RPM | 1100 | 1100 | 1100 | 1100 | 1100 | 1100 |
| Frame size | 48 | 48 | 48 | 48 | 48 | 48 |
| FILTERS | | | | | | |
| Size / Quantity | - | - | - | - | - | - |

NM and UQ Unit Limitations

| Size (Tons) | Model | Unit Voltage | Unit Limitations | | |
|----------------|----------|--------------|------------------|-----|-----------------|
| | | | Applied Voltage | | Outdoor DB Temp |
| | | | Min | Max | Max (°F) |
| 024 (2.0) | NM UQ | 208/230-1-60 | 187 | 252 | 125 |
| 030 (2.5) | NM UQ | 208/230-1-60 | 187 | 252 | 125 |
| 036 (3.0) | NM UQ | 208/230-1-60 | 187 | 252 | 125 |
| | | 208/230-3-60 | 187 | 252 | 125 |
| 042 (3.5) | NM UQ | 208/230-1-60 | 187 | 252 | 125 |
| 048 (4.0) | NM UQ | 208/230-1-60 | 187 | 252 | 125 |
| | | 208/230-3-60 | 187 | 252 | 125 |
| | | 460-3-60 | 432 | 504 | 125 |
| 060 (5.0) | NM UQ | 208/230-1-60 | 187 | 252 | 125 |
| | | 208/230-3-60 | 187 | 252 | 125 |
| | | 460-3-60 | 432 | 504 | 125 |

NM024 (2.0 Ton) (Continued)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | | |
|---------------------------|----|---|-------------------------------------|-------------------------|------|------|------|------|-----|---|-------------------------------------|-------------------------|----------------------|------|------|-------|-----|--|
| | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | |
| | | | | Return Dry Bulb (°F) | | | | | | | | | Return Dry Bulb (°F) | | | | | |
| 115°F | | | | | | | | | | | | | | | | 125°F | | |
| 500 | 77 | 22.5 | 2.2 | 9.6 | 7.9 | 6.1 | - | - | - | 20.7 | 2.4 | 10.1 | 6.5 | 5.4 | - | - | - | |
| | 72 | 19.9 | 2.2 | 13.4 | 11.2 | 9.0 | 6.9 | - | - | 17.9 | 2.5 | 12.6 | 10.4 | 8.3 | 6.1 | - | - | |
| | 67 | 17.2 | 2.2 | 17.2 | 14.6 | 12.0 | 9.8 | 7.6 | - | 15.2 | 2.5 | 15.2 | 14.1 | 11.1 | 8.9 | 6.7 | - | |
| | 62 | 15.1 | 2.2 | 15.1 | 15.1 | 12.3 | 10.1 | 7.9 | 5.7 | 13.0 | 2.4 | 13.0 | 13.0 | 10.2 | 8.0 | 5.8 | 3.6 | |
| 600 | 77 | 23.0 | 2.2 | 12.7 | 9.3 | 6.7 | - | - | - | 21.1 | 2.5 | 13.3 | 8.6 | 6.1 | - | - | - | |
| | 72 | 20.3 | 2.2 | 15.1 | 12.5 | 10.0 | 7.4 | - | - | 18.2 | 2.5 | 14.3 | 11.8 | 9.2 | 6.6 | - | - | |
| | 67 | 17.5 | 2.2 | 17.5 | 15.8 | 13.2 | 10.7 | 8.1 | - | 15.4 | 2.5 | 15.4 | 14.9 | 12.3 | 9.7 | 7.2 | - | |
| | 62 | 15.5 | 2.2 | 15.5 | 15.5 | 13.5 | 11.0 | 8.4 | 5.8 | 13.2 | 2.5 | 13.2 | 13.2 | 11.3 | 8.8 | 6.2 | 3.6 | |
| | 57 | 17.1 | 2.2 | 17.1 | 17.1 | 14.7 | 12.2 | 9.6 | 7.0 | 15.6 | 2.5 | 15.6 | 15.6 | 13.1 | 10.6 | 8.0 | 5.4 | |
| 700 | 77 | 23.5 | 2.2 | 15.8 | 10.7 | 7.4 | - | - | - | 21.4 | 2.5 | 16.5 | 10.8 | 6.7 | - | - | - | |
| | 72 | 20.7 | 2.2 | 16.8 | 13.9 | 10.9 | 8.0 | - | - | 18.5 | 2.5 | 16.1 | 13.1 | 10.1 | 7.1 | - | - | |
| | 67 | 17.9 | 2.2 | 17.9 | 17.0 | 14.5 | 11.5 | 8.6 | - | 15.7 | 2.5 | 15.7 | 15.7 | 13.6 | 10.6 | 7.6 | - | |
| | 62 | 15.8 | 2.2 | 15.8 | 15.8 | 14.8 | 11.9 | 8.9 | 6.0 | 13.4 | 2.5 | 13.4 | 13.4 | 12.5 | 9.5 | 6.5 | 3.6 | |
| | 57 | 17.5 | 2.2 | 17.5 | 17.5 | 16.1 | 13.2 | 10.2 | 7.3 | 15.8 | 2.5 | 15.8 | 15.8 | 14.5 | 11.5 | 8.5 | 5.5 | |
| 800 | 77 | 24.0 | 2.3 | 18.8 | 12.2 | 8.0 | - | - | - | 21.8 | 2.5 | 19.7 | 12.9 | 7.3 | - | - | - | |
| | 72 | 21.1 | 2.3 | 18.6 | 15.2 | 11.9 | 8.5 | - | - | 18.8 | 2.5 | 17.8 | 14.4 | 11.0 | 7.7 | - | - | |
| | 67 | 18.3 | 2.3 | 18.3 | 18.3 | 15.7 | 12.4 | 9.1 | - | 15.9 | 2.5 | 15.9 | 15.9 | 14.8 | 11.4 | 8.0 | - | |
| | 62 | 16.1 | 2.2 | 16.1 | 16.1 | 16.1 | 12.8 | 9.4 | 6.1 | 13.6 | 2.5 | 13.6 | 13.6 | 13.6 | 10.3 | 6.9 | 3.5 | |
| | 57 | 17.9 | 2.2 | 17.9 | 17.9 | 17.5 | 14.2 | 10.8 | 7.5 | 16.1 | 2.5 | 16.1 | 16.1 | 15.8 | 12.4 | 9.0 | 5.7 | |
| 900 | 72 | 21.5 | 2.2 | 20.1 | 16.4 | 12.7 | 9.0 | - | - | 19.2 | 2.5 | 19.2 | 15.6 | 11.9 | 8.2 | - | - | |
| | 67 | 18.6 | 2.2 | 18.6 | 18.6 | 16.9 | 13.2 | 9.5 | - | 16.3 | 2.5 | 16.3 | 16.3 | 15.9 | 12.2 | 8.5 | - | |
| | 62 | 16.4 | 2.2 | 16.4 | 16.4 | 16.4 | 12.8 | 9.1 | 5.4 | 13.9 | 2.5 | 13.9 | 13.9 | 13.9 | 10.2 | 6.5 | 2.7 | |
| | 57 | 18.2 | 2.2 | 18.2 | 18.2 | 18.0 | 14.4 | 10.7 | 7.0 | 16.4 | 2.5 | 16.4 | 16.4 | 16.3 | 12.5 | 8.8 | 5.1 | |
| 1000 | 72 | 21.9 | 2.2 | 21.6 | 17.6 | 13.6 | 9.6 | - | - | 19.6 | 2.5 | 19.6 | 16.8 | 12.7 | 8.6 | - | - | |
| | 67 | 19.0 | 2.2 | 19.0 | 19.0 | 18.0 | 14.0 | 10.0 | - | 16.6 | 2.5 | 16.6 | 16.6 | 16.6 | 13.0 | 8.9 | - | |
| | 62 | 16.7 | 2.2 | 16.7 | 16.7 | 16.7 | 12.7 | 8.7 | 4.7 | 14.2 | 2.5 | 14.2 | 14.2 | 14.2 | 10.1 | 6.1 | 2.0 | |
| | 57 | 18.5 | 2.2 | 18.5 | 18.5 | 18.5 | 14.5 | 10.5 | 6.5 | 16.8 | 2.4 | 16.8 | 16.8 | 16.8 | 12.7 | 8.6 | 4.5 | |

1. These capacities are Net capacities.

2. These ratings include the compressor, condenser fan and supply air blower motors.

NM030 (2.5 Ton) (Continued)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | | | |
|------------------------|------------|--------------------------------------|----------------------------------|-------------------------|------|------|------|------|-----|--------------------------------------|----------------------------------|-------------------------|----------------------|------|------|--------------|-----|--|--|
| CFM | WB (°F) | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | | |
| | | | | Return Dry Bulb (°F) | | | | | | | | | Return Dry Bulb (°F) | | | | | | |
| 115°F | | | | | | | | | | | | | | | | 125°F | | | |
| 675 | 77 | 29.5 | 3.1 | 13.4 | 10.4 | 7.6 | - | - | - | 26.5 | 3.3 | 14.2 | 8.6 | 6.4 | - | - | - | | |
| | 72 | 25.1 | 3.0 | 17.1 | 14.3 | 11.5 | 8.7 | - | - | 21.9 | 3.2 | 15.8 | 13.0 | 10.2 | 7.4 | - | - | | |
| | 67 | 20.8 | 2.9 | 20.8 | 18.2 | 15.4 | 12.6 | 9.8 | - | 17.4 | 3.1 | 17.4 | 14.0 | 11.2 | 8.4 | - | - | | |
| | 62 | 18.1 | 2.8 | 18.1 | 18.1 | 15.3 | 12.5 | 9.7 | 6.9 | 15.4 | 3.0 | 15.4 | 15.4 | 12.0 | 9.2 | 6.4 | 3.6 | | |
| 750 | 77 | 29.6 | 3.1 | 15.3 | 11.0 | 8.0 | - | - | - | 26.3 | 3.3 | 16.3 | 10.2 | 6.7 | - | - | - | | |
| | 72 | 25.3 | 3.0 | 18.1 | 15.1 | 12.1 | 9.0 | - | - | 21.7 | 3.2 | 16.7 | 13.7 | 10.7 | 7.6 | - | - | | |
| | 67 | 20.9 | 2.9 | 20.9 | 19.2 | 16.1 | 13.1 | 10.1 | - | 17.1 | 3.1 | 17.1 | 17.1 | 14.6 | 11.6 | 8.6 | - | | |
| | 62 | 18.2 | 2.9 | 18.2 | 18.2 | 16.1 | 13.0 | 10.0 | 7.0 | 15.2 | 3.1 | 15.2 | 15.2 | 12.6 | 9.6 | 6.5 | 3.5 | | |
| | 57 | 17.3 | 2.9 | 17.3 | 17.3 | 16.0 | 13.0 | 10.0 | 6.9 | 14.0 | 3.1 | 14.0 | 14.0 | 12.5 | 9.5 | 6.5 | 3.5 | | |
| 825 | 77 | 29.8 | 3.1 | 17.3 | 11.6 | 8.4 | - | - | - | 26.0 | 3.4 | 18.4 | 11.9 | 7.0 | - | - | - | | |
| | 72 | 25.5 | 3.1 | 19.2 | 15.9 | 12.6 | 9.4 | - | - | 21.5 | 3.3 | 17.6 | 14.4 | 11.1 | 7.9 | - | - | | |
| | 67 | 21.1 | 3.0 | 21.1 | 20.2 | 16.9 | 13.6 | 10.4 | - | 16.9 | 3.2 | 16.9 | 16.9 | 15.3 | 12.0 | 8.8 | - | | |
| | 62 | 18.3 | 2.9 | 18.3 | 18.3 | 16.8 | 13.6 | 10.3 | 7.1 | 15.0 | 3.1 | 15.0 | 15.0 | 13.1 | 9.9 | 6.6 | 3.4 | | |
| | 57 | 17.4 | 3.0 | 17.4 | 17.4 | 16.8 | 13.5 | 10.3 | 7.0 | 13.8 | 3.2 | 13.8 | 13.8 | 13.1 | 9.8 | 6.6 | 3.3 | | |
| 900 | 77 | 30.0 | 3.2 | 19.2 | 12.3 | 8.8 | - | - | - | 25.7 | 3.4 | 20.4 | 13.5 | 7.3 | - | - | - | | |
| | 72 | 25.6 | 3.1 | 20.2 | 16.7 | 13.2 | 9.7 | - | - | 21.2 | 3.3 | 18.6 | 15.1 | 11.6 | 8.1 | - | - | | |
| | 67 | 21.2 | 3.0 | 21.2 | 21.2 | 17.7 | 14.2 | 10.7 | - | 16.7 | 3.2 | 16.7 | 16.7 | 15.9 | 12.5 | 9.0 | - | | |
| | 62 | 18.5 | 3.0 | 18.5 | 18.5 | 17.6 | 14.1 | 10.6 | 7.2 | 14.9 | 3.2 | 14.9 | 14.9 | 13.7 | 10.2 | 6.7 | 3.2 | | |
| | 57 | 17.5 | 3.0 | 17.5 | 17.5 | 17.5 | 14.1 | 10.6 | 7.1 | 13.6 | 3.2 | 13.6 | 13.6 | 13.6 | 10.2 | 6.7 | 3.2 | | |
| 1075 | 72 | 26.8 | 3.2 | 22.9 | 18.8 | 14.7 | 10.7 | - | - | 22.4 | 3.4 | 21.3 | 17.2 | 13.1 | 9.0 | - | - | | |
| | 67 | 22.1 | 3.1 | 22.1 | 22.1 | 19.7 | 15.6 | 11.5 | - | 17.7 | 3.3 | 17.7 | 17.7 | 17.7 | 13.9 | 9.7 | - | | |
| | 62 | 19.3 | 3.1 | 19.3 | 19.3 | 18.9 | 14.8 | 10.7 | 6.6 | 15.7 | 3.3 | 15.7 | 15.7 | 15.1 | 11.0 | 6.9 | 2.8 | | |
| | 57 | 18.3 | 3.1 | 18.3 | 18.3 | 18.3 | 14.2 | 10.2 | 6.1 | 14.4 | 3.3 | 14.4 | 14.4 | 14.4 | 10.3 | 6.2 | 2.1 | | |
| 1250 | 72 | 27.9 | 3.3 | 25.6 | 20.9 | 16.3 | 11.6 | - | - | 23.7 | 3.6 | 23.7 | 19.3 | 14.6 | 9.8 | - | - | | |
| | 67 | 23.1 | 3.2 | 23.1 | 23.1 | 21.7 | 17.1 | 12.4 | - | 18.7 | 3.4 | 18.7 | 18.7 | 18.7 | 15.2 | 10.5 | - | | |
| | 62 | 20.1 | 3.2 | 20.1 | 20.1 | 20.1 | 15.4 | 10.8 | 6.1 | 16.6 | 3.4 | 16.6 | 16.6 | 16.6 | 11.8 | 7.1 | 2.3 | | |
| | 57 | 19.1 | 3.2 | 19.1 | 19.1 | 19.1 | 14.4 | 9.8 | 5.1 | 15.3 | 3.4 | 15.3 | 15.3 | 15.3 | 10.5 | 5.7 | 1.0 | | |

1. These capacities are Net capacities.

2. These ratings include the compressor, condenser fan and supply air blower motors.

NM036 (3.0 Ton) (Continued)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | | | |
|------------------------|------------|--------------------------------------|----------------------------------|-------------------------|------|------|------|------|-----|--------------------------------------|----------------------------------|-------------------------|----------------------|------|------|------|------|--|--|
| CFM | WB (°F) | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | | |
| | | | | Return Dry Bulb (°F) | | | | | | | | | Return Dry Bulb (°F) | | | | | | |
| 115°F | | | | | | | | | | | | | | | | | | | |
| 750 | 77 | 33.9 | 3.7 | 25.0 | 20.6 | 17.4 | - | - | - | 30.3 | 4.0 | 31.2 | 23.6 | 20.5 | - | - | - | | |
| | 72 | 29.7 | 3.6 | 25.2 | 22.0 | 18.9 | 15.7 | - | - | 26.0 | 3.8 | 26.5 | 23.4 | 20.2 | 17.1 | - | - | | |
| | 67 | 25.5 | 3.5 | 25.5 | 23.5 | 20.3 | 17.2 | 14.0 | - | 21.8 | 3.7 | 21.8 | 23.1 | 19.9 | 16.8 | 13.6 | - | | |
| | 62 | 21.6 | 3.4 | 21.6 | 21.1 | 17.9 | 14.7 | 11.5 | - | 17.7 | 3.7 | 17.7 | 17.7 | 18.9 | 17.5 | 14.4 | 11.3 | | |
| 900 | 77 | 34.5 | 3.7 | 25.7 | 20.6 | 16.8 | - | - | - | 30.7 | 4.0 | 30.2 | 22.9 | 19.2 | - | - | - | | |
| | 72 | 30.2 | 3.6 | 25.8 | 22.0 | 18.3 | 14.5 | - | - | 26.4 | 3.9 | 26.1 | 22.4 | 18.6 | 14.9 | - | - | | |
| | 67 | 25.9 | 3.5 | 25.9 | 23.5 | 19.7 | 15.9 | 12.2 | - | 22.0 | 3.8 | 22.0 | 21.8 | 18.1 | 14.3 | 10.6 | - | | |
| | 62 | 22.0 | 3.5 | 22.0 | 22.0 | 20.4 | 16.6 | 12.9 | 9.1 | 17.9 | 3.7 | 17.9 | 17.9 | 15.0 | 11.3 | 7.6 | - | | |
| | 57 | 19.1 | 3.5 | 19.1 | 19.1 | 19.1 | 15.3 | 11.5 | 7.8 | 15.2 | 3.7 | 15.2 | 15.2 | 12.7 | 8.9 | 5.2 | - | | |
| 1050 | 77 | 35.1 | 3.8 | 26.3 | 20.6 | 16.3 | - | - | - | 31.0 | 4.1 | 29.2 | 22.2 | 17.9 | - | - | - | | |
| | 72 | 30.7 | 3.7 | 26.4 | 22.0 | 17.7 | 13.3 | - | - | 26.7 | 4.0 | 25.7 | 21.4 | 17.1 | 12.7 | - | - | | |
| | 67 | 26.4 | 3.6 | 26.4 | 23.4 | 19.0 | 14.7 | 10.3 | - | 22.3 | 3.8 | 22.3 | 20.6 | 16.2 | 11.9 | 7.6 | - | | |
| | 62 | 22.4 | 3.6 | 22.4 | 22.4 | 19.7 | 15.4 | 11.0 | 6.7 | 18.1 | 3.8 | 18.1 | 18.1 | 16.9 | 12.6 | 8.2 | 3.9 | | |
| | 57 | 19.4 | 3.6 | 19.4 | 19.4 | 19.4 | 15.0 | 10.7 | 6.3 | 15.4 | 3.8 | 15.4 | 15.4 | 15.4 | 11.7 | 7.3 | 3.0 | | |
| 1200 | 77 | 35.7 | 3.9 | 27.0 | 20.6 | 15.7 | - | - | - | 31.4 | 4.2 | 28.2 | 21.5 | 16.6 | - | - | - | | |
| | 72 | 31.3 | 3.8 | 26.9 | 22.0 | 17.0 | 12.1 | - | - | 27.0 | 4.0 | 25.4 | 20.4 | 15.5 | 10.6 | - | - | | |
| | 67 | 26.8 | 3.7 | 26.8 | 23.3 | 18.4 | 13.4 | 8.5 | - | 22.5 | 3.9 | 22.5 | 19.3 | 14.4 | 9.5 | 4.6 | - | | |
| | 62 | 22.8 | 3.6 | 22.8 | 22.8 | 19.0 | 14.1 | 9.2 | 4.2 | 18.3 | 3.9 | 18.3 | 18.3 | 15.0 | 10.1 | 5.1 | 0.2 | | |
| | 57 | 19.7 | 3.6 | 19.7 | 19.7 | 19.7 | 14.8 | 9.8 | 4.9 | 15.6 | 3.9 | 15.6 | 15.6 | 15.6 | 10.6 | 5.7 | 0.8 | | |
| 1350 | 72 | 31.9 | 3.8 | 29.8 | 26.2 | 20.7 | 15.2 | - | - | 27.6 | 4.1 | 27.6 | 25.9 | 20.4 | 14.9 | - | - | | |
| | 67 | 27.4 | 3.7 | 27.4 | 25.6 | 22.3 | 16.8 | 11.3 | - | 23.0 | 4.0 | 23.0 | 21.7 | 19.5 | 14.0 | 8.5 | - | | |
| | 62 | 23.3 | 3.7 | 23.3 | 23.3 | 21.4 | 15.9 | 10.4 | 4.9 | 18.7 | 3.9 | 18.7 | 18.7 | 17.6 | 12.1 | 6.6 | 1.1 | | |
| | 57 | 20.1 | 3.7 | 20.1 | 20.1 | 20.1 | 14.6 | 9.1 | 3.6 | 15.9 | 3.9 | 15.9 | 15.9 | 15.9 | 10.4 | 4.9 | -0.6 | | |
| 1500 | 72 | 32.6 | 3.9 | 32.6 | 30.5 | 24.4 | 18.3 | - | - | 28.2 | 4.2 | 28.2 | 28.2 | 25.3 | 19.2 | - | - | | |
| | 67 | 28.0 | 3.8 | 28.0 | 28.0 | 26.3 | 20.2 | 14.2 | - | 23.5 | 4.0 | 23.5 | 23.5 | 23.5 | 18.5 | 12.4 | - | | |
| | 62 | 23.7 | 3.8 | 23.7 | 23.7 | 23.7 | 17.7 | 11.6 | 5.5 | 19.1 | 4.0 | 19.1 | 19.1 | 19.1 | 14.2 | 8.1 | 2.0 | | |
| | 57 | 20.6 | 3.8 | 20.6 | 20.6 | 20.6 | 14.5 | 8.4 | 2.3 | 16.3 | 4.0 | 16.3 | 16.3 | 16.3 | 10.2 | 4.1 | -2.0 | | |

1. These capacities are Net capacities.

2. These ratings include the compressor, condenser fan and supply air blower motors.

NM042 (3.5 Ton) (Continued)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | | | |
|---------------------------|----|---|-------------------------------------|-------------------------|------|------|------|------|------|---|-------------------------------------|-------------------------|----------------------|------|------|-------|-----|----|----|
| | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | | |
| | | | | Return Dry Bulb (°F) | | | | | | | | | Return Dry Bulb (°F) | | | | | | |
| 115°F | | | | | | | | | | | | | | | | 125°F | | | |
| | | 90 | 85 | 80 | 75 | 70 | 65 | | | | | | | 90 | 85 | 80 | 75 | 70 | 65 |
| 975 | 77 | 37.6 | 4.6 | 16.4 | 13.8 | 10.0 | - | - | - | 34.2 | 5.0 | 17.7 | 11.6 | 8.8 | - | - | - | - | |
| | 72 | 33.7 | 4.4 | 23.0 | 19.2 | 15.4 | 11.5 | - | - | 29.9 | 4.7 | 21.7 | 17.8 | 14.0 | 10.1 | - | - | - | |
| | 67 | 29.7 | 4.2 | 29.7 | 24.6 | 20.7 | 16.9 | 13.0 | - | 25.6 | 4.5 | 25.6 | 23.5 | 19.1 | 15.2 | 11.4 | - | - | |
| | 62 | 26.1 | 4.1 | 26.1 | 26.1 | 20.9 | 17.1 | 13.2 | 9.4 | 22.5 | 4.4 | 22.5 | 22.5 | 18.3 | 14.5 | 10.6 | 6.8 | - | |
| 1050 | 77 | 38.3 | 4.6 | 19.3 | 14.9 | 10.8 | - | - | - | 34.7 | 5.0 | 21.0 | 13.8 | 9.6 | - | - | - | - | |
| | 72 | 34.2 | 4.5 | 24.8 | 20.7 | 16.6 | 12.4 | - | - | 30.3 | 4.8 | 23.5 | 19.3 | 15.2 | 11.0 | - | - | - | |
| | 67 | 30.2 | 4.3 | 30.2 | 26.4 | 22.3 | 18.2 | 14.1 | - | 26.0 | 4.5 | 26.0 | 24.9 | 20.8 | 16.6 | 12.5 | - | - | |
| | 62 | 26.6 | 4.1 | 26.6 | 26.6 | 22.6 | 18.4 | 14.3 | 10.2 | 22.8 | 4.4 | 22.8 | 22.8 | 19.9 | 15.8 | 11.6 | 7.5 | - | |
| | 57 | 25.2 | 4.2 | 25.2 | 25.2 | 22.8 | 18.7 | 14.6 | 10.4 | 21.6 | 4.5 | 21.6 | 21.6 | 19.1 | 15.0 | 10.8 | 6.7 | - | |
| 1125 | 77 | 38.9 | 4.7 | 22.3 | 15.9 | 11.6 | - | - | - | 35.2 | 5.0 | 24.2 | 15.9 | 10.4 | - | - | - | - | |
| | 72 | 34.8 | 4.5 | 26.5 | 22.1 | 17.7 | 13.4 | - | - | 30.8 | 4.8 | 25.3 | 20.9 | 16.4 | 12.0 | - | - | - | |
| | 67 | 30.7 | 4.3 | 30.7 | 28.3 | 23.9 | 19.6 | 15.2 | - | 26.4 | 4.6 | 26.4 | 22.4 | 18.0 | 13.5 | - | - | - | |
| | 62 | 27.0 | 4.1 | 27.0 | 27.0 | 24.2 | 19.8 | 15.4 | 11.0 | 23.1 | 4.4 | 23.1 | 23.1 | 21.6 | 17.1 | 12.7 | 8.2 | - | |
| | 57 | 25.7 | 4.2 | 25.7 | 25.7 | 24.4 | 20.1 | 15.7 | 11.3 | 22.0 | 4.5 | 22.0 | 22.0 | 20.7 | 16.2 | 11.8 | 7.3 | - | |
| 1200 | 77 | 39.6 | 4.7 | 25.3 | 17.0 | 12.3 | - | - | - | 35.7 | 5.0 | 27.5 | 18.0 | 11.2 | - | - | - | - | |
| | 72 | 35.4 | 4.5 | 28.3 | 23.6 | 18.9 | 14.3 | - | - | 31.2 | 4.8 | 27.1 | 22.4 | 17.6 | 12.9 | - | - | - | |
| | 67 | 31.2 | 4.3 | 31.2 | 30.2 | 25.6 | 20.9 | 16.2 | - | 26.7 | 4.6 | 26.7 | 26.7 | 24.1 | 19.4 | 14.6 | - | - | |
| | 62 | 27.5 | 4.2 | 27.5 | 27.5 | 25.8 | 21.2 | 16.5 | 11.9 | 23.4 | 4.4 | 23.4 | 23.4 | 23.2 | 18.4 | 13.7 | 9.0 | - | |
| | 57 | 26.1 | 4.2 | 26.1 | 26.1 | 21.4 | 16.8 | 12.1 | - | 22.3 | 4.5 | 22.3 | 22.3 | 22.3 | 17.5 | 12.8 | 8.0 | - | |
| 1350 | 72 | 35.8 | 4.5 | 30.5 | 25.3 | 20.1 | 14.9 | - | - | 31.5 | 4.8 | 29.2 | 23.9 | 18.7 | 13.4 | - | - | - | |
| | 67 | 31.5 | 4.3 | 31.5 | 31.0 | 27.1 | 21.9 | 16.7 | - | 27.0 | 4.6 | 27.0 | 27.0 | 25.5 | 20.3 | 15.1 | - | - | |
| | 62 | 27.7 | 4.2 | 27.7 | 27.7 | 26.9 | 21.7 | 16.5 | 11.3 | 23.7 | 4.5 | 23.7 | 23.7 | 23.7 | 18.6 | 13.4 | 8.1 | - | |
| | 57 | 26.3 | 4.2 | 26.3 | 26.3 | 26.3 | 21.1 | 15.9 | 10.8 | 22.5 | 4.5 | 22.5 | 22.5 | 22.5 | 17.3 | 12.0 | 6.8 | - | |
| 1500 | 72 | 36.1 | 4.6 | 32.7 | 27.0 | 21.2 | 15.5 | - | - | 31.9 | 4.9 | 31.2 | 25.5 | 19.7 | 14.0 | - | - | - | |
| | 67 | 31.8 | 4.4 | 31.8 | 31.8 | 28.6 | 22.9 | 17.1 | - | 27.3 | 4.7 | 27.3 | 27.3 | 27.0 | 21.2 | 15.5 | - | - | |
| | 62 | 28.0 | 4.2 | 28.0 | 28.0 | 28.0 | 22.3 | 16.5 | 10.8 | 23.9 | 4.5 | 23.9 | 23.9 | 23.9 | 18.8 | 13.1 | 7.3 | - | |
| | 57 | 26.6 | 4.3 | 26.6 | 26.6 | 26.6 | 20.9 | 15.1 | 9.4 | 22.7 | 4.6 | 22.7 | 22.7 | 22.7 | 17.0 | 11.3 | 5.5 | - | |

1. These capacities are Net capacities.

2. These ratings include the compressor, condenser fan and supply air blower motors.

NM048 (4.0 Ton) (Continued)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | | |
|---------------------------|----|---|-------------------------------------|-------------------------|------|------|------|------|------|---|-------------------------------------|-------------------------|----------------------|------|------|-------|------|--|
| | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | |
| | | | | Return Dry Bulb (°F) | | | | | | | | | Return Dry Bulb (°F) | | | | | |
| 115°F | | | | | | | | | | | | | | | | 125°F | | |
| 1000 | 77 | 43.5 | 4.4 | 17.9 | 15.7 | 11.6 | - | - | - | 39.5 | 4.8 | 19.5 | 13.1 | 10.2 | - | - | - | |
| | 72 | 38.9 | 4.3 | 26.1 | 21.9 | 17.7 | 13.6 | - | - | 34.6 | 4.6 | 24.6 | 20.4 | 16.1 | 11.9 | - | - | |
| | 67 | 34.3 | 4.1 | 34.3 | 28.1 | 23.9 | 19.7 | 15.6 | - | 29.6 | 4.4 | 29.6 | 26.9 | 22.1 | 17.8 | 13.6 | - | |
| | 62 | 30.2 | 4.1 | 30.2 | 30.2 | 25.7 | 21.5 | 17.4 | 13.2 | 26.0 | 4.3 | 26.0 | 26.0 | 24.3 | 19.2 | 15.0 | 10.8 | |
| 1200 | 77 | 44.3 | 4.6 | 21.9 | 17.1 | 12.5 | - | - | - | 40.1 | 5.0 | 23.9 | 15.8 | 11.1 | - | - | - | |
| | 72 | 39.6 | 4.5 | 28.4 | 23.8 | 19.1 | 14.5 | - | - | 35.1 | 4.8 | 27.0 | 22.3 | 17.5 | 12.8 | - | - | |
| | 67 | 34.9 | 4.3 | 34.9 | 30.4 | 25.8 | 21.1 | 16.5 | - | 30.1 | 4.6 | 30.1 | 28.7 | 24.0 | 19.3 | 14.5 | - | |
| | 62 | 30.7 | 4.2 | 30.7 | 30.7 | 27.7 | 23.1 | 18.4 | 13.8 | 26.3 | 4.5 | 26.3 | 26.3 | 25.5 | 20.8 | 16.1 | 11.3 | |
| | 57 | 29.2 | 4.3 | 29.2 | 29.2 | 26.3 | 21.7 | 17.0 | 12.4 | 25.0 | 4.6 | 25.0 | 25.0 | 22.1 | 17.3 | 12.6 | 7.9 | |
| 1400 | 77 | 45.0 | 4.8 | 25.9 | 18.5 | 13.4 | - | - | - | 40.7 | 5.2 | 28.3 | 18.5 | 12.0 | - | - | - | |
| | 72 | 40.3 | 4.7 | 30.7 | 25.6 | 20.5 | 15.4 | - | - | 35.6 | 5.0 | 29.4 | 24.2 | 19.0 | 13.7 | - | - | |
| | 67 | 35.5 | 4.5 | 35.5 | 32.8 | 27.7 | 22.5 | 17.4 | - | 30.5 | 4.8 | 30.5 | 30.5 | 25.9 | 20.7 | 15.5 | - | |
| | 62 | 31.2 | 4.4 | 31.2 | 31.2 | 29.7 | 24.6 | 19.5 | 14.4 | 26.7 | 4.7 | 26.7 | 26.7 | 26.7 | 22.3 | 17.1 | 11.9 | |
| | 57 | 29.7 | 4.5 | 29.7 | 29.7 | 28.2 | 23.1 | 18.0 | 12.9 | 25.4 | 4.8 | 25.4 | 25.4 | 23.9 | 18.7 | 13.5 | 8.2 | |
| 1600 | 77 | 45.8 | 5.0 | 30.0 | 19.8 | 14.3 | - | - | - | 41.3 | 5.4 | 32.7 | 21.3 | 12.9 | - | - | - | |
| | 72 | 40.9 | 4.9 | 33.1 | 27.5 | 21.9 | 16.3 | - | - | 36.1 | 5.2 | 31.8 | 26.1 | 20.4 | 14.6 | - | - | |
| | 67 | 36.1 | 4.7 | 36.1 | 35.1 | 29.5 | 23.9 | 18.4 | - | 30.9 | 5.0 | 30.9 | 30.9 | 27.8 | 22.1 | 16.4 | - | |
| | 62 | 31.8 | 4.6 | 31.8 | 31.8 | 31.7 | 26.1 | 20.6 | 15.0 | 27.1 | 4.9 | 27.1 | 27.1 | 27.1 | 23.9 | 18.2 | 12.5 | |
| | 57 | 30.2 | 4.7 | 30.2 | 30.2 | 30.1 | 24.6 | 19.0 | 13.4 | 25.7 | 4.9 | 25.7 | 25.7 | 25.7 | 20.0 | 14.3 | 8.6 | |
| 1800 | 72 | 41.3 | 5.0 | 35.3 | 29.3 | 23.2 | 17.1 | - | - | 36.5 | 5.4 | 34.0 | 27.8 | 21.6 | 15.4 | - | - | |
| | 67 | 36.5 | 4.9 | 36.5 | 36.0 | 31.3 | 25.2 | 19.2 | - | 31.2 | 5.2 | 31.2 | 31.2 | 29.5 | 23.3 | 17.0 | - | |
| | 62 | 32.1 | 4.8 | 32.1 | 32.1 | 32.0 | 26.0 | 19.9 | 13.8 | 27.4 | 5.0 | 27.4 | 27.4 | 27.4 | 22.8 | 16.6 | 10.3 | |
| | 57 | 30.5 | 4.8 | 30.5 | 30.5 | 30.4 | 24.4 | 18.3 | 12.2 | 26.0 | 5.1 | 26.0 | 26.0 | 26.0 | 19.8 | 13.6 | 7.3 | |
| 2000 | 72 | 41.7 | 5.2 | 37.6 | 31.1 | 24.5 | 18.0 | - | - | 36.9 | 5.5 | 36.2 | 29.5 | 22.8 | 16.1 | - | - | |
| | 67 | 36.8 | 5.0 | 36.8 | 36.8 | 33.1 | 26.5 | 20.0 | - | 31.6 | 5.3 | 31.6 | 31.6 | 31.1 | 24.4 | 17.7 | - | |
| | 62 | 32.4 | 4.9 | 32.4 | 32.4 | 32.4 | 25.8 | 19.3 | 12.7 | 27.7 | 5.2 | 27.7 | 27.7 | 27.7 | 21.7 | 14.9 | 8.2 | |
| | 57 | 30.7 | 4.9 | 30.7 | 30.7 | 30.7 | 24.2 | 17.6 | 11.1 | 26.3 | 5.2 | 26.3 | 26.3 | 26.3 | 19.6 | 12.8 | 6.1 | |

1. These capacities are Net capacities.

2. These ratings include the compressor, condenser fan and supply air blower motors.

NM060 (5.0 Ton) (Continued)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | | | |
|------------------------|------------|--------------------------------------|----------------------------------|-------------------------|------|------|------|------|------|--------------------------------------|----------------------------------|-------------------------|----------------------|------|------|--------------|------|--|--|
| CFM | WB (°F) | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | | |
| | | | | Return Dry Bulb (°F) | | | | | | | | | Return Dry Bulb (°F) | | | | | | |
| 115°F | | | | | | | | | | | | | | | | 125°F | | | |
| 1400 | 77 | 63.9 | 5.6 | 32.9 | 26.8 | 20.8 | - | - | - | 59.1 | 6.2 | 31.0 | 25.6 | 19.5 | - | - | - | | |
| | 72 | 57.1 | 5.6 | 39.8 | 33.7 | 27.7 | 21.6 | - | - | 52.4 | 6.1 | 38.4 | 32.3 | 26.1 | 20.0 | - | - | | |
| | 67 | 50.3 | 5.5 | 46.7 | 40.6 | 34.6 | 28.5 | 22.4 | - | 45.8 | 6.1 | 45.8 | 38.9 | 32.8 | 26.6 | 20.5 | - | | |
| | 62 | 50.7 | 5.5 | 50.7 | 48.7 | 42.1 | 36.1 | 30.0 | 23.9 | 47.3 | 6.0 | 47.3 | 45.4 | 38.9 | 32.8 | 26.6 | 20.5 | | |
| 1500 | 77 | 63.6 | 5.6 | 33.7 | 27.4 | 21.2 | - | - | - | 59.1 | 6.2 | 32.9 | 26.2 | 19.9 | - | - | - | | |
| | 72 | 56.8 | 5.6 | 40.7 | 34.5 | 28.2 | 21.9 | - | - | 52.5 | 6.1 | 39.3 | 33.0 | 26.7 | 20.3 | - | - | | |
| | 67 | 50.1 | 5.5 | 47.7 | 41.5 | 35.2 | 28.9 | 22.7 | - | 45.8 | 6.1 | 45.8 | 39.8 | 33.4 | 27.1 | 20.8 | - | | |
| | 62 | 50.5 | 5.5 | 50.5 | 49.2 | 42.9 | 36.7 | 30.4 | 24.2 | 47.3 | 6.0 | 47.3 | 46.1 | 39.7 | 33.4 | 27.0 | 20.7 | | |
| | 57 | 43.1 | 5.5 | 43.1 | 43.1 | 39.7 | 33.5 | 27.2 | 21.0 | 38.6 | 6.1 | 38.6 | 38.6 | 35.6 | 29.2 | 22.9 | 16.6 | | |
| 1600 | 77 | 63.4 | 5.6 | 34.5 | 28.0 | 21.6 | - | - | - | 59.1 | 6.2 | 34.7 | 26.8 | 20.3 | - | - | - | | |
| | 72 | 56.6 | 5.6 | 41.6 | 35.2 | 28.7 | 22.3 | - | - | 52.5 | 6.2 | 40.3 | 33.7 | 27.2 | 20.6 | - | - | | |
| | 67 | 49.9 | 5.6 | 48.7 | 42.3 | 35.9 | 29.4 | 22.9 | - | 45.8 | 6.1 | 45.8 | 40.6 | 34.1 | 27.6 | 21.0 | - | | |
| | 62 | 50.3 | 5.5 | 50.3 | 49.7 | 43.7 | 37.3 | 30.8 | 24.4 | 47.3 | 6.0 | 47.3 | 46.7 | 40.5 | 34.0 | 27.4 | 20.9 | | |
| | 57 | 42.9 | 5.5 | 42.9 | 42.9 | 40.5 | 34.0 | 27.6 | 21.1 | 38.6 | 6.1 | 38.6 | 38.6 | 36.3 | 29.8 | 23.2 | 16.7 | | |
| 1700 | 77 | 63.2 | 5.7 | 35.4 | 28.6 | 22.0 | - | - | - | 59.1 | 6.2 | 36.6 | 27.4 | 20.7 | - | - | - | | |
| | 72 | 56.4 | 5.6 | 42.5 | 35.9 | 29.2 | 22.6 | - | - | 52.5 | 6.2 | 41.2 | 34.5 | 27.7 | 21.0 | - | - | | |
| | 67 | 49.7 | 5.6 | 49.7 | 43.2 | 36.5 | 29.9 | 23.2 | - | 45.9 | 6.1 | 45.9 | 41.5 | 34.8 | 28.0 | 21.3 | - | | |
| | 62 | 50.1 | 5.5 | 50.1 | 50.1 | 44.5 | 37.9 | 31.2 | 24.6 | 47.3 | 6.0 | 47.3 | 47.3 | 41.3 | 34.6 | 27.8 | 21.1 | | |
| | 57 | 42.8 | 5.5 | 42.8 | 42.8 | 41.2 | 34.6 | 27.9 | 21.3 | 38.7 | 6.1 | 38.7 | 38.7 | 37.0 | 30.3 | 23.5 | 16.8 | | |
| 2100 | 72 | 57.1 | 5.6 | 49.2 | 40.9 | 32.7 | 24.4 | - | - | 52.5 | 6.2 | 48.5 | 40.0 | 31.4 | 22.8 | - | - | | |
| | 67 | 50.3 | 5.6 | 50.3 | 47.0 | 40.8 | 32.5 | 24.2 | - | 45.8 | 6.1 | 45.8 | 44.9 | 39.4 | 30.8 | 22.2 | - | | |
| | 62 | 50.7 | 5.5 | 50.7 | 50.7 | 47.9 | 39.7 | 31.4 | 23.1 | 47.3 | 6.1 | 47.3 | 47.3 | 44.3 | 35.7 | 27.2 | 18.6 | | |
| | 57 | 43.3 | 5.6 | 43.3 | 43.3 | 42.5 | 34.3 | 26.0 | 17.7 | 38.6 | 6.1 | 38.6 | 38.6 | 37.8 | 29.2 | 20.6 | 12.1 | | |
| 2500 | 72 | 57.8 | 5.7 | 55.9 | 46.0 | 36.1 | 26.2 | - | - | 52.4 | 6.2 | 52.4 | 45.5 | 35.1 | 24.7 | - | - | | |
| | 67 | 50.9 | 5.6 | 50.9 | 50.9 | 45.1 | 35.2 | 25.3 | - | 45.8 | 6.2 | 45.8 | 45.8 | 44.0 | 33.6 | 23.2 | - | | |
| | 62 | 51.3 | 5.5 | 51.3 | 51.3 | 51.3 | 41.4 | 31.5 | 21.7 | 47.3 | 6.1 | 47.3 | 47.3 | 47.3 | 36.9 | 26.5 | 16.1 | | |
| | 57 | 43.8 | 5.6 | 43.8 | 43.8 | 43.8 | 33.9 | 24.0 | 14.1 | 38.5 | 6.2 | 38.5 | 38.5 | 38.5 | 28.1 | 17.7 | 7.4 | | |

1. These capacities are Net capacities.

2. These ratings include the compressor, condenser fan and supply air blower motors.

UQ024 (2.0 Ton) (Continued)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | |
|---------------------------|----|---|-------------------------------------|-------------------------|------|------|------|------|------|---|-------------------------------------|-------------------------|----------------------|------|------|-------|------|
| | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | |
| | | | | Return Dry Bulb (°F) | | | | | | | | | Return Dry Bulb (°F) | | | | |
| | | 115°F | | | | | | | | | | | | | | 125°F | |
| 500 | 77 | 20.9 | 2.4 | 10.6 | 6.2 | 5.5 | - | - | - | 21.7 | 2.7 | 14.1 | 8.3 | 5.7 | - | - | - |
| | 72 | 17.9 | 2.4 | 12.7 | 10.5 | 8.3 | 6.1 | - | - | 17.4 | 2.6 | 12.9 | 10.7 | 8.6 | 6.5 | - | - |
| | 67 | 14.8 | 2.3 | 14.8 | 14.8 | 11.1 | 8.9 | 6.7 | - | 13.1 | 2.5 | 13.1 | 11.0 | 8.7 | 6.6 | - | - |
| | 62 | 13.3 | 2.3 | 13.3 | 13.3 | 10.0 | 7.8 | 5.6 | 3.4 | 12.5 | 2.5 | 12.5 | 12.5 | 9.6 | 7.5 | 5.4 | 3.2 |
| 600 | 77 | 21.0 | 2.5 | 13.9 | 8.7 | 6.1 | - | - | - | 21.1 | 2.7 | 16.0 | 10.9 | 6.9 | - | - | - |
| | 72 | 17.9 | 2.4 | 14.4 | 11.8 | 9.2 | 6.6 | - | - | 16.8 | 2.7 | 14.2 | 11.7 | 9.1 | 6.6 | - | - |
| | 67 | 14.9 | 2.4 | 14.9 | 14.9 | 12.3 | 9.8 | 7.2 | - | 12.5 | 2.6 | 12.5 | 12.5 | 11.4 | 8.9 | 6.3 | - |
| | 62 | 13.3 | 2.3 | 13.3 | 13.3 | 11.2 | 8.6 | 6.0 | 3.4 | 12.0 | 2.6 | 12.0 | 12.0 | 10.1 | 7.5 | 5.0 | 2.4 |
| | 57 | 13.5 | 2.3 | 13.5 | 13.5 | 11.3 | 8.7 | 6.2 | 3.6 | 12.2 | 2.5 | 12.2 | 12.2 | 10.2 | 7.7 | 5.1 | 2.6 |
| 700 | 77 | 21.1 | 2.5 | 17.1 | 11.2 | 6.7 | - | - | - | 20.4 | 2.8 | 17.8 | 13.4 | 8.0 | - | - | - |
| | 72 | 18.0 | 2.5 | 16.0 | 13.1 | 10.1 | 7.2 | - | - | 16.1 | 2.7 | 15.6 | 12.6 | 9.6 | 6.7 | - | - |
| | 67 | 14.9 | 2.4 | 14.9 | 14.9 | 13.6 | 10.7 | 7.7 | - | 11.8 | 2.6 | 11.8 | 11.8 | 9.0 | 6.0 | - | - |
| | 62 | 13.4 | 2.4 | 13.4 | 13.4 | 12.3 | 9.3 | 6.4 | 3.5 | 11.5 | 2.6 | 11.5 | 11.5 | 10.5 | 7.5 | 4.6 | 1.6 |
| | 57 | 13.6 | 2.4 | 13.6 | 13.6 | 12.5 | 9.5 | 6.6 | 3.6 | 11.6 | 2.6 | 11.6 | 11.6 | 10.7 | 7.7 | 4.7 | 1.8 |
| 800 | 77 | 21.2 | 2.6 | 20.4 | 13.8 | 7.3 | - | - | - | 19.7 | 2.8 | 19.7 | 15.9 | 9.2 | - | - | - |
| | 72 | 18.1 | 2.5 | 17.7 | 14.4 | 11.1 | 7.8 | - | - | 15.4 | 2.7 | 15.4 | 13.5 | 10.2 | 6.8 | - | - |
| | 67 | 15.0 | 2.5 | 15.0 | 15.0 | 14.8 | 11.5 | 8.2 | - | 11.1 | 2.7 | 11.1 | 11.1 | 11.1 | 9.1 | 5.7 | - |
| | 62 | 13.4 | 2.4 | 13.4 | 13.4 | 13.4 | 10.1 | 6.8 | 3.5 | 10.9 | 2.7 | 10.9 | 10.9 | 10.9 | 7.6 | 4.2 | 0.8 |
| | 57 | 13.6 | 2.4 | 13.6 | 13.6 | 13.6 | 10.3 | 7.0 | 3.7 | 11.1 | 2.6 | 11.1 | 11.1 | 11.1 | 7.7 | 4.3 | 1.0 |
| 900 | 72 | 18.9 | 2.5 | 15.8 | 13.6 | 11.3 | 9.1 | - | - | 16.5 | 2.8 | 13.7 | 12.1 | 10.5 | 8.9 | - | - |
| | 67 | 15.6 | 2.5 | 15.6 | 15.6 | 15.2 | 12.9 | 10.7 | - | 12.0 | 2.7 | 12.0 | 12.0 | 12.0 | 11.3 | 9.7 | - |
| | 62 | 14.0 | 2.5 | 14.0 | 14.0 | 13.7 | 11.4 | 9.2 | 6.9 | 11.7 | 2.7 | 11.7 | 11.7 | 11.3 | 9.7 | 8.1 | 6.5 |
| | 57 | 14.2 | 2.5 | 14.2 | 14.2 | 13.9 | 11.6 | 9.4 | 7.1 | 11.9 | 2.6 | 11.9 | 11.9 | 11.4 | 9.8 | 8.2 | 6.6 |
| 1000 | 72 | 19.7 | 2.6 | 14.0 | 12.8 | 11.6 | 10.4 | - | - | 17.6 | 2.8 | 10.4 | 10.6 | 10.8 | 10.9 | - | - |
| | 67 | 16.3 | 2.5 | 16.3 | 16.3 | 15.5 | 14.3 | 13.1 | - | 12.9 | 2.7 | 12.9 | 12.9 | 12.9 | 12.9 | - | - |
| | 62 | 14.6 | 2.5 | 14.6 | 14.6 | 14.0 | 12.8 | 11.6 | 10.4 | 12.5 | 2.7 | 12.5 | 12.5 | 11.6 | 11.8 | 12.0 | 12.2 |
| | 57 | 14.8 | 2.5 | 14.8 | 14.8 | 14.2 | 13.0 | 11.8 | 10.6 | 12.7 | 2.7 | 12.7 | 12.7 | 11.8 | 12.0 | 12.1 | 12.3 |

1. These capacities are Net capacities.

2. These ratings include the compressor, condenser fan and supply air blower motors.

UQ030 (2.5 Ton) (Continued)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | | |
|---------------------------|----|---|-------------------------------------|-------------------------|------|------|------|------|------|---|-------------------------------------|-------------------------|----------------------|------|------|-------|-----|--|
| | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | |
| | | | | Return Dry Bulb (°F) | | | | | | | | | Return Dry Bulb (°F) | | | | | |
| 115°F | | | | | | | | | | | | | | | | 125°F | | |
| 900 | 77 | 35.0 | 3.0 | 13.9 | 10.7 | 8.6 | - | - | - | 36.1 | 3.4 | 14.5 | 9.5 | 8.2 | - | - | - | |
| | 72 | 30.4 | 3.0 | 19.8 | 16.4 | 13.0 | 9.6 | - | - | 30.4 | 3.3 | 19.6 | 16.2 | 12.8 | 9.3 | - | - | |
| | 67 | 25.7 | 2.9 | 25.7 | 22.1 | 17.4 | 14.0 | 10.6 | - | 24.8 | 3.2 | 24.8 | 22.5 | 17.1 | 13.7 | 10.2 | - | |
| | 62 | 24.4 | 2.9 | 24.4 | 23.3 | 17.8 | 14.4 | 10.9 | 7.5 | 23.9 | 3.2 | 23.9 | 22.3 | 16.5 | 13.0 | 9.6 | 6.2 | |
| 950 | 77 | 33.1 | 3.1 | 17.6 | 12.6 | 9.0 | - | - | - | 33.0 | 3.4 | 18.4 | 12.3 | 8.7 | - | - | - | |
| | 72 | 28.7 | 3.0 | 20.9 | 17.3 | 13.6 | 9.9 | - | - | 27.8 | 3.3 | 20.5 | 16.8 | 13.1 | 9.5 | - | - | |
| | 67 | 24.3 | 3.0 | 24.3 | 21.9 | 18.2 | 14.6 | 10.9 | - | 22.5 | 3.2 | 22.5 | 21.3 | 17.6 | 13.9 | 10.3 | - | |
| | 62 | 23.0 | 2.9 | 23.0 | 22.3 | 18.6 | 14.9 | 11.3 | 7.6 | 21.8 | 3.2 | 21.8 | 20.7 | 16.9 | 13.2 | 9.5 | 5.9 | |
| | 57 | 26.3 | 2.9 | 26.3 | 25.0 | 21.3 | 17.6 | 14.0 | 10.3 | 26.7 | 3.2 | 26.7 | 24.7 | 20.7 | 17.0 | 13.4 | 9.7 | |
| 1000 | 77 | 31.1 | 3.1 | 21.2 | 14.6 | 9.4 | - | - | - | 30.0 | 3.4 | 22.3 | 15.1 | 9.2 | - | - | - | |
| | 72 | 27.0 | 3.0 | 22.1 | 18.1 | 14.2 | 10.3 | - | - | 25.1 | 3.3 | 21.3 | 17.4 | 13.5 | 9.6 | - | - | |
| | 67 | 22.9 | 3.0 | 22.9 | 21.7 | 19.1 | 15.1 | 11.2 | - | 20.3 | 3.3 | 20.3 | 20.0 | 18.1 | 14.2 | 10.3 | - | |
| | 62 | 21.7 | 3.0 | 21.7 | 21.3 | 19.5 | 15.5 | 11.6 | 7.7 | 19.7 | 3.2 | 19.7 | 19.1 | 17.3 | 13.4 | 9.5 | 5.6 | |
| | 57 | 24.8 | 2.9 | 24.8 | 24.1 | 22.3 | 18.3 | 14.4 | 10.5 | 24.3 | 3.2 | 24.3 | 23.3 | 21.3 | 17.4 | 13.5 | 9.6 | |
| 1050 | 77 | 29.2 | 3.1 | 24.9 | 16.6 | 9.8 | - | - | - | 27.0 | 3.5 | 26.2 | 17.9 | 9.7 | - | - | - | |
| | 72 | 25.3 | 3.1 | 23.2 | 19.0 | 14.8 | 10.7 | - | - | 22.5 | 3.4 | 22.1 | 18.0 | 13.8 | 9.7 | - | - | |
| | 67 | 21.4 | 3.0 | 21.4 | 21.4 | 19.9 | 15.7 | 11.5 | - | 18.0 | 3.3 | 18.0 | 18.0 | 18.0 | 14.4 | 10.3 | - | |
| | 62 | 20.3 | 3.0 | 20.3 | 20.3 | 20.3 | 16.1 | 11.9 | 7.8 | 17.5 | 3.3 | 17.5 | 17.5 | 17.5 | 13.5 | 9.4 | 5.3 | |
| | 57 | 23.2 | 3.0 | 23.2 | 23.2 | 23.2 | 19.1 | 14.9 | 10.7 | 21.9 | 3.2 | 21.9 | 21.9 | 21.9 | 17.7 | 13.6 | 9.5 | |
| 1150 | 72 | 25.0 | 3.2 | 23.4 | 18.9 | 14.4 | 10.0 | - | - | 22.2 | 3.5 | 21.8 | 17.4 | 12.9 | 8.4 | - | - | |
| | 67 | 21.2 | 3.1 | 21.2 | 21.2 | 19.4 | 14.9 | 10.4 | - | 17.8 | 3.4 | 17.8 | 17.8 | 17.3 | 12.8 | 8.4 | - | |
| | 62 | 20.1 | 3.1 | 20.1 | 20.1 | 19.8 | 15.3 | 10.8 | 6.4 | 17.3 | 3.4 | 17.3 | 17.3 | 16.9 | 12.5 | 8.0 | 3.6 | |
| | 57 | 23.0 | 3.1 | 23.0 | 23.0 | 22.6 | 18.2 | 13.7 | 9.2 | 21.5 | 3.4 | 21.5 | 21.5 | 21.0 | 16.6 | 12.1 | 7.7 | |
| 1250 | 72 | 24.7 | 3.3 | 23.6 | 18.8 | 14.1 | 9.3 | - | - | 21.8 | 3.7 | 21.5 | 16.7 | 12.0 | 7.2 | - | - | |
| | 67 | 20.9 | 3.2 | 20.9 | 20.9 | 18.8 | 14.1 | 9.3 | - | 17.5 | 3.6 | 17.5 | 17.5 | 16.0 | 11.2 | 6.5 | - | |
| | 62 | 19.8 | 3.2 | 19.8 | 19.8 | 19.2 | 14.5 | 9.7 | 5.0 | 17.0 | 3.5 | 17.0 | 17.0 | 16.2 | 11.4 | 6.6 | 1.8 | |
| | 57 | 22.7 | 3.2 | 22.7 | 22.7 | 22.0 | 17.3 | 12.5 | 7.8 | 21.2 | 3.5 | 21.2 | 21.2 | 20.2 | 15.5 | 10.7 | 5.9 | |

1. These capacities are Net capacities.

2. These ratings include the compressor, condenser fan and supply air blower motors.

UQ048 (4.0 Ton) (Continued)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | | | |
|---------------------------|----|--------------------------------------|------------|---|-------------------------------------|-------------------------|------|------|------|------|-----|---|-------------------------------------|-------------------------|------|------|------|--|--|
| | | CFM | WB (°F) | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | |
| | | | | | | Return Dry Bulb (°F) | | | | | | | | Return Dry Bulb (°F) | | | | | |
| 115°F | | | | | | | | | | | | | | | | | | | |
| 1000 | 77 | 44.9 | 4.7 | 19.2 | 17.4 | 13.1 | - | - | - | 41.4 | 5.2 | 19.0 | 15.1 | 11.7 | - | - | - | | |
| | 72 | 41.1 | 4.6 | 28.2 | 24.0 | 19.7 | 15.4 | - | - | 37.8 | 5.1 | 26.7 | 22.5 | 18.3 | 14.0 | - | - | | |
| | 67 | 37.3 | 4.6 | 37.3 | 30.5 | 26.3 | 22.0 | 17.7 | - | 34.3 | 5.1 | 34.3 | 29.0 | 24.8 | 20.6 | 16.4 | - | | |
| | 62 | 33.7 | 4.6 | 33.7 | 33.7 | 29.0 | 24.7 | 20.4 | 16.1 | 30.9 | 5.0 | 30.9 | 30.9 | 25.8 | 21.6 | 17.4 | 13.2 | | |
| 1200 | 77 | 45.4 | 4.7 | 24.0 | 18.9 | 14.0 | - | - | - | 41.3 | 5.2 | 24.0 | 17.3 | 12.4 | - | - | - | | |
| | 72 | 41.6 | 4.7 | 30.9 | 25.9 | 21.0 | 16.1 | - | - | 37.8 | 5.2 | 29.2 | 24.3 | 19.4 | 14.6 | - | - | | |
| | 67 | 37.8 | 4.6 | 37.8 | 33.0 | 28.1 | 23.1 | 18.2 | - | 34.3 | 5.1 | 34.3 | 31.3 | 26.5 | 21.6 | 16.7 | - | | |
| | 62 | 34.1 | 4.6 | 34.1 | 34.1 | 30.9 | 26.0 | 21.1 | 16.2 | 30.9 | 5.1 | 30.9 | 30.9 | 27.5 | 22.7 | 17.8 | 12.9 | | |
| | 57 | 35.2 | 4.6 | 35.2 | 35.2 | 32.0 | 27.0 | 22.1 | 17.2 | 32.3 | 5.1 | 32.3 | 32.3 | 28.9 | 24.0 | 19.2 | 14.3 | | |
| 1400 | 77 | 45.9 | 4.7 | 28.8 | 20.4 | 14.9 | - | - | - | 41.3 | 5.2 | 29.0 | 19.5 | 13.2 | - | - | - | | |
| | 72 | 42.1 | 4.7 | 33.5 | 27.9 | 22.4 | 16.8 | - | - | 37.8 | 5.2 | 31.7 | 26.2 | 20.6 | 15.1 | - | - | | |
| | 67 | 38.2 | 4.6 | 38.2 | 35.4 | 29.8 | 24.3 | 18.7 | - | 34.3 | 5.1 | 34.3 | 33.6 | 28.1 | 22.6 | 17.1 | - | | |
| | 62 | 34.5 | 4.6 | 34.5 | 34.5 | 32.9 | 27.3 | 21.8 | 16.2 | 30.9 | 5.1 | 30.9 | 30.9 | 29.2 | 23.7 | 18.2 | 12.7 | | |
| | 57 | 35.6 | 4.6 | 35.6 | 35.6 | 34.0 | 28.4 | 22.9 | 17.3 | 32.3 | 5.1 | 32.3 | 32.3 | 30.7 | 25.2 | 19.6 | 14.1 | | |
| 1600 | 77 | 46.5 | 4.7 | 33.6 | 22.0 | 15.8 | - | - | - | 41.3 | 5.2 | 34.0 | 21.7 | 14.0 | - | - | - | | |
| | 72 | 42.5 | 4.7 | 36.1 | 29.9 | 23.7 | 17.5 | - | - | 37.8 | 5.2 | 34.2 | 28.0 | 21.8 | 15.7 | - | - | | |
| | 67 | 38.6 | 4.6 | 38.6 | 37.8 | 31.6 | 25.4 | 19.2 | - | 34.3 | 5.2 | 34.3 | 34.3 | 29.7 | 23.6 | 17.4 | - | | |
| | 62 | 34.9 | 4.6 | 34.9 | 34.9 | 34.9 | 28.7 | 22.5 | 16.2 | 30.9 | 5.1 | 30.9 | 30.9 | 30.9 | 24.7 | 18.6 | 12.4 | | |
| | 57 | 36.0 | 4.6 | 36.0 | 36.0 | 36.0 | 29.8 | 23.6 | 17.4 | 32.2 | 5.1 | 32.2 | 32.2 | 32.2 | 26.3 | 20.1 | 14.0 | | |
| 1800 | 72 | 42.2 | 4.7 | 38.3 | 31.5 | 24.8 | 18.0 | - | - | 37.2 | 5.2 | 36.3 | 29.5 | 22.8 | 16.1 | - | - | | |
| | 67 | 38.3 | 4.6 | 38.3 | 37.9 | 33.0 | 26.3 | 19.5 | - | 33.8 | 5.2 | 33.8 | 33.8 | 31.1 | 24.4 | 17.6 | - | | |
| | 62 | 34.6 | 4.6 | 34.6 | 34.6 | 34.6 | 27.8 | 21.0 | 14.3 | 30.4 | 5.1 | 30.4 | 30.4 | 30.4 | 23.7 | 17.0 | 10.3 | | |
| | 57 | 35.7 | 4.6 | 35.7 | 35.7 | 35.7 | 28.9 | 22.2 | 15.4 | 31.8 | 5.1 | 31.8 | 31.8 | 31.8 | 25.2 | 18.4 | 11.7 | | |
| 2000 | 72 | 41.8 | 4.7 | 40.5 | 33.1 | 25.8 | 18.5 | - | - | 36.7 | 5.2 | 36.7 | 31.1 | 23.8 | 16.6 | - | - | | |
| | 67 | 37.9 | 4.7 | 37.9 | 37.9 | 34.5 | 27.1 | 19.8 | - | 33.3 | 5.2 | 33.3 | 33.3 | 32.4 | 25.2 | 17.9 | - | | |
| | 62 | 34.2 | 4.6 | 34.2 | 34.2 | 34.2 | 26.9 | 19.6 | 12.3 | 30.0 | 5.1 | 30.0 | 30.0 | 30.0 | 22.7 | 15.4 | 8.2 | | |
| | 57 | 35.4 | 4.6 | 35.4 | 35.4 | 35.4 | 28.1 | 20.7 | 13.4 | 31.3 | 5.1 | 31.3 | 31.3 | 31.3 | 24.0 | 16.8 | 9.5 | | |

1. These capacities are Net capacities.

2. These ratings include the compressor, condenser fan and supply air blower motors.

UQ060 (5.0 Ton) (Continued)

| Air on Evaporator Coil | | Temperature of Air on Condenser Coil | | | | | | | | | | | | | | | | |
|---------------------------|----|---|-------------------------------------|-------------------------|------|------|------|------|------|---|-------------------------------------|-------------------------|----------------------|------|------|-------|------|--|
| | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | Total Capacity ¹ (MBh) | Total Input (kW) ² | Sensible Capacity (MBh) | | | | | | |
| | | | | Return Dry Bulb (°F) | | | | | | | | | Return Dry Bulb (°F) | | | | | |
| 115°F | | | | | | | | | | | | | | | | 125°F | | |
| 1350 | 77 | 47.3 | 5.8 | 26.5 | 21.3 | 15.7 | - | - | - | 42.4 | 6.3 | 28.6 | 19.8 | 13.9 | - | - | - | |
| | 72 | 44.5 | 5.8 | 34.1 | 28.6 | 23.1 | 17.6 | - | - | 40.1 | 6.3 | 33.2 | 27.3 | 21.4 | 15.5 | - | - | |
| | 67 | 41.7 | 5.8 | 41.7 | 35.9 | 30.4 | 24.9 | 19.4 | - | 37.8 | 6.4 | 37.8 | 34.8 | 28.9 | 23.0 | 17.1 | - | |
| | 62 | 37.3 | 5.8 | 37.3 | 37.3 | 35.3 | 29.8 | 24.3 | 18.8 | 33.7 | 6.3 | 33.7 | 33.7 | 31.9 | 26.0 | 20.1 | 14.2 | |
| 1500 | 77 | 48.8 | 5.9 | 28.4 | 22.3 | 16.6 | - | - | - | 43.7 | 6.4 | 29.0 | 20.4 | 14.6 | - | - | - | |
| | 72 | 45.9 | 5.9 | 35.7 | 30.0 | 24.3 | 18.5 | - | - | 41.3 | 6.5 | 34.0 | 28.3 | 22.5 | 16.8 | - | - | |
| | 67 | 42.9 | 5.9 | 42.9 | 37.7 | 32.0 | 26.2 | 20.5 | - | 39.0 | 6.5 | 39.0 | 36.1 | 30.4 | 24.7 | 19.0 | - | |
| | 62 | 38.4 | 5.9 | 38.4 | 38.4 | 37.1 | 31.4 | 25.7 | 19.9 | 34.8 | 6.4 | 34.8 | 34.8 | 33.6 | 27.9 | 22.2 | 16.5 | |
| | 57 | 38.3 | 5.9 | 38.3 | 38.3 | 37.0 | 31.3 | 25.5 | 19.8 | 34.7 | 6.4 | 34.7 | 34.7 | 33.5 | 27.7 | 22.0 | 16.3 | |
| 1650 | 77 | 50.2 | 6.1 | 30.4 | 23.3 | 17.4 | - | - | - | 45.0 | 6.5 | 29.3 | 20.9 | 15.4 | - | - | - | |
| | 72 | 47.2 | 6.1 | 37.3 | 31.4 | 25.4 | 19.5 | - | - | 42.6 | 6.6 | 34.7 | 29.2 | 23.7 | 18.1 | - | - | |
| | 67 | 44.2 | 6.1 | 44.2 | 39.4 | 33.5 | 27.6 | 21.7 | - | 40.2 | 6.6 | 40.2 | 37.5 | 32.0 | 26.4 | 20.9 | - | |
| | 62 | 39.6 | 6.0 | 39.6 | 39.6 | 38.9 | 33.0 | 27.1 | 21.1 | 35.9 | 6.5 | 35.9 | 35.9 | 35.3 | 29.8 | 24.3 | 18.7 | |
| | 57 | 39.4 | 6.0 | 39.4 | 39.4 | 38.8 | 32.9 | 26.9 | 21.0 | 35.8 | 6.5 | 35.8 | 35.8 | 35.2 | 29.6 | 24.1 | 18.5 | |
| 1800 | 77 | 51.7 | 6.2 | 32.3 | 24.3 | 18.2 | - | - | - | 46.4 | 6.7 | 29.7 | 21.5 | 16.1 | - | - | - | |
| | 72 | 48.6 | 6.2 | 38.9 | 32.8 | 26.6 | 20.5 | - | - | 43.9 | 6.7 | 35.5 | 30.2 | 24.8 | 19.5 | - | - | |
| | 67 | 45.5 | 6.2 | 45.5 | 41.2 | 35.1 | 28.9 | 22.8 | - | 41.4 | 6.7 | 41.4 | 38.8 | 33.5 | 28.2 | 22.8 | - | |
| | 62 | 40.7 | 6.1 | 40.7 | 40.7 | 40.7 | 34.6 | 28.5 | 22.3 | 36.9 | 6.6 | 36.9 | 36.9 | 36.9 | 31.7 | 26.4 | 21.0 | |
| | 57 | 40.6 | 6.1 | 40.6 | 40.6 | 40.6 | 34.5 | 28.3 | 22.2 | 36.8 | 6.6 | 36.8 | 36.8 | 36.8 | 31.5 | 26.2 | 20.8 | |
| 2150 | 72 | 49.0 | 6.4 | 44.1 | 36.9 | 29.4 | 22.0 | - | - | 44.3 | 6.9 | 41.3 | 34.6 | 27.6 | 20.5 | - | - | |
| | 67 | 45.8 | 6.4 | 45.8 | 43.7 | 38.8 | 31.3 | 23.8 | - | 41.8 | 6.9 | 41.8 | 40.5 | 37.2 | 30.2 | 23.1 | - | |
| | 62 | 41.0 | 6.3 | 41.0 | 41.0 | 41.0 | 33.6 | 26.1 | 18.6 | 37.3 | 6.8 | 37.3 | 37.3 | 37.3 | 30.3 | 23.2 | 16.2 | |
| | 57 | 40.9 | 6.3 | 40.9 | 40.9 | 40.9 | 33.4 | 26.0 | 18.5 | 37.2 | 6.8 | 37.2 | 37.2 | 37.2 | 30.2 | 23.1 | 16.0 | |
| 2500 | 72 | 49.3 | 6.6 | 49.3 | 41.1 | 32.3 | 23.4 | - | - | 44.7 | 7.1 | 44.7 | 39.1 | 30.4 | 21.6 | - | - | |
| | 67 | 46.2 | 6.6 | 46.2 | 46.2 | 42.5 | 33.7 | 24.9 | - | 42.2 | 7.1 | 42.2 | 42.2 | 41.0 | 32.2 | 23.4 | - | |
| | 62 | 41.3 | 6.5 | 41.3 | 41.3 | 41.3 | 32.5 | 23.7 | 14.9 | 37.7 | 7.0 | 37.7 | 37.7 | 37.7 | 28.9 | 20.1 | 11.3 | |
| | 57 | 41.2 | 6.5 | 41.2 | 41.2 | 41.2 | 32.4 | 23.6 | 14.8 | 37.6 | 7.0 | 37.6 | 37.6 | 37.6 | 28.8 | 20.0 | 11.3 | |

1. These capacities are Net capacities.

2. These ratings include the compressor, condenser fan and supply air blower motors.

Heating Capacities

UQ024-060

| Size (Tons) | Model | Air Over Evaporator Coil | | Capacity & kW | Outdoor Temperature (°F @ 72% RH) | | | | | | | |
|----------------|-------|-----------------------------|---------|---------------|-----------------------------------|-------|-------|-------|-------|-------|-------|-------|
| | | CFM | DB (°F) | | -10 | 0 | 10 | 20 | 30 | 40 | 50 | 60 |
| 024 (2.0) | UQ | 600 | 55 | MBH | 7.03 | 8.39 | 10.00 | 11.91 | 14.17 | 16.86 | 20.04 | 23.81 |
| | | | | KW | 1.27 | 1.33 | 1.39 | 1.45 | 1.51 | 1.57 | 1.63 | 1.69 |
| | | 70 | MBH | 6.20 | 7.56 | 9.17 | 11.08 | 13.34 | 16.03 | 19.21 | 22.98 | |
| | | | KW | 1.47 | 1.53 | 1.59 | 1.65 | 1.71 | 1.77 | 1.83 | 1.89 | |
| | | 800 | 55 | MBH | 4.90 | 6.26 | 7.87 | 9.78 | 12.04 | 14.73 | 17.91 | 21.68 |
| | | | | KW | 1.67 | 1.73 | 1.79 | 1.85 | 1.91 | 1.97 | 2.03 | 2.09 |
| | | | 70 | MBH | 8.18 | 9.54 | 11.15 | 13.06 | 15.32 | 18.01 | 21.19 | 24.96 |
| | | | | KW | 1.17 | 1.23 | 1.29 | 1.35 | 1.41 | 1.47 | 1.53 | 1.59 |
| | | 1000 | 55 | MBH | 7.35 | 8.71 | 10.32 | 12.23 | 14.49 | 17.18 | 20.36 | 24.13 |
| | | | | KW | 1.37 | 1.43 | 1.49 | 1.55 | 1.61 | 1.67 | 1.73 | 1.79 |
| | | | 70 | MBH | 6.05 | 7.41 | 9.02 | 10.93 | 13.19 | 15.88 | 19.06 | 22.83 |
| | | | | KW | 1.57 | 1.63 | 1.69 | 1.75 | 1.81 | 1.87 | 1.93 | 1.99 |
| 030 (2.5) | UQ | 750 | 55 | MBH | 8.56 | 9.92 | 11.53 | 13.44 | 15.70 | 18.39 | 21.57 | 25.34 |
| | | | | KW | 1.14 | 1.20 | 1.26 | 1.32 | 1.38 | 1.44 | 1.50 | 1.56 |
| | | | 70 | MBH | 7.73 | 9.09 | 10.70 | 12.61 | 14.87 | 17.56 | 20.74 | 24.51 |
| | | | | KW | 1.34 | 1.40 | 1.46 | 1.52 | 1.58 | 1.64 | 1.70 | 1.76 |
| | | 1000 | 55 | MBH | 6.43 | 7.79 | 9.40 | 11.31 | 13.57 | 16.26 | 19.44 | 23.21 |
| | | | | KW | 1.54 | 1.60 | 1.66 | 1.72 | 1.78 | 1.84 | 1.90 | 1.96 |
| | | | 70 | MBH | 8.50 | 10.31 | 12.54 | 15.26 | 18.59 | 22.67 | 27.67 | 33.79 |
| | | | | KW | 1.54 | 1.60 | 1.66 | 1.72 | 1.78 | 1.84 | 1.90 | 1.96 |
| | | 1250 | 55 | MBH | 6.95 | 8.76 | 10.99 | 13.71 | 17.04 | 21.12 | 26.12 | 32.24 |
| | | | | KW | 2.05 | 2.11 | 2.17 | 2.23 | 2.29 | 2.35 | 2.41 | 2.47 |
| | | | 70 | MBH | 6.25 | 8.06 | 10.29 | 13.01 | 16.34 | 20.42 | 25.42 | 31.54 |
| | | | | KW | 2.21 | 2.27 | 2.33 | 2.39 | 2.45 | 2.51 | 2.57 | 2.63 |
| 036 (3.0) | UQ | 900 | 55 | MBH | 9.65 | 11.46 | 13.69 | 16.41 | 19.74 | 23.82 | 28.82 | 34.94 |
| | | | | KW | 1.44 | 1.50 | 1.56 | 1.62 | 1.68 | 1.74 | 1.80 | 1.86 |
| | | | 70 | MBH | 8.10 | 9.91 | 12.14 | 14.86 | 18.19 | 22.27 | 27.27 | 33.39 |
| | | | | KW | 1.95 | 2.01 | 2.07 | 2.13 | 2.19 | 2.25 | 2.31 | 2.37 |
| | | 1200 | 55 | MBH | 7.40 | 9.21 | 11.44 | 14.16 | 17.49 | 21.57 | 26.57 | 32.69 |
| | | | | KW | 2.11 | 2.17 | 2.23 | 2.29 | 2.35 | 2.41 | 2.47 | 2.53 |
| | | | 70 | MBH | 10.25 | 12.06 | 14.29 | 17.01 | 20.34 | 24.42 | 29.42 | 35.54 |
| | | | | KW | 1.48 | 1.54 | 1.60 | 1.66 | 1.72 | 1.78 | 1.84 | 1.90 |
| | | 1500 | 55 | MBH | 8.70 | 10.51 | 12.74 | 15.46 | 18.79 | 22.87 | 27.87 | 33.99 |
| | | | | KW | 1.99 | 2.05 | 2.11 | 2.17 | 2.23 | 2.29 | 2.35 | 2.41 |
| | | | 70 | MBH | 8.00 | 9.81 | 12.04 | 14.76 | 18.09 | 22.17 | 27.17 | 33.29 |
| | | | | KW | 2.15 | 2.21 | 2.27 | 2.33 | 2.39 | 2.45 | 2.51 | 2.57 |

Additional Static Resistance

| Size (Tons) | Model | CFM | Wet Indoor Coil | Electric Heat, kW | | | |
|----------------|----------|------|-----------------|-------------------|------|------|------|
| | | | | 5 | 6.5 | 10 | 15 |
| 024 (2.0) | NM UQ | 400 | 0.05 | 0.05 | 0.05 | 0.06 | 0.07 |
| | | 500 | 0.06 | 0.06 | 0.06 | 0.07 | 0.08 |
| | | 600 | 0.07 | 0.07 | 0.07 | 0.08 | 0.09 |
| | | 700 | 0.08 | 0.08 | 0.08 | 0.09 | 0.10 |
| | | 800 | 0.09 | 0.09 | 0.09 | 0.10 | 0.12 |
| | | 900 | 0.1 | 0.10 | 0.10 | 0.11 | 0.13 |
| | | 1000 | 0.12 | 0.12 | 0.12 | 0.13 | 0.15 |
| | | 1100 | 0.13 | 0.13 | 0.13 | 0.14 | 0.17 |
| | | 1200 | 0.15 | 0.15 | 0.15 | 0.16 | 0.19 |
| | | 1300 | 0.17 | 0.17 | 0.17 | 0.18 | 0.21 |
| | | 1400 | 0.19 | 0.19 | 0.19 | 0.20 | 0.23 |
| 030 (2.5) | NM UQ | 400 | 0.05 | 0.05 | 0.05 | 0.06 | 0.07 |
| | | 500 | 0.06 | 0.06 | 0.06 | 0.07 | 0.08 |
| | | 600 | 0.07 | 0.07 | 0.07 | 0.08 | 0.09 |
| | | 700 | 0.08 | 0.08 | 0.08 | 0.09 | 0.10 |
| | | 800 | 0.09 | 0.09 | 0.09 | 0.10 | 0.12 |
| | | 900 | 0.1 | 0.10 | 0.10 | 0.11 | 0.13 |
| | | 1000 | 0.12 | 0.12 | 0.12 | 0.13 | 0.15 |
| | | 1100 | 0.13 | 0.13 | 0.13 | 0.14 | 0.17 |
| | | 1200 | 0.15 | 0.15 | 0.15 | 0.16 | 0.19 |
| | | 1300 | 0.17 | 0.17 | 0.17 | 0.18 | 0.21 |
| | | 1400 | 0.19 | 0.19 | 0.19 | 0.20 | 0.23 |
| 036 (3.0) | NM UQ | 400 | 0.05 | 0.05 | 0.05 | 0.06 | 0.07 |
| | | 500 | 0.06 | 0.06 | 0.06 | 0.07 | 0.08 |
| | | 600 | 0.07 | 0.07 | 0.07 | 0.08 | 0.09 |
| | | 700 | 0.08 | 0.08 | 0.08 | 0.09 | 0.10 |
| | | 800 | 0.09 | 0.09 | 0.09 | 0.10 | 0.12 |
| | | 900 | 0.1 | 0.10 | 0.10 | 0.11 | 0.13 |
| | | 1000 | 0.12 | 0.12 | 0.12 | 0.13 | 0.15 |
| | | 1100 | 0.13 | 0.13 | 0.13 | 0.14 | 0.17 |
| | | 1200 | 0.15 | 0.15 | 0.15 | 0.16 | 0.19 |
| | | 1300 | 0.17 | 0.17 | 0.17 | 0.18 | 0.21 |
| | | 1400 | 0.19 | 0.19 | 0.19 | 0.20 | 0.23 |
| 042 (3.5) | NM | 400 | 0.05 | 0.05 | 0.05 | 0.06 | 0.07 |
| | | 500 | 0.06 | 0.06 | 0.06 | 0.07 | 0.08 |
| | | 600 | 0.07 | 0.07 | 0.07 | 0.08 | 0.09 |
| | | 700 | 0.08 | 0.08 | 0.08 | 0.09 | 0.10 |
| | | 800 | 0.09 | 0.09 | 0.09 | 0.10 | 0.12 |
| | | 900 | 0.1 | 0.10 | 0.10 | 0.11 | 0.13 |
| | | 1000 | 0.12 | 0.12 | 0.12 | 0.13 | 0.15 |
| | | 1100 | 0.13 | 0.13 | 0.13 | 0.14 | 0.17 |
| | | 1200 | 0.15 | 0.15 | 0.15 | 0.16 | 0.19 |
| | | 1300 | 0.17 | 0.17 | 0.17 | 0.18 | 0.21 |
| | | 1400 | 0.19 | 0.19 | 0.19 | 0.20 | 0.23 |
| | UQ | 500 | 0.09 | 0.09 | 0.09 | 0.10 | 0.12 |
| | | 600 | 0.1 | 0.10 | 0.10 | 0.11 | 0.13 |
| | | 700 | 0.12 | 0.12 | 0.12 | 0.13 | 0.15 |
| | | 800 | 0.13 | 0.13 | 0.13 | 0.14 | 0.17 |
| | | 900 | 0.15 | 0.15 | 0.15 | 0.16 | 0.19 |
| | | 1000 | 0.17 | 0.17 | 0.17 | 0.18 | 0.21 |
| | | 1100 | 0.19 | 0.19 | 0.19 | 0.20 | 0.23 |
| | | 1200 | 0.21 | 0.21 | 0.21 | 0.22 | 0.25 |
| | | 1300 | 0.23 | 0.23 | 0.23 | 0.24 | 0.27 |
| | | 1400 | 0.25 | 0.25 | 0.25 | 0.26 | 0.29 |
| | | 1500 | 0.27 | 0.27 | 0.27 | 0.28 | 0.31 |
| | | 1600 | 0.29 | 0.29 | 0.29 | 0.30 | 0.33 |
| | | 1700 | 0.31 | 0.31 | 0.31 | 0.32 | 0.35 |
| | | 1800 | 0.33 | 0.33 | 0.33 | 0.34 | 0.37 |
| | | 1900 | 0.35 | 0.35 | 0.35 | 0.36 | 0.39 |
| | | 2000 | 0.37 | 0.37 | 0.37 | 0.38 | 0.41 |
| | | 2100 | 0.39 | 0.39 | 0.39 | 0.40 | 0.43 |
| | | 2200 | 0.41 | 0.41 | 0.41 | 0.42 | 0.45 |

Additional Static Resistance (Continued)

| Size (Tons) | Model | CFM | Wet Indoor Coil | Electric Heat, kW | | | |
|----------------|-------|------|-----------------|-------------------|------|------|------|
| | | | | 5 | 6.5 | 10 | 15 |
| 048 (4.0) | NM | 800 | 0.09 | 0.09 | 0.09 | 0.10 | 0.12 |
| | | 900 | 0.1 | 0.10 | 0.10 | 0.11 | 0.13 |
| | | 1000 | 0.12 | 0.12 | 0.12 | 0.13 | 0.15 |
| | | 1100 | 0.13 | 0.13 | 0.13 | 0.14 | 0.17 |
| | | 1200 | 0.15 | 0.15 | 0.15 | 0.16 | 0.19 |
| | | 1300 | 0.17 | 0.17 | 0.17 | 0.18 | 0.21 |
| | | 1400 | 0.19 | 0.19 | 0.19 | 0.20 | 0.23 |
| | | 1500 | 0.21 | 0.21 | 0.21 | 0.22 | 0.25 |
| | | 1600 | 0.23 | 0.23 | 0.23 | 0.24 | 0.27 |
| | | 1700 | 0.25 | 0.25 | 0.25 | 0.26 | 0.29 |
| | | 1800 | 0.27 | 0.27 | 0.27 | 0.28 | 0.31 |
| | | 1900 | 0.29 | 0.29 | 0.29 | 0.30 | 0.33 |
| | | 2000 | 0.31 | 0.31 | 0.31 | 0.32 | 0.35 |
| | | 2100 | 0.33 | 0.33 | 0.33 | 0.34 | 0.37 |
| | | 2200 | 0.35 | 0.35 | 0.35 | 0.36 | 0.39 |
| | UQ | 500 | 0.09 | 0.09 | 0.09 | 0.10 | 0.12 |
| | | 600 | 0.1 | 0.10 | 0.10 | 0.11 | 0.13 |
| | | 700 | 0.12 | 0.12 | 0.12 | 0.13 | 0.15 |
| | | 800 | 0.13 | 0.13 | 0.13 | 0.14 | 0.17 |
| | | 900 | 0.15 | 0.15 | 0.15 | 0.16 | 0.19 |
| | | 1000 | 0.17 | 0.17 | 0.17 | 0.18 | 0.21 |
| | | 1100 | 0.19 | 0.19 | 0.19 | 0.20 | 0.23 |
| | | 1200 | 0.21 | 0.21 | 0.21 | 0.22 | 0.25 |
| | | 1300 | 0.23 | 0.23 | 0.23 | 0.24 | 0.27 |
| | | 1400 | 0.25 | 0.25 | 0.25 | 0.26 | 0.29 |
| | | 1500 | 0.27 | 0.27 | 0.27 | 0.28 | 0.31 |
| | | 1600 | 0.29 | 0.29 | 0.29 | 0.30 | 0.33 |
| | | 1700 | 0.31 | 0.31 | 0.31 | 0.32 | 0.35 |
| | | 1800 | 0.33 | 0.33 | 0.33 | 0.34 | 0.37 |
| | | 1900 | 0.35 | 0.35 | 0.35 | 0.36 | 0.39 |
| | | 2000 | 0.37 | 0.37 | 0.37 | 0.38 | 0.41 |
| | | 2100 | 0.39 | 0.39 | 0.39 | 0.40 | 0.43 |
| | | 2200 | 0.41 | 0.41 | 0.41 | 0.42 | 0.45 |
| 060 (5.0) | NM | 800 | 0.09 | 0.09 | 0.09 | 0.10 | 0.12 |
| | | 900 | 0.1 | 0.10 | 0.10 | 0.11 | 0.13 |
| | | 1000 | 0.12 | 0.12 | 0.12 | 0.13 | 0.15 |
| | | 1100 | 0.13 | 0.13 | 0.13 | 0.14 | 0.17 |
| | | 1200 | 0.15 | 0.15 | 0.15 | 0.16 | 0.19 |
| | | 1300 | 0.17 | 0.17 | 0.17 | 0.18 | 0.21 |
| | | 1400 | 0.19 | 0.19 | 0.19 | 0.20 | 0.23 |
| | | 1500 | 0.21 | 0.21 | 0.21 | 0.22 | 0.25 |
| | | 1600 | 0.23 | 0.23 | 0.23 | 0.24 | 0.27 |
| | | 1700 | 0.25 | 0.25 | 0.25 | 0.26 | 0.29 |
| | | 1800 | 0.27 | 0.27 | 0.27 | 0.28 | 0.31 |
| | | 1900 | 0.29 | 0.29 | 0.29 | 0.30 | 0.33 |
| | | 2000 | 0.31 | 0.31 | 0.31 | 0.32 | 0.35 |
| | | 2100 | 0.33 | 0.33 | 0.33 | 0.34 | 0.37 |
| | | 2200 | 0.35 | 0.35 | 0.35 | 0.36 | 0.39 |
| | UQ | 500 | 0.09 | 0.09 | 0.09 | 0.10 | 0.12 |
| | | 600 | 0.1 | 0.10 | 0.10 | 0.11 | 0.13 |
| | | 700 | 0.12 | 0.12 | 0.12 | 0.13 | 0.15 |
| | | 800 | 0.13 | 0.13 | 0.13 | 0.14 | 0.17 |
| | | 900 | 0.15 | 0.15 | 0.15 | 0.16 | 0.19 |
| | | 1000 | 0.17 | 0.17 | 0.17 | 0.18 | 0.21 |
| | | 1100 | 0.19 | 0.19 | 0.19 | 0.20 | 0.23 |
| | | 1200 | 0.21 | 0.21 | 0.21 | 0.22 | 0.25 |
| | | 1300 | 0.23 | 0.23 | 0.23 | 0.24 | 0.27 |
| | | 1400 | 0.25 | 0.25 | 0.25 | 0.26 | 0.29 |
| | | 1500 | 0.27 | 0.27 | 0.27 | 0.28 | 0.31 |
| | | 1600 | 0.29 | 0.29 | 0.29 | 0.30 | 0.33 |
| | | 1700 | 0.31 | 0.31 | 0.31 | 0.32 | 0.35 |
| | | 1800 | 0.33 | 0.33 | 0.33 | 0.34 | 0.37 |
| | | 1900 | 0.35 | 0.35 | 0.35 | 0.36 | 0.39 |
| | | 2000 | 0.37 | 0.37 | 0.37 | 0.38 | 0.41 |
| | | 2100 | 0.39 | 0.39 | 0.39 | 0.40 | 0.43 |
| | | 2200 | 0.41 | 0.41 | 0.41 | 0.42 | 0.45 |

Electric Heat Minimum Supply Air

| Size (Tons) | Model | Voltage | Minimum Supply Air (CFM) | | | |
|----------------|-------|--------------|--------------------------|------|------|------|
| | | | Heater kW | | | |
| | | | 5.0 | 6.5 | 10 | 15 |
| 024 (2.0) | NM | 208/230-1-60 | 800 | 800 | 800 | 775 |
| 030 (2.5) | NM | 208/230-1-60 | 800 | 800 | 800 | 775 |
| 036 (3.0) | NM | 208/230-1-60 | 800 | 800 | 800 | 775 |
| 042 (3.5) | NM | 208/230-1-60 | 800 | 800 | 800 | 775 |
| 048 (4.0) | NM | 208/230-1-60 | 1300 | 1300 | 1270 | 1160 |
| 060 (5.0) | NM | 208/230-1-60 | 1300 | 1300 | 1270 | 1160 |
| 024 (2.0) | UQ | 208/230-1-60 | 800 | 800 | 800 | 750 |
| 030 (2.5) | UQ | 208/230-1-60 | 800 | 800 | 800 | 750 |
| 036 (3.0) | UQ | 208/230-1-60 | 800 | 800 | 800 | 750 |
| 042 (3.5) | UQ | 208/230-1-60 | 1300 | 1300 | 1270 | 1270 |
| 048 (4.0) | UQ | 208/230-1-60 | 1300 | 1300 | 1270 | 1270 |
| 060 (5.0) | UQ | 208/230-1-60 | 1300 | 1300 | 1270 | 1270 |

Indoor Blower Specifications

| Size (Tons) | Model | Motor | | | | |
|----------------|-------|-------|------|------|-----|-------|
| | | HP | RPM | Eff. | SF | Frame |
| 024 (2.0) | UM | 1/2 | 1075 | 0.8 | 1.0 | 48 |
| 030 (2.5) | UM | 1/2 | 1075 | 0.8 | 1.0 | 48 |
| 036 (3.0) | UM | 1/2 | 1075 | 0.8 | 1.0 | 48 |
| 042 (3.5) | UM | 1/2 | 1100 | 0.8 | 1.0 | 48 |
| 048 (4.0) | UM | 1 | 1100 | 0.8 | 1.0 | 48 |
| 060 (5.0) | UM | 1 | 1100 | 0.8 | 1.0 | 48 |
| 024 (2.0) | UQ | 1/2 | 1100 | 0.8 | 1.0 | 48 |
| 030 (2.5) | UQ | 1/2 | 1100 | 0.8 | 1.0 | 48 |
| 036 (3.0) | UQ | 1/2 | 1100 | 0.8 | 1.0 | 48 |
| 042 (3.5) | UQ | 1 | 1100 | 0.8 | 1.0 | 48 |
| 048 (4.0) | UQ | 1 | 1100 | 0.8 | 1.0 | 48 |
| 060 (5.0) | UQ | 1 | 1100 | 0.8 | 1.0 | 48 |


Electric Heat Multipliers

| Voltage | | kW Capacity Multipliers ¹ |
|---------|---------|--------------------------------------|
| Nominal | Applied | |
| 240 | 208 | 0.75 |
| | 230 | 0.92 |


1. Electric heaters are rated at nominal voltage. Use this table to determine the electric heat capacity for heaters applied at lower voltages.

NM/UQ024-060 Typical Wiring Diagrams

NM024, 030 and 036 Typical Cooling Unit 208/230-1-60 volt Wiring Diagram

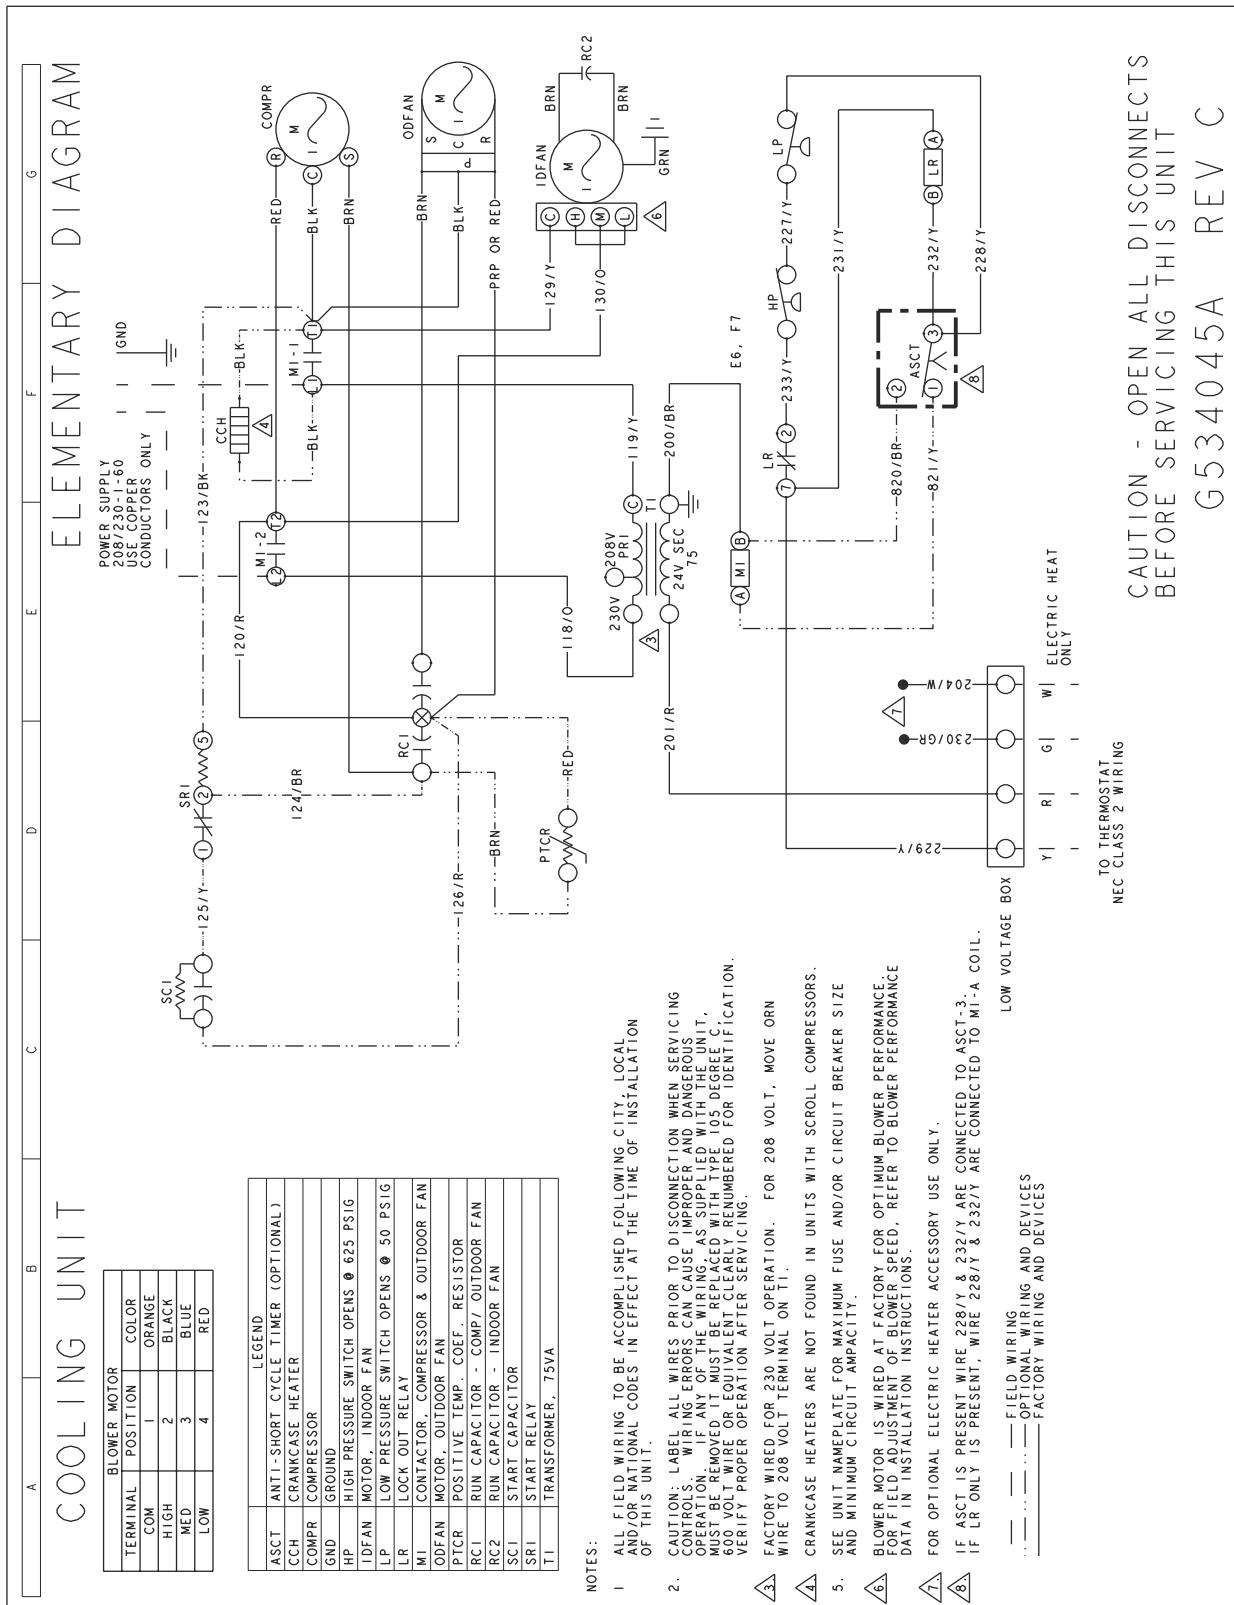

NM036 Typical Cooling Unit 208/230-3-60 volt Wiring Diagram

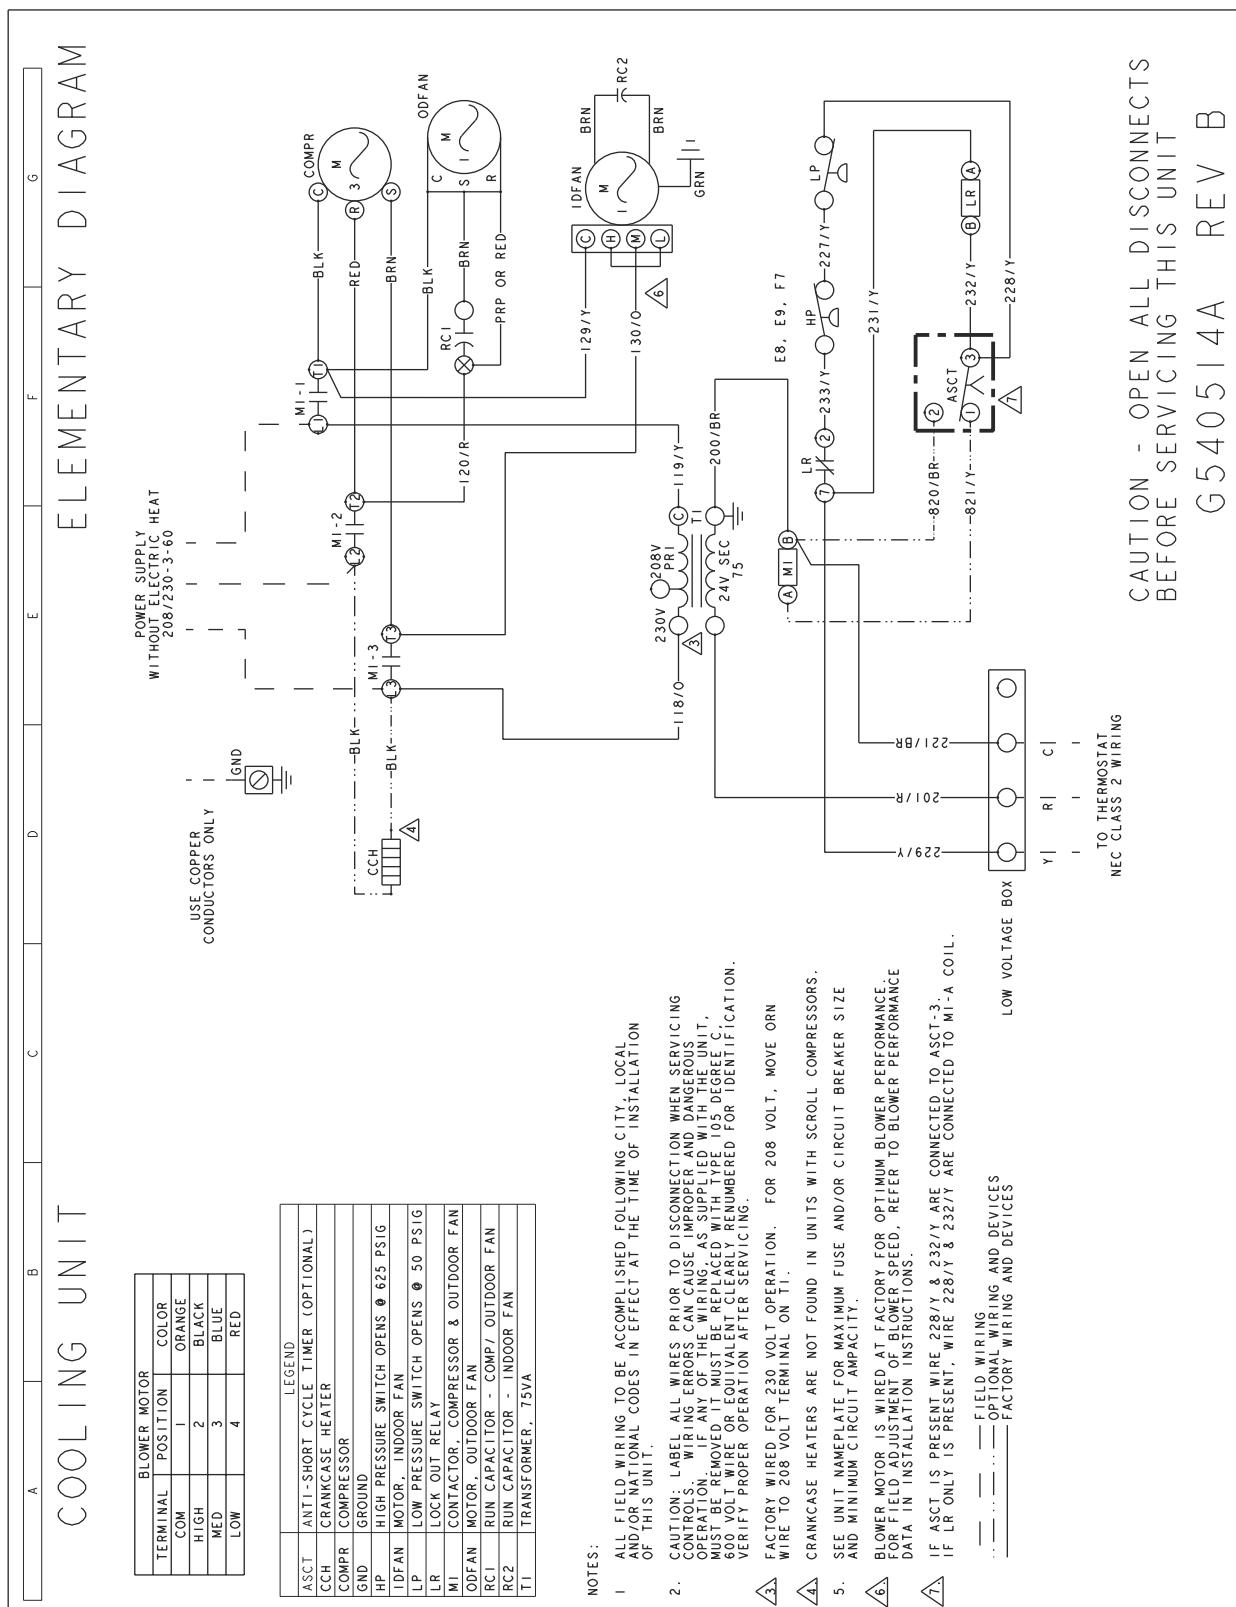

NM048 and 060 Typical Cooling Unit 208/230-3-60 volt Wiring Diagram

COOLING UNIT

| LEGEND | |
|--------|---------------------------------------|
| ASCT | ANTI-SHORT CYCLE TIMER (OPTIONAL) |
| CCH | CRANKCASE HEATER |
| COMPR | COMPRESSOR |
| GND | GROUND |
| HPS | HIGH PRESSURE SWITCH OPENS @ 625 PSIG |
| IDFAN | MOTOR, INDOOR FAN |
| LP | LOW PRESSURE SWITCH OPENS @ 50 PSIG |
| LR | LOCK OUT RELAY |
| M1 | CONTACTOR, COMPRESSOR & OUTDOOR FAN |
| ODFAN | MOTOR, OUTDOOR FAN |
| RC1 | RUN CAPACITOR - COMP/ OUTDOOR FAN |
| T1 | TRANSFORMER, 75VA |

NOTES:

1. ALL FIELD WIRING TO BE ACCOMPLISHED FOLLOWING CITY LOCAL AND/OR NATIONAL CODES IN EFFECT AT THE TIME OF INSTALLATION OF THIS UNIT.

2. CAUTION: LABEL ALL WIRES PRIOR TO DISCONNECTION WHEN SERVICING CONTROLS. WIRING ERRORS CAN CAUSE IMPROPER AND DANGEROUS OPERATION. IF ANY OF THE WIRING AS SUPPLIED WITH THE UNIT MUST BE REMOVED IT MUST BE REPLACED WITH TYPE 106 DEGREE C. 600 VOLT WIRE OR EQUIVALENT CLEARLY RENUMBERED FOR IDENTIFICATION. VERIFY PROPER OPERATION AFTER SERVICING.

3. FACTORY WIRED FOR 230 VOLT OPERATION. FOR 208 VOLT, MOVE GRN WIRE TO 208 VOLT TERMINAL ON T1.

4. CRANKCASE HEATERS ARE NOT FOUND IN UNITS WITH SCROLL COMPRESSORS.

5. SEE UNIT NAMEPLATE FOR MAXIMUM FUSE AND/OR CIRCUIT BREAKER SIZE AND MINIMUM CIRCUIT AMPACITY.


6. SELECT SPEED TAP TO ACHIEVE DESIRED AIRFLOW.

7. IF ASCT IS PRESENT WIRE 228Y & 232Y ARE CONNECTED TO ASCT-3. IF LR ONLY IS PRESENT, WIRE 228Y & 232Y ARE CONNECTED TO M1-A COIL.

— — — FIELD WIRING

— — — OPTIONAL WIRING AND DEVICES
FACTORY WIRING AND DEVICES

ELEMENTARY DIAGRAM

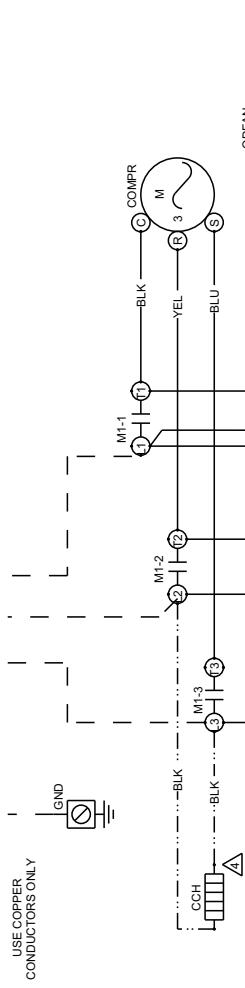POWER SUPPLY
WITHOUT ELECTRIC HEAT
208/230-3-60

1. ALL FIELD WIRING TO BE ACCOMPLISHED FOLLOWING CITY LOCAL AND/OR NATIONAL CODES IN EFFECT AT THE TIME OF INSTALLATION OF THIS UNIT.

2. CAUTION: LABEL ALL WIRES PRIOR TO DISCONNECTION WHEN SERVICING CONTROLS. WIRING ERRORS CAN CAUSE IMPROPER AND DANGEROUS OPERATION. IF ANY OF THE WIRING AS SUPPLIED WITH THE UNIT MUST BE REMOVED IT MUST BE REPLACED WITH TYPE 106 DEGREE C. 600 VOLT WIRE OR EQUIVALENT CLEARLY RENUMBERED FOR IDENTIFICATION. VERIFY PROPER OPERATION AFTER SERVICING.

3. FACTORY WIRED FOR 230 VOLT OPERATION. FOR 208 VOLT, MOVE GRN WIRE TO 208 VOLT TERMINAL ON T1.

4. CRANKCASE HEATERS ARE NOT FOUND IN UNITS WITH SCROLL COMPRESSORS.


5. SEE UNIT NAMEPLATE FOR MAXIMUM FUSE AND/OR CIRCUIT BREAKER SIZE AND MINIMUM CIRCUIT AMPACITY.

6. SELECT SPEED TAP TO ACHIEVE DESIRED AIRFLOW.

7. IF ASCT IS PRESENT WIRE 228Y & 232Y ARE CONNECTED TO ASCT-3. IF LR ONLY IS PRESENT, WIRE 228Y & 232Y ARE CONNECTED TO M1-A COIL.

— — — FIELD WIRING

— — — OPTIONAL WIRING AND DEVICES
FACTORY WIRING AND DEVICES

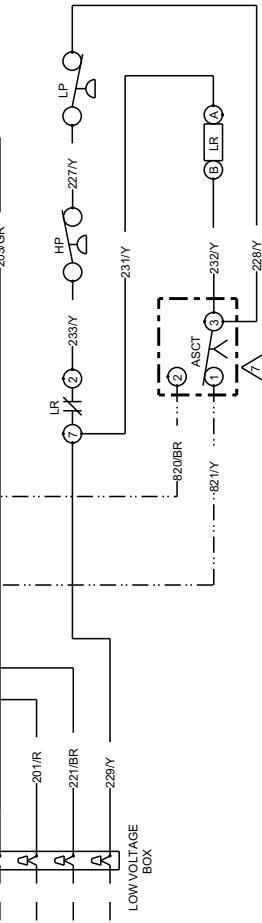

CAUTION - OPEN ALL DISCONNECTS
BEFORE SERVICING THIS UNIT


NM048 and 060 Typical Cooling Unit 460-3-60 volt Wiring Diagram

COOLING UNIT

ELEMENTARY DIAGRAM


POWER SUPPLY
460-3-60

| LEGEND | |
|--------|---------------------------------------|
| ASCT | ANTI-SHORT CYCLE TIMER (OPTIONAL) |
| CCH | CRANKCASE HEATER |
| COMPR | COMPRESSOR |
| F1 | FUSE, LINE VOLTAGE |
| F2 | FUSE, LINE VOLTAGE |
| GND | GROUND |
| HPI | HIGH PRESSURE SWITCH OPENS @ 625 PSIG |
| IDFAN | MOTOR, INDOOR FAN |
| LPS | LOW PRESSURE SWITCH OPENS @ 50 PSIG |
| LR | LOCK OUT RELAY |
| M1 | CONTACTOR, COMPRESSOR & OUTDOOR FAN |
| ODFAN | MOTOR, OUTDOOR FAN |
| RC1 | RUN CAPACITOR, OUTDOOR FAN MOTOR |
| T1 | TRANSFORMER, 24V |
| T2 | TRANSFORMER, 480/240V |

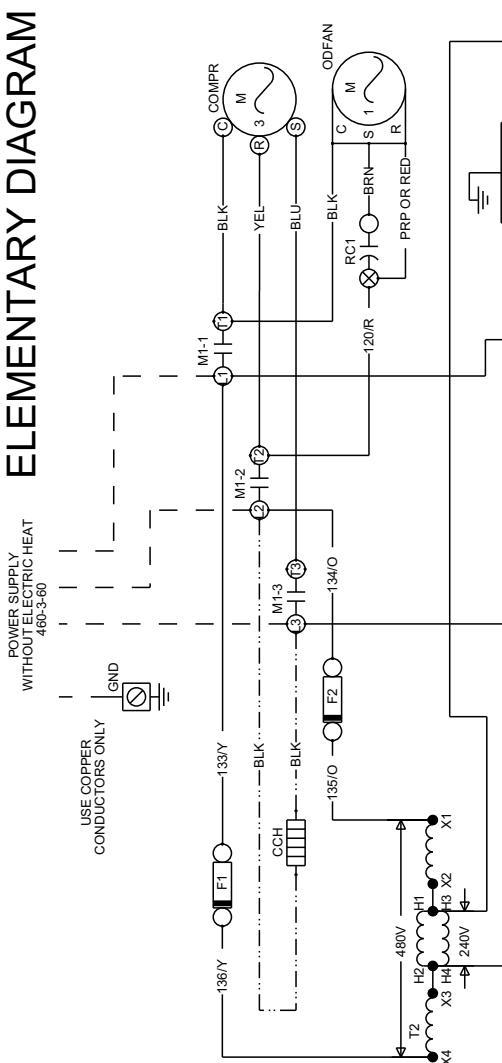


NOTES:


1. ALL FIELD WIRING TO BE ACCOMPLISHED FOLLOWING CITY, LOCAL AND/OR NATIONAL CODES IN EFFECT AT THE TIME OF INSTALLATION OF THIS UNIT.
2. CAUTION: LABEL ALL WIRES PRIOR TO DISCONNECTION WHEN SERVICING CONTROLS. WIRING ERRORS CAN CAUSE IMPROPER AND DANGEROUS OPERATION. IF ANY OF THE WIRING IS SUPPLIED WITH THE UNIT, MUST BE REMOVED IT MUST BE REPLACED WITH TYPE 105 DEGREE C. VERIFY PROPER OPERATION AFTER SERVICING.
3. SEE UNIT NAMEPLATE FOR MAXIMUM FUSE AND/OR CIRCUIT BREAKER SIZE AND MINIMUM CIRCUIT AMPACITY.
4. SELECT SPEED TAP TO ACHIEVE DESIRED AIRFLOW.
 ▲ IF ASCT IS PRESENT, WIRE 229Y & 232Y ARE CONNECTED TO ASCT. 3
 If LR ONLY IS PRESENT, WIRE 228Y & 232Y ARE CONNECTED TO M1A COIL.
- — — FIELD WIRING
 - - - - - OPTIONAL WIRING AND DEVICES
 _____ FACTORY WIRING AND DEVICES

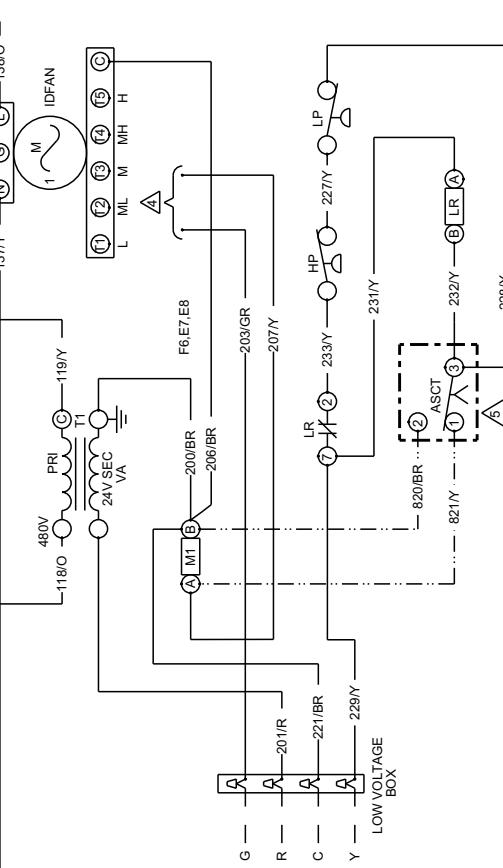CAUTION - OPEN ALL DISCONNECTS
BEFORE SERVICING THIS UNIT


UQ024-060 Typical Heat Pump 208/230-1-60 volt Wiring Diagram

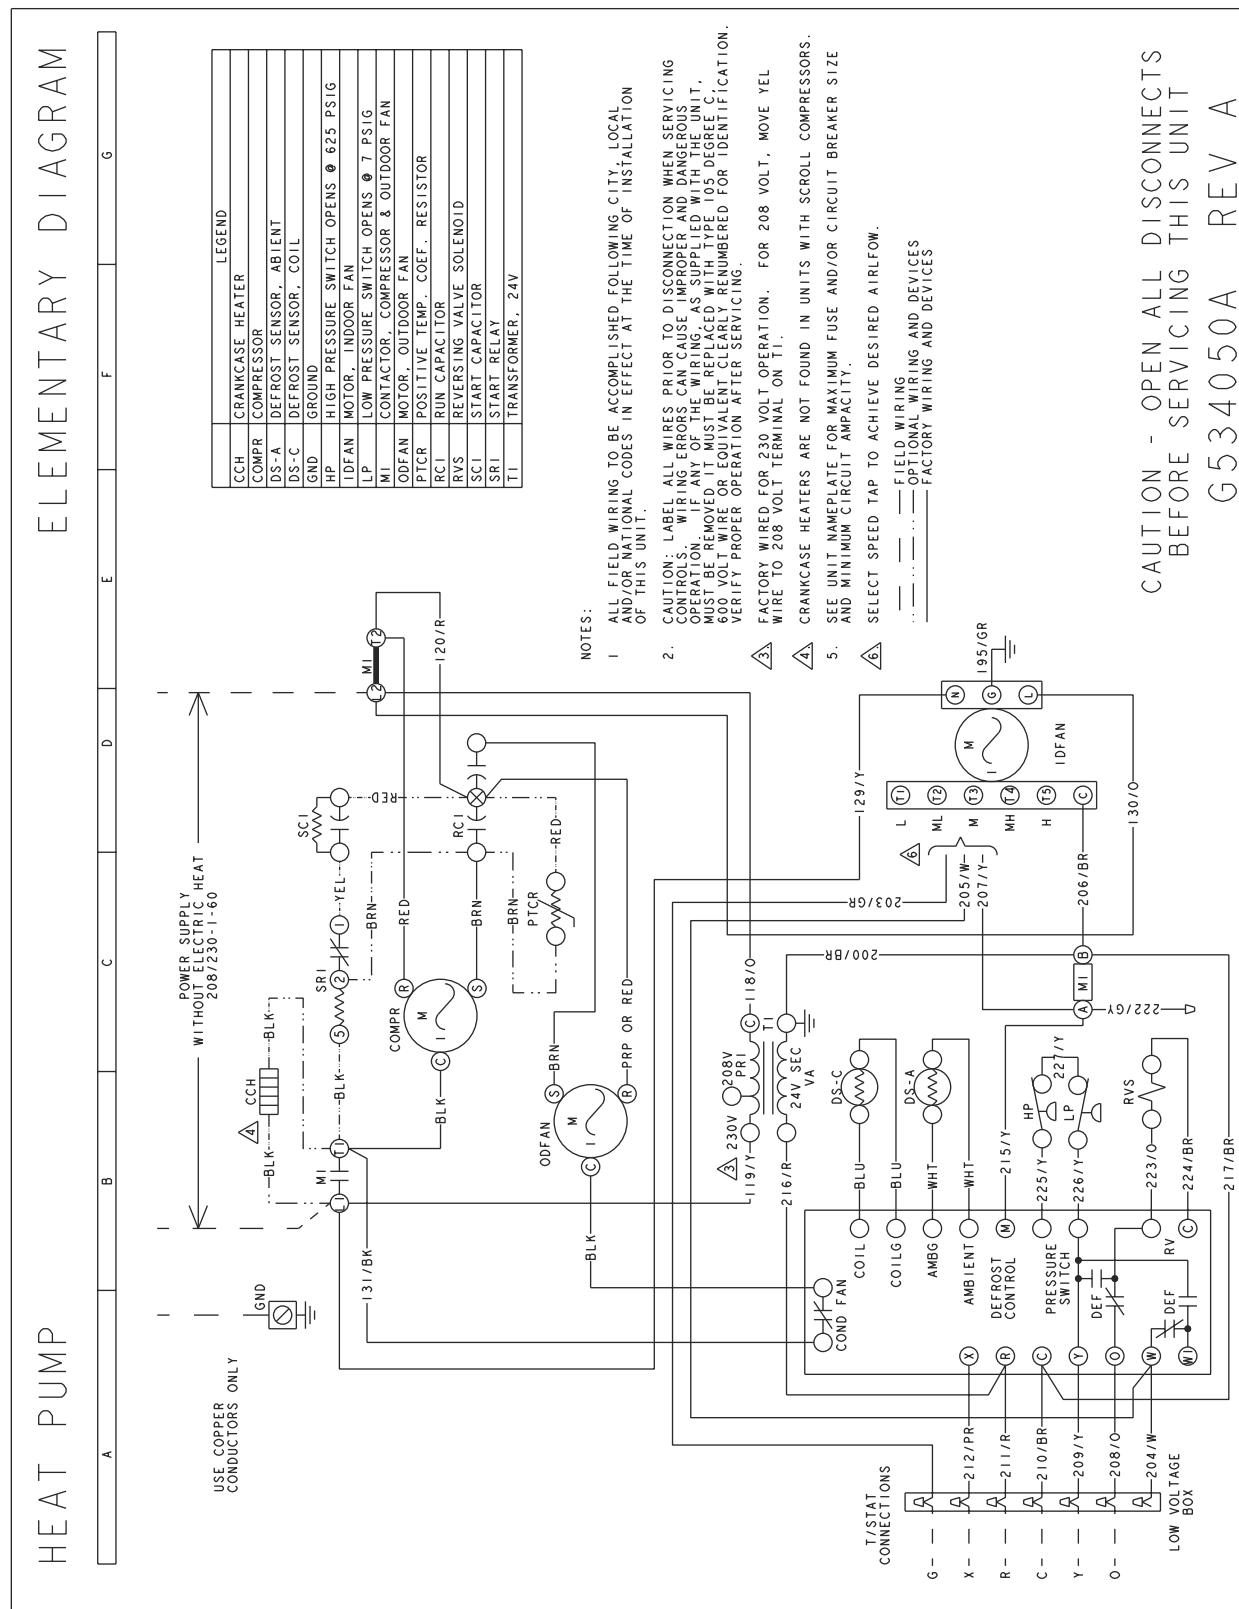

UQ036, 048 and 060 Typical Heat Pump 208/230-3-60 volt Wiring Diagram

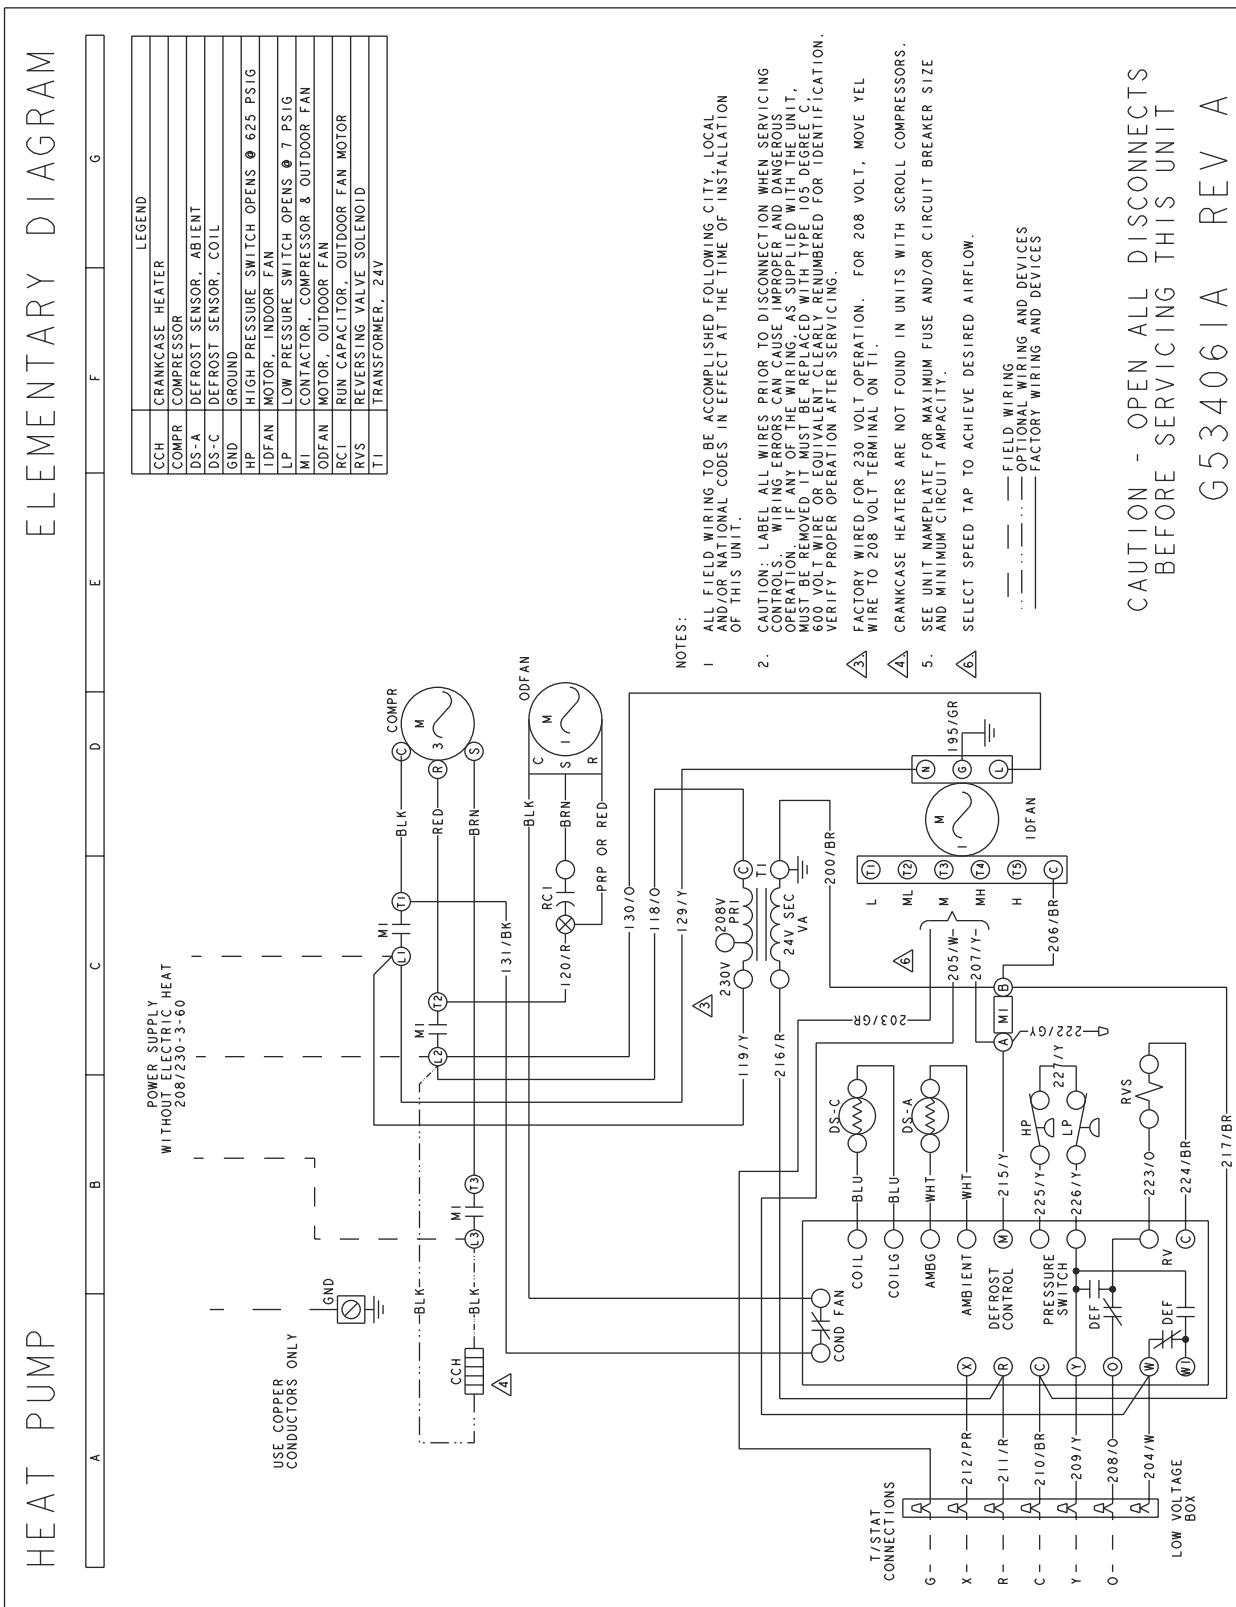


UQ060 Typical Heat Pump 460-3-60 volt Wiring Diagram

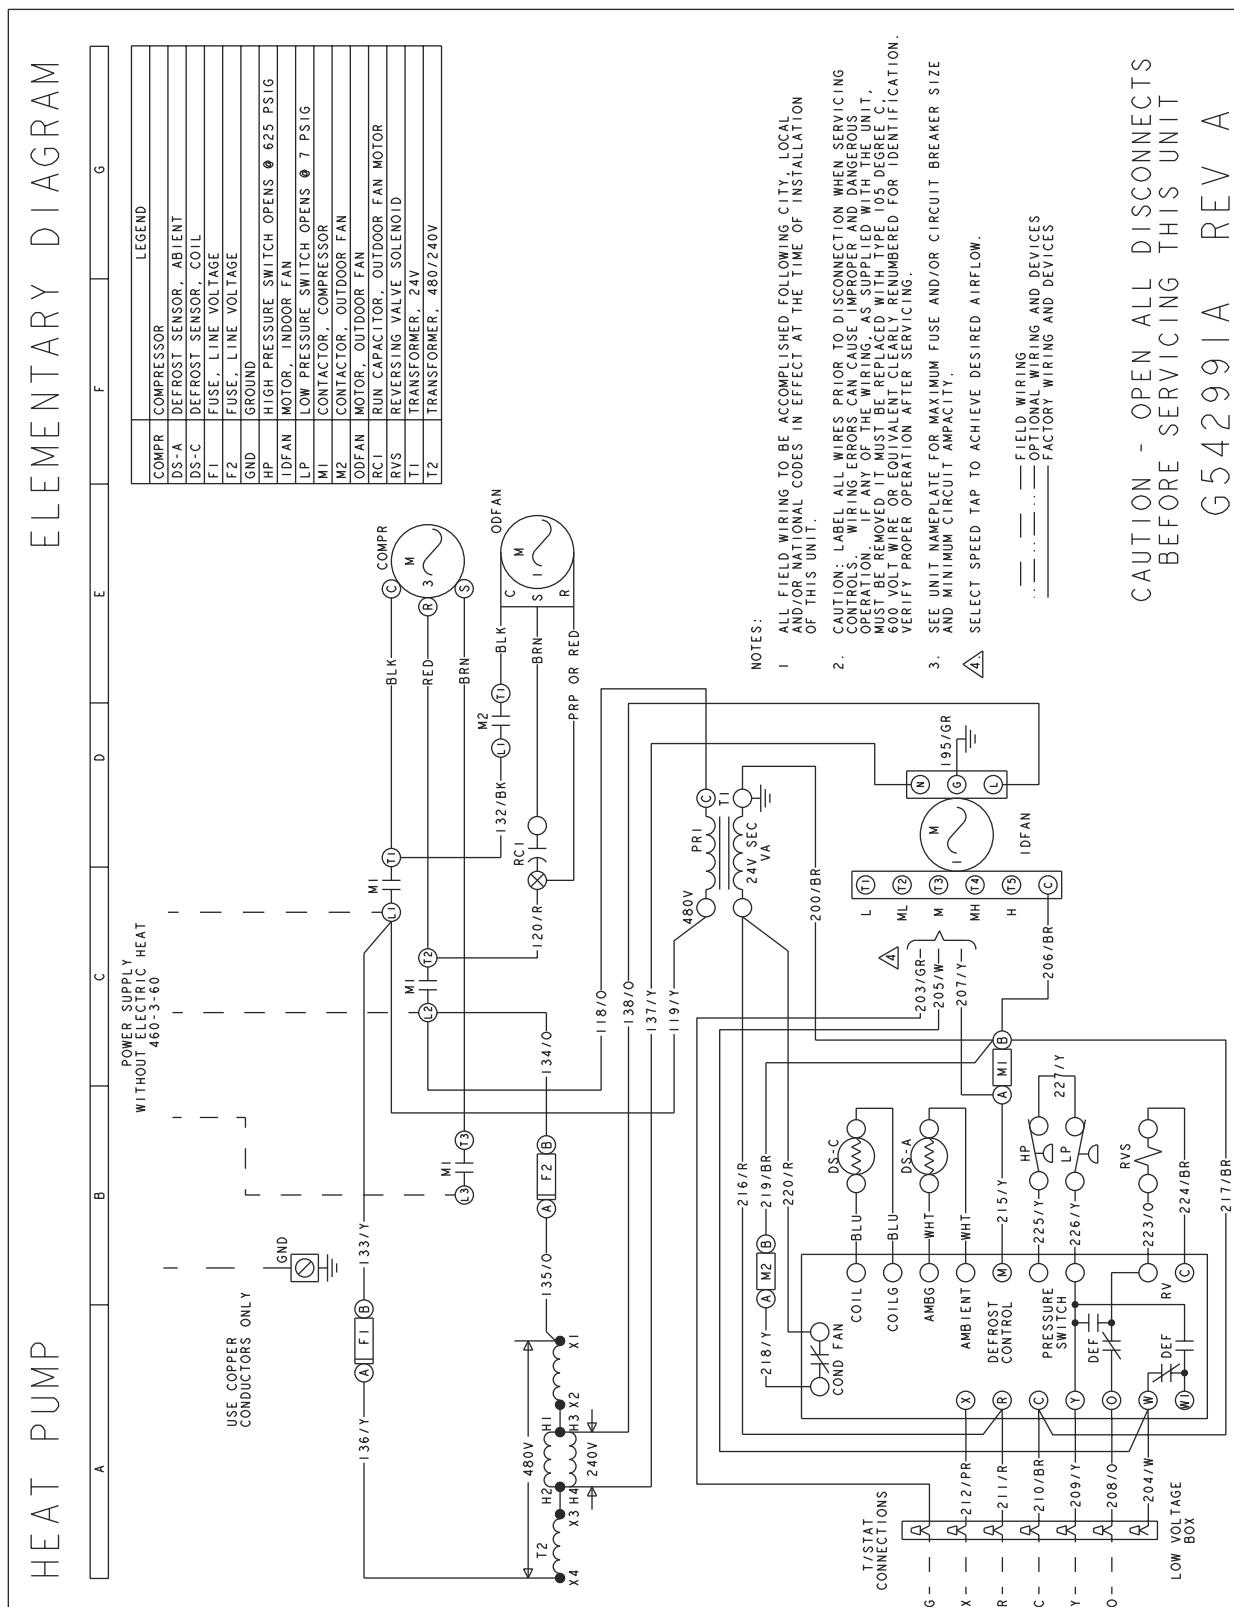

Weights and Dimensions


NM and UQ Unit Weights

Unit 4 Point Load Weights

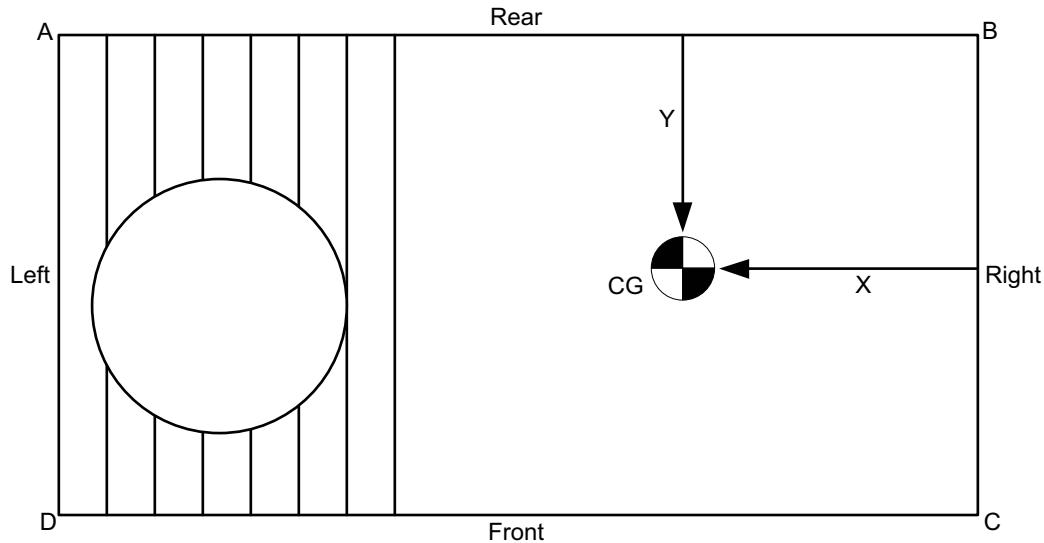

| Size (Tons) | Model | Weight (lbs.) | | Center of Gravity | | 4 Point Load Location (lbs.) | | | |
|----------------|-------|---------------|-----------|-------------------|-------|------------------------------|----|----|-----|
| | | Shipping | Operating | X | Y | A | B | C | D |
| 024 (2.0) | NM | 279 | 276 | 23.5 | 16 | 68 | 71 | 71 | 68 |
| | UQ | 328 | 325 | 21.75 | 14 | 75 | 67 | 86 | 96 |
| 030 (2.5) | NM | 282 | 279 | 23.5 | 16 | 68 | 71 | 71 | 68 |
| | UQ | 343 | 340 | 21.75 | 14 | 78 | 70 | 90 | 101 |
| 036 (3.0) | NM | 318 | 315 | 22 | 15.5 | 80 | 73 | 78 | 85 |
| | UQ | 348 | 345 | 23.5 | 15 | 79 | 83 | 94 | 90 |
| 042 (3.5) | NM | 318 | 315 | 22 | 15.5 | 80 | 73 | 78 | 85 |
| | UQ | 375 | 372 | 23.5 | 15 | 100 | 69 | 83 | 120 |
| 048 (4.0) | NM | 360 | 357 | 29 | 16 | 86 | 87 | 93 | 91 |
| | UQ | 388 | 385 | 28.75 | 16.25 | 95 | 95 | 98 | 98 |
| 060 (5.0) | NM | 353 | 350 | 29 | 16 | 84 | 86 | 91 | 89 |
| | UQ | 395 | 392 | 28.75 | 16.25 | 97 | 97 | 99 | 99 |

Unit Dimensions

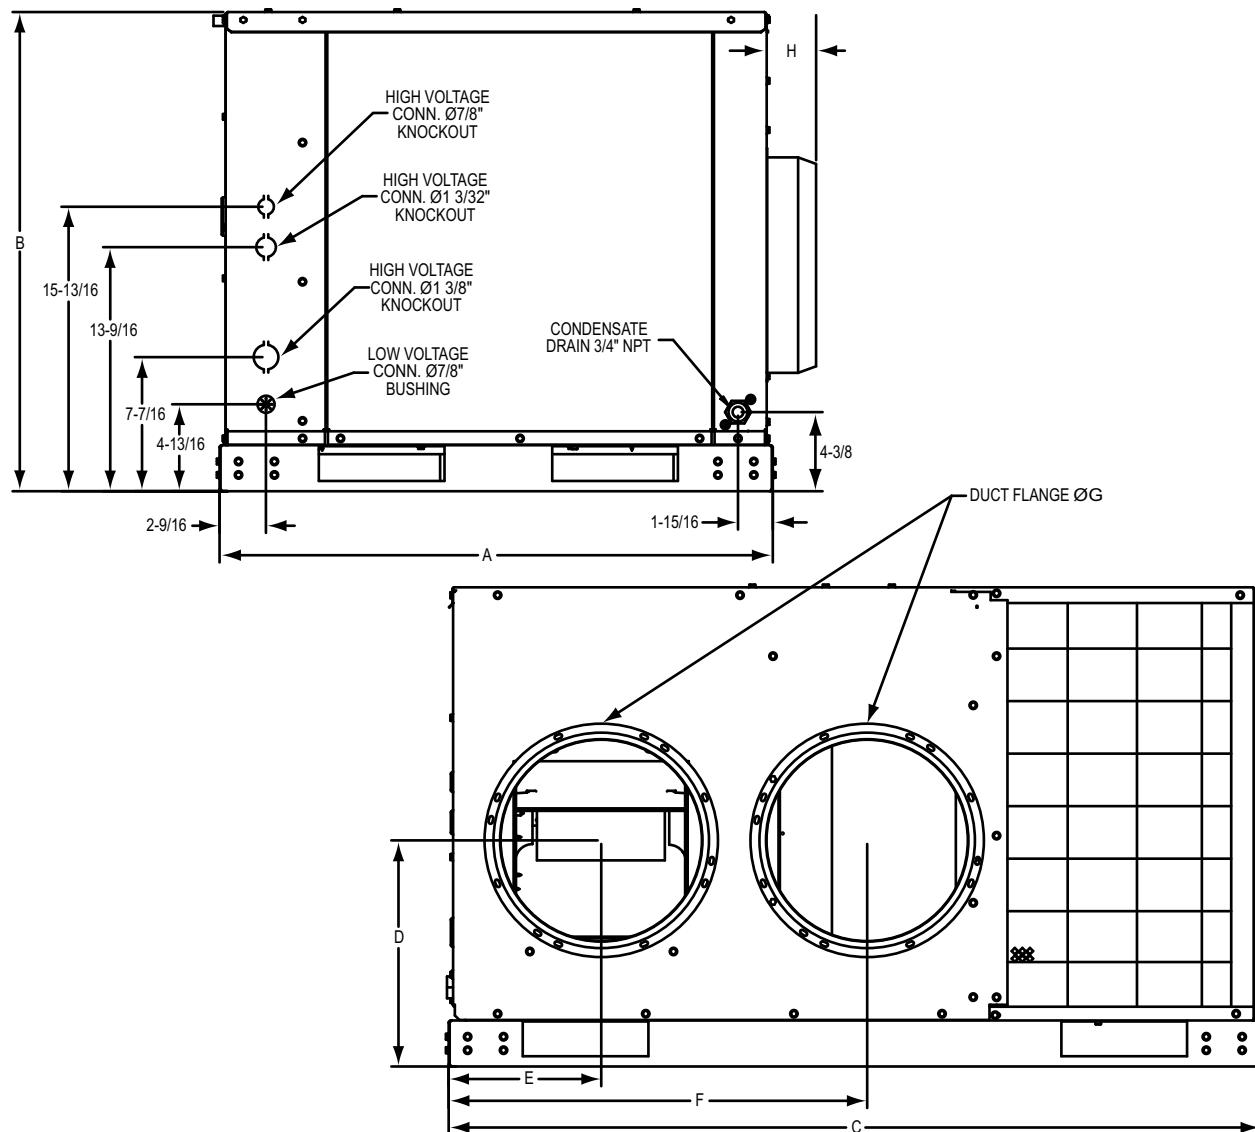

Unit Dimensions

| Size (Tons) | Model | Dimensions | | | | | | | |
|----------------|-------|------------|----------|---------|---------|---------|---------|-----|-------|
| | | "A" | "B" | "C" | "D" | "E" | "F" | "G" | "H" |
| 024 (2.0) | NM | 32 13/16 | 30 15/16 | 47 1/4 | 12 9/16 | 8 1/2 | 24 1/16 | 12 | 2 3/4 |
| | UQ | 32 13/16 | 30 15/16 | 47 1/4 | 12 9/16 | 8 1/2 | 24 1/16 | 12 | 2 3/4 |
| 030 (2.5) | NM | 32 13/16 | 30 15/16 | 47 1/4 | 12 9/16 | 8 1/2 | 24 1/16 | 12 | 2 3/4 |
| | UQ | 32 13/16 | 30 15/16 | 47 1/4 | 12 9/16 | 8 1/2 | 24 1/16 | 12 | 2 3/4 |
| 036 (3.0) | NM | 32 13/16 | 30 15/16 | 47 1/4 | 12 9/16 | 8 1/2 | 24 1/16 | 12 | 2 3/4 |
| | UQ | 32 13/16 | 30 15/16 | 47 1/4 | 12 9/16 | 8 1/2 | 24 1/16 | 12 | 2 3/4 |
| 042 (3.5) | NM | 32 13/16 | 30 15/16 | 47 1/4 | 12 9/16 | 8 1/2 | 24 1/16 | 12 | 2 3/4 |
| | UQ | 32 13/16 | 34 15/16 | 57 9/16 | 11 9/16 | 10 5/16 | 28 7/8 | 14 | 2 3/4 |
| 048 (4.0) | NM | 32 13/16 | 34 15/16 | 57 9/16 | 11 9/16 | 10 5/16 | 28 7/8 | 14 | 2 3/4 |
| | UQ | 32 13/16 | 34 15/16 | 57 9/16 | 11 9/16 | 10 5/16 | 28 7/8 | 14 | 2 3/4 |
| 060 (5.0) | NM | 32 13/16 | 34 15/16 | 57 9/16 | 11 9/16 | 10 5/16 | 28 7/8 | 14 | 2 3/4 |
| | UQ | 32 13/16 | 34 15/16 | 57 9/16 | 11 9/16 | 10 5/16 | 28 7/8 | 14 | 2 3/4 |

Unit Clearances

| Direction | Distance (in.) | Direction | Distance (in.) |
|-------------------|-------------------|-----------|-------------------|
| Top ¹ | 60 | Right | 24 |
| Front | 36 | Left | 24 |
| Rear ² | 18 | Bottom | 0 |

1. Units must be installed outdoors. Over hanging structure or shrubs should not obscure condenser air discharge outlet.
2. Unit may be positioned to draw air from underneath structure.

