

How to Properly Size Surge Protective Devices



When an electrical surge occurs, voltage that greatly exceeds accepted peak voltage levels can pass through building circuits to electrical equipment. Without proper protection, this equipment is susceptible to damage or failure from a voltage surge. The type of protection required to negate these spikes can be provided by a surge protective device (SPD).

Specifying the correct SPD requires that you identify and understand the ratings associated with its application. There are many performance values and ratings associated with an SPD, such as maximum continuous operating voltage (MCOV), voltage protection rating (VPR), nominal discharge current (I_n), and short circuit current rating (SCCR). The most misunderstood rating is the surge current rating, typically quantified in kilo-Ampere (kA).

The UL1449 standard was developed to take the ambiguity out of the marketplace and ensure proper protection with a level playing field. However, it has undergone many changes over the years and any SPDs (or filters) installed in your facility or equipment prior to 2009 should be examined for compliance.

How to Properly Size SPDs

There is very little published data or even recommendations on what level of surge current (kA) rating should be used in the different locations. The Institute of Electrical and Electronics Engineers (IEEE) has provided some input on what surge ratings are and how to interpret them but does not publish recommendations. Unfortunately, there is not a proven equation or calculator available to input system requirements and receive a solution. Any information a manufacturer provides, via calculators or other means, is merely their recommendation.

There is a tendency to assume that the larger the panel, the larger the kA device rating needed for protection. Another misconception is that if 200 kA is good, then 400 kA must be two times better. As you will see in this whitepaper, this is not always the case. As a result of its many years of knowledge, experience and expertise in the electrical industry, Emerson has generated some guidance on how to apply surge current ratings.
(See figure 1, next page)

How to Properly Size Surge Protective Devices

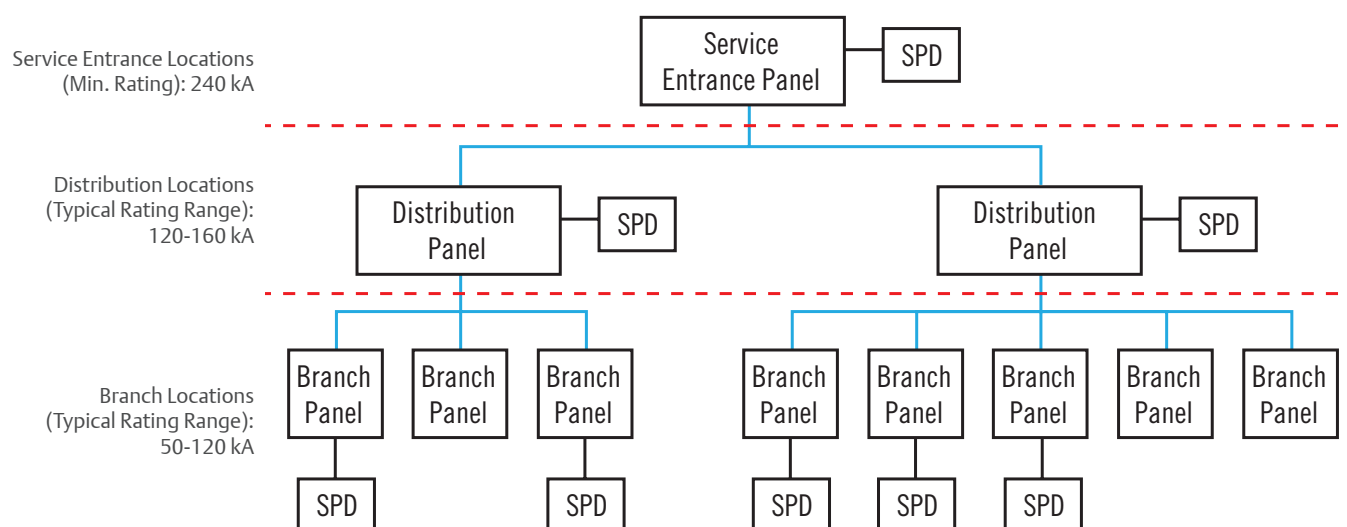


Figure 1: Cascaded Surge Suppression | IEEE Standard 1100

Cascading Protection

To optimize the level of suppression throughout a system, SPDs should be installed at all levels of the electrical distribution system. This is known in the electrical industry as cascading (or layering), or as IEEE refers to it “Protection in Depth”.

Cascaded surge protection provides additional suppression from large transients that step their way through from the service entrance by further reducing the let-through voltages. It also provides suppression from the more frequently generated internal transients.

Let-through voltage is the voltage appearing on the equipment side (load side) of an SPD when an impulse voltage/current of a defined wave-shape and amplitude is applied to the line side of an SPD. It can be used to compare different SPD’s abilities to lower the surge voltage to the equipment requiring protection.

IEEE Standard 1100 recommends cascading levels of protection from the service entrance, to distribution and branch panels, and even protection for individual critical loads. The closer to the service entrance, the more robust the device should be rated. This protection in-depth

strategy provides the best protection for your facility and critical loads. In recommending a kA per phase rating there is a general rule of thumb – the 3, 2, 1 Rule of Thumb. The service entrance should be 300 kA, distribution panels 200 kA, and finally branch panels can be 100 kA per phase.

Once it has been determined where the SPD units are to be installed, help in determining the surge rating (level of protection) can be found by referencing the panels Ampere rating (see chart below).

Panel Size	Surge Rating “Per Phase” (L-N + LG) Recommended Protection	
	(Better)	(Best)
0 - 225 Amp	50 kA	100 kA
400 - 600 Amp	100 kA	200 kA
800 - 1200 Amp	100 kA	200 kA
1600 - 2500 Amp	200 kA	300 kA
3000 Amp and Above	300 kA	300 kA

UL = Type
IEEE = Category

Service Entrance

Branch Panel

Type 1 or Category C

Type 2 or Category B

Type 3 or Category A

Point of Use

The diagram illustrates a typical aircraft power system architecture. It shows the flow of power from a primary source (likely a generator or engine-driven generator) through various components including a Primary Power section, a Type 1 SPD, a UPS 11, a PDU 11, and a Type 2 SPD, leading to IT Equipment. A secondary path for Alternate Power is shown, featuring a Red G symbol, a Generator, and a Breaker (Greater than 800 ampere disconnect), which then feeds into a Panel Bus and a Type 2 SPD, ultimately connecting to the HVAC System. The system also includes a central distribution unit with components like CB1, CB2, CB3, CB4, CB5, CB6, and CB7, and a central ATC (Automatic Transfer Control) unit.

Types of SPD Locations

Recommendations

Choosing the appropriate surge rating for an SPD comes down to two things:

- 1) The location of the SPD within the electrical distribution, and;
- 2) The location of the facility (geographically)

Emerson recommends the following surge current ratings based on SPD location within the electrical distribution using the general “3, 2, 1 Rule of Thumb” mentioned earlier.

Location	kA	Sola SPD
Service Entrance	300 kA/phase	SPD300K
Distribution Panel	200 kA/phase or 100 kA/phase	SPD200K STV100K
Branch Panel(s)	100 kA/phase or 50 kA/phase	STV100K SPD50K

SOLAHD™

Larger more destructive surge currents are mostly found at the facility service entrance. On very rare occasions, for example if the exposure level is “extreme” (states like Florida), it might be wise to increase surge current ratings. In this example, the SPD will be exposed to larger surge events more frequently, but when choosing the correct surge current rating for your application, the SPD can then be exposed to a higher number of surge events before it needs to be replaced. In addition, SPD event counters come standard on some manufacturers models to help you accurately monitor events for these types of locations.

Our experience with SPD products shows that a device carrying a surge current rating between 240 and 250kA for a service panel or critical load will provide many years of service in the “high to medium” exposure locations over time, like the example above.

Conclusion

The primary purpose of a surge protective device is to shunt and suppress the transient voltages that are being introduced into an electrical distribution system from either an external or internal source. Selecting the proper surge current (kA) rated SPDs throughout the electrical distribution system provides the best performance life for equipment. When selecting the appropriate SPDs for your facility, keep these key points in mind:

1. Providing proper surge suppression to a facility and the equipment within requires more than a single SPD located at the service entrance. We recommend cascaded SPDs with a proper surge current rating for each location. This will provide superior suppression for a service panel or critical load. A single SPD, no matter how big or expensive, will not provide the same level of system protection.
2. Over-sizing an SPD for its application cannot hurt a system, but under-sizing the SPD can result in premature failure of the SPD, leaving systems exposed to transients and their effects.
3. For direct lightning strikes, SPDs alone are not a replacement for a comprehensive lightning protection system (refer to UL96A Master Lightning Certification).

Following these guidelines for sizing and placing SPDs throughout an electrical distribution system (Table 1) takes the guess work out of selecting the appropriate SPDs for the intended locations and maximizes your surge suppression at every point. Remember, bigger isn’t always better. Size appropriately for the load and protect your critical panels and loads to ensure a maximum return on investment.

United States
(Headquarters)
Appleton Grp LLC
9377 W. Higgins Road
Rosemont, IL 60018
United States
T +1 800 621 1506

Canada
EGS Electrical Group Canada Ltd.
99 Union Street
Elmira ON, N3B 3L7
Canada
T +1 888 765 2226

Europe
ATX SAS
Espace Industriel Nord
35, rue André Durouchez,
CS 98017
80084 Amiens Cedex 2, France
T +33 3 2254 1390

Latin America
EGS Comercializadora Mexico
S de RL de CV
Calle 10 N°145 Piso 3
Col. San Pedro de los Pinos
Del. Álvaro Obregon
Ciudad de México. 01180
T +52 55 5809 5049

Australia Sales Office
Bayswater, Victoria
T +61 3 9721 0387

Korea Sales Office
Seoul
T +82 2 3483 1555

China Sales Office
Shanghai
T +86 21 3338 7000

Chile Sales Office
Las Condes
T +56 2928 4819

India Sales Office
Chennai
T +91 44 3919 7300

Asia Pacific
EGS Private Ltd.
Block 4008, Ang Mo Kio Ave 10,
#04-16 TechPlace 1,
Singapore 569625
T +65 6556 1100

Jebel Ali- Dubai Office
Emerson, Building A
Appleton Group
Jebel Ali Free Zone- South
T +971 4 811 81 00

Middle East Sales Office
Dammam, Saudi Arabia
T +966 13 510 3702

The Emerson logo is a trademark and service mark of Emerson Electric Co. The SolaHD brand logo is a registered trademark of Appleton Grp LLC. © 2021 Emerson Electric Co. All rights reserved. All other marks are the property of their respective owners.

The contents of this publication are presented for informational purposes only, and while diligent efforts were made to ensure their accuracy, they are not to be construed as warranties or guarantees, express or implied, regarding the products or services described herein or their use or applicability. All sales are governed by our terms and conditions, which are available on request. We reserve the right to modify or improve the designs or specifications of our products at any time without notice.