

NX-series EtherNet/IP Coupler Unit

NX-EIC

Connecting to open industrial network standard EtherNet/IP

- The EtherNet/IP Coupler Unit is the link between the controllers with the EtherNet/IP network and the NX-series I/O Units and Safety Units. With wide variety of the I/O Units and Safety Units, the NX-series is the perfect match for the CJ-series and third party controllers.




Features

- Up to 63 NX-IO Units can be connected to one EtherNet/IP Coupler Unit. Standard and high-performance units can be mixed.*
- I/O control and safety control can be integrated by connecting a safety controller and I/O.
- Slave configuration by Sysmac Studio can be completed centrally via the controller, or using the Coupler's built-in USB port.

* Input per Coupler Unit: Maximum 504 bytes, Output per Coupler Unit: Maximum 504 bytes

System Configuration

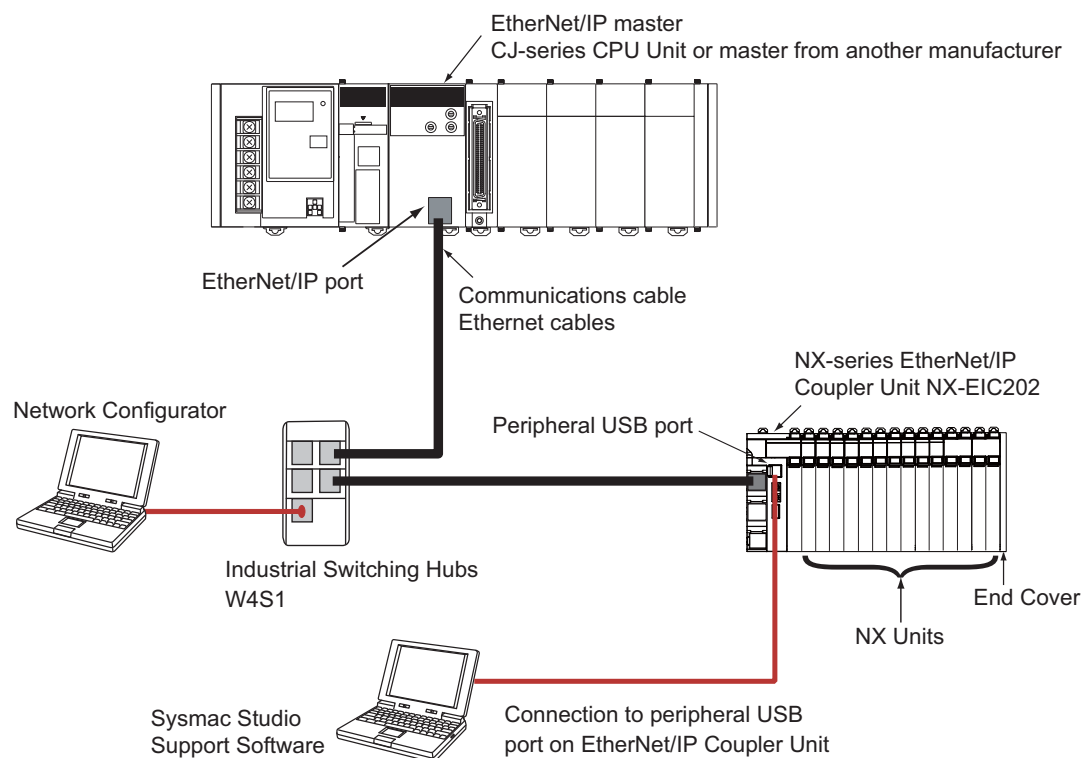

Refer to page 8 for the NX Units that can be connected to the NX-series EtherNet/IP Coupler Unit.

Ordering Information

International Standards

- The standards are abbreviated as follows: U: UL, U1: UL(Class I Division 2 Products for Hazardous Locations), C: CSA, UC: cULus, UC1: cULus (Class I Division 2 Products for Hazardous Locations), CU: cUL, N: NK, L: Lloyd, CE: EC Directives, and KC: KC Registration.
- Contact your OMRON representative for further details and applicable conditions for these standards.

Unit type	Product Name	Current consumption	Maximum I/O power supply current	Model	Standards
NX Series EtherNet/IP Coupler Unit		1.50 W or lower	10 A	NX-EIC202	UC1, CE, KC

Automation Software Sysmac Studio

Please purchase a DVD and required number of licenses the first time you purchase the Sysmac Studio. DVDs and licenses are available individually. Each model of licenses does not include any DVD.

Product name	Specifications	Number of licenses	Media	Model	Standards
Sysmac Studio NX-I/O Edition Ver.1.□□ *1 *2	Sysmac Studio NX-I/O Edition is a limited license that provides selected functions required for EtherNet/IP Coupler settings. Because this product is a license only, you need the Sysmac Studio Standard Edition DVD media to install it.	1 license	---	SYSMAC-NE001L	---
Sysmac Studio Standard Edition Ver.1.□□ *2	The Sysmac Studio is the software that provides an integrated environment for setting, programming, debugging and maintenance of machine automation controllers including the NJ Series, EtherCat Slave, and the HMI. Sysmac Studio runs on the following OS. Windows XP (Service Pack 3 or higher, 32-bit version)/ Windows Vista (32-bit version)/Windows 7 (32-bit/64-bit version)/Windows 8 (32-bit/64-bit version)/ Windows 8.1 (32-bit/64-bit version) This software provides functions of the Vision Edition. Refer to Sysmac Catalog (P072) for details such as supported models and functions.	--- (Media only)	DVD	SYSMAC-SE200D	---

*1. The Sysmac Studio Standard Edition with license(s) (SYSMAC-SE□□□L) provides functions of the NX-I/O Edition (SYSMAC-NE001L).

*2. With the Sysmac Studio Standard Edition with license(s) (SYSMAC-SE□□□L) version 1.10 or higher, you can use the setup functions for the EtherNet/IP Coupler.

Recommended Ethernet/IP Communications Cables

Use STP (shielded twisted-pair) cable of category 5 or higher for EtherNet/IP.

Cabel with Connectors

Item	Appearance	Recommended manufacturer	Cable length(m) *1	Model
Standard type Cable with Connectors on Both Ends (RJ45/RJ45) Wire Gauge and Number of Pairs: AWG27, 4-pair Cable Cable Sheath material: LSZH *2 Cable color: Yellow *3		OMRON	0.3	XS6W-6LSZH8SS30CM-Y
			0.5	XS6W-6LSZH8SS50CM-Y
			1	XS6W-6LSZH8SS100CM-Y
			2	XS6W-6LSZH8SS200CM-Y
			3	XS6W-6LSZH8SS300CM-Y
			5	XS6W-6LSZH8SS500CM-Y
Rugged type Cable with Connectors on Both Ends (RJ45/RJ45) Wire Gauge and Number of Pairs: AWG22, 2-pair Cable		OMRON	0.3	XS5W-T421-AMD-K
			0.5	XS5W-T421-BMD-K
			1	XS5W-T421-CMD-K
			2	XS5W-T421-DMD-K
			5	XS5W-T421-GMD-K
			10	XS5W-T421-JMD-K
Rugged type Cable with Connectors on Both Ends (M12 Straight/RJ45) Wire Gauge and Number of Pairs: AWG22, 2-pair Cable		OMRON	0.3	XS5W-T421-AMC-K
			0.5	XS5W-T421-BMC-K
			1	XS5W-T421-CMC-K
			2	XS5W-T421-DMC-K
			5	XS5W-T421-GMC-K
			10	XS5W-T421-JMC-K
Rugged type Cable with Connectors on Both Ends (M12 Right-angle/RJ45) Wire Gauge and Number of Pairs: AWG22, 2-pair Cable		OMRON	0.3	XS5W-T422-AMC-K
			0.5	XS5W-T422-BMC-K
			1	XS5W-T422-CMC-K
			2	XS5W-T422-DMC-K
			5	XS5W-T422-GMC-K
			10	XS5W-T422-JMC-K

Note: For details, refer to Cat.No.G019.

*1 Standard type cables length 0.2, 0.3, 0.5, 1, 1.5, 2, 3, 5, 7.5, 10, 15 and 20m are available.

Rugged type cables length 0.3, 0.5, 1, 2, 3, 5, 10 and 15m are available.

*2 The lineup features Low Smoke Zero Halogen cables for in-cabinet use and PUR cables for out-of-cabinet use.


*3 Cables colors are available in blue, yellow, or Green

Optional Products

Product name	Specification				Model	Standards
Unit/Terminal Block Coding Pins	Pins for 10 Units (30 terminal block pins and 30 Unit pins)				NX-AUX02	---
Product Name	Specification				Model	Standards
	No. of terminals	Terminal number indications	Ground terminal mark	Terminal current capacity		
Terminal Block	8	A/B	Provided	10 A	NX-TBC082	---

End Cover (NX-END01)

One End Cover is provided together with the EtherNet/IP Coupler Unit.

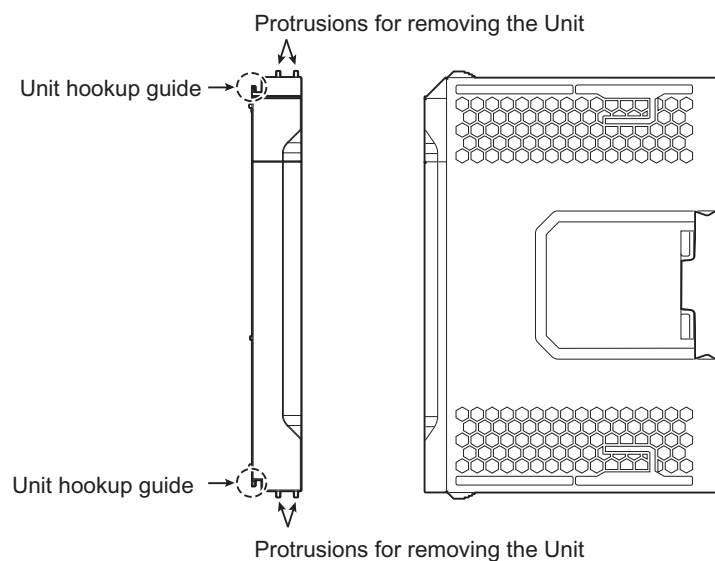

General Specification

Item		Specification
Enclosure		Mounted in a panel
Grounding method		Ground to 100 Ω or less
Operating environment	Ambient operating temperature	0 to 55°C
	Ambient operating humidity	10% to 95% (with no condensation or icing)
	Atmosphere	Must be free from corrosive gases.
	Ambient storage temperature	-25 to 70°C (with no condensation or icing)
	Altitude	2,000 m max.
	Pollution degree	Pollution degree 2 or less: Conforms to JIS B 3502 and IEC 61131-2.
	Noise immunity	Conforms to IEC 61000-4-4. 2 kV (power supply line)
	Overvoltage category	Category II: Conforms to JIS B 3502 and IEC 61131-2.
	EMC immunity level	Zone B
	Vibration resistance	Conforms to IEC 60068-2-6. 5 to 8.4 Hz with 3.5-mm amplitude, 8.4 to 150 Hz, acceleration of 9.8 m/s ² , 100 min each in X, Y, and Z directions (10 sweeps of 10 min each = 100 min total)
	Shock resistance	Conforms to IEC 60068-2-27. 147 m/s ² , 3 times each in X, Y, and Z directions
Applicable standards		cULus: Listed UL508 and ANSI/ISA 12.12.01 EC: EN 61131-2 and C-Tick




EtherNet/IP Coupler Unit Specifications

Item		Specification
Model		NX-EIC202
Number of connectable NX Units		63 Units max.*1
Communications protocols		EtherNet/IP
		UDP/IP and TCP/IP (Message Services) Number of buffers (sockets): • 8 message buffers for server • No message buffers for client • Shared buffers for UDP/IP messages and TCP/IP messages Maximum message size: • Request: 492 bytes • Response: 496 bytes Maximum NX output data size: • 490 bytes Maximum NX input data size: • 496 bytes
Modulation		Baseband
Link speed		100 Mbps
Physical layer		100BASE-TX (IEEE 802.3)
Number of connections		8
Received Packet Interval (RPI, refresh cycle)		4 to 1,000 ms
Allowed communications bandwidth per Unit		1,000 pps
Topology		Line, Tree, Star
Transmission media		Category 5 or higher twisted-pair cable (Recommended cable: double-shielded cable with aluminum tape and braiding)
Transmission distance		Distance between nodes: 100 m or less
NX bus I/O data size		Input: 512 bytes max. (including input data, status, and unused areas) Output: 512 bytes max. (including output data and unused areas)
EtherNet/IP I/O connection size		Input: 504 bytes max. (including input data, status, and unused areas) Output: 504 bytes max. (including output data and unused areas)
Refreshing methods		Free-Run refreshing
Unit power supply	Power supply voltage	24 VDC (20.4 to 28.8 VDC)
	NX Unit power supply capacity	10 W max.
	NX Unit power supply efficiency	70%
	Isolation method	No isolation between NX Unit power supply and Unit power supply terminals
	Current capacity of power supply terminals	4 A max.
I/O power supply	Power supply voltage	5 to 24 VDC (4.5 to 28.8 VDC) *2
	Maximum I/O power supply current	10 A
	Current capacity of power supply terminals	10 A max.
NX Unit power consumption		1.60 W max.
Current consumption from I/O power supply		10 mA max. (for 24 VDC)
Dielectric strength		510 VAC for 1 min, leakage current: 5 mA max. (between isolated circuits)
Insulation resistance		100 VDC, 20 MΩ min. (between isolated circuits)
External connection terminals		Communications Connector For EtherNet/IP communications. • RJ45 × 2 (shielded)
		Screwless Clamping Terminal Block For Unit power supply, I/O power supply, and grounding. Removable.
		Peripheral USB Port For Sysmac Studio connection. • Physical layer: USB 2.0-compliant, B-type connector • Transmission distance: 5 m max.
Dimensions		46 × 100 × 71 mm (W×H×D)
Weight		150 g max.

*1. Refer to the NX-series Safety Control Unit User's Manual (Cat. No. Z930) for the number of Safety Control Units that can be connected.

*2. Use a voltage that is appropriate for the I/O circuits of the NX Units and the connected external devices.

*3 NX-PG0 Pulse output cards are not compatible with the EtherNet/IP Coupler.

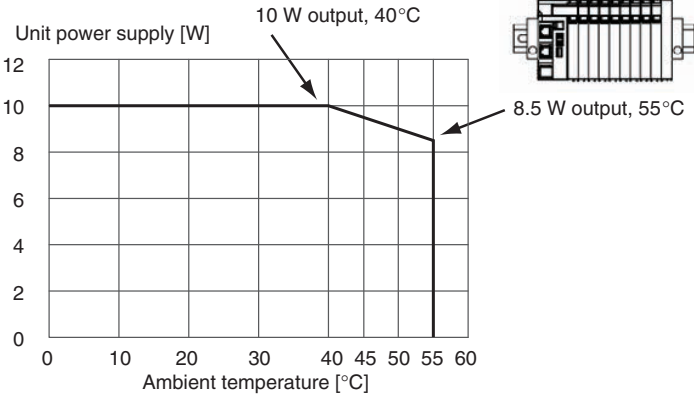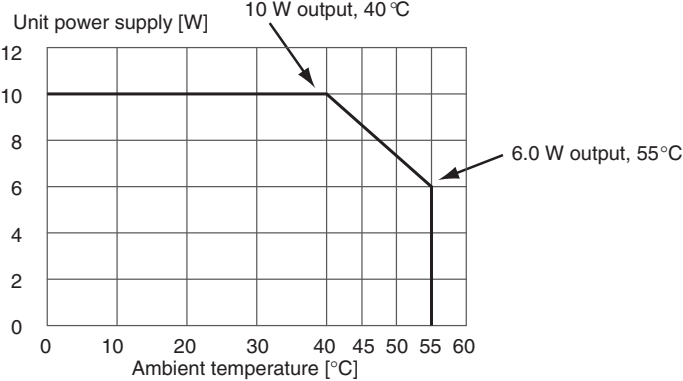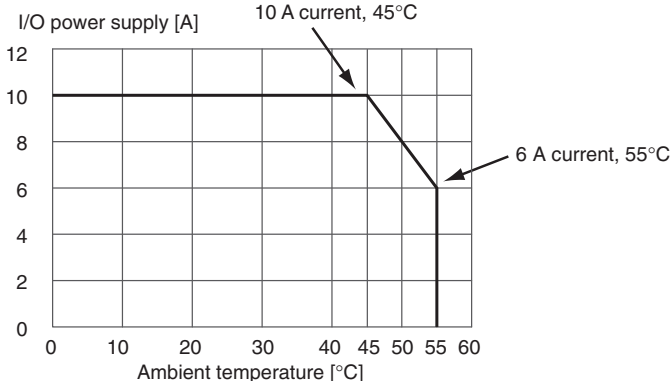Item	Specification
Installation orientation and restrictions	Installation orientation: 6 possible orientations Restrictions: Used in the upright installation orientation.
	Unit power supply [W] 10 W output, 40 °C 8.5 W output, 55 °C  Ambient temperature [°C]
	Used in any other orientation than the upright installation orientation.
	Unit power supply [W] 10 W output, 40 °C 6.0 W output, 55 °C  Ambient temperature [°C]
	I/O power supply [A] 10 A current, 45 °C 6 A current, 55 °C  Ambient temperature [°C]

Item	Specification
Circuit layout	
Terminal arrangement	
Accessory	End Cover (NX-END01): 1

NX-EIC

Configuration Unit

Refer to the user's manuals for information on the NX Units that can be connected to the NX-series EtherNet/IP Coupler Unit.

EtherNet/IP Coupler Unit

Unit	Model
EtherNet/IP Coupler Unit	NX-EIC202

I/O Units

Unit	Model				
	2-point Units	4-point Units	8-point Units	16-point Units	32-point Units
Digital Input Unit	–	NX-ID3317 NX-ID3343 NX-ID3417 NX-ID3443 NX-IA3117	NX-ID4342 NX-ID4442	NX-ID5142-5 NX-ID5342 NX-ID5442	NX-ID6142-5
Digital Output Unit	NX-OC2633 NX-OC2733	NX-OD3121 NX-OD3153 NX-OD3256 NX-OD3257	NX-OD4121 NX-OD4256	NX-OD5121 NX-OD5121-5 NX-OD5256 NX-OD5256-5	NX-OD6121-5 NX-OD6256-5
Digital Mixed I/O Unit	–	–	–	NX-MD6121-5 NX-MD6256-5	–
Analog Input Unit	NX-AD2603 NX-AD2604 NX-AD2608 NX-AD2203 NX-AD2204 NX-AD2208	NX-AD3603 NX-AD3604 NX-AD3608 NX-AD3203 NX-AD3204 NX-AD3208	NX-AD4603 NX-AD4604 NX-AD4608 NX-AD4203 NX-AD4204 NX-AD4208	–	–
Analog Output Unit	NX-DA2603 NX-DA2605 NX-DA2203 NX-DA2205	NX-DA3603 NX-DA3605 NX-DA3203 NX-DA3205	–	–	–
Temperature Input Unit	NX-TS2101 NX-TS2102 NX-TS2104 NX-TS2201 NX-TS2202 NX-TS2204	NX-TS3101 NX-TS3102 NX-TS3104 NX-TS3201 NX-TS3202 NX-TS3204	–	–	–

Position Interface Unit

Unit	Model	
	1CH	2CH
Incremental Encoder Input Unit	NX-EC0112 NX-EC0122 NX-EC0132 NX-EC0142	NX-EC0212 NX-EC0222
SSI Input Unit	NX-ECS112	NX-ECS212

System Units

Unit	Model
Additional NX Unit Power Supply Unit	NX-PD1000
Additional I/O Power Supply Unit	NX-PF0630 NX-PF0730
I/O Power Supply Connection Unit	NX-PC0010 NX-PC0020 NX-PC0030
Shield Connection Unit	NX-TBX01

Safety Control Units

Unit	Model
Safety CPU Unit	NX-SL3300 *1
Safety Input Unit	NX-SIH400 *2 NX-SID800
Safety Output Unit	NX-SOH200 NX-SOD400

*1 Safety CPU Unit Ver.1.1 or higher.

*2 Safety Input Unit Ver.1.1 or higher.


Version Information

NX-series EtherNet/IP Coupler Unit and Sysmac Studio

NX Units		version
Model	Unit Version	Sysmac Studio
NX-EIC202	Ver.1.0	Version 1.10 or later


External Interface

EtherNet/IP Coupler Unit NX-EIC202

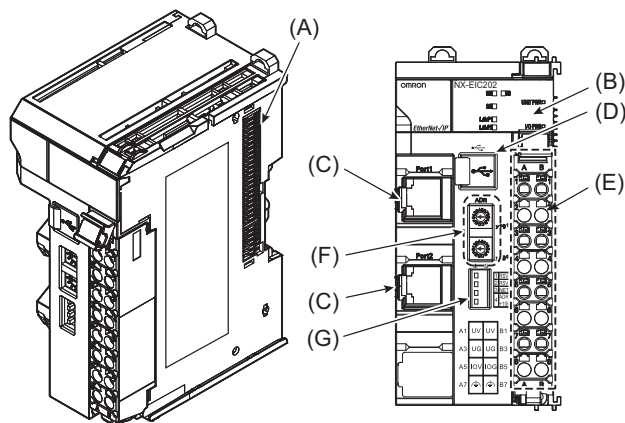

Letter	Name	Function
(A)	NX bus connector	This connector is used to connect the EtherNet/IP Coupler Unit to the NX Unit on the right of the Coupler Unit.
(B)	Indicators	The indicators show the current operating status of the Unit and the status of the power supply.
(C)	Communications connectors	These connectors are connected to the communications cables of the EtherNet/IP network.
(D)	Peripheral USB port	This port is used to connect to the Sysmac Studio.
(E)	Terminal block	The terminal block is used to connect to the power supply cables and ground wire.
(F)	Rotary switches	The rotary switches are used to set the last octet of the IP address of the EtherNet/IP Coupler Unit as an EtherNet/IP Slave. The address is set in hexadecimal.
(G)	DIP switch	The DIP switch is used to set the default node address of the EtherNet/IP Coupler Unit as an EtherNet/IP slave.

Terminal Block

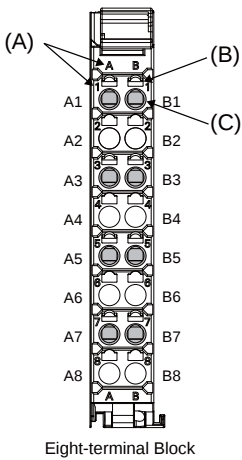

Symbol	Name	Function
(A)	Terminal number indications	The terminal numbers (A1 to A8 and B1 to B8) are displayed. The terminal number indicators are the same regardless of the number of terminals on the terminal block, as shown above.
(B)	Release holes	Insert a flat-blade screwdriver into these holes to connect and remove the wires.
(C)	Terminal holes	The wires are inserted into these holes.

Applicable Wires

Twisted Wires/Solid Wires

If you use the twisted wires or the solid wires, use the following table to determine the correct wire specifications.

Terminals		Wire type		Wire plating		Wire size	Conductor length (stripping length)
Classification	Current capacity	Twisted wires	Solid wire	Plated	Unplated		
All terminals except ground terminals	2 A max.	Possible	Possible	Possible	Possible	0.08 to 1.5 mm ² AWG28 to 16	8 to 10 mm
	Greater than 2 A and 4 A or less				Not Possible		
	Greater than 4 A		Possible				
Ground terminals *	---		Possible		Possible	2.0 mm ²	9 to 10 mm

* With the NX-TB□□□1 Terminal Block, use twisted wires to connect the ground terminal. Do not use a solid wire.



Conductor length (stripping length)

<Additional Information> If more than 2 A will flow on the wires, use plated wires or use ferrules.

Precautions for Compliance with UL Standards and CSA Standards

Notice to Users of the NX series components in USA and Canada

Please use the following installation information instead of the general information in the instruction manuals in order to use the product under certified conditions of UL and CSA when the product is installed in the USA or Canada. These conditions are required by NFPA 70, National Electrical Code in the USA and the Canadian Electrical Code, Part I in Canada and may vary from information given in the product manuals or safety precautions.

Applicable Wire Size

For unit power source and IO power source terminal

Type	Wire size	Strip length
Solid/Strand	AWG 24-16	9mm


Do not use ferrule terminals. Insert the strand or solid wire directly into the holes on the terminal block.

Please select wire sizes suitable for rated current.


Wire size	Current (MAX)
AWG 24	2A
AWG 22	3A
AWG 20	5A
AWG 18	7A
AWG 16	10A

Dimensions

● EtherNet/IP Coupler Unit Only

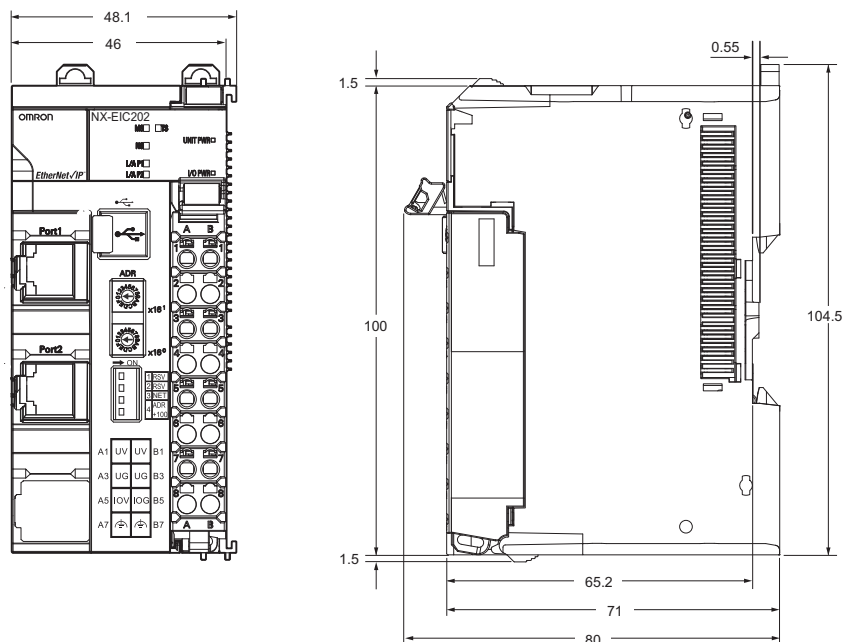

● With Cables Connected

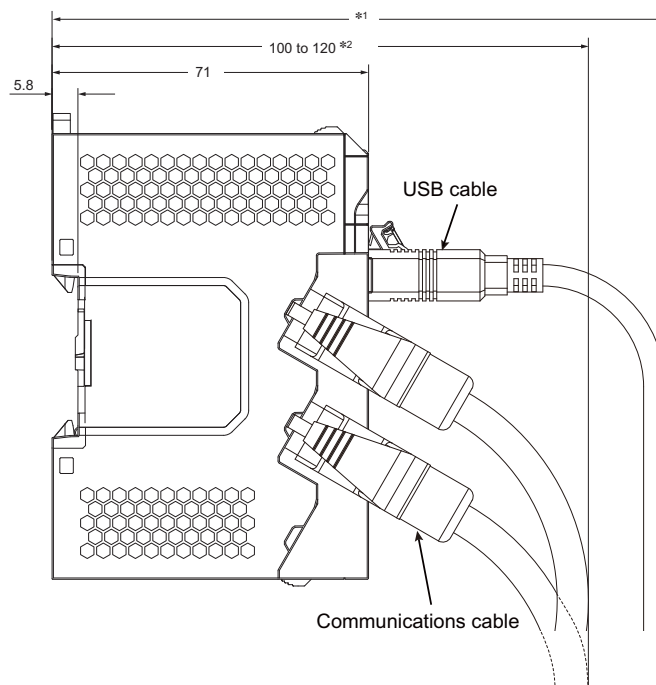


*1. This dimension depends on the specifications of the commercially available USB cable. Check the specifications of the USB cable that is used.

*2. This is the dimension from the back of the Unit to the communications cables.

- 100 mm: When an MPS588-C Connector is used.
- 120 mm: When an XS6G-T421-1 Connector is used.

● End Cover

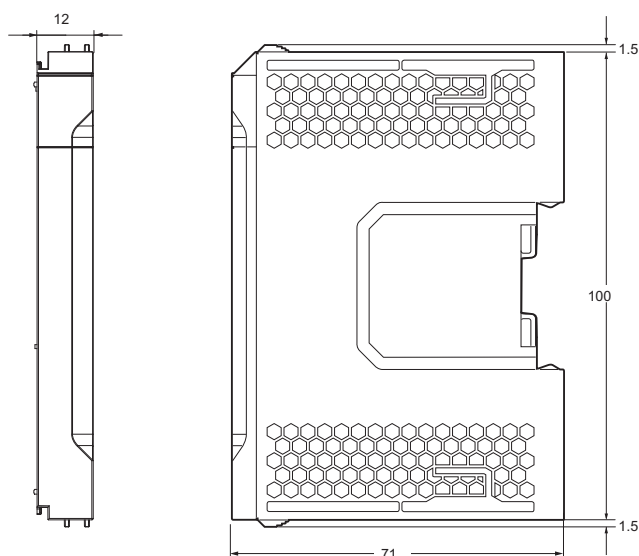

Related Manuals

Man. No	Model	Manual	Application	Description
W536	NX-EIC□□□□	NX-series EtherNet/IP Coupler Unit User's Manual	Learning how to use an NX-series Ether-Net/IP Coupler Unit and EtherNet/IP Slave Terminals	Introduces the system, configuration methods, Unit hardware, setting methods, and functions of EtherNet/IP Slave Terminals that consist of an EtherNet/IP Coupler Unit and NX Units.
W525	NX-□□□□□□	NX-series Data Reference Manual	Referencing lists of the data that is required to configure systems with NX-series Units	Lists of the power consumptions, weights, and other NX Unit data that is required to configure systems with NX-series Units are provided.
W521	NX-ID□□□□ NX-IA□□□□ NX-OC□□□□ NX-OD□□□□ NX-MD□□□□	NX-series Digital I/O Units User's Manual	Learning how to use NX-series Digital I/O Units	The hardware, setup methods, and functions of the NX-series Digital I/O Units are described.
W522	NX-AD□□□□ NX-DA□□□□ NX-TS□□□□	NX-series Analog I/O Units User's Manual	Learning how to use NX-series Analog I/O Units and Temperature Input Units	The hardware, setup methods, and functions of the NX-series Analog I/O Units and Temperature Input Units are described.
W523	NX-PD1□□□ NX-PF0□□□ NX-PC0□□□ NX-TBX01	NX-series System Units User's Manual	Learning how to use NX-series System Units	The hardware and functions of the NX-series System Units are described.
W524	NX-EC0□□□ NX-ECS□□□ NX-PG0□□□	NX-series Position Interface Units User's Manual	Learning how to use NX-series Position Interface Units	The hardware, setup methods, and functions of the NX-series Incremental Encoder Input Units, SSI Input Units, and Pulse Output Unit are described.
Z930	NX-SL□□□□ NX-SI□□□□ NX-SO□□□□	NX-series Safety Control Unit User's Manual	Learning how to use NX-series Safety Control Units	The hardware, setup methods, and functions of the NX-series Safety Control Units are described.
Z931	NX-SL□□□□	NX-series Safety Control Unit Instructions Reference Manual	Learning about the specifications of instructions for the Safety CPU Unit.	The instructions for the Safety CPU Unit are described. When programming, use this manual together with the <i>NX-series Safety Control Unit User's Manual</i> (Cat. No. Z930).

NX Unit Compatibility with EtherNet/IP Unit and Sysmac Studio Versions

● Digital I/O Units

NX Units		Corresponding Unit Versions/Versions* ¹				
Model	Unit version	EtherCAT			EtherNet/IP	
		Communica- tions Coupler Units	CPU Units	Sysmac Studio	Communica- tions Coupler Units	Sysmac Studio
NX-ID3317	Ver.1.0	Ver.1.0	Ver.1.05	Ver.1.06	Ver.1.0	Ver.1.10
NX-ID3343						
NX-ID3344		Ver.1.1	Ver.1.06* ²	Ver.1.07	---	---
NX-ID3417		Ver.1.0	Ver.1.05	Ver.1.06	Ver.1.0	Ver.1.10
NX-ID3443						
NX-ID3444		Ver.1.1	Ver.1.06* ²	Ver.1.07	---	---
NX-ID4342		Ver.1.0	Ver.1.05	Ver.1.06	Ver.1.0	Ver.1.10
NX-ID4442						
NX-ID5142-1				Ver.1.13		Ver.1.13
NX-ID5142-5				Ver.1.10		Ver.1.10
NX-ID5342				Ver.1.06		
NX-ID5442						
NX-ID6142-5				Ver.1.10		
NX-ID6142-6				Ver.1.13		Ver.1.13
NX-IA3117				Ver.1.08		Ver.1.10
NX-OD2154		Ver.1.1	Ver.1.06* ²	Ver.1.07	---	---
NX-OD2258						
NX-OD3121		Ver.1.0	Ver.1.05	Ver.1.06	Ver.1.0	Ver.1.10
NX-OD3153						
NX-OD3256						
NX-OD3257						
NX-OD3268				Ver.1.13		Ver.1.13
NX-OD4121				Ver.1.06		Ver.1.10
NX-OD4256						
NX-OD5121						
NX-OD5121-1				Ver.1.13		Ver.1.13
NX-OD5121-5				Ver.1.10		Ver.1.10
NX-OD5256				Ver.1.06		
NX-OD5256-1				Ver.1.13		Ver.1.13
NX-OD5256-5				Ver.1.10		Ver.1.10
NX-OD6121-5						
NX-OD6121-6				Ver.1.13		Ver.1.13
NX-OD6256-5				Ver.1.10		Ver.1.10
NX-OC2633				Ver.1.06		
NX-OC2733				Ver.1.08		
NX-MD6121-5				Ver.1.10		
NX-MD6121-6				Ver.1.13		Ver.1.13
NX-MD6256-5				Ver.1.10		Ver.1.10

*1. Some Units do not have all of the versions given in the above table. If a Unit does not have the specified version, support is provided by the oldest available version after the specified version. Refer to the user's manuals for the specific Units for the relation between models and versions.

*2. The instructions for time stamp refreshing are supported by CPU Units with unit version 1.06 or later. If you do not use instructions for time stamp refreshing, you can use version 1.05. Refer to the NJ/NX-series Instructions Reference Manual (Cat. No. W502) for details on the instructions for time stamp refreshing.

● Analog Input Units/Analog Output Units

NX Units		Corresponding Unit Versions/Versions ^{*1}				
Model	Unit Version	EtherCAT			EtherNet/IP	
		Communications Coupler Units	CPU Units	Sysmac Studio	Communications Coupler Units	Sysmac Studio
NX-AD2203	Ver.1.0	Ver.1.0	Ver.1.05	Ver.1.06	Ver.1.0	Ver.1.10
NX-AD2204						
NX-AD2208						
NX-AD2603						
NX-AD2604						
NX-AD2608						
NX-AD3203						
NX-AD3204						
NX-AD3208						
NX-AD3603						
NX-AD3604						
NX-AD3608						
NX-AD4203						
NX-AD4204						
NX-AD4208						
NX-AD4603						
NX-AD4604						
NX-AD4608						
NX-DA2203						
NX-DA2205						
NX-DA2603						
NX-DA2605						
NX-DA3203						
NX-DA3205						
NX-DA3603						
NX-DA3605						

*1. Some Units do not have all of the versions given in the above table. If a Unit does not have the specified version, support is provided by the oldest available version after the specified version. Refer to the user's manuals for the specific Units for the relation between models and versions.

● Temperature Input Units

NX Units		Corresponding Unit Versions/Versions ^{*1}				
Model	Unit Version	EtherCAT			EtherNet/IP	
		Communications Coupler Units	CPU Units	Sysmac Studio	Communications Coupler Units	Sysmac Studio
NX-TS2101	Ver.1.0	Ver.1.0 ^{*1}	Ver.1.05	Ver.1.06	Ver.1.0	Ver.1.10
	Ver.1.1			Ver.1.08		
NX-TS2102	Ver.1.1					
NX-TS2104	Ver.1.1					
NX-TS2201	Ver.1.0			Ver.1.06		
	Ver.1.1			Ver.1.08		
NX-TS2202	Ver.1.1					
NX-TS2204	Ver.1.1					
NX-TS3101	Ver.1.0			Ver.1.06		
	Ver.1.1			Ver.1.08		
NX-TS3102	Ver.1.1					
NX-TS3104	Ver.1.1					
NX-TS3201	Ver.1.0			Ver.1.06		
	Ver.1.1			Ver.1.08		
NX-TS3202	Ver.1.1					
NX-TS3204	Ver.1.1					

^{*1}. Some Units do not have all of the versions given in the above table. If a Unit does not have the specified version, support is provided by the oldest available version after the specified version. Refer to the user's manuals for the specific Units for the relation between models and versions.

● Position Interface Units

NX Units		Corresponding Unit Versions/Versions*1				
Model	Unit version	EtherCAT			EtherNet/IP	
		Communications Coupler Units	CPU Units	Sysmac Studio	Communications Coupler Unit	Sysmac Studio
NX-EC0112	Ver.1.1	*2	Ver.1.06	Ver.1.10	Ver.1.0	Ver.1.10
	Ver.1.2			Ver.1.13		Ver.1.13
NX-EC0122	Ver.1.0			Ver.1.07		Ver.1.10
	Ver.1.1			Ver.1.08		
	Ver.1.2			Ver.1.13		Ver.1.13
NX-EC0132	Ver.1.1			Ver.1.10		Ver.1.10
	Ver.1.2			Ver.1.13		Ver.1.13
NX-EC0142	Ver.1.0			Ver.1.07		Ver.1.10
	Ver.1.1			Ver.1.08		
	Ver.1.2			Ver.1.13		Ver.1.13
NX-EC0212	Ver.1.1			Ver.1.10		Ver.1.10
	Ver.1.2			Ver.1.13		Ver.1.13
NX-EC0222	Ver.1.0			Ver.1.07		Ver.1.10
	Ver.1.1			Ver.1.08		
	Ver.1.2			Ver.1.13		Ver.1.13
NX-ECS112	Ver.1.0			Ver.1.07		Ver.1.10
	Ver.1.1			Ver.1.08		
	Ver.1.2			Ver.1.13		Ver.1.13
NX-ECS212	Ver.1.0			Ver.1.07		Ver.1.10
	Ver.1.1			Ver.1.08		
	Ver.1.2			Ver.1.13		Ver.1.13
NX-PG0112	Ver.1.1	Ver.1.0	Ver.1.05	Ver.1.10	---	---
	Ver.1.2			Ver.1.13		
NX-PG0122	Ver.1.0			Ver.1.06		
	Ver.1.1			Ver.1.08		
	Ver.1.2			Ver.1.13		

*1. Some Units do not have all of the versions given in the above table. If a Unit does not have the specified version, support is provided by the oldest available version after the specified version. Refer to the user's manuals for the specific Units for the relation between models and versions.

*2. You can use the following versions if the time stamp refreshing function is not used.
 EtherCAT Coupler Unit: Version 1.0
 NJ-series CPU Units: Version 1.05

● Communications Interface Units

NX Units		Corresponding Unit Versions/Versions				
Model	Unit version	EtherCAT			EtherNet/IP	
		Communications Coupler Units	CPU Units	Sysmac Studio	Communications Coupler Unit	Sysmac Studio
NX-CIF101	Ver.1.0	Ver.1.0	Ver.1.10	Ver.1.12	---	---
NX-CIF105						
NX-CIF210						

● System Units

NX Units		Corresponding Unit Versions/Versions*1				
Model	Unit ver- sion	EtherCAT			EtherNet/IP	
		Commu- nications Coupler Units	CPU Units	Sysmac Studio	Commu- nications Coupler Unit	Sysmac Studio
NX-PD1000	Ver.1.0	Ver.1.0	Ver.1.05	Ver.1.06	Ver.1.0	Ver.1.10
NX-PF0630						
NX-PF0730				Ver.1.08		
NX-PC0020				Ver.1.06		
NX-PC0010						
NX-PC0030						
NX-TBX01						

*1. Some Units do not have all of the versions given in the above table. If a Unit does not have the specified version, support is provided by the oldest available version after the specified version. Refer to the user's manuals for the specific Units for the relation between models and versions.

● Safety Control Units

NX Units		Corresponding Unit Versions/Versions*1				
Model	Unit version	EtherCAT			EtherNet/IP	
		Commu- nications Coupler Units	CPU Units	Sysmac Studio	Commu- nications Coupler Unit	Sysmac Studio
NX-SL3300	Ver.1.0	Ver.1.1	Ver.1.06	Ver.1.07	---	---
	Ver.1.1			Ver.1.10	Ver.1.0	Ver.1.10
NX-SL3500	Ver.1.0	Ver.1.2	Ver.1.07	Ver.1.08	---	---
	Ver.1.1			Ver.1.10		
NX-SIH400	Ver.1.0	Ver.1.1	Ver.1.06	Ver.1.07	---	---
	Ver.1.1			Ver.1.10	Ver.1.0	Ver.1.10
NX-SID800	Ver.1.0	Ver.1.1	Ver.1.06	Ver.1.07		
NX-SOD400						
NX-SOH200						

*1. Some Units do not have all of the versions given in the above table. If a Unit does not have the specified version, support is provided by the oldest available version after the specified version. Refer to the user's manuals for the specific Units for the relation between models and versions.

MEMO

Terms and Conditions of Sale

- Offer; Acceptance.** These terms and conditions (these "Terms") are deemed part of all quotes, agreements, purchase orders, acknowledgments, price lists, catalogs, manuals, brochures and other documents, whether electronic or in writing, relating to the sale of products or services (collectively, the "Products") by Omron Electronics LLC and its subsidiary companies ("Omron"). Omron objects to any terms or conditions proposed in Buyer's purchase order or other documents which are inconsistent with, or in addition to, these Terms.
- Prices; Payment Terms.** All prices stated are current, subject to change without notice by Omron. Omron reserves the right to increase or decrease prices on any unshipped portions of outstanding orders. Payments for Products are due net 30 days unless otherwise stated in the invoice.
- Discounts.** Cash discounts, if any, will apply only on the net amount of invoices sent to Buyer after deducting transportation charges, taxes and duties, and will be allowed only if (i) the invoice is paid according to Omron's payment terms and (ii) Buyer has no past due amounts.
- Interest.** Omron, at its option, may charge Buyer 1-1/2% interest per month or the maximum legal rate, whichever is less, on any balance not paid within the stated terms.
- Orders.** Omron will accept no order less than \$200 net billing.
- Governmental Approvals.** Buyer shall be responsible for, and shall bear all costs involved in, obtaining any government approvals required for the importation or sale of the Products.
- Taxes.** All taxes, duties and other governmental charges (other than general real property and income taxes), including any interest or penalties thereon, imposed directly or indirectly on Omron or required to be collected directly or indirectly by Omron for the manufacture, production, sale, delivery, importation, consumption or use of the Products sold hereunder (including customs duties and sales, excise, use, turnover and license taxes) shall be charged to and remitted by Buyer to Omron.
- Financial.** If the financial position of Buyer at any time becomes unsatisfactory to Omron, Omron reserves the right to stop shipments or require satisfactory security or payment in advance. If Buyer fails to make payment or otherwise comply with these Terms or any related agreement, Omron may (without liability and in addition to other remedies) cancel any unshipped portion of Products sold hereunder and stop any Products in transit until Buyer pays all amounts, including amounts payable hereunder, whether or not then due, which are owing to it by Buyer. Buyer shall in any event remain liable for all unpaid accounts.
- Cancellation; Etc.** Orders are not subject to rescheduling or cancellation unless Buyer indemnifies Omron against all related costs or expenses.
- Force Majeure.** Omron shall not be liable for any delay or failure in delivery resulting from causes beyond its control, including earthquakes, fires, floods, strikes or other labor disputes, shortage of labor or materials, accidents to machinery, acts of sabotage, riots, delay in or lack of transportation or the requirements of any government authority.
- Shipping; Delivery.** Unless otherwise expressly agreed in writing by Omron:
 - Shipments shall be by a carrier selected by Omron; Omron will not drop ship except in "break down" situations.
 - Such carrier shall act as the agent of Buyer and delivery to such carrier shall constitute delivery to Buyer;
 - All sales and shipments of Products shall be FOB shipping point (unless otherwise stated in writing by Omron), at which point title and risk of loss shall pass from Omron to Buyer; provided that Omron shall retain a security interest in the Products until the full purchase price is paid;
 - Delivery and shipping dates are estimates only; and
 - Omron will package Products as it deems proper for protection against normal handling and extra charges apply to special conditions.
- Claims.** Any claim by Buyer against Omron for shortage or damage to the Products occurring before delivery to the carrier must be presented in writing to Omron within 30 days of receipt of shipment and include the original transportation bill signed by the carrier noting that the carrier received the Products from Omron in the condition claimed.
- Warranties.** (a) **Exclusive Warranty.** Omron's exclusive warranty is that the Products will be free from defects in materials and workmanship for a period of twelve months from the date of sale by Omron (or such other period expressed in writing by Omron). Omron disclaims all other warranties, express or implied. (b) **Limitations.** OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, ABOUT NON-INFRINGEMENT, MERCHANTABILITY

ITY OR FITNESS FOR A PARTICULAR PURPOSE OF THE PRODUCTS. BUYER ACKNOWLEDGES THAT IT ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE. Omron further disclaims all warranties and responsibility of any type for claims or expenses based on infringement by the Products or otherwise of any intellectual property right. (c) **Buyer Remedy.** Omron's sole obligation hereunder shall be, at Omron's election, to (i) replace (in the form originally shipped with Buyer responsible for labor charges for removal or replacement thereof) the non-complying Product, (ii) repair the non-complying Product, or (iii) repay or credit Buyer an amount equal to the purchase price of the non-complying Product; provided that in no event shall Omron be responsible for warranty, repair, indemnity or any other claims or expenses regarding the Products unless Omron's analysis confirms that the Products were properly handled, stored, installed and maintained and not subject to contamination, abuse, misuse or inappropriate modification. Return of any Products by Buyer must be approved in writing by Omron before shipment. Omron Companies shall not be liable for the suitability or unsuitability or the results from the use of Products in combination with any electrical or electronic components, circuits, system assemblies or any other materials or substances or environments. Any advice, recommendations or information given orally or in writing, are not to be construed as an amendment or addition to the above warranty. See <http://www.omron247.com> or contact your Omron representative for published information.

- Limitation on Liability; Etc.** OMRON COMPANIES SHALL NOT BE LIABLE FOR SPECIAL, INDIRECT, INCIDENTAL, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS OR PRODUCTION OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED IN CONTRACT, WARRANTY, NEGLIGENCE OR STRICT LIABILITY. Further, in no event shall liability of Omron Companies exceed the individual price of the Product on which liability is asserted.
- Indemnities.** Buyer shall indemnify and hold harmless Omron Companies and their employees from and against all liabilities, losses, claims, costs and expenses (including attorney's fees and expenses) related to any claim, investigation, litigation or proceeding (whether or not Omron is a party) which arises or is alleged to arise from Buyer's acts or omissions under these Terms or in any way with respect to the Products. Without limiting the foregoing, Buyer (at its own expense) shall indemnify and hold harmless Omron and defend or settle any action brought against such Companies to the extent based on a claim that any Product made to Buyer specifications infringed intellectual property rights of another party.
- Property; Confidentiality.** Any intellectual property in the Products is the exclusive property of Omron Companies and Buyer shall not attempt to duplicate it in any way without the written permission of Omron. Notwithstanding any charges to Buyer for engineering or tooling, all engineering and tooling shall remain the exclusive property of Omron. All information and materials supplied by Omron to Buyer relating to the Products are confidential and proprietary, and Buyer shall limit distribution thereof to its trusted employees and strictly prevent disclosure to any third party.
- Export Controls.** Buyer shall comply with all applicable laws, regulations and licenses regarding (i) export of products or information; (iii) sale of products to "forbidden" or other proscribed persons; and (ii) disclosure to non-citizens of regulated technology or information.
- Miscellaneous.** (a) **Waiver.** No failure or delay by Omron in exercising any right and no course of dealing between Buyer and Omron shall operate as a waiver of rights by Omron. (b) **Assignment.** Buyer may not assign its rights hereunder without Omron's written consent. (c) **Law.** These Terms are governed by the law of the jurisdiction of the home office of the Omron company from which Buyer is purchasing the Products (without regard to conflict of law principles). (d) **Amendment.** These Terms constitute the entire agreement between Buyer and Omron relating to the Products, and no provision may be changed or waived unless in writing signed by the parties. (e) **Severability.** If any provision hereof is rendered ineffective or invalid, such provision shall not invalidate any other provision. (f) **Setoff.** Buyer shall have no right to set off any amounts against the amount owing in respect of this invoice. (g) **Definitions.** As used herein, "including" means "including without limitation"; and "Omron Companies" (or similar words) mean Omron Corporation and any direct or indirect subsidiary or affiliate thereof.

Certain Precautions on Specifications and Use

- Suitability of Use.** Omron Companies shall not be responsible for conformity with any standards, codes or regulations which apply to the combination of the Product in the Buyer's application or use of the Product. At Buyer's request, Omron will provide applicable third party certification documents identifying ratings and limitations of use which apply to the Product. This information by itself is not sufficient for a complete determination of the suitability of the Product in combination with the end product, machine, system, or other application or use. Buyer shall be solely responsible for determining appropriateness of the particular Product with respect to Buyer's application, product or system. Buyer shall take application responsibility in all cases but the following is a non-exhaustive list of applications for which particular attention must be given:
 - Outdoor use, uses involving potential chemical contamination or electrical interference, or conditions or uses not described in this document.
 - Use in consumer products or any use in significant quantities.
 - Energy control systems, combustion systems, railroad systems, aviation systems, medical equipment, amusement machines, vehicles, safety equipment, and installations subject to separate industry or government regulations.
 - Systems, machines and equipment that could present a risk to life or property. Please know and observe all prohibitions of use applicable to this Product.
- NEVER USE THE PRODUCT FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY OR IN LARGE QUANTITIES WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO

ADDRESS THE RISKS, AND THAT THE OMRON'S PRODUCT IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

- Programmable Products.** Omron Companies shall not be responsible for the user's programming of a programmable Product, or any consequence thereof.
- Performance Data.** Data presented in Omron Company websites, catalogs and other materials is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of Omron's test conditions, and the user must correlate it to actual application requirements. Actual performance is subject to the Omron's Warranty and Limitations of Liability.
- Change in Specifications.** Product specifications and accessories may be changed at any time based on improvements and other reasons. It is our practice to change part numbers when published ratings or features are changed, or when significant construction changes are made. However, some specifications of the Product may be changed without any notice. When in doubt, special part numbers may be assigned to fix or establish key specifications for your application. Please consult with your Omron's representative at any time to confirm actual specifications of purchased Product.
- Errors and Omissions.** Information presented by Omron Companies has been checked and is believed to be accurate; however, no responsibility is assumed for clerical, typographical or proofreading errors or omissions.

OMRON AUTOMATION AND SAFETY • THE AMERICAS HEADQUARTERS • Chicago, IL USA • 847.843.7900 • 800.556.6766 • www.omron247.com

OMRON CANADA, INC. • HEAD OFFICE

Toronto, ON, Canada • 416.286.6465 • 866.986.6766 • www.omron247.com

OMRON ELECTRONICS DE MEXICO • HEAD OFFICE

México DF • 52.55.59.01.43.00 • 01-800-226-6766 • mela@omron.com

OMRON ELECTRONICS DE MEXICO • SALES OFFICE

Apodaca, N.L. • 52.81.11.56.99.20 • 01-800-226-6766 • mela@omron.com

OMRON ELETRÔNICA DO BRASIL LTDA • HEAD OFFICE

São Paulo, SP, Brasil • 55.11.2101.6300 • www.omron.com.br

OMRON ARGENTINA • SALES OFFICE

Cono Sur • 54.11.4783.5300

OMRON CHILE • SALES OFFICE

Santiago • 56.9.9917.3920

OTHER OMRON LATIN AMERICA SALES

54.11.4783.5300

OMRON EUROPE B.V. • Wegalaan 67-69, NL-2132 JD, Hoofddorp, The Netherlands. • +31 (0) 23 568 13 00 • www.industrial.omron.eu

Authorized Distributor:

Automation Control Systems

- Machine Automation Controllers (MAC) • Programmable Controllers (PLC)
- Operator interfaces (HMI) • Distributed I/O • Software

Drives & Motion Controls

- Servo & AC Drives • Motion Controllers & Encoders

Temperature & Process Controllers

- Single and Multi-loop Controllers

Sensors & Vision

- Proximity Sensors • Photoelectric Sensors • Fiber-Optic Sensors
- Amplified Photomicrosensors • Measurement Sensors
- Ultrasonic Sensors • Vision Sensors

Industrial Components

- RFID/Code Readers • Relays • Pushbuttons & Indicators
- Limit and Basic Switches • Timers • Counters • Metering Devices
- Power Supplies

Safety

- Laser Scanners • Safety Mats • Edges and Bumpers • Programmable Safety Controllers • Light Curtains • Safety Relays • Safety Interlock Switches