



BAScontrol20C – 20-point BACnet/IP Client Sedona Unitary Controller

Most BACnet devices are BACnet servers which do not initiate requests to other devices other than an initial “I-Am” request when first joining the network. BACnet client devices do initiate requests and expect BACnet servers to respond to requests and data is exchanged. The BAScontrol20C is a BACnet/IP server and also provides BACnet/IP client capability which allows the user to read and/or write points served up by devices on the BACnet internetwork. The BAScontrol20C is a 20-point unitary controller which supports BACnet/IP and Sedona Framework using an Ethernet connection. The controller complies with the B-ASC device profile having a convenient mix of 8 universal inputs, 4 binary inputs, 4 analog outputs and 4 relay outputs. Unique to the unit are 48 web components which link Sedona wire sheet readable/writeable data to web pages, and 24 virtual points


which link Sedona wire sheet readable/writeable data to a BACnet client. The device is fully web page-configurable, and freely programmable using Sedona’s drag-and-drop programming methodology of assembling components onto a wire sheet to create applications. The unit can be programmed using Niagara Workbench AX or a third-party Sedona programming tool such as Sedona Application Editor (SAE). Rugged design, low profile, and wide temperature operation make it suitable for indoor or outdoor use. To download the free Sedona Application Editor, visit: www.ccontrols.com/sae. For more information about Sedona, SAE, kits, components and programming download the Sedona Reference Manual at: www.ccontrols.com/sedona

Versatile Control Device — unitary controller or remote Ethernet I/O

- BACnet/IP compliant with a B-ASC device profile
- Resident BACnet Client can read/write BACnet objects from other BACnet devices on the network
- Resident Sedona Virtual Machine (SVM)
- Programmable via Workbench AX or Sedona Editor
- Configurable with a common web browser
- Direct connection to Ethernet network
- NTP or manually-settable real-time clock
- COV subscriptions – 14 binary and 2 analog
- Outdoor temperature operation -40°C to +75°C

Flexible Input/Output — 20-points of physical I/O

- Eight configurable universal inputs:
Thermistor, resistance, analog voltage, binary input, pulse inputs (4 max)
- Four contact closure inputs
- Four analog voltage outputs
- Four relay outputs

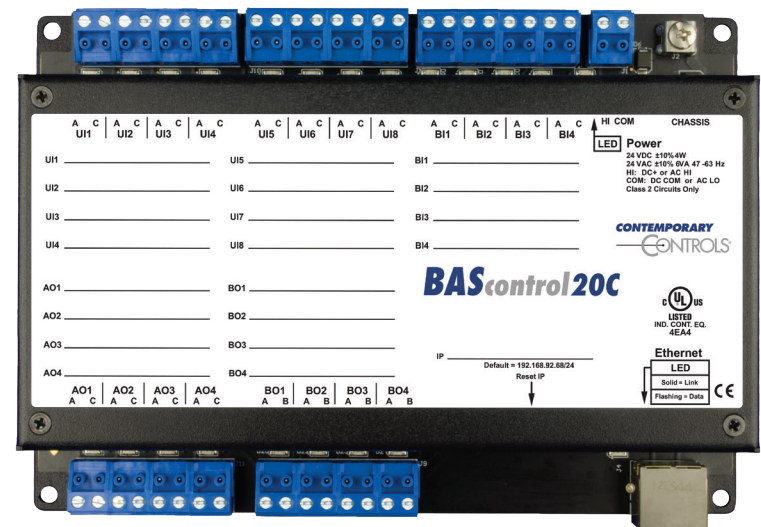

BASC-20CR has four relay outputs

BASautomation® Sedona

BAScontrol20C – Overview

The BAScontrol20C utilizes a powerful 32-bit ARM7 processor with 512 kB of flash memory plus a 16 Mbit serial flash file system for storing configuration data and an application program.

The BAScontrol20C is a BACnet/IP server and also provides some BACnet/IP client capability which allows the user to read and/or write points served up by devices on the BACnet internetwork. By operating at the BACnet/IP level, the BAScontrol20C can share the same Ethernet network with supervisory controllers and operator workstations. The unit can be configured for a fixed IP address or can operate as a DHCP client receiving its IP address from a DHCP server. A real-time clock with a super-cap backup allows for creating local schedules.

Via a 10/100 Mbps Ethernet port, the BAScontrol supports protocols such as BACnet/IP, Sedona SOX, HTTP and FTP. Configuration of universal inputs and virtual points can be accomplished using web pages. Type II and type III 10 k Ω thermistor curves and a 20 k Ω thermistor curve are resident in the unit. Current inputs can be measured using external resistors. Contact closures require a voltage-free source. Binary inputs and outputs as well as analog outputs require no configuration. The unit is powered from either a 24VAC/VDC source.

BACnet servers serve up their points to BACnet clients. Writable BACnet server device points can also be written to by BACnet clients. The BAScontrol20C is capable of directly reading from and writing to BACnet/IP devices on the network connected to one of its Ethernet ports by the use of NetV (Network Variable) Sedona components. NetV components allow the BAScontrol20C to read and/or write Analog Input (AI), Binary Input (BI), Analog Value (AV), Binary Value (BV), Analog Output (AO), and Binary Output (BO) BACnet object types in its wire sheet. In addition, with a BACnet router in place (such as BASRT-B or BASRTLX-B), the BAScontrol20C is capable of reading from and/or writing to BACnet MS/TP devices which are being routed to BACnet/IP. The points obtained over the BACnet network can be used in the BAScontrol20C's Sedona wire sheet application logic, become scaled, calculated, and/or converted to different data types, written to other BACnet devices, served up to BACnet supervisory controllers and operator workstations by using Virtual Components, as well as be monitored, displayed, or exposed for configuration on BAScontrol20C's web page by the use of Web Components.

Universal Inputs

Eight input points can be configured — all discoverable as BACnet objects.

- Analog inputs: 0–10 VDC, 12-bit resolution, 0–20 mA (with external resistor)
- Temperature inputs: Type II or Type III 10 k Ω thermistors; 20 k Ω thermistor
- Resistance inputs: 1 k Ω to 100 k Ω
- Contact closure, voltage-free
- Pulse input accumulators (UI1–UI4): accommodates active or passive sources (40 Hz max)

Binary Inputs

Four points of voltage-free contact closure

Power Input

24 VAC/VDC 6 VA half-wave rectified allows power sharing with other half-wave devices.

Earth

Optional Earth Connection

Power LED

Indicates power applied

IP Address

fixed or DHCP client

Ethernet LED

Lights on link and flashes with data

Ethernet Port

10/100 Mbps Ethernet with auto-negotiation and Auto-MDIX. Protocols supported include HTTP, IP, UDP, TCP, BACnet/IP, NTP, DNS, DHCP, FTP, and Sedona SOX.

Analog Outputs

0–10 V, 10-bit resolution

Binary Outputs


Four form “A” relays for 30 VAC/VDC 2 A loads. Class 2 circuits only.

Point LEDs

for all 20 points

Reset

to factory IP defaults

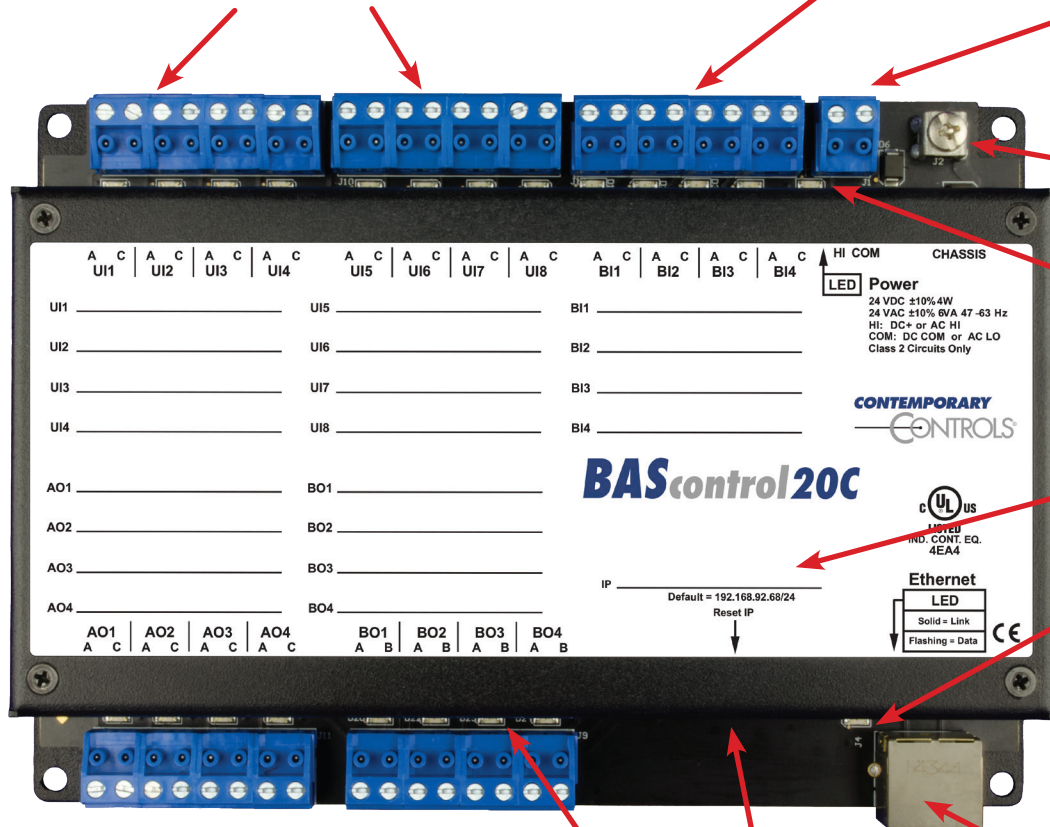

Web Page Configuration – Main Page and System

Access to the web pages is intended for the installer or skilled technicians. In order to access any of the web pages authentication is required. The default IP address is 192.68.92.68 and the default User Name and Password is admin/admin. Once on the main page, the System Configuration button can be clicked.

The main web page provides an overview of all real points plus access to other web pages. To configure a point, click

on the point and a configuration page will appear. To observe the updated data for each point, click Auto Refresh button to ON. Point values can be temporarily forced by checking the box adjacent to the point and entering a value into the point's text box (make sure Auto Refresh button is OFF). The value will remain forced until the box is unchecked or the unit power cycled. Care must be exercised when forcing values into points.

The screenshot displays the main web page of the BAScontrol20C system. It features four columns of points: Universal Inputs (UI1-UI8), Binary Inputs (BI1-BI4), Analog Outputs (AO1-AO4), and Binary Outputs (BO1-BO4). Each point has a label, a value field, and a checkbox. Below the points is a large 'BAScontrol20C' logo. At the bottom, there are navigation buttons: System Config, System Status, Set Time, Virtual Points, Web Components, BACnet Utility, and Restart Controller. An 'Auto Refresh ON' button is also present. Copyright information and a note about the green label are at the very bottom.

Universal Inputs

Zone 1 Temperature	UI1	78.119°F	☐
Universal Input 2	UI2	78.557°F	☐
Zone 3 Temperature	UI3	79.009°F	☐
Zone 4 Temperature	UI4	78.363°F	☐
Universal Input 5	UI5	0.009	☐
Universal Input 6	UI6	0.003	☐
Universal Input 7	UI7	0.002	☐
Universal Input 8	UI8	0.002	☐

Binary Inputs

Binary Input 1	BI1	0	☐
Binary Input 2	BI2	0	☐
Binary Input 3	BI3	0	☐
Binary Input 4	BI4	0	☐

Analog Outputs

Analog Output 1	AO1	7.034	☐
Analog Output 2	AO2	4.688	☐
Analog Output 3	AO3	2.344	☐
Analog Output 4	AO4	9.377	☐

Binary Outputs

Fan Enable	BO1	1	☐
Cool Stage 1	BO2	1	☐
Cool Stage 2	BO3	1	☐
Binary Output 4	BO4	0	☐

BAScontrol20C

System Config System Status Set Time Virtual Points Web Components BACnet Utility Restart Controller

Auto Refresh ON

Copyright 2017 Contemporary Control Systems, Inc. All rights reserved.
Firmware Revision 3.2 : Web Page Revision 6.1.4
NOTE: A GREEN label indicates that the I/O point has been placed on the wire sheet.

The IP settings can be changed to the desired values. Either DHCP or a static IP address can be selected. If a static address is desired, enter the value along with the network mask and gateway address. If domain address is required, enter in the Primary and Secondary DNS addresses.

BACnet device data must be entered when using BACnet. Make sure the Device Instance and Device Object Name are both unique over the complete BACnet Internetwork.

Either BACnet or Sedona protocols or both can be selected.

The screenshot displays the configuration page of the BAScontrol20C system. It is divided into four main sections: IP Configuration, BACnet Device Configuration, BACnet Client, and Enable Protocol. Each section contains various fields for configuration, such as IP address, device name, instance, and protocols. There are also buttons for 'Configure BACnet Servers', 'Close', and 'Submit'. A note at the bottom states: 'NOTE: You must click the Submit button to store any changes. Changes will not take effect until the controller has been restarted. You can restart the controller from the main page.'

IP Configuration

IP Mode	Static IP
IP Address	192.168.92.68
Netmask	255.255.255.0
Gateway	192.168.92.1
Primary DNS	8.8.8.8
Secondary DNS	8.8.4.4

BACnet Device Configuration

Device Object Name	BAScontrol 20C
Device Instance	2749
UDP Port	47808
BBMD IP Address	0.0.0.0
BBMD Reg Time	100
Time Transmissions (Min)	0
☐ BIP	

BACnet Client

Poll Delay (mS)	1000
Retry Delay (S)	20
Configure BACnet Servers	

Enable Protocol

BACnet/IP	☒	BACnet Client	☒
Sedona	☒		
FTP	☐		

Authentication

User Name	admin
Password	*****
Close	Submit

NOTE: You must click the Submit button to store any changes.
Changes will not take effect until the controller has been restarted. You can restart the controller from the main page.

Web Page Configuration – Channel, Time and Web Components

BAS Channel Configuration

Channel Type Therm 10kT3

Temperature Offset -1.1

Temperature Units Fahrenheit

Out of Bounds Value 77

UI1

BACnet Object Configuration

Object Instance 1

Object Name Space Temperature

Object Type Analog Input

Object Description Space Temperature

Units DEGREES_FAHRENHEIT

COV Increment 0

Close
Submit

The BAS Channel should be configured first. Universal inputs must first be defined which may lead to more requests for information. Once the BAS Channel is configured, the BACnet Object Configuration can be accomplished. Although the BACnet Object Instance is predefined, the Object Name can be entered and Units can be selected with the drop-down. The COV Increment can be specified for those channels intended for COV reporting by the BACnet client device.

System Time

Year 2017

Month June

Day 1

Hour 9 AM

Minute 14

Manual Time Set

Close

NTP Configuration

☒ NTP Enabled

NTP Server pool.ntp.org

Time Zone Central:UTC-6

NTP Refresh (Days) 1

NTP Success

DST Configuration

☐ DST Enabled

	DST ON	DST OFF
Month	March	November
Day of Month	2nd SUN	1st SUN
Hour	2 AM	2 AM

Submit

Time and date can be set manually or with the help of a NTP server if access to the Internet is possible. Daylight Savings Time can also be supported. Manually-set time is backed up for seven days through the use of a supercap in the event of power loss. If accessing an NTP server using domain names, make sure the DNS servers are specified in the System Configuration screen.

Separate web pages allow for the configuration of up to 48 web components. Web components provide a means to write and read data to and from Sedona wire sheets without the need of a Workbench tool. A web component configured as a wire sheet input can have its input range restricted to minimum and maximum values eliminating the need to add limit detection within the wire sheet logic. Web components are ideal for simplified control logic configuration.

Web Components

<PREV
NEXT>

	Description	Value	Wire Sheet	Min	Max
WC01	Space Temperature (SpcTmp)	77.272514	Output		
WC02	Default Web Component 2	0.000000	Input	0.000000	100.000000
WC03	Default Web Component 3	0.000000	Input	0.000000	100.000000
WC04	Default Web Component 4	0.000000	Input	0.000000	100.000000
WC05	Default Web Component 5	0.000000	Input	0.000000	100.000000
WC06	Default Web Component 6	0.000000	Input	0.000000	100.000000
WC07	Default Web Component 7	0.000000	Input	0.000000	100.000000
WC08	Default Web Component 8	0.000000	Input	0.000000	100.000000

Auto Refresh ON

NOTE: A GREEN label indicates that the component has been placed on the wire sheet.

Close
Submit

Virtual Points

Space Temperature Zone 1 VT01 83.187 ☐ Cooling Runtime in Hrs VT02 0.000 ☐ Virtual Point 3 VT03 0.000 ☐ Virtual Point 4 VT04 0.000 ☐ Virtual Point 5 VT05 0.000 ☐ Virtual Point 6 VT06 0.000 ☐ Virtual Point 7 VT07 0.000 ☐ Virtual Point 8 VT08 0.000 ☐	Occupied State VT09 0.000 ☐ Virtual Point 10 VT10 0.000 ☐ Virtual Point 11 VT11 0.000 ☐ Virtual Point 12 VT12 0.000 ☐ Virtual Point 13 VT13 0.000 ☐ Virtual Point 14 VT14 0.000 ☐ Virtual Point 15 VT15 0.000 ☐ Virtual Point 16 VT16 0.000 ☐	Virtual Point 17 VT17 0.000 ☐ Virtual Point 18 VT18 0.000 ☐ Virtual Point 19 VT19 0.000 ☐ Virtual Point 20 VT20 0.000 ☐ Virtual Point 21 VT21 0.000 ☐ Virtual Point 22 VT22 0.000 ☐ Virtual Point 23 VT23 0.000 ☐ Virtual Point 24 VT24 0.000 ☐
---	--	--

Auto Refresh OFF

NOTES:

1. A GREEN label means that the virtual point has been placed on the wire sheet. The label hover text indicates if the point is configured as "Read from Wire Sheet" or "Write to Wire Sheet"
2. Values for virtual points VT01-VT08 are kept in persistent memory and will remain unchanged through resets and power cycles.

The 24 virtual points are viewable from a separate web page.

System Status

Firmware Revision 3.2.8	MAC Address 00:50:DB:01:1C:30	Available Memory 24208
--	--	---

System Message Log

```

BAScontrol20C : 3.2.8 : Apr 17 2018 : 16:13:53
Free memory: 97544
Watchdog timer enabled
Low memory limit= 8192
Creating object name and instance mappings...done
Creating object data...done
Updating forcing data...done
IP Addr: 192.168.92.68
IP Mask: 255.255.255.0
IP Gate: 192.168.92.1
Start Responder...OK
SVM starting; 54640 bytes free
Running SVM in platform mode
Sedona VM 1.2.28
buildDate: Apr 17 2018 16:13:52
endian: little
blockSize: 4
refSize: 4

bacnet-ip : 3.2.8 : Apr 17 2018 : 16:13:49
Network initialized
RTC Time: Tue Jan 9 13:39:05 2001
  
```


The System Status page provides information on the controller.

Powered by a Sedona Virtual Machine – for Implementing Control

The BAScontrol20C incorporates Sedona Virtual Machine (SVM) technology developed by Tridium. Using established Tridium tools such as Niagara Workbench AX, a system integrator can develop a control application using Workbench's powerful drag-and-drop visual programming methodology. Once developed, the program remains stored in the BAScontrol20C and executes by way of the SVM. The application can run standalone in the BAScontrol20C or it can interact with a program in a Tridium JACE supervisory controller over Ethernet. The number of potential applications is only limited by the imagination of the system integrator.

The BAScontrol20C includes Tridium's Sedona 1.2 kits of components — and Contemporary Controls' product-specific and non-product-specific kits. The BAScontrol20 IO Kit components provide 20 physical points, virtual points and four retentive counters. The BAScontrol20C Web Kit has 48 components that share data with web pages. Input components receive data from hosted web pages. Output components send data to hosted web pages. The Contemporary Controls' Function kit provides additional components for increased flexibility.

The free Sedona Application Editor, Workbench AX, or a third-party Sedona tool can be used to program Sedona applications running on the BAScontrol 20C.

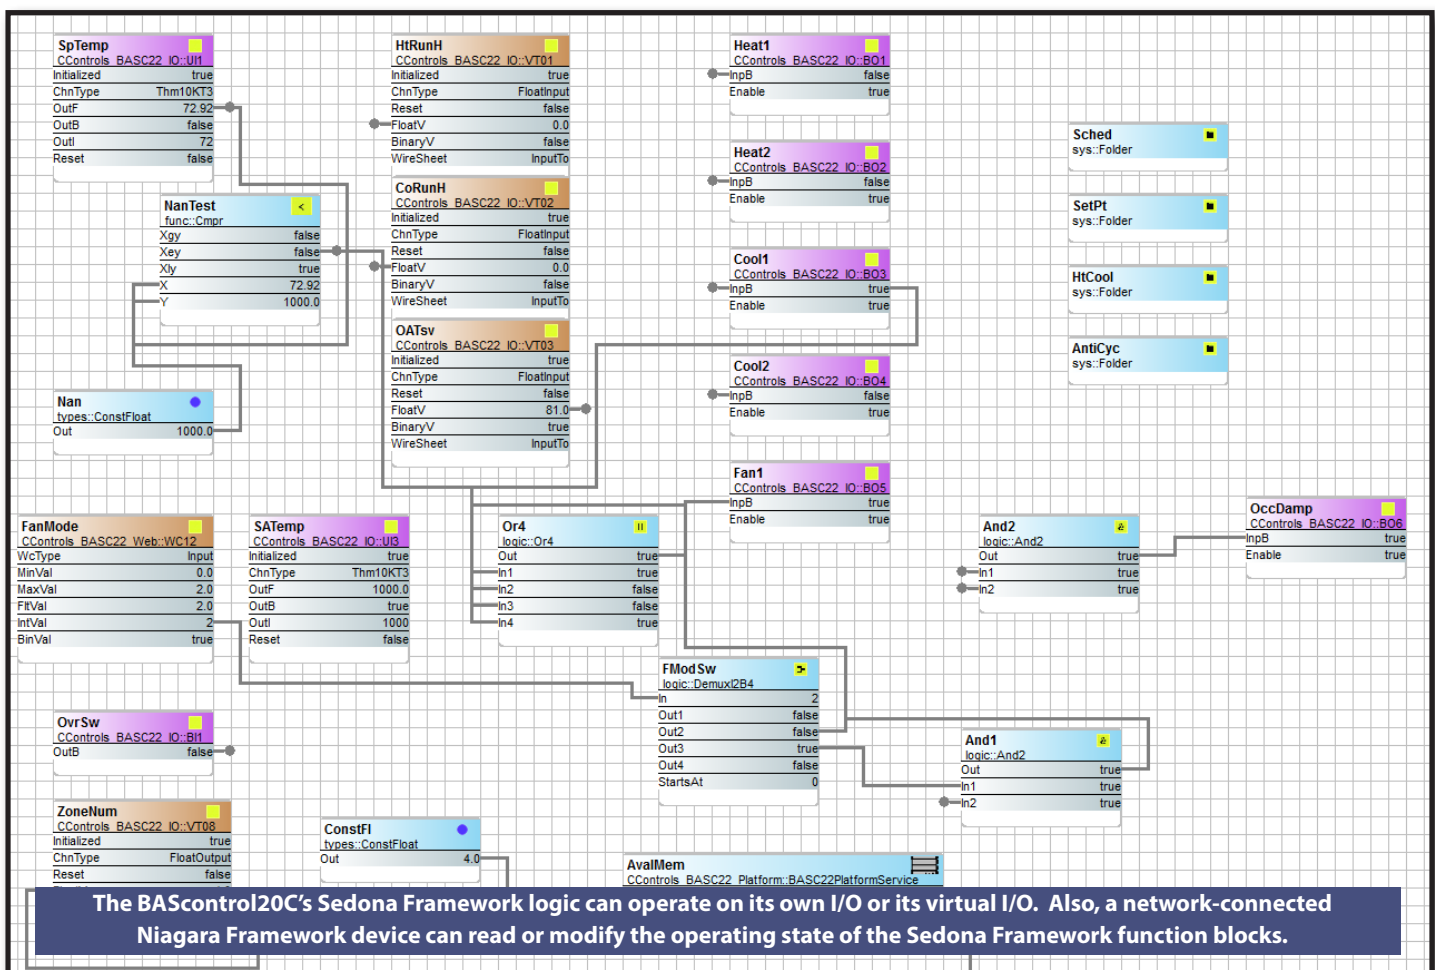

Contemporary Controls' Developed Sedona Components

BAScontrol20 I/O Kit BAScontrol20 platform specific components	AO1 – AO4	Analog output – analog voltage output point	
	BI1 – BI4	Binary input – binary input point	
	BO1 – BO4	Binary output – binary output point	
	ScanTim	Scan time monitor – records the min, max and average scan times	
	UI1 – UI4	Universal input – binary, analog voltage, thermistor, resistance or accumulator	
	UI5 – UI8	Universal input – binary, analog voltage, thermistor or resistance	
	UC1 – UC4	Retentive universal counters – up/down retentive counters	
BAScontrol20 Web Kit BAScontrol20 platform specific components	VT01 – VT08	Retentive virtual points – share retentive wire sheet data with BACnet/IP clients	
	VT09 – VT24	Virtual points – share wire sheet data with BACnet/IP clients	
	WC01 – WC48	Web components – share wire sheet data with the BAScontrol20 web pages	
	Contemporary Controls Function Kit Common to Sedona 1.2 compliant controllers	Cand2	Two-input Boolean product – two-input AND/NAND gate with complementary outputs
		Cand4	Four-input Boolean product – four-input AND/NAND gate with complementary outputs
		Cand6	Six-input Boolean product – six-input AND/NAND gate with complementary outputs
		Cand8	Eight-input Boolean product – eight-input AND/NAND gate with complementary outputs
Cmt		Comment – comment field up to 64 characters	
Cor2		Two-input Boolean sum – two-input OR/NOR gate with complementary outputs	
Cor4		Four-input Boolean sum – four-input OR/NOR gate with complementary outputs	
Cor6		Six-input Boolean sum – six-input OR/NOR gate with complementary outputs	
Cor8		Eight-input Boolean sum – eight-input OR/NOR gate with complementary outputs	
CtoF		°C to °F – Celsius to Fahrenheit Temperature Conversion	
Dff		“D” Flip-Flop – D-style Edge-triggered Single-bit Storage	
FtoC		°F to °C – Fahrenheit to Celsius Temperature Conversion	
HLpre		High – Low Preset – defined logical true and false states	
PsychrE		Psychrometric Calculator – English Units	
PsychrS		Psychrometric Calculator – SI Units	
Contemporary Controls Client Kit BAScontrol20C platform specific components	SCLatch	Set/Clear Latch – single-bit level-triggered single-bit data storage	
	NetV	Network Variable — command single BACnet object of type AI, AO, AV, BI, BO, or BV	
	NETVAI4	Network Variable AI4 — initiate read of up to four BACnet objects of type AI	
	NETVAO4	Network Variable AO4 — initiate read or write of up to four BACnet objects of type AO	
	NETVBI4	Network Variable BI4 — initiate read of up to four BACnet objects of type BI	
	NETVBO4	Network Variable BO4 — initiate read or write of up to four BACnet objects of type BO	

Tridium's Sedona 1.2 Components

The HVAC Group operations that facilitate control	LSeq	Linear Sequencer — bar graph representation of input value
	ReheatSeq	Reheat sequence — linear sequence up to four outputs
	Reset	Reset — output scales an input range between two limits
	Tstat	Thermostat — on/off temperature controller
The Scheduling Group scheduling operations based upon time of day	DailySc	Daily Schedule Boolean — two-period Boolean scheduler
	DailyS1	Daily Schedule Float — two-period float scheduler
	DateTime	Time of Day — time, day, month, year
The Function Group convenient functions for developing control schemes	Cmpr	Comparison math — comparison ($\leq$ or $\geq$) of two floats
	Count	Integer counter — up/down counter with integer output
	Freq	Pulse frequency — calculates the input pulse frequency
	Hysteresis	Hysteresis — setting on/off trip points to an input variable
	IRamp	IRamp — generates a repeating triangular wave with an integer output
	Limiter	Limiter — Restricts output within upper and lower bounds
	Linearize	Linearize — piecewise linearization of a float
	LP	LP — proportional, integral, derivative (PID) loop controller
	Ramp	Ramp — generates a repeating triangular or sawtooth wave with a float output
	SRLatch	Set/Reset Latch — single-bit data storage
	TickTock	Ticking clock — an astable oscillator used as a time base
	UpDn	Float counter — up/down counter with float output
The Priority Group prioritizing actions of Boolean, Float and Integer variables	PrioritizedBool	Prioritized boolean output — highest of sixteen inputs
	PrioritizedFloat	Prioritized float output — highest of sixteen inputs
	PrioritizedInt	Prioritized integer output — highest of sixteen inputs
The Types Group variable types and conversion between types	B2F	Binary to float encoder — 16-bit binary to float conversion
	ConstBool	Boolean constant — a predefined Boolean value
	ConstFloat	Float constant — a predefined float variable
	ConstInt	Integer constant — a predefined integer variable
	F2B	Float to binary decoder — float to 16-bit binary conversion
	F2I	Float to integer — float to integer conversion
	I2F	Integer to float — integer to float conversion
	L2F	Long to float — long integer to float conversion
	WriteBool	Write Boolean — setting a writable Boolean value
	WriteFloat	Write Float — setting a writable float value
	WriteInt	Write integer — setting an integer value
The Logic Group logical operations using Boolean variables	ADemux2	Analog Demux — Single-input, two-output analog de-multiplexer
	And2	Two-input Boolean product — two-input AND gate
	And4	Four-input Boolean product — four-input AND gate
	ASW	Analog switch — selection between two float variables
	ASW4	Analog switch — selection between four floats
	B2P	Binary to pulse — simple mono-stable oscillator (single-shot)
	BSW	Boolean switch — selection between two Boolean variables
	DemuxI2B4	Four-output Demux — integer to Boolean de-multiplexer
	ISW	Integer switch — selection between two integer variables
	Not	Not — inverts the state of a Boolean
	Or2	Two-input Boolean sum — two-input OR gate
	Or4	Four-input Boolean sum — four-input OR gate
	Xor	Two-input exclusive Boolean sum — two-input XOR gate
The Timing Group time-based components	DlyOff	Off delay timer — time delay from a “true” to “false” transition of the input
	DlyOn	On delay timer — time delay from an “false” to “true” transition of the input
	OneShot	Single Shot — provides an adjustable pulse width to an input transition
	Timer	Timer — countdown timer
The Math Group math-based components	Add2	Two-input addition — results in the addition of two floats
	Add4	Four-input addition — results in the addition of four floats
	Avg10	Average of 10 — sums the last ten floats while dividing by ten thereby providing a running average
	AvgN	Average of N — sums the last N floats while dividing by N thereby providing a running average
	Div2	Divide two — results in the division of two float variables
	FloatOffset	Float offset — float shifted by a fixed amount
	Max	Maximum selector — selects the greater of two inputs
	Min	Minimum selector — selects the lesser of two inputs
	MinMax	Min/Max detector — records both the maximum and minimum values of a float
	Mul2	Multiply two — results in the multiplication of two floats
	Mul4	Multiply four — results in the multiplication of four floats
	Neg	Negate — changes the sign of a float
	Round	Round — rounds a float to the nearest N places
	Sub2	Subtract two — results in the subtraction of two floats
	Sub4	Subtract four — results in the subtraction of four floats
	TimeAvg	Time average — average value of float over time

BACnet Protocol Implementation Conformance (PIC) Statement



BAScontrol20C

BACnet/IP Sedona Field Controller



BACnet Protocol Implementation Conformance Statement (Annex A)

Date: June 21, 2019
Vendor Name: Contemporary Controls
Product Name: BAScontrol20C
Product Model Number: BASC-20CR
Applications Software Version: 1.2.28 **Firmware Revision:** 3.2.8 **BACnet Protocol Revision:** 3
Product Description: BACnet/IP compliant 20-point field controller or remote I/O that allows a direct connection to Ethernet without the need of a BACnet router.

BACnet Standardized Device Profile (Annex L):

- | | |
|---|--|
| ☐ BACnet Operator Workstation (B-OWS) | ☒ BACnet Application Specific Controller (B-ASC) |
| ☐ BACnet Building Controller (B-BC) | ☐ BACnet Smart Sensor (B-SS) |
| ☐ BACnet Advanced Application Controller (B-AAC) | ☐ BACnet Smart Actuator (B-SA) |

List all BACnet Interoperability Building Block Supported (Annex K):

- | | |
|--|---|
| DS-RP-B Data Sharing — ReadProperty — A,B | DM-DDB-B Device Management — Dynamic Device Binding — B |
| DS-WP-B Data Sharing — WriteProperty — A,B | DM-DOB-B Device Management — Dynamic Object Binding — B |
| DS-RPM-B Data Sharing — ReadPropertyMultiple — B | DM-DCC-B Device Management — Device Communication Control — B |
| DS-COV-B Data Sharing — ChangeOfValue — B | DM-TS-B Device Management — Time Synchronization — B |

Segmentation Capability:

- | | |
|--|--------------|
| ☐ Able to transmit segmented messages | Window Size: |
| ☐ Able to receive segmented messages | Window Size: |

Standard Object Types Supported:

Object Type Supported	Can Be Created Dynamically	Can Be Deleted Dynamically
Analog Input	No	No
Analog Output	No	No
Analog Value	No	No
Binary Input	No	No
Binary Output	No	No
Binary Value	No	No
Device	No	No

No optional properties are supported.

Data Link Layer Options:

- | | |
|---|---|
| ☒ BACnet IP, (Annex J) | ☐ MS/TP slave (Clause 9), baud rate(s): |
| ☒ BACnet IP, (Annex J), Foreign Device | ☐ Point-To-Point, EIA 232 (Clause 10), baud rate(s): |
| ☐ ISO 8802-3, Ethernet (Clause 7) | ☐ Point-To-Point, modem, (Clause 10), baud rate(s): |
| ☐ ANSI/ATA 878.1, EIA-485 ARCNET (Clause 8), baud rate(s): | ☐ LonTalk, (Clause 11), medium: |
| ☐ MS/TP master (Clause 9), baud rate(s): | ☐ Other: |

Device Address Binding:

Is static device binding supported? (This is currently necessary for two-way communication with MS/TP slaves and certain other devices.) ☐ Yes ☒ No

Networking Options:

- ☐ Router, Clause 6 – List all routing configurations, e.g., ARCNET-Ethernet-MS/TP, etc.
☐ Annex H, BACnet Tunneling Router over IP
☐ BACnet/IP Broadcast Management Device (BBMD)
 Does the BBMD support registrations by Foreign Devices? ☐ Yes ☐ No

Character Sets Supported:

Indicating support for multiple character sets does not imply that they can all be supported simultaneously.


- | | | |
|---|---|-------------------------------------|
| ☒ ANSI X3.4 | ☐ IBM™/Microsoft™ DBCS | ☐ ISO 8859-1 |
| ☐ ISO 10646 (UCS-2) | ☐ ISO 10646 (UCS-4) | ☐ JIS C 6226 |

If this product is a communication gateway, describe the types of non-BACnet equipment/network(s) that the gateway supports:
No gateway support.


21 June 2019

PI-BASC20C-AA0

Wiring Diagram

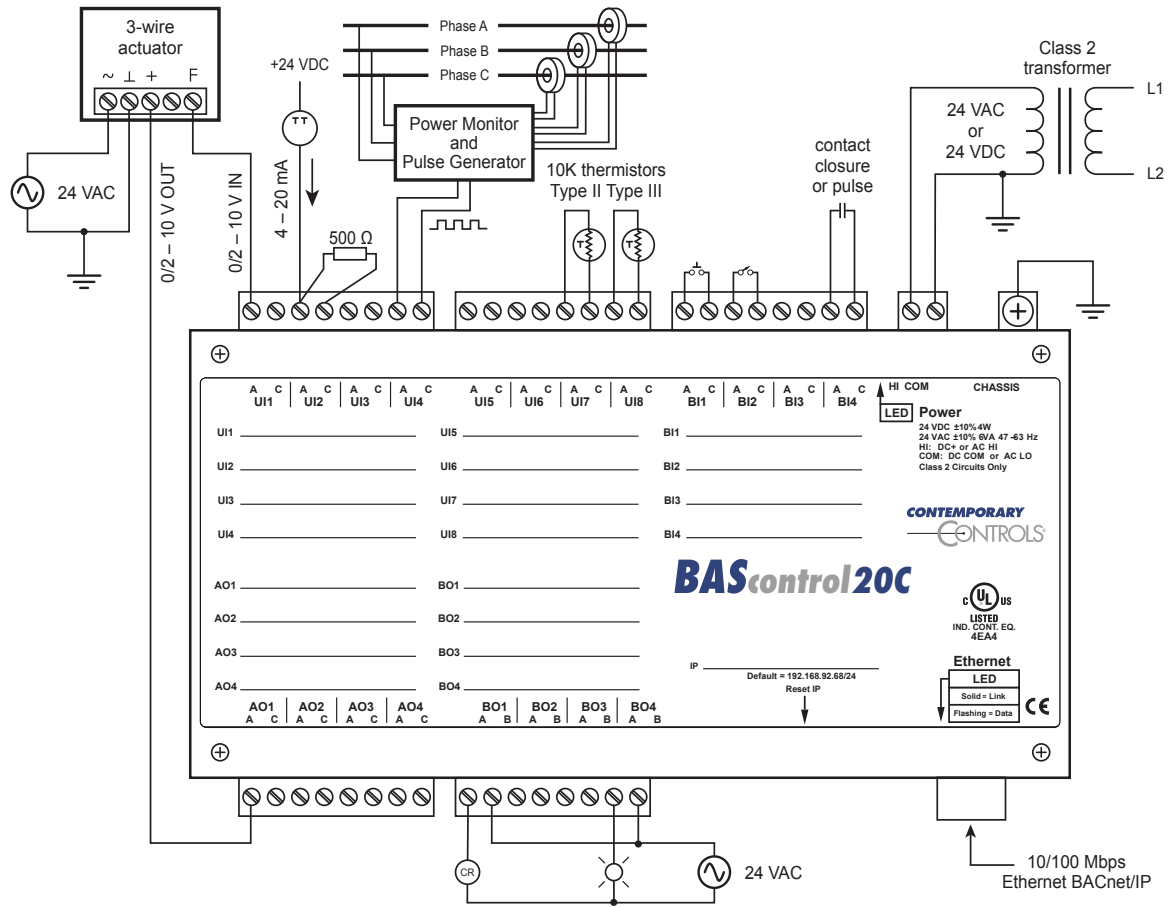

Dimensions (all dimensions are in mm)

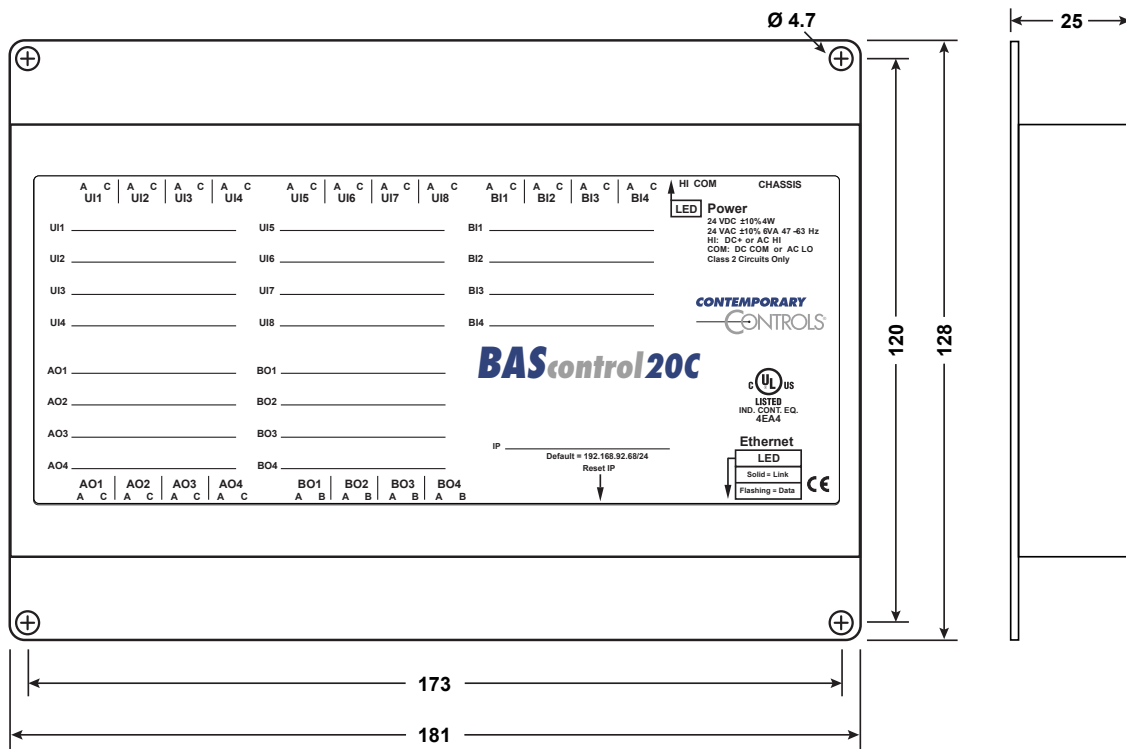

Specifications

Universal Inputs (Points UI1 through UI8)

Configured As	Characteristics
Analog input	0–10 VDC or 0–20 mA (with external resistor). Input impedance 1 MΩ on voltage.
Temperature input	Type II 10 kΩ thermistors: –10° to +190 °F (–23.3° to +87.8°C) Type III 10 kΩ thermistors: –15° to +200 °F (–26.1° to +93.3°C) 20 kΩ thermistors: 15° to 215° F (–9° to +101° C)
Contact closure input	Excitation current 0.5 mA. Open circuit voltage 12 VDC. Sensing threshold 3 VDC (low) and 7 VDC (high). Response time 20 ms.
Pulse input (Points UI1–UI4)	0–10 VDC for active output devices 0–12 VDC for passive devices (configured for internal pull-up resistor) 40 Hz maximum input frequency with 50% duty cycle. Adjustable high and low thresholds.
Resistance	1 kΩ -100 kΩ range

Binary Inputs (Points BI1 through BI4)

Contact closure	Excitation current 1.2 mA. Open circuit voltage 12 VDC Sensing threshold 3 VDC (low) and 7 VDC (high). Response time 20 ms
-----------------	---

Analog Outputs (Points AO1 through AO4)


Analog output	0–10 VDC. 10-bit resolution. 4 mA maximum
---------------	---

Binary Outputs (Points BO1 through BO4) (Class 2 circuits only — requires external power source)

Binary output	Normally open relay contacts. 30VAC/VDC 2A
---------------	--

Regulatory Compliance

CE Mark; CFR 47, Part 15 Class A; RoHS
UL 508, C22.2 No. 142-M1987

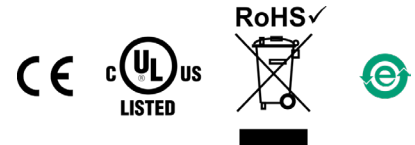

Functional

Compliance	IEEE 802.3
Protocols supported	BACnet/IP, Sedona SOX, HTTP and FTP
Data rate	10 Mbps, 100 Mbps
Physical layer	10BASE-T, 100BASE-TX
Cable length	100 m (max)
Port connector	Shielded RJ-45
LED	Green = Link established Flash = Link activity

Ethernet


Electrical

Input (DC or AC)	DC	AC
Voltage (V, ± 10%)	24	24
Power	4 W	6 VA
Frequency	N/A	47–63 Hz

Specifications (continued)

Environmental/Mechanical

Operating temperature	-40°C to +75°C
Storage temperature	-40°C to +85°C
Relative humidity	10–95%, noncondensing
Protection	IP30
Weight	0.6 lbs. (.27 kg)



RJ-45 Pin Assignments

10BASE-T/100BASE-TX

Terminal	Usage
1	TD +
2	TD –
3	RD +
6	RD –
Other pins	Not Used

Electromagnetic Compatibility

Standard	Test Method	Description	Test Levels
EN 55024	EN 61000-4-2	Electrostatic Discharge	6 kV contact & 8 kV air
EN 55024	EN 61000-4-3	Radiated Immunity	10 V/m, 80 MHz to 1 GHz
EN 55024	EN 61000-4-4	Fast Transient Burst	1 kV clamp & 2 kV direct
EN 55024	EN 61000-4-5	Voltage Surge	2 kV L-L & 2 kV L-Earth
EN 55024	EN 61000-4-6	Conducted Immunity	10 Volts (rms)
EN 55024	EN 61000-4-11	Voltage Dips & Interruptions	1 Line Cycle, 1 to 5 s @ 100% dip
EN 55022	CISPR 22	Radiated Emissions	Class A
EN 55022	CISPR 22	Conducted Emissions	Class B
CFR 47, Part 15	ANSI C63-4	Radiated Emissions	Class A

Ordering Information

Model	Description
BASC-20CR	BAScontrol20 BACnet Client/Server 20-Point 4 Relay

United States

Contemporary Control Systems, Inc.
2431 Curtiss Street
Downers Grove, IL 60515 USA

Tel: +1 630 963 7070
Fax: +1 630 963 0109

info@ccontrols.com

China

Contemporary Controls (Suzhou) Co. Ltd
19F, Metropolitan Towers,
No.199 Shishan Road,
Suzhou New District,
215009 China

Tel: +86 512 68095866
Fax: +86 512 68093760

info@ccontrols.com.cn

United Kingdom

Contemporary Controls Ltd
14 Bow Court
Fletchworth Gate
Coventry CV5 6SP
United Kingdom

Tel: +44 (0)24 7641 3786
Fax: +44 (0)24 7641 3923

info@ccontrols.co.uk

Germany

Contemporary Controls GmbH
Fuggerstraße 1 B
04158 Leipzig
Germany

Tel: +49 341 520359 0
Fax: +49 341 520359 16

info@ccontrols.de

www.ccontrols.com