

**SIEMENS**  
*Ingenuity for life*

# SIMATIC S7-1500R/H

Unrestricted @ Siemens 2020

[siemens.com/S7-1500](https://www.siemens.com/S7-1500)

V16

# SIMATIC S7-1500 Redundant Systems

- **Motivation and Product Strategy**
- System Overview
- System Redundancy and Network Configuration
- Communication
- S7-1500R/H and Safety
- HMI Connection
- Installation Recommendations
- New Features with TIA Portal V16
- Remaining Restrictions
- Ordering Information



# SIMATIC S7-1500 Redundant Systems

## Motivation

**SIEMENS**  
*Ingenuity for life*

### Preventing plant downtime

High availability during operation,  
Avoidance of loss of production



### Prevention of data losses

The data remain intact and long restart times after a failure are eliminated.

### Prevention of damages

Avoidance of unplanned production stops where the product to be processed would be permanently damaged



### Operation without persons locally

Maintenance trips can be better planned



### Save on maintenance

Application solutions are mostly complicated and difficult to maintain

**Redundant systems reduce costs**



# SIMATIC S7-1500 Redundant Systems

## Product Strategy S7-1500R/H

### Based on Standard S7-1500 CPUs and PROFINET

- Basis Hardware Standard-CPU/Fail-safe CPUs



### Transparent Programming

- Standard Engineering Tool TIA Portal
  - Redundancy functions fully integrated in TIA Portal
  - General handling like standard
  - No deep Redundancy Know-How needed



### Extensive Scalability

- Scalability of switch-over time
- Scalability of the Redundancy Architecture
- Scalability of the CPU Performance (1513 → 1517)




### Step by Step Product Launch Strategy

- First release with basic redundancy functions
- First release will not include all standard and redundancy functions
- Step by Step increasing of feature set in future versions



# SIMATIC S7-1500 Redundant Systems

- Motivation and Product Strategy
- **System Overview**
- System Redundancy and Network Configuration
- Failure Scenarios
- Communication
- S7-1500R/H and Safety
- HMI Connection
- Installation Recommendations
- New Features with TIA Portal V16 
- Remaining Restrictions
- Ordering Information

# SIMATIC S7-1500 Redundant Systems

## System overview

Consistent concept –  
**Identical** synchronization  
process

**Scaling** of the switching  
performance over the **available  
bandwidth** of the  
sync connection

CPU type

Synchronization

Switchover time

I/O systems

Type of connection

### Redundant – S7-1500R



**CPU 1513R / CPU 1515R**

via **PROFINET Ring (MRP)**

**300 ms**

### High Available – S7-1500H



**CPU 1517H**

via **Sync-Module**

**50 ms**

ET 200SP and ET 200MP <sup>1)</sup>

Single connection (PN redundancy S2) and switched S1 <sup>2)</sup>

# SIMATIC S7-1500 Redundant Systems PLC Hardware



**CPU 1513R-1 PN**  
6ES7513-1RL00-0AB0

**CPU 1515R-2 PN**  
6ES7515-2RM00-0AB0

**CPU 1517H-3 PN**  
6ES7517-3HP00-0AB0

**Short Distance**  
≤ 10m

**Long Distance**  
≤ 10km

<b>Program / memory</b>	350 kB code 1,5 MB data	500 kB code 3 MB data	2 MB code 8 MB data	Fiber Optic Cable	
<b>Interfaces</b>	X1 	X2 X1 	X2 X1 X3 X4 	Plastic	Glass fiber
<b>Firmware</b>	V2.8	V2.8	V2.8	Sync module SFP	
				6ES7960-1CB00-0AA5	6ES7960-1FB00-0AA5



X1: PROFINET IO Controller, Supports RT, MRP, Transport Protocol TCP/IP, Open User Communication  
X2: PROFINET Basic Services, Transport Protocol TCP/IP, Open User Communication

# PROFINET System Redundancy Concept



## PROFINET SR

A System with redundant PN controllers and single or redundant PN devices.

Three levels:

1. PN Controller
2. PROFINET Network
3. PN Device


Redundancy at one level is independent of redundancy at each other level.

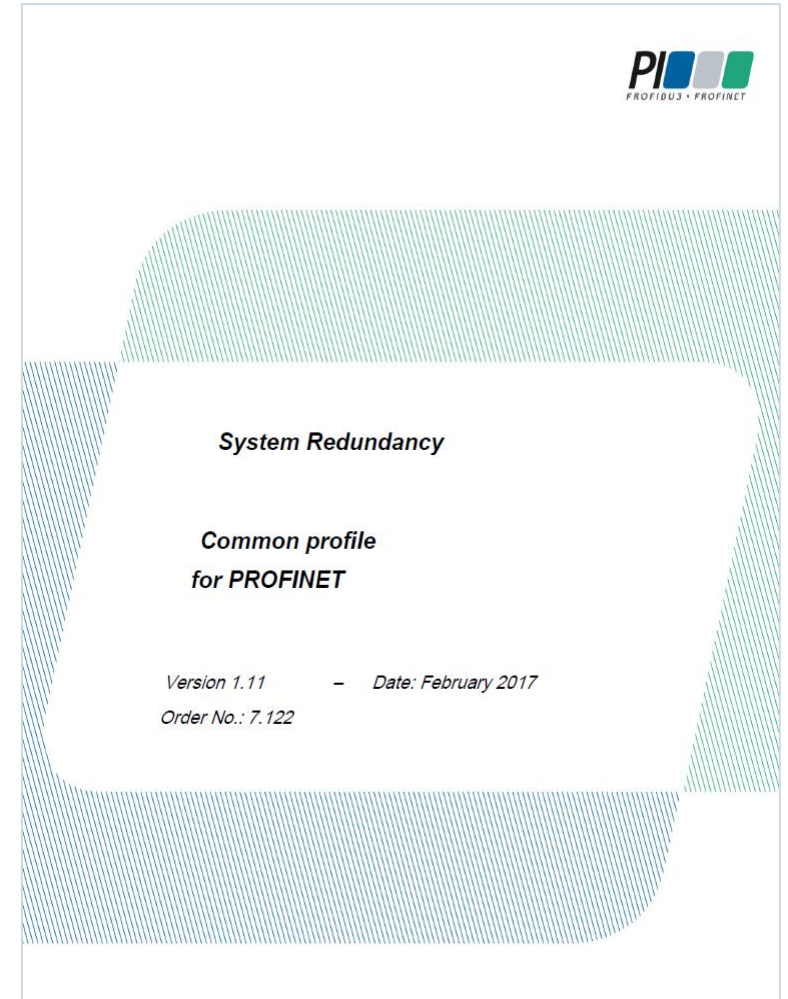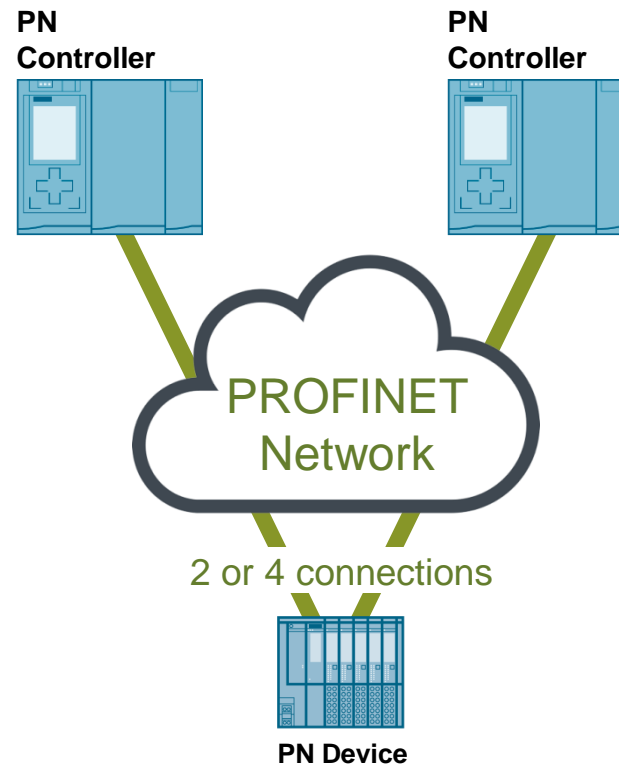



# PROFINET System Redundancy

## S1 Mode

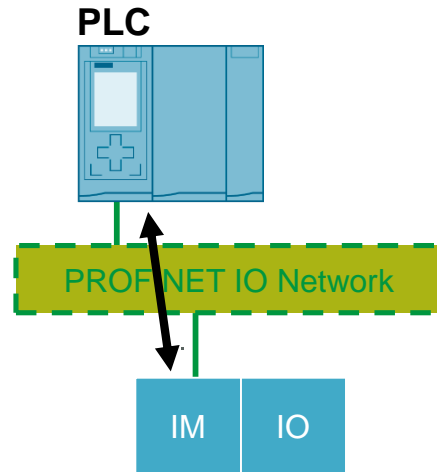


S1 Device

- S → Single interface
- 1 → one connection to one PLC

**Standard PLC + R/H**

## S2 Mode

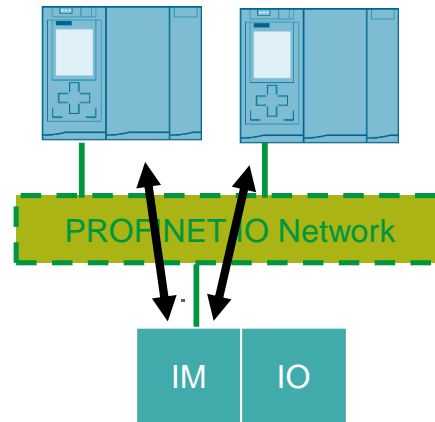


S2 Device

- S → Single interface
- 2 → can switch between two connections

**For R/H PLC**

## R1 Mode

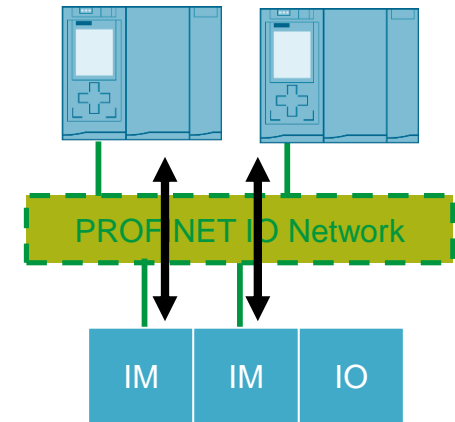

R1 Device

- R → Redundant interface
- 1 → each interface has one connection to one PLC

**Future 1500H release**

# PROFINET System Redundancy

## Siemens PN IO-Devices with PN S2 Support

### I/O-Systems



ET 200SP - IM155-6PN HF (FW>=4.2)		6ES7155-6AU01-0CN0 6ES7155-6AU30-0CN0
ET 200MP - IM155-5PN HF (FW>=4.2) now also available with active backplane. 		6ES7155-5AA00-0AC0
PN/PN-Coupler		6ES7158-3AD10-0XA0
ET 200eco PN M12-L 		6ES7 14*-6**00-0BB0

# PROFINET System Redundancy




## Siemens PN IO-Devices with PN S2 Support



### Drives

<b>S120, CU310-2PN (FW &gt;=5.2)</b> (with gsddl)		<b>6SL3040-1LA01-0AA0</b>
<b>S120, CU320-2PN (FW &gt;=5.2)</b> (with gsddl)		<b>6SL3040-1MA01-0AA0</b>

### Switches


<b>SCALANCE XC-200 Serie</b>		<b>6GK5 2...-...00-2.C2</b>
<b>SCALANCE XP-200 Serie</b>		<b>6GK5 2...-0.A00-...S6</b>
<b>SCALANCE XF204-2BA</b>		<b>6GK5 204-2AA00-2GF2</b>

# Network Configuration with S7-1500R/H Requirements

## Requirements for the PROFINET network configuration


- MRP Ring (default setting in the configuration)
- PN IO only at X1 interface
- PLC's need to be part of the ring
- S7-1500R → no devices in the connection between the two PLC's
- PN Devices need to support PN System redundancy NAP S2 (V1.11)

### Redundant – S7-1500R

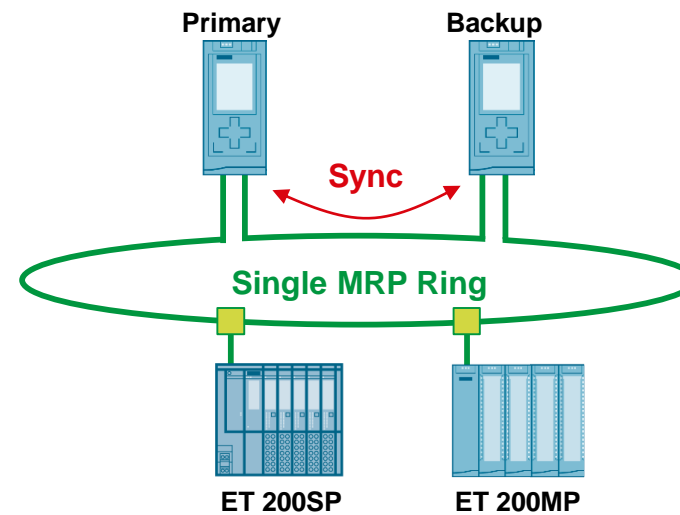

Max. 16 devices in ring\*)


### High Available – S7-1500H

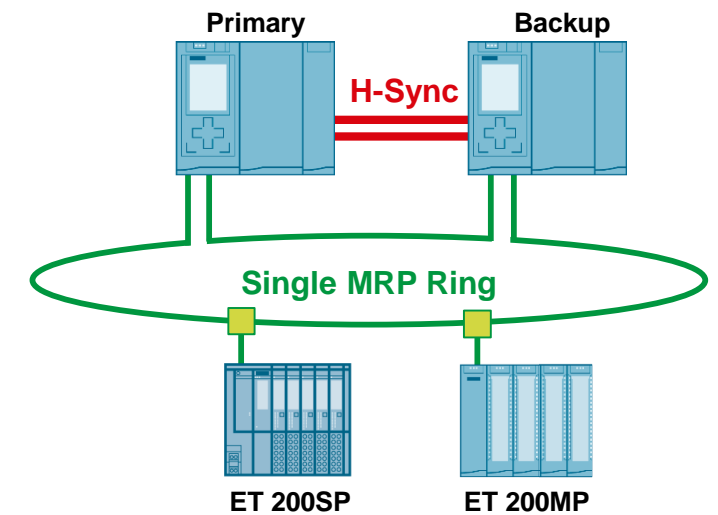

Max. 50 devices in ring\*)

# Network Configuration with S7-1500R/H

## Basic System Configuration for R-CPU

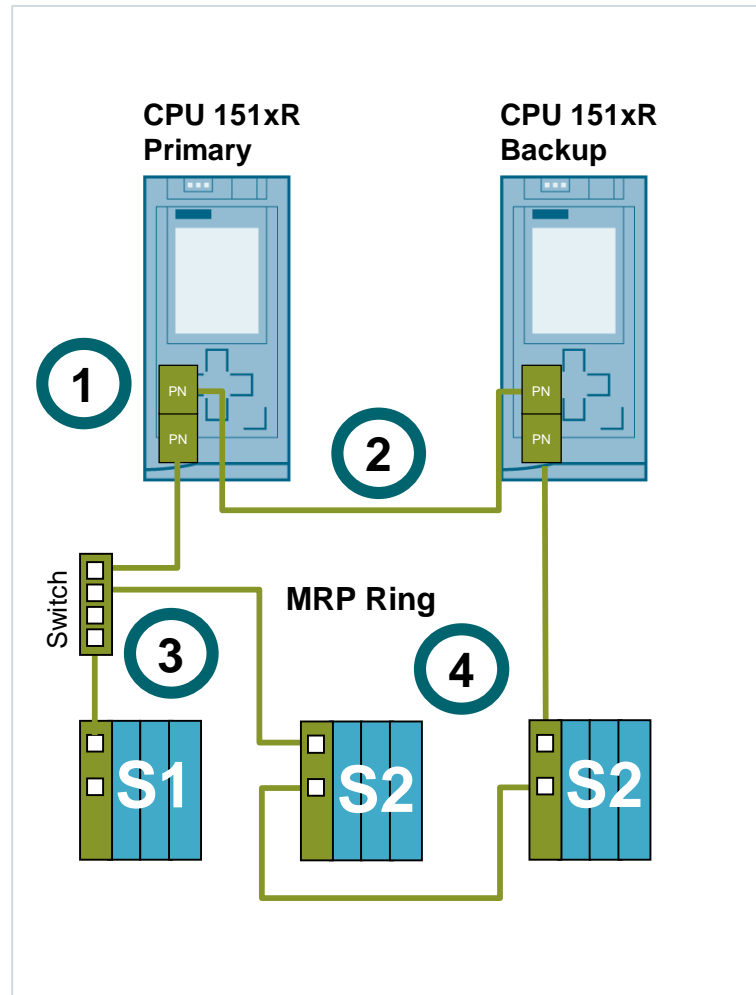

### Structure

- 1 MRP-Ring must be connected to the X1 - Port
- 2 Synchronization over PN-Ring – no device in this segment
- 3 S1 Devices should be connected via a switch to the ring<sup>1)</sup>
- 4 S2 Devices can be integrated into the ring or also separated with a switch

1) Reason: S1 devices do not forward H-sync telegrams during a MRP reconfiguration phase. This would lead to a high PLC cycle time in the case that segment 2 is interrupted.  
See chapter „H-Sync Forwarding“ in the system manual of S7-1500R/H for details.



# Network Configuration with S7-1500R

## Length of the synchronization connection




CPU 1513R  
CPU 1515R

Direct link up to 100 m




Fiber optic link  
(media converter) up to 3 km

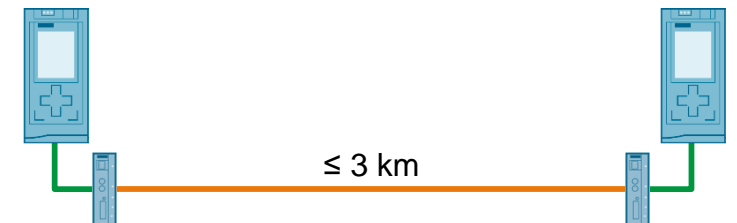

# Configuration example

## CPU 1515R

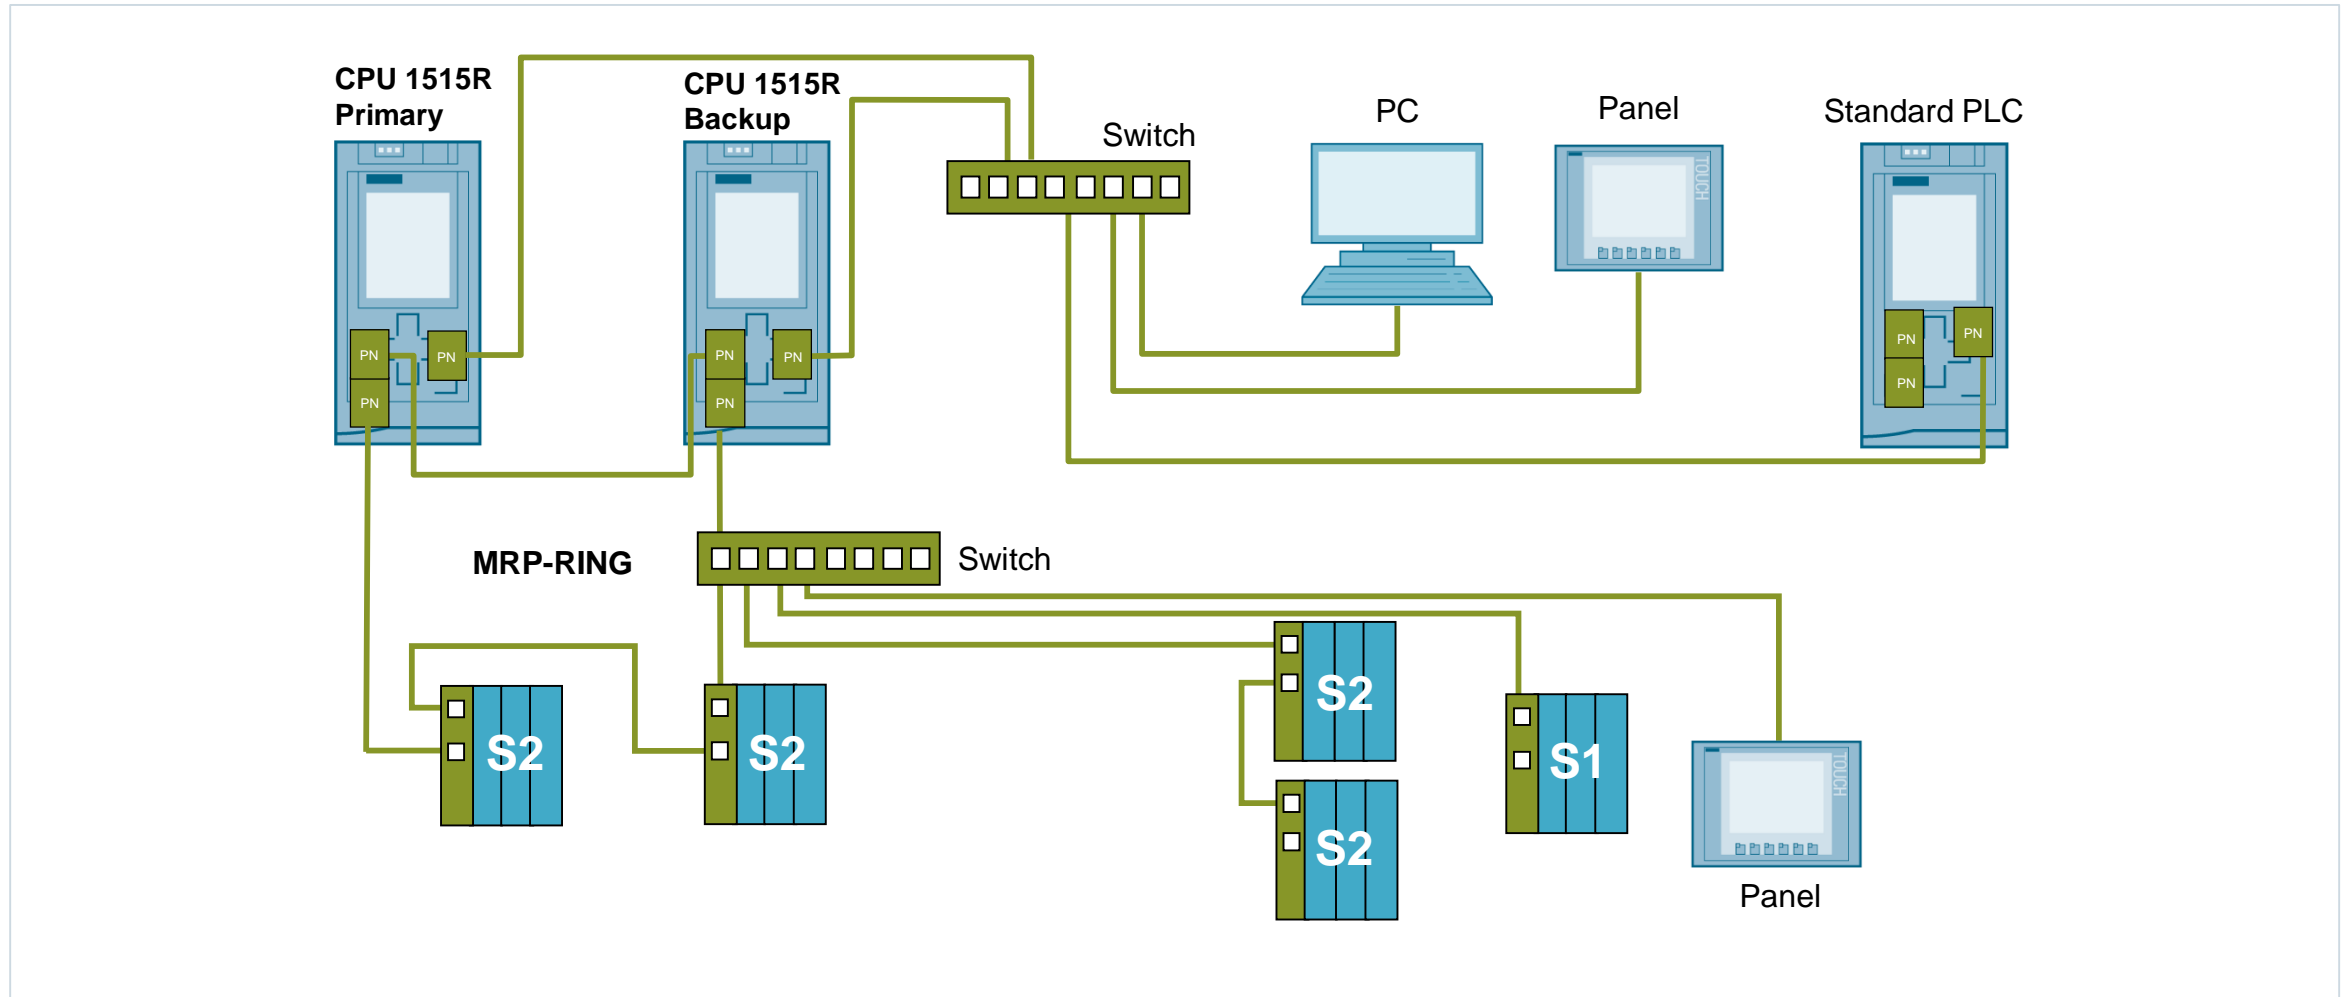

# Network Configuration with S7-1500H



## Length of the synchronization connection



CPU 1517H

Short distance Sync modules  
up to 10 Meter (LED)


Long distance Sync modules  
up to 10 km

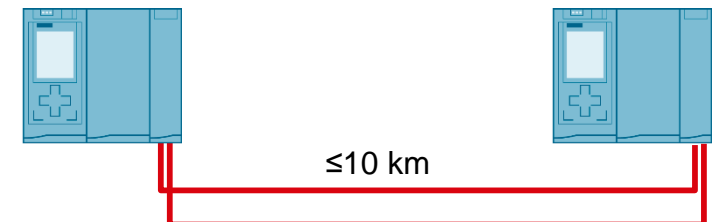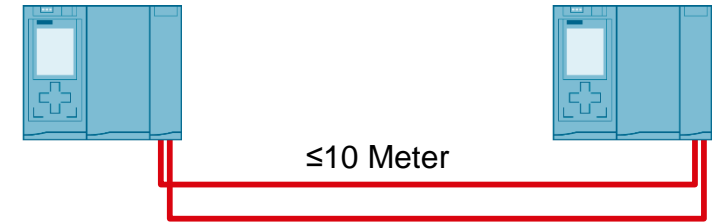

The sync cables are redundant.  
The loss of one fiber optic cable has no impact on the runtime behavior.

# Network Configuration with S7-1500H


## Basic System Configuration

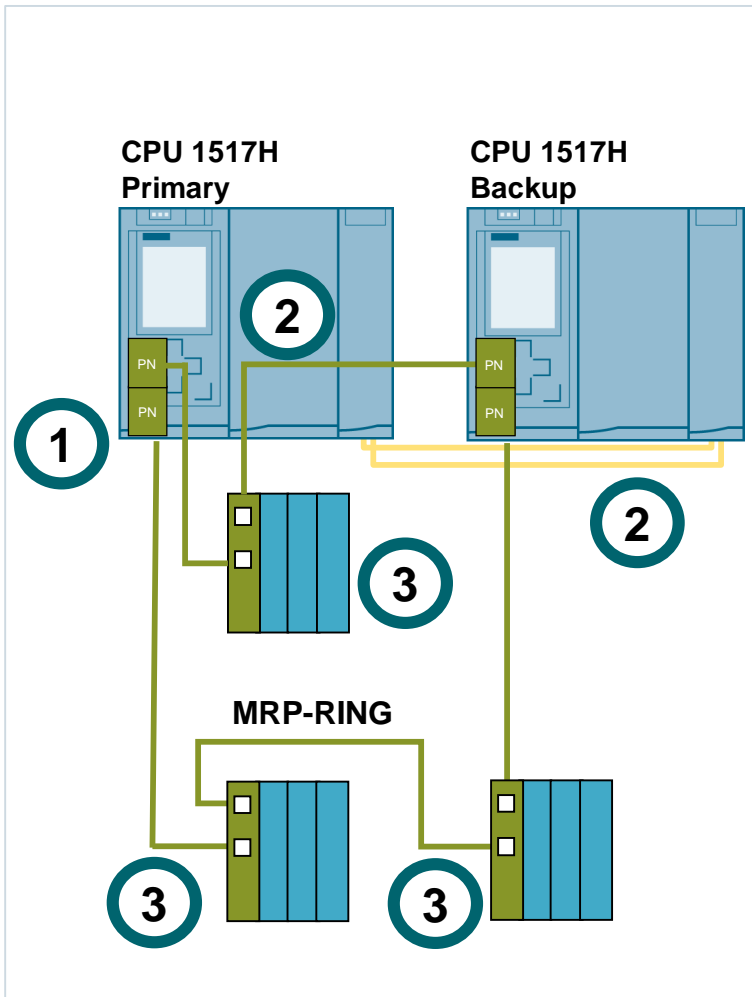

### Structure

- 1 MRP-Ring must be connected to X1 - Port
- 2 Synchronization over Sync-Modules – Device connection possible
- 3 S1 and S2 devices can be integrated into the MRP ring

# Configuration example SIMATIC S7-1500H CPU 1517H

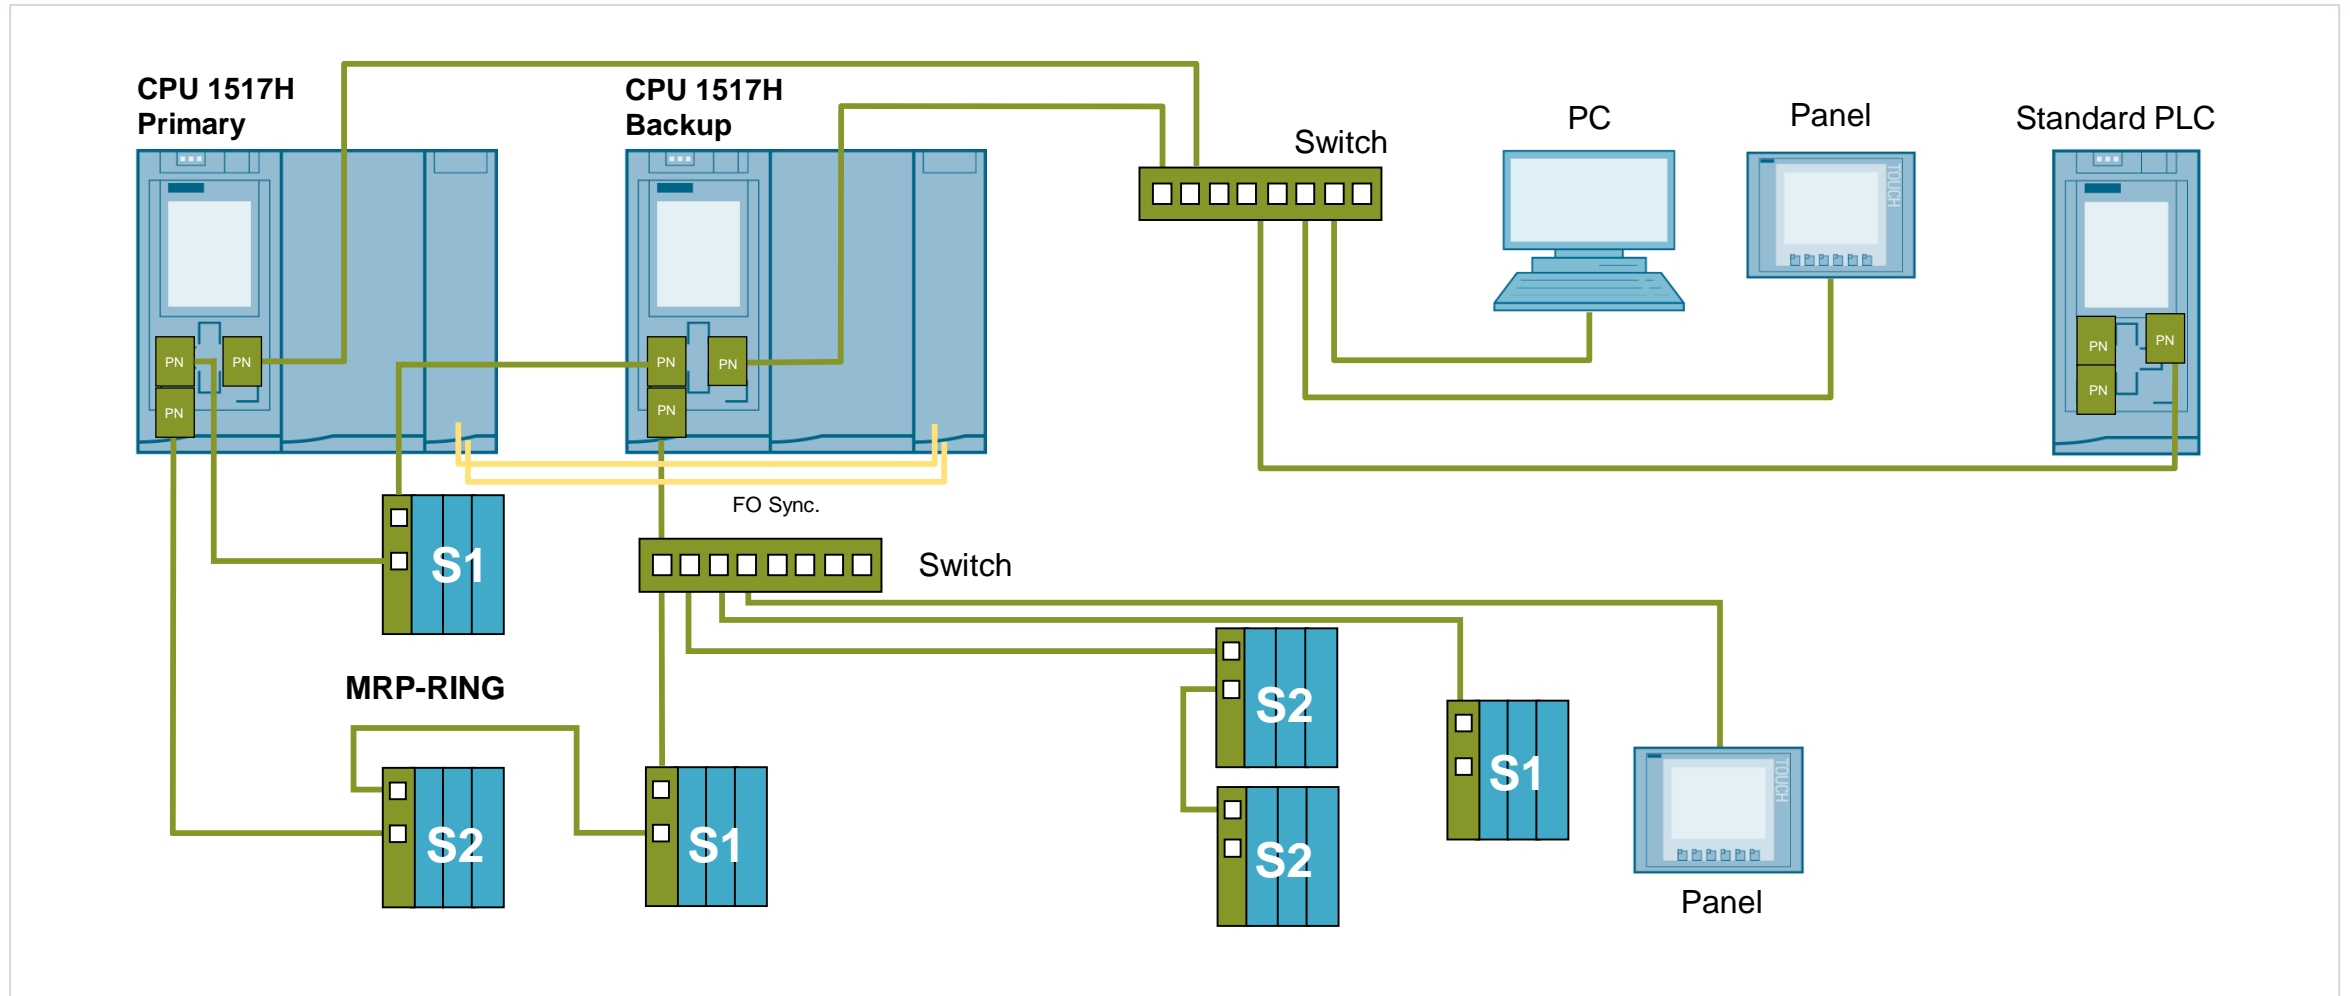



# SIMATIC S7-1500 Redundant Systems

- Motivation and Product Strategy
- System Overview
- **Add In and System Redundancy and Network Configuration**
- Communication
- S7-1500R/H and Safety
- HMI Connection
- Installation Recommendations
- New Features with TIA Portal V16
- Remaining Restrictions
- Ordering Information





# Engineering R/H System with TIA Portal Add-in

To connect a PROFINET device to a redundant system S7-1500R/H, it is necessary to set the correct watchdog time for each device. The S7-1500R/H AddIn, as a context menu function for each PN IO device connected to an R/H system, calculates the correct factor and updates it in the settings.

Free download: <https://support.industry.siemens.com/cs/ww/en/view/109769093>

Copy the add in into the folder  
.\Program Files\Siemens\Automation\Portal V1x\Add-Ins

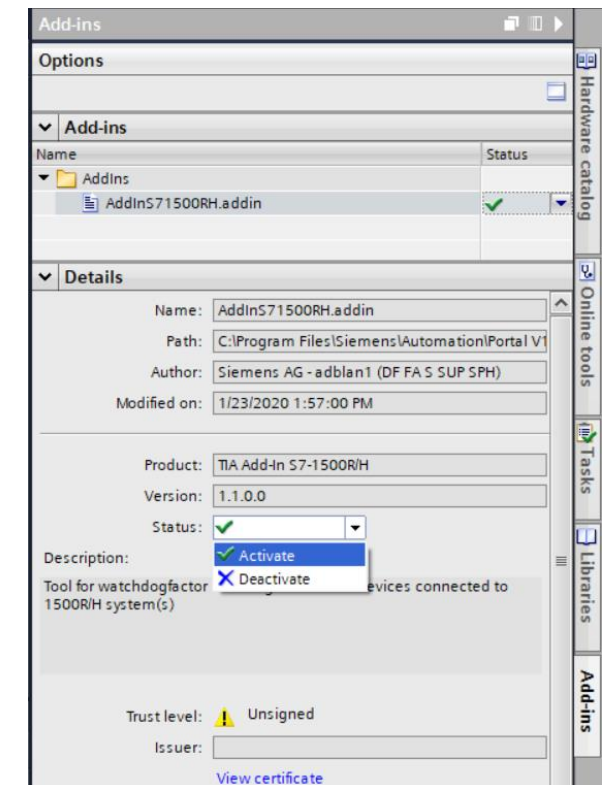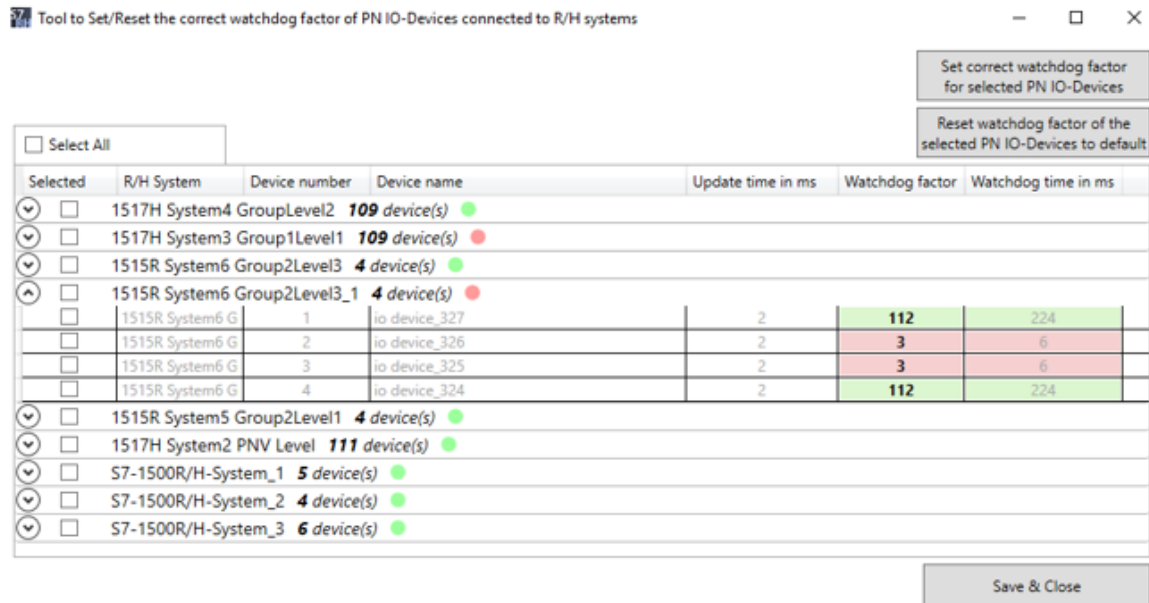


# R/H PROFINET Network configuration – Connectivity ET200 Stations

## Connectivity ET 200SP

Module func.	PtP Connections	Bus systems
3 Port IM Module	IO-Link Master	AS-I Master
Motorstarter	PtP / Modbus RTU	<ul style="list-style-type: none"> <li>• DALI</li> <li>• CAN</li> <li>• DMX512</li> </ul>
ET200AL System	HART	

## Connectivity ET 200MP

IO-Link Master
PtP / Modbus RTU
Configuration with active backplane possible
64 Channels are now available

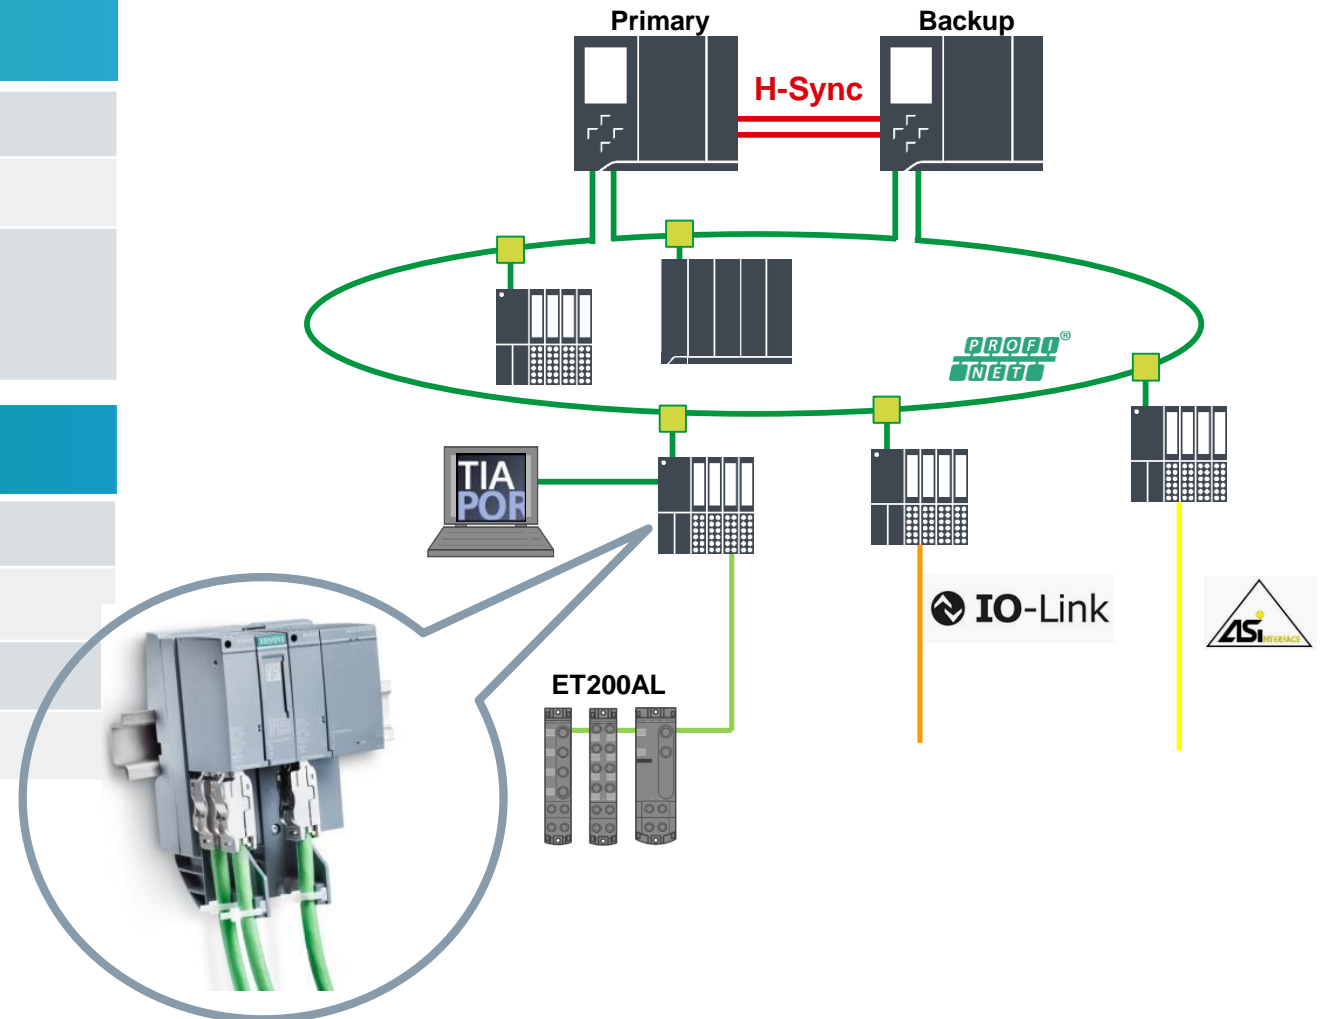


# SIMATIC S7-1500 / ET 200MP – New products

## Summary of 64-channel modules and active backplane bus




### High-channel modules (shifted to 08/2020)

New

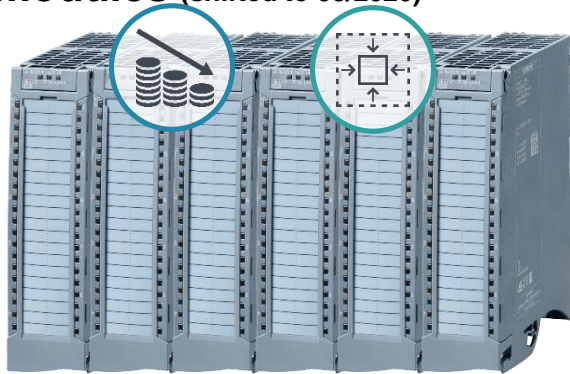

### Active backplane bus

New

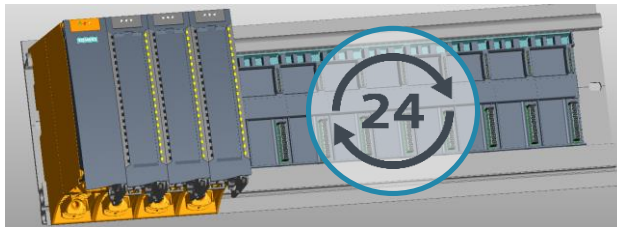

## Features / functions

### New high-channel ET 200MP modules

#### 64-channel digital modules:

- DI 64x24VDC BA (sinking/sourcing input)
- DQ 64x24VDC/0.3A BA
- DQ 64x24VDC/0.3A SNK BA (sinking output)
- DI 32x24VDC/DQ 32x24VDC/0.3A SNK BA

### Active backplane bus / hot swapping

Hot swapping (module replacement during runtime of the CPU) is possible also with multiple modules through the use of the active backplane bus for the ET 200MP. Up to **12** S7-1500 / ET 200MP modules can be inserted per station.

## Benefits

- **Optimum price-performance solution** for price-sensitive applications
- **Very small footprint** due to greatest possible channel density
- **Time savings** during installation due to toolless mounting of shielding and TOP Connect

**Maximum machine/plant availability** because the CPU and unaffected modules remain in operation during failure and replacement of one or more modules.

# 64-channel digital modules

## Overview




Type	Article number
DI 64x24VDC SNC/SRC BA	6ES7 521-1BP00-0AA0
DQ 64x24VDC/0.3A BA	6ES7 522-1BP00-0AA0
DQ 64x24VDC/0.3A SNK BA	6ES7 522-1BP50-0AA0
DI 32 / DQ 32 x24VDC/0.3A SNK BA	6ES7 523-1BP50-0AA0



# Network Configuration with S7-1500R/H

## Connection of PROFINET Devices


### S2 and S1 Devices can be connected

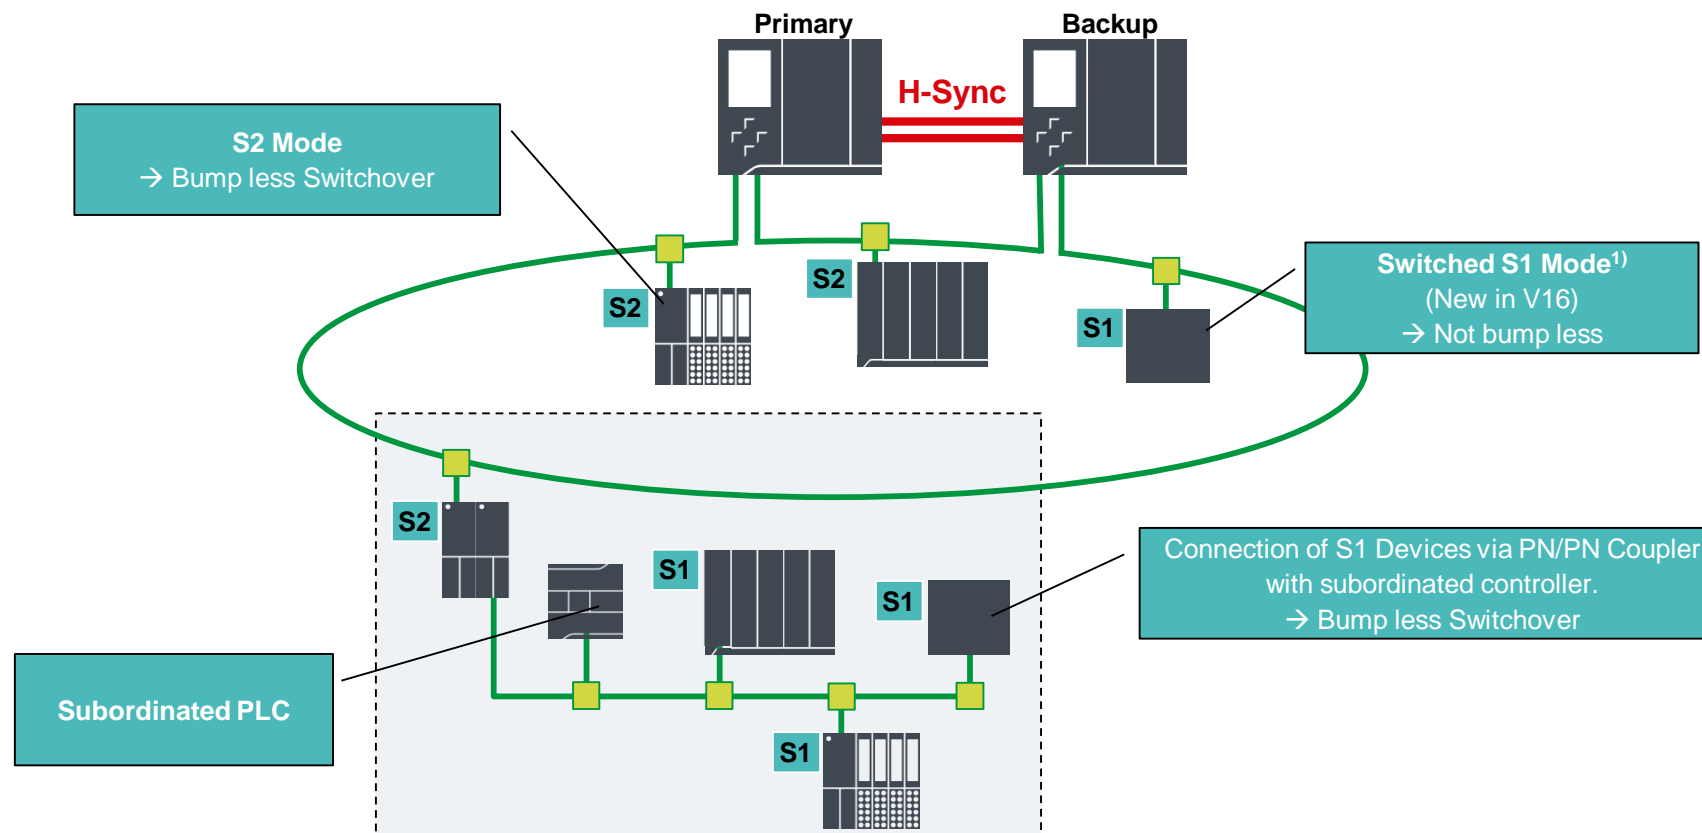

# Network Configuration with S7-1500R/H

## Connection of Subordinated Controller


### New in V16: Connection without PN/PN coupler is possible

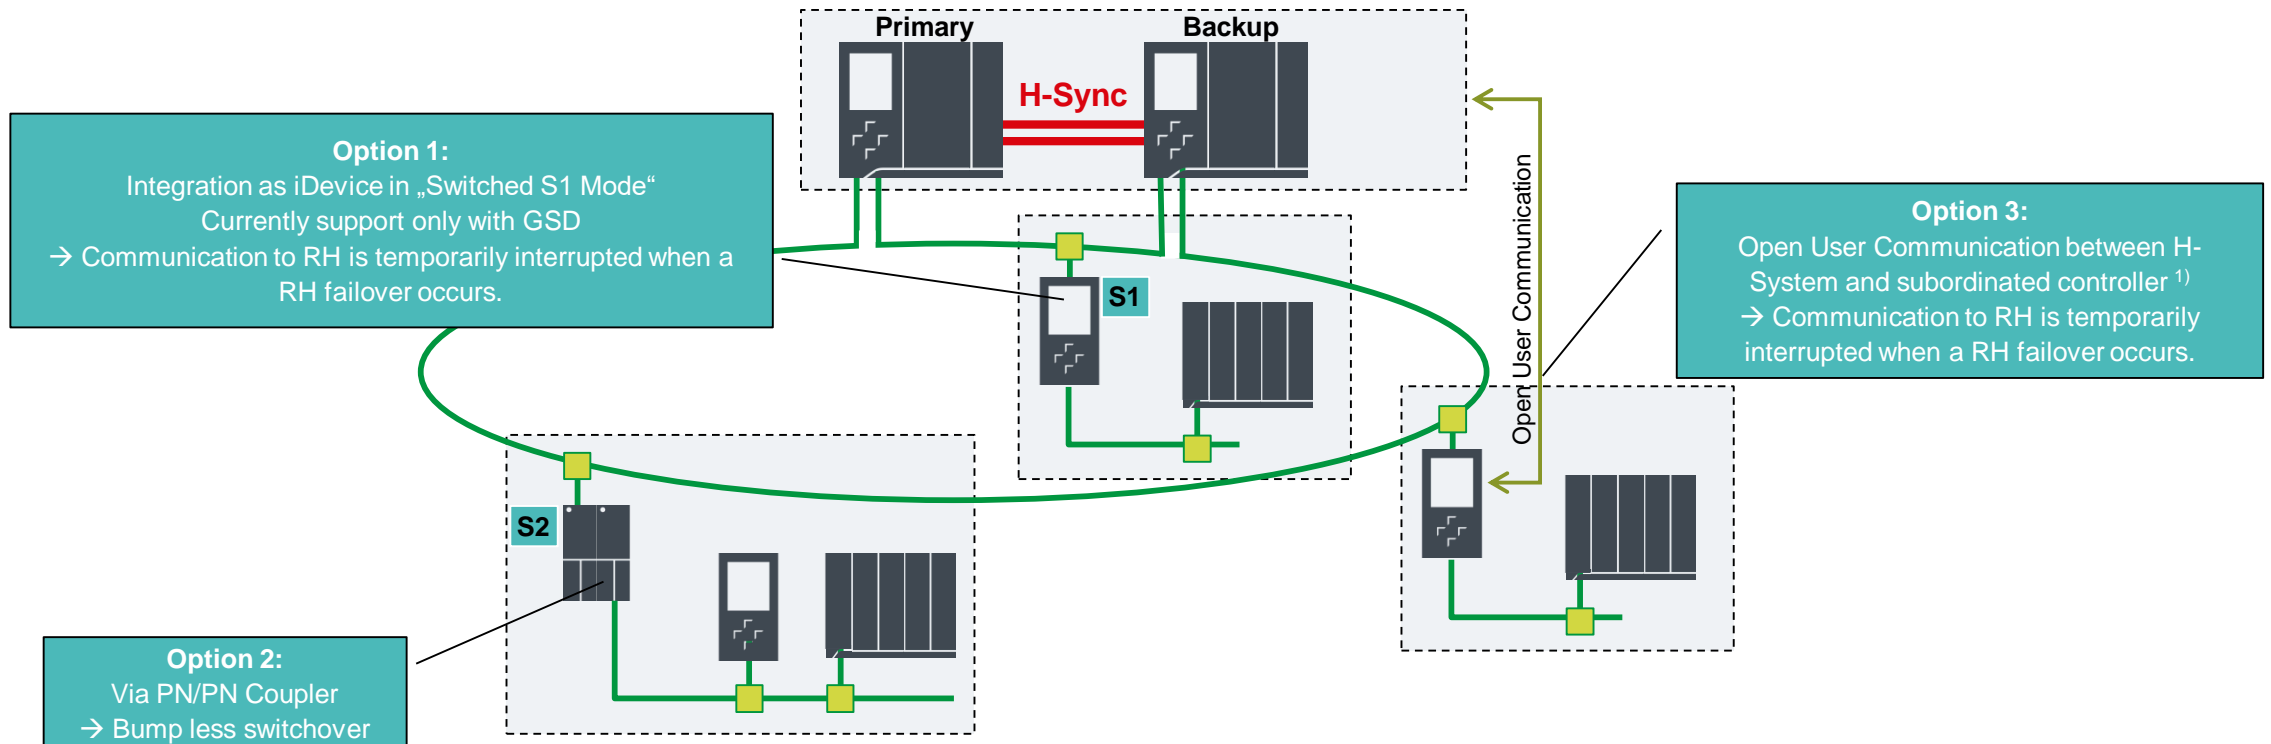

# Network Configuration with S7-1500R/H

## Connection of PROFIBUS DP Slaves

### New in V16: Connection without PN/PN coupler is possible

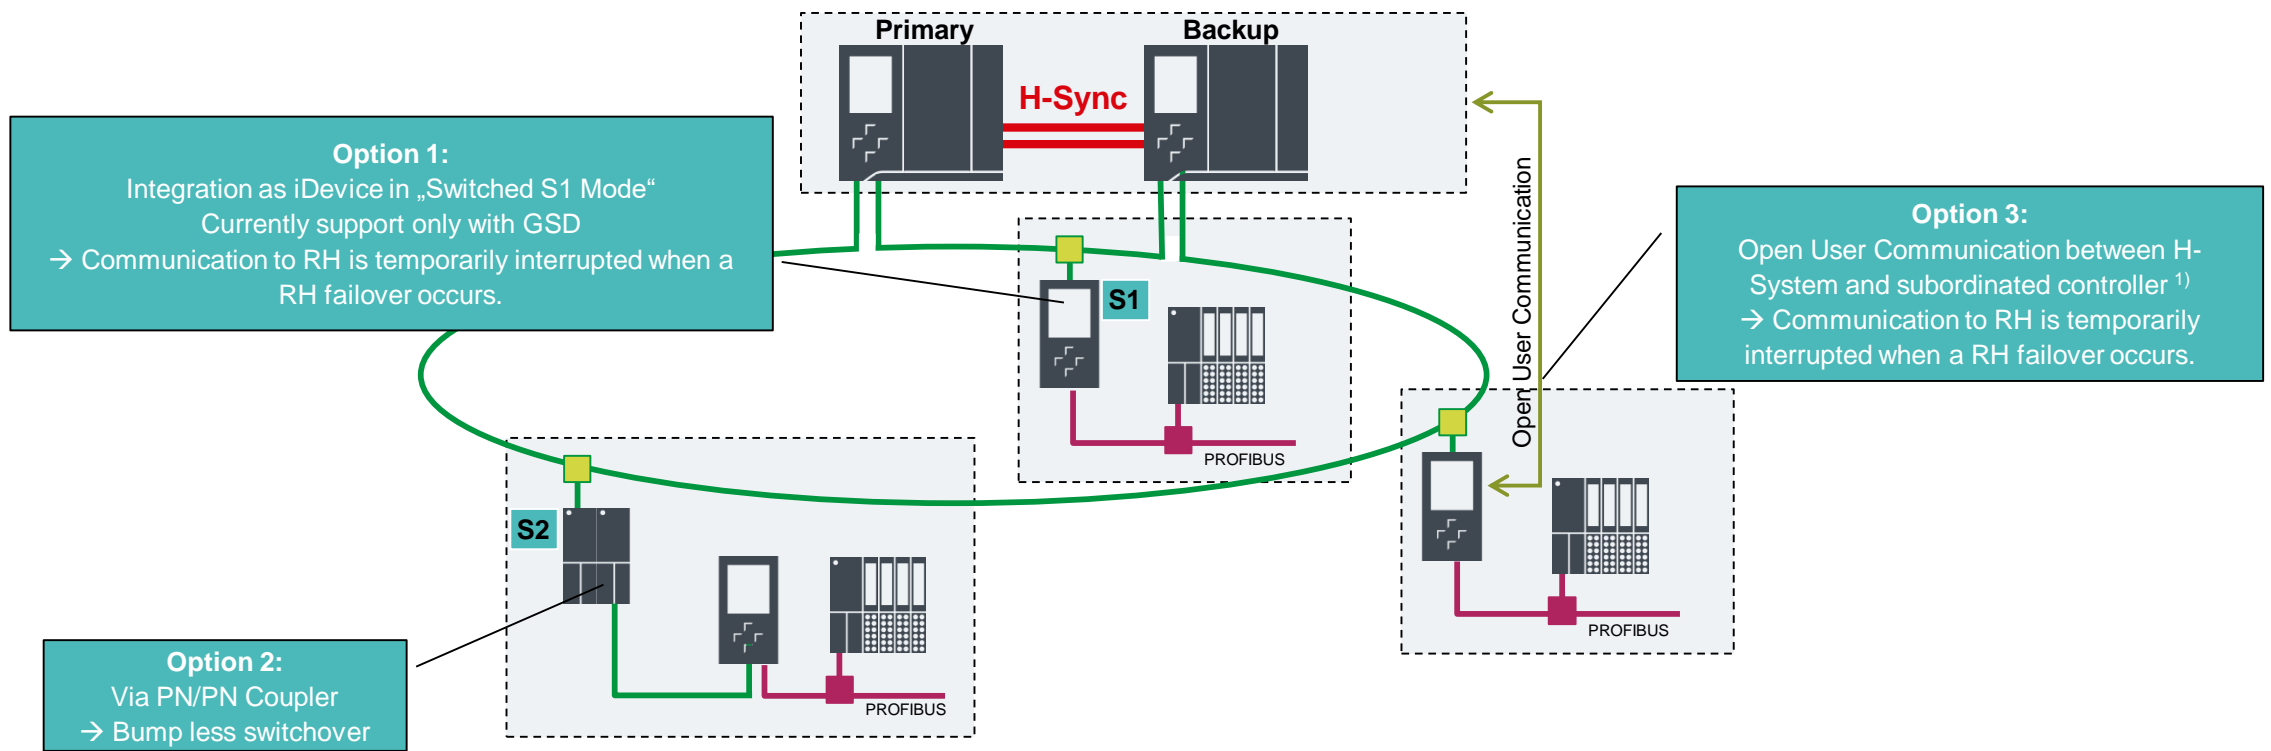


Please note: IE/PB Link and IE/PB LINK HA are currently not supported



# Network Configuration with S7-1500R/H

## Network connections

As a stitch over a switch into the ring

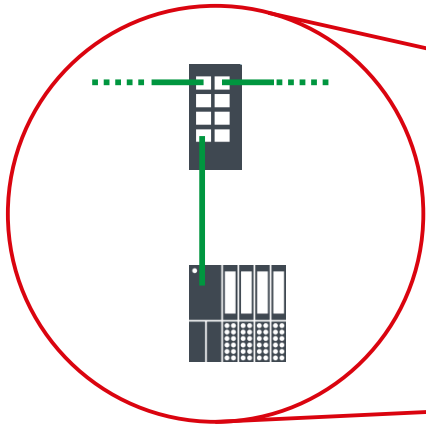

As part of the ring

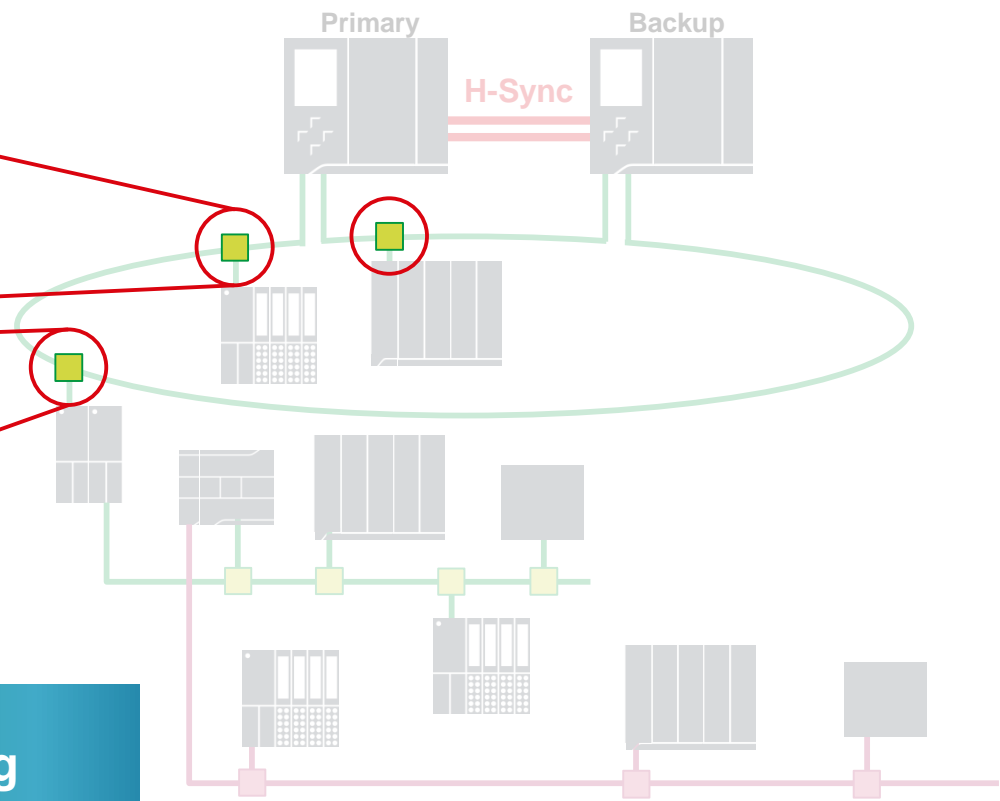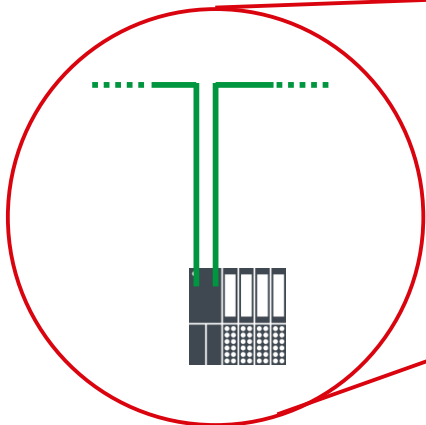





# SIMATIC S7-1500 Redundant Systems

- Motivation and Product Strategy
- System Overview
- Add In and System Redundancy and Network Configuration
- Communication
- S7-1500R/H and Safety
- HMI Connection
- Installation Recommendations
- New Features with TIA Portal V16
- Remaining Restrictions
- Ordering Information




# SIMATIC S7-1500 Redundant Systems


- Motivation and Product Strategy
- System Overview
- Add In and System Redundancy and Network Configuration
- **Communication**
- **S7-1500R/H and Safety**
- **HMI Connection**
- Installation Recommendations
- New Features with TIA Portal V16
- Remaining Restrictions
- Ordering Information



# Communication

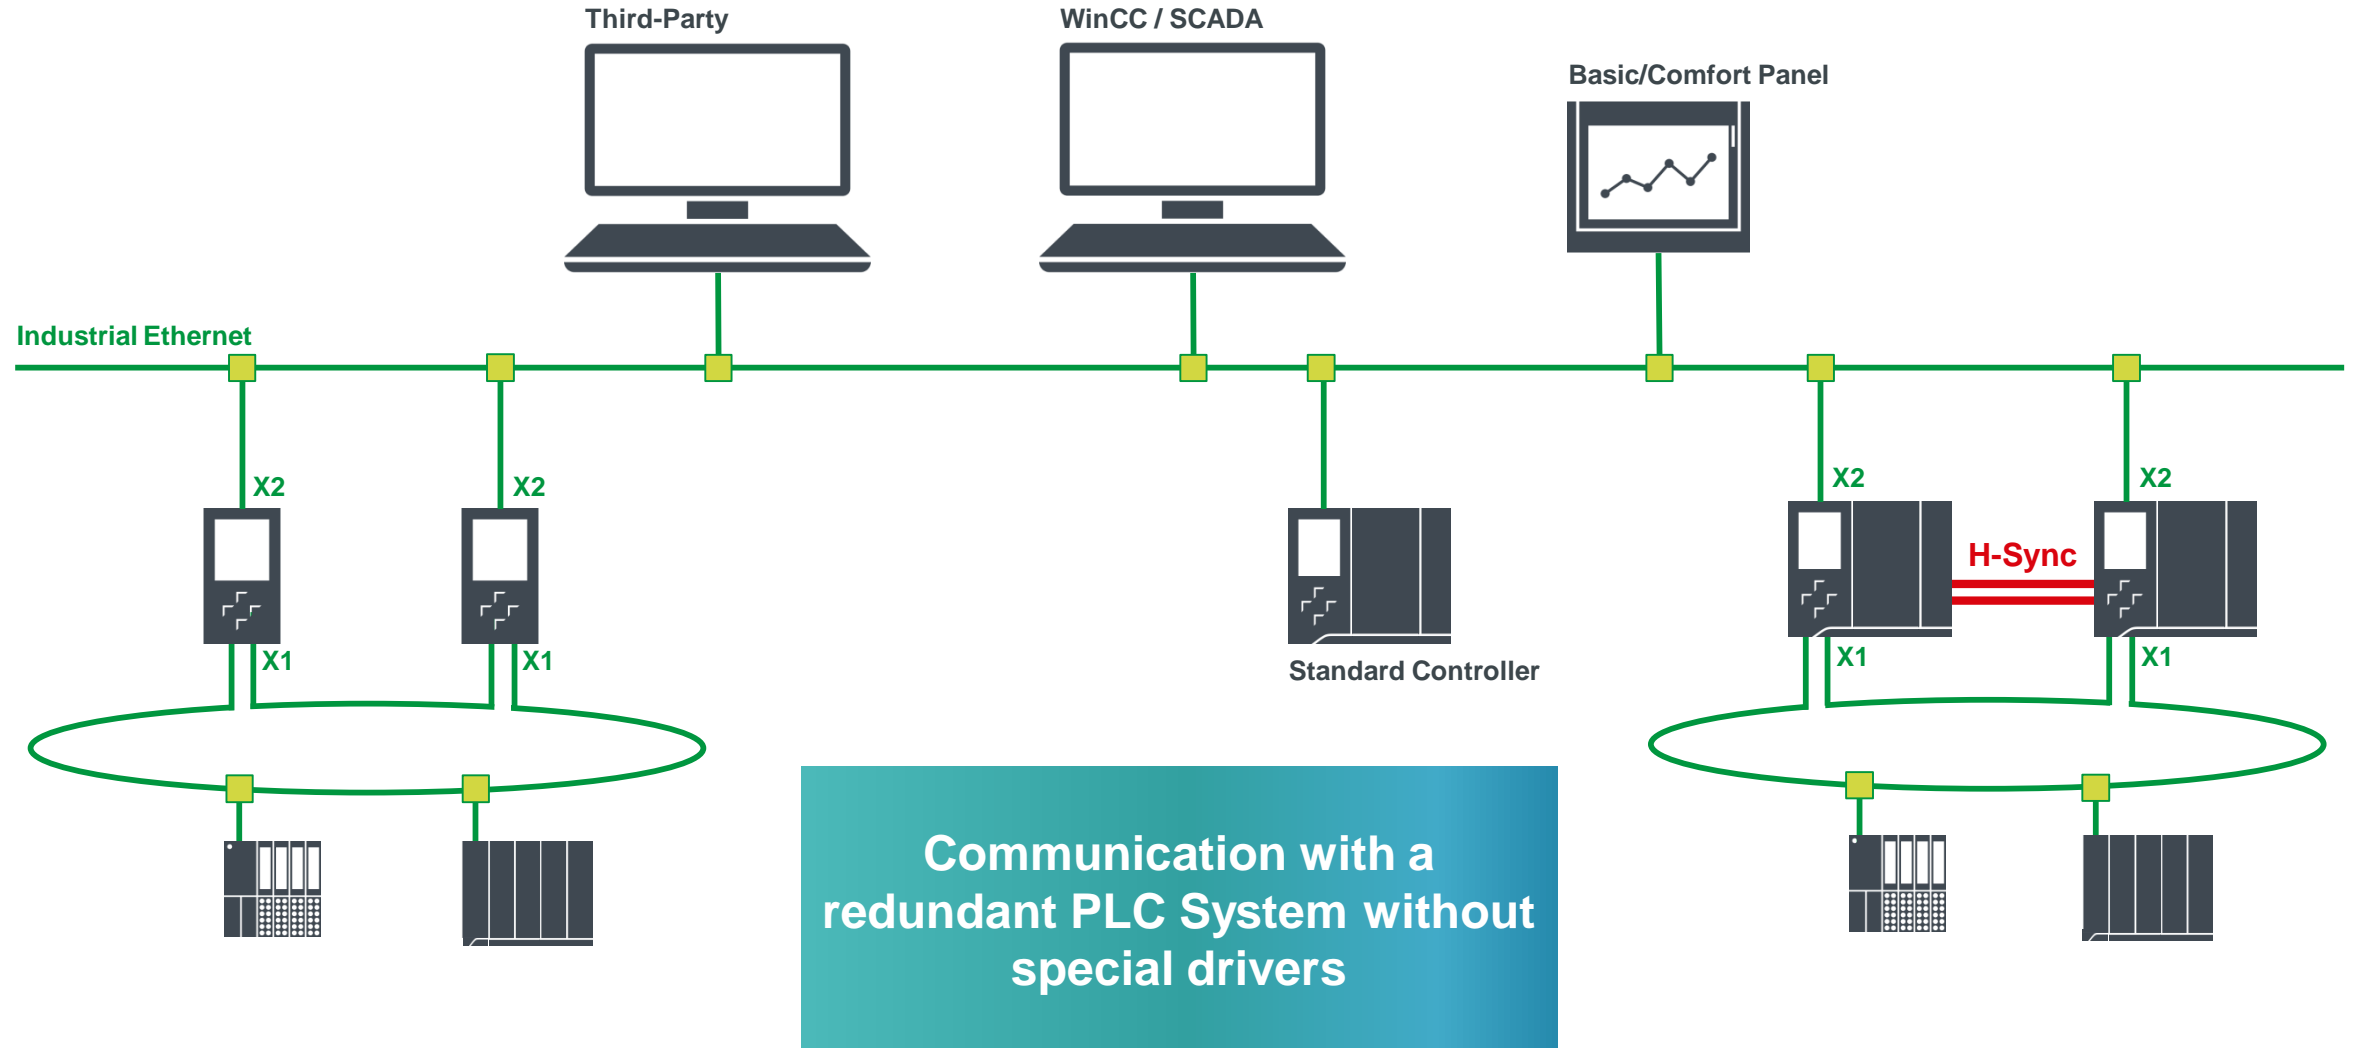


# Communication System IP-Address

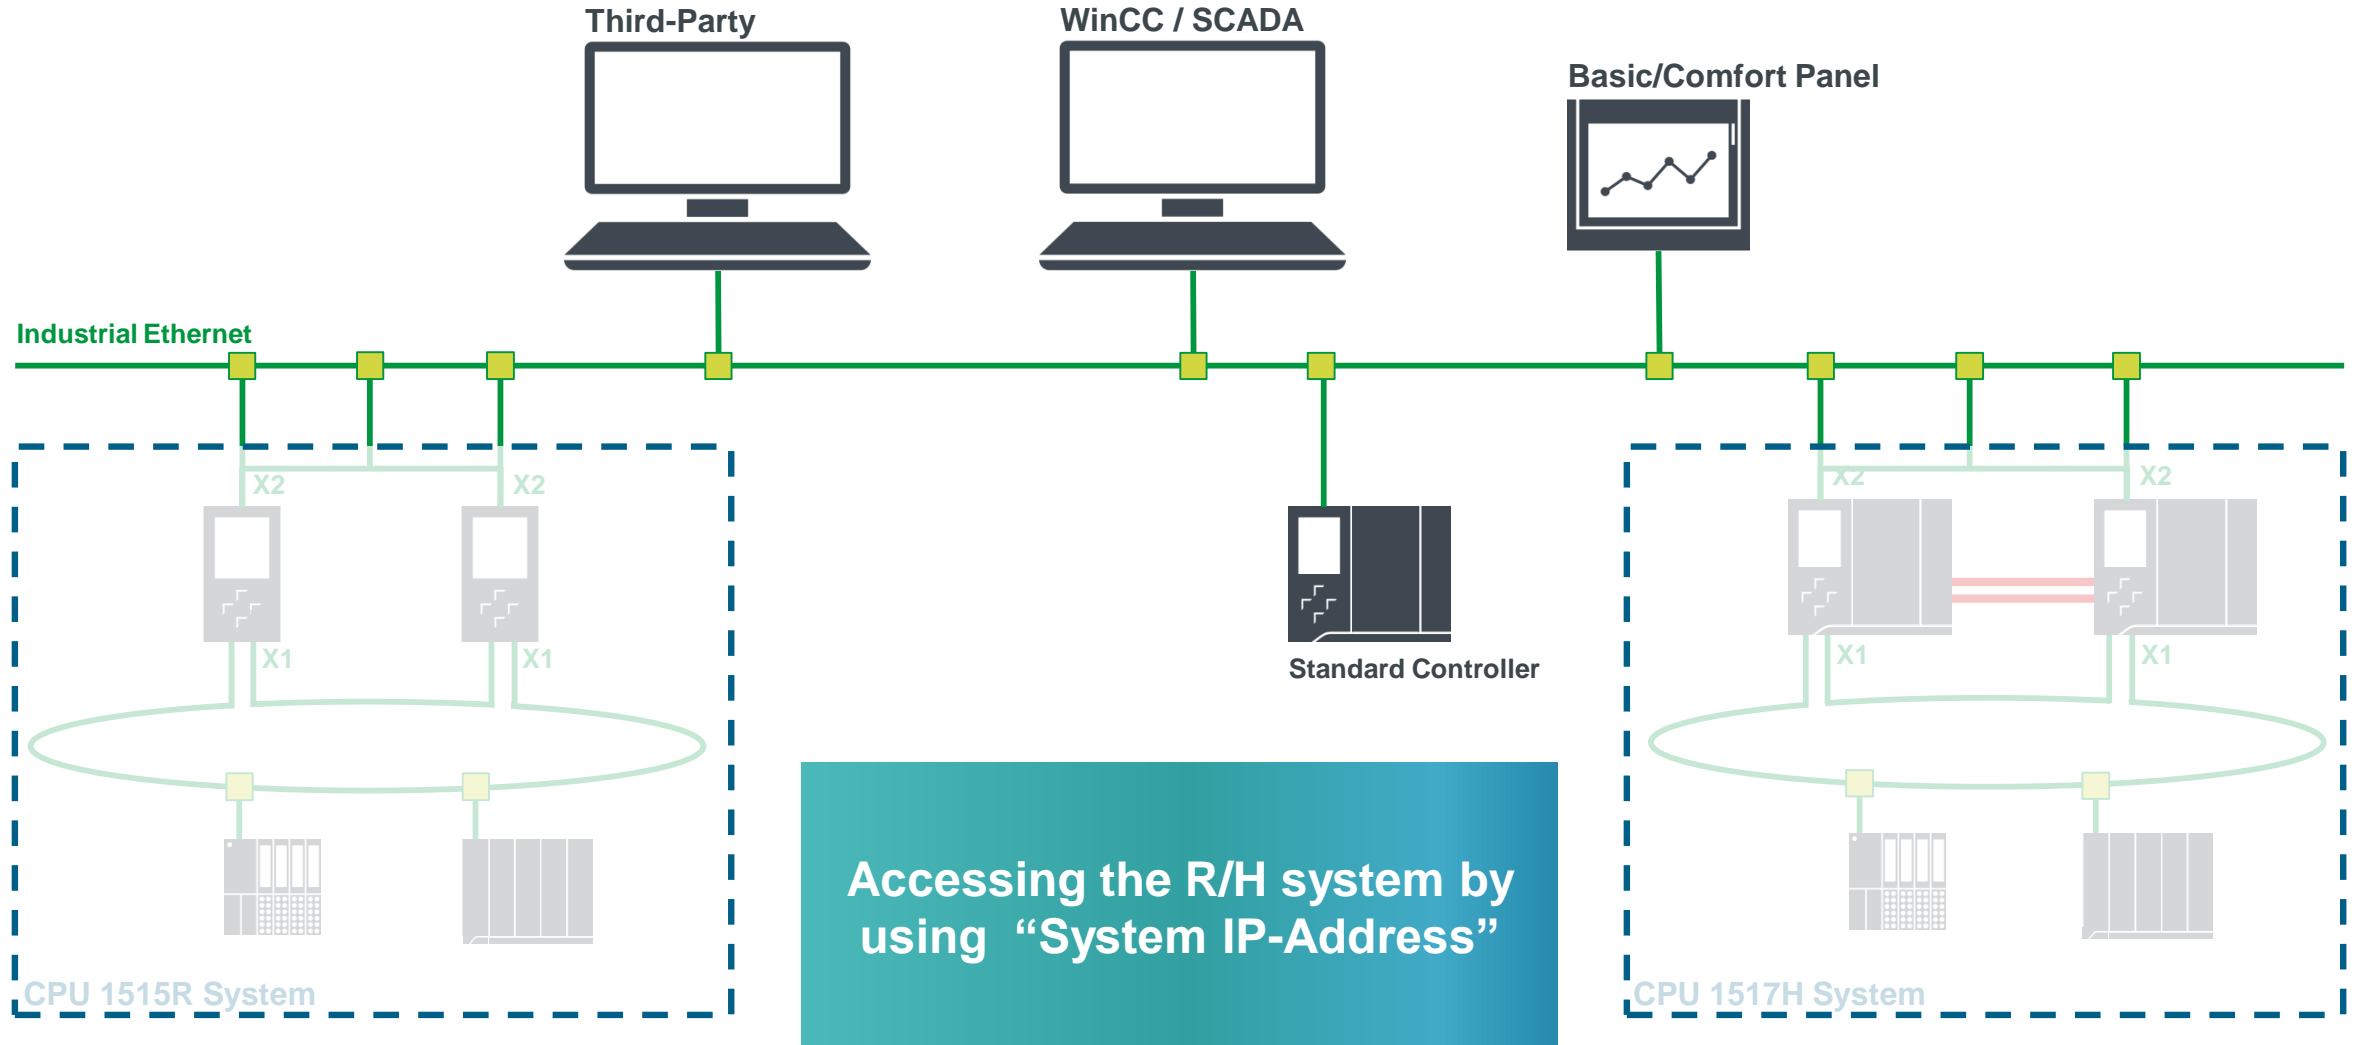

# Communication System IP-Address

## Using System IP instead of PLC interface IP


- Transparent communication between standard PLC and R/H-System
- The standard communication partner is automatically connected to the primary PLC

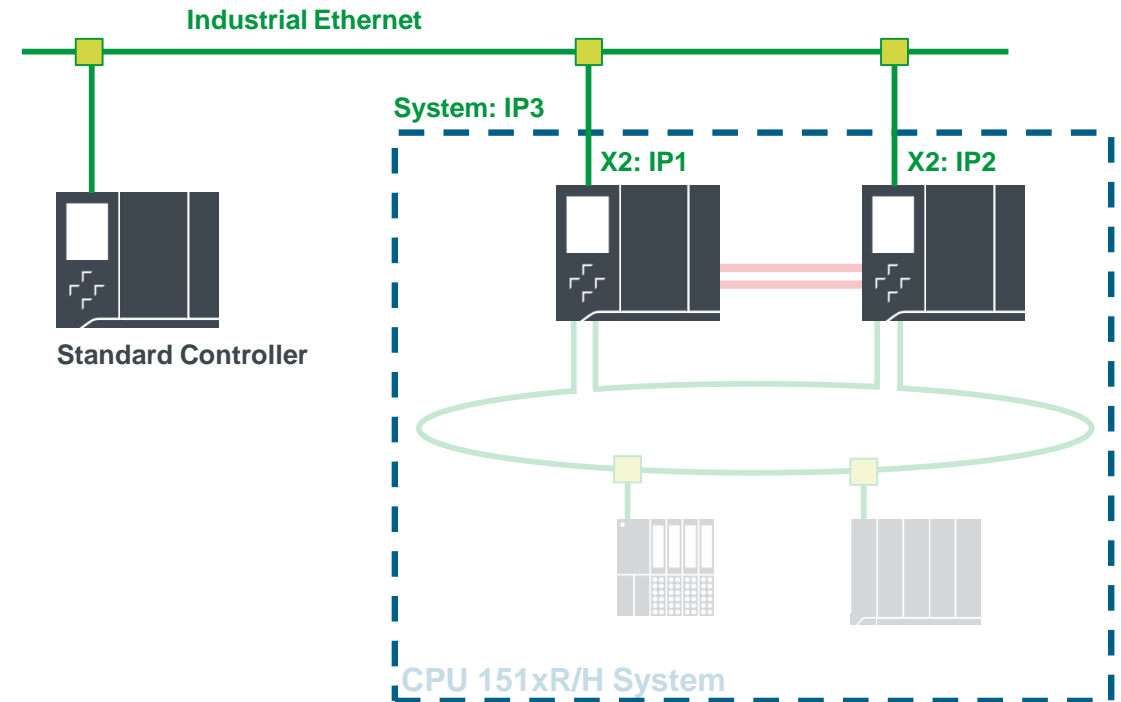

# Communication System IP-Address

## Using System IP instead of PLC interface IP

- Transparent communication between standard PLC and R/H-System
- The standard communication partner is automatically connected to the primary PLC

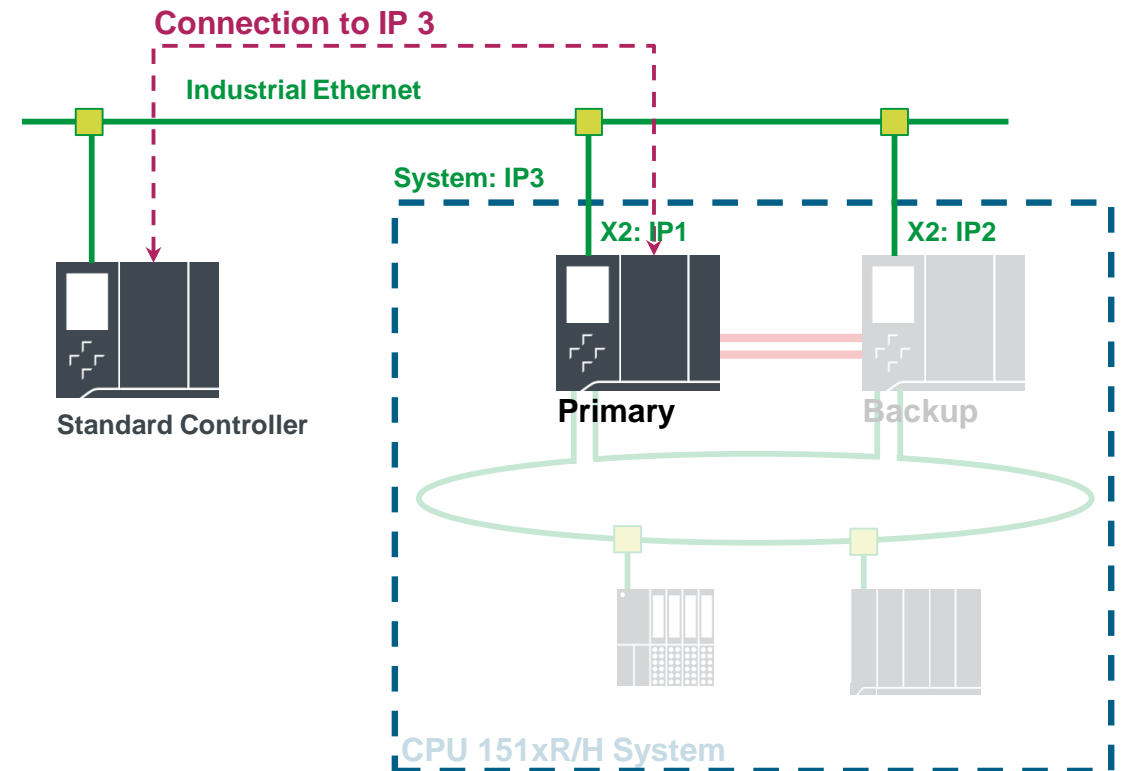




# Communication System IP-Address – Switching Primary


## Using System IP instead of PLC interface IP

- Transparent communication between standard PLC and R/H-System
- The standard communication partner is automatically connected to the primary PLC

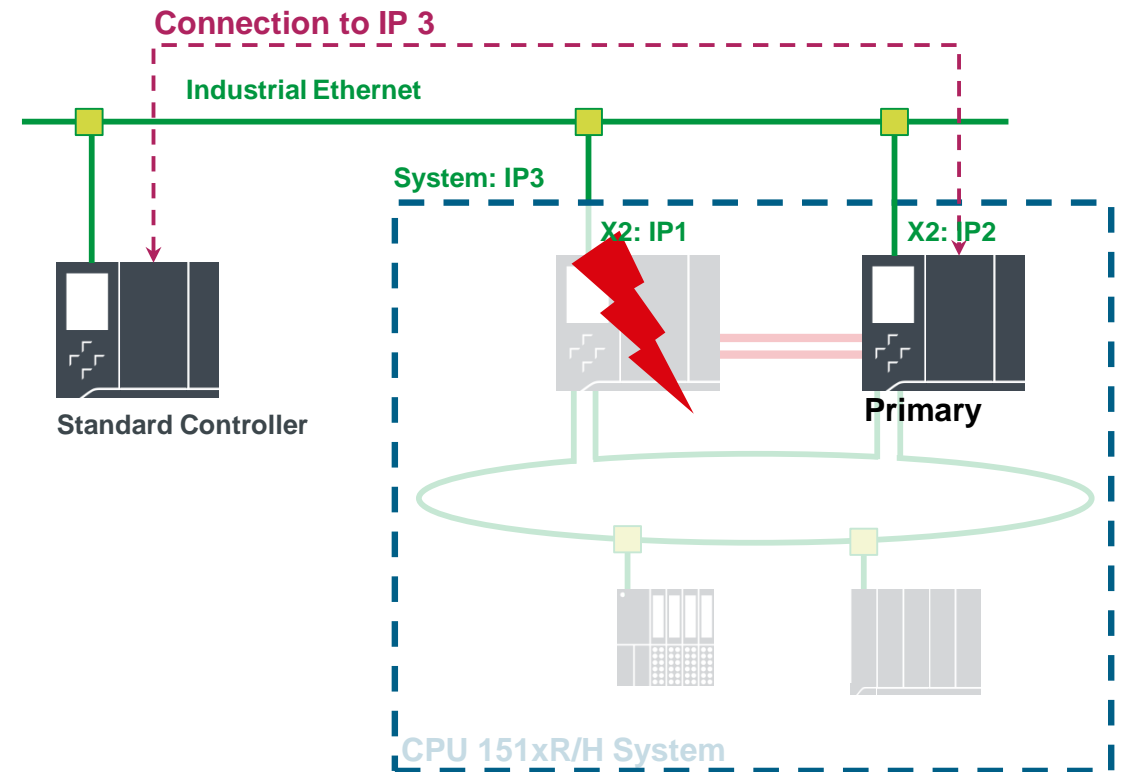


# Network Configuration with S7-1500R/H Safety Devices

Safety Devices can be integrated via subordinated F-Controller

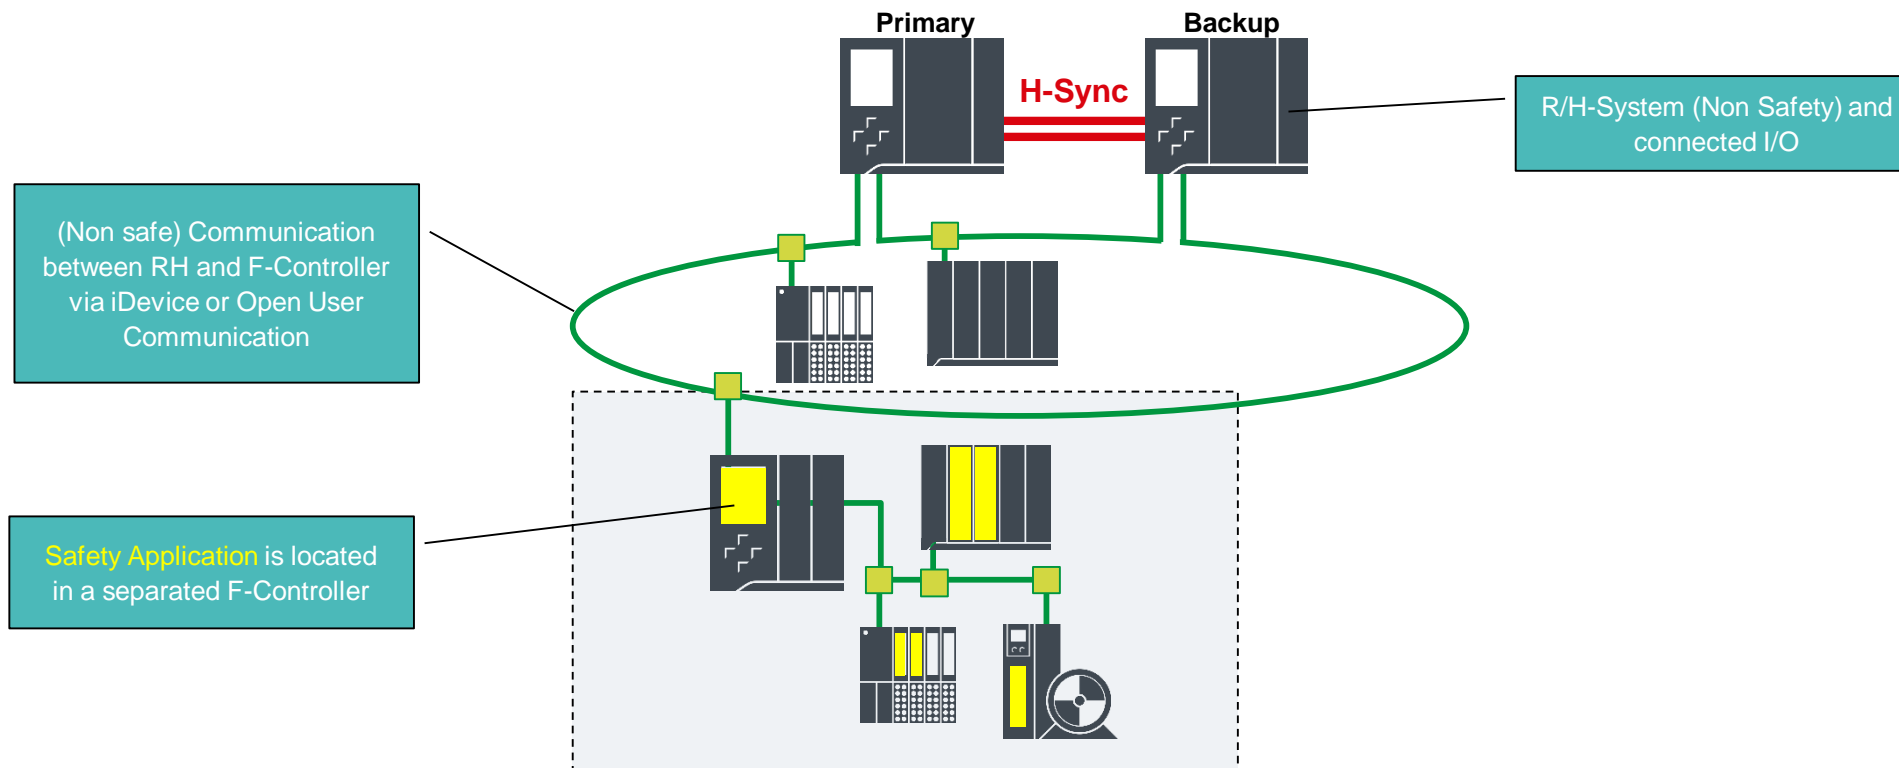


# Network Configuration with S7-1500R/H Safety Devices


Safety Devices can be integrated via subordinated F-Controller and PN/PN Coupler

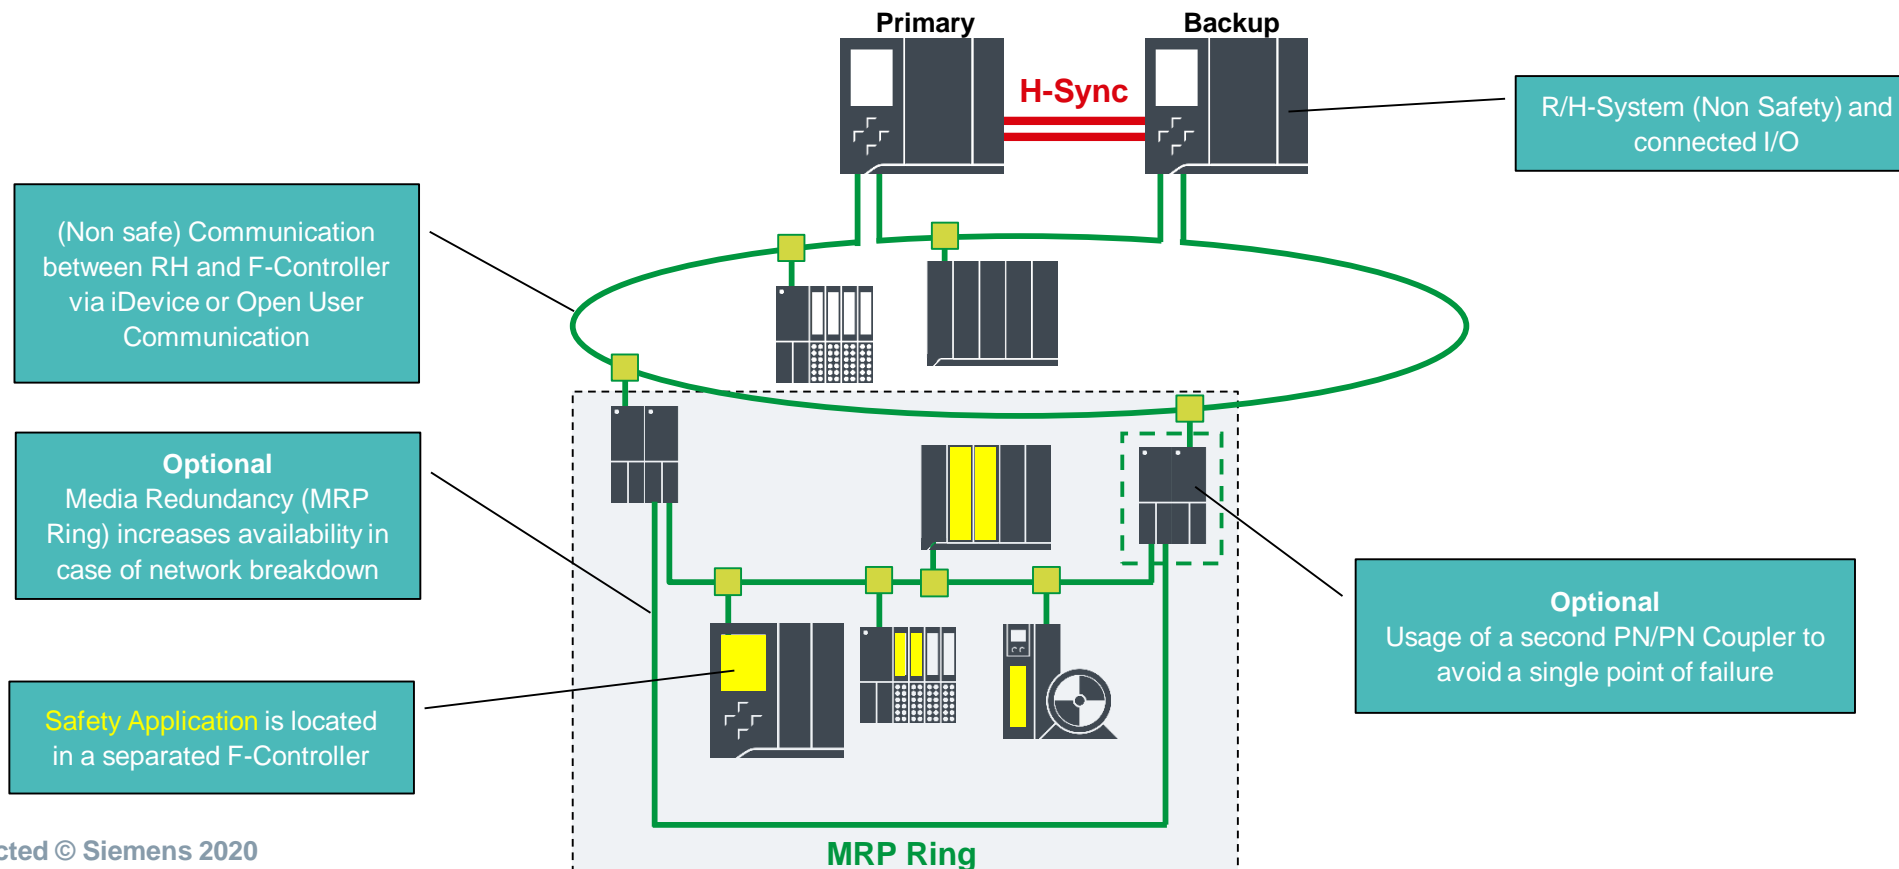

# HMI Connection via 1 Network (Ring or Line)

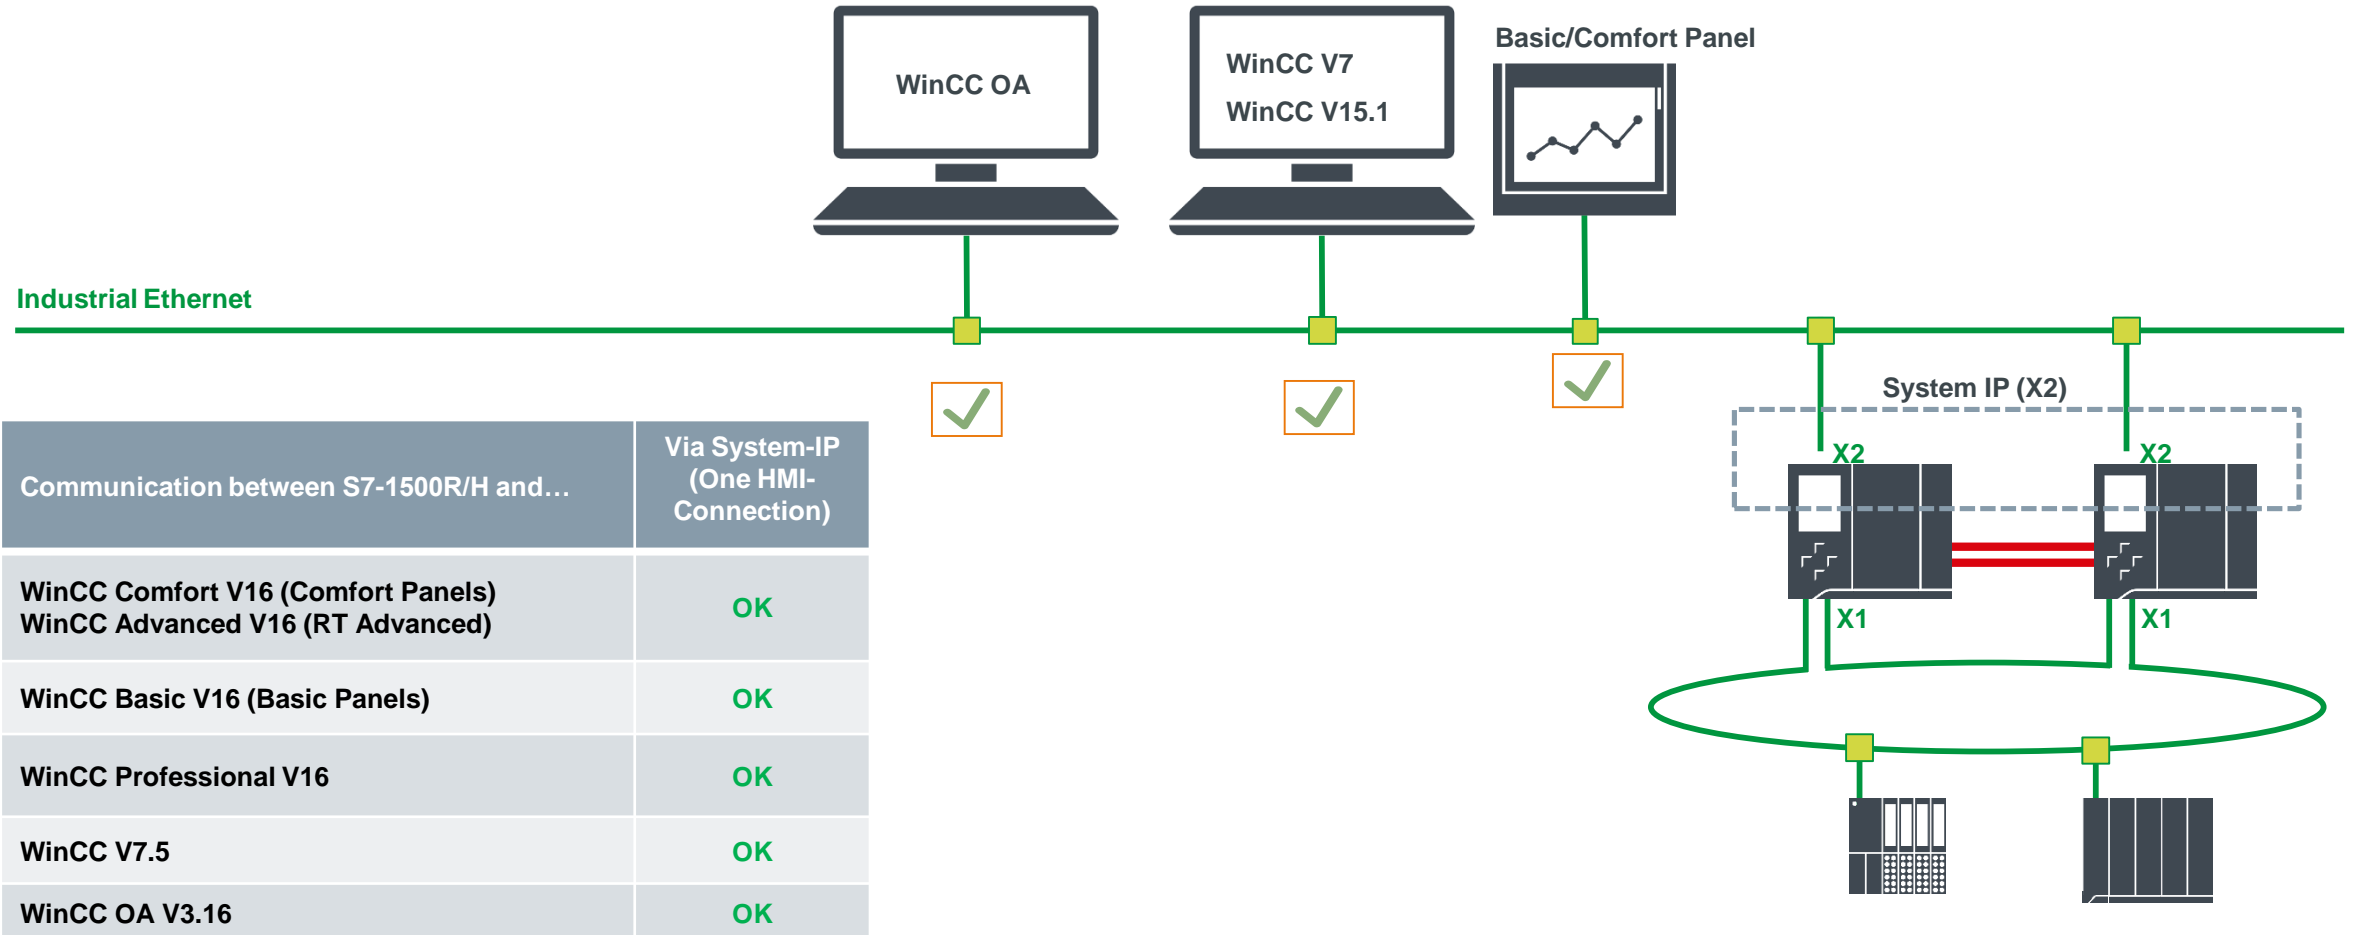


# HMI Connection via 1 Network (Ring or Line)

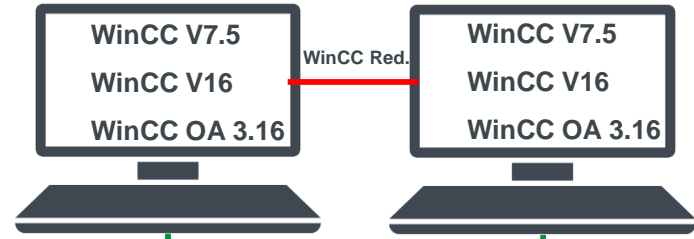

Industrial Ethernet



Communication between S7-1500R/H and...	Via System-IP (One HMI-Connection)
WinCC Professional V16	OK
WinCC V7.5	OK
WinCC OA 3.16	OK

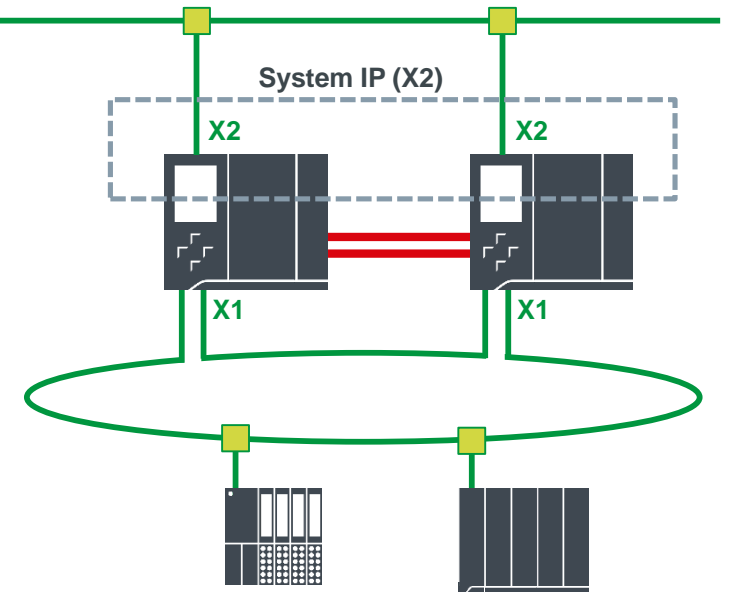


# SIMATIC S7-1500 Redundant Systems

- Motivation and Product Strategy
- System Overview
- Add In and System Redundancy and Network Configuration
- Communication
- S7-1500R/H and Safety
- HMI Connection
- **Installation Recommendations**
- New Features with TIA Portal V16
- Remaining Restrictions
- Ordering Information




# Installation Recommendations for CPU 1513R-1 PN

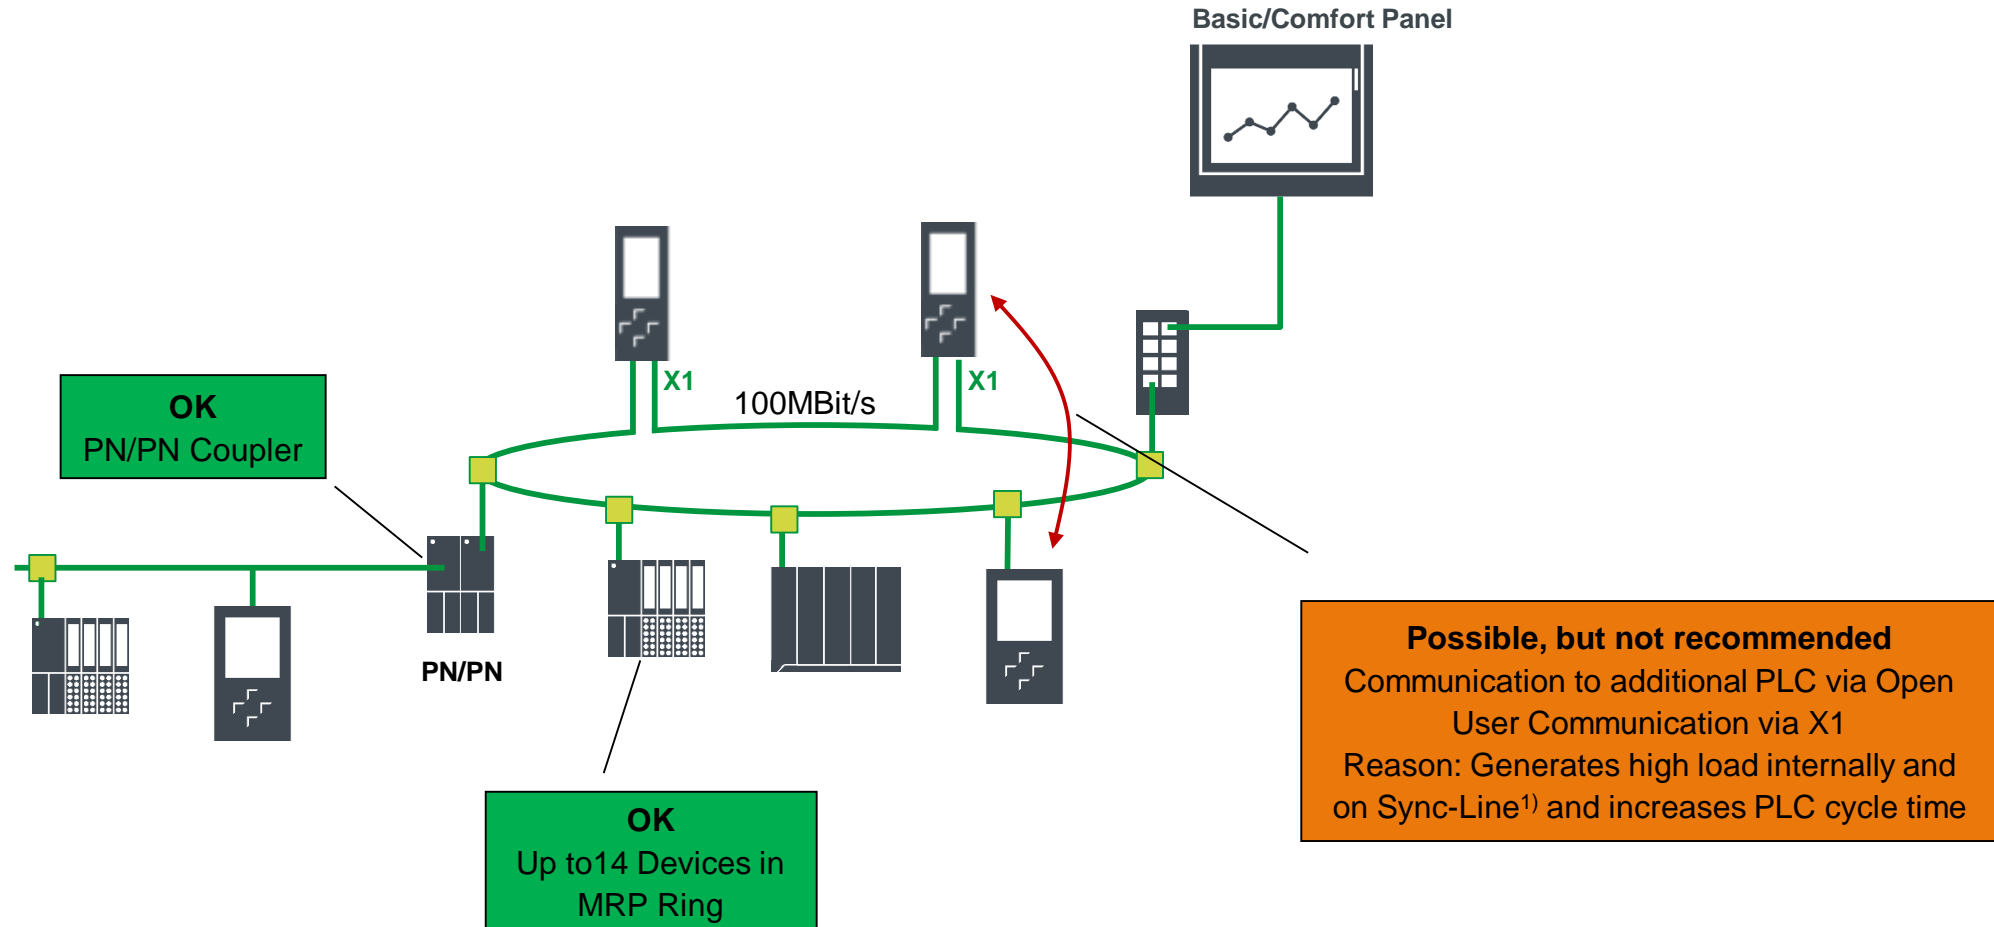





# Installation Recommendations for CPU 1517H-3 PN

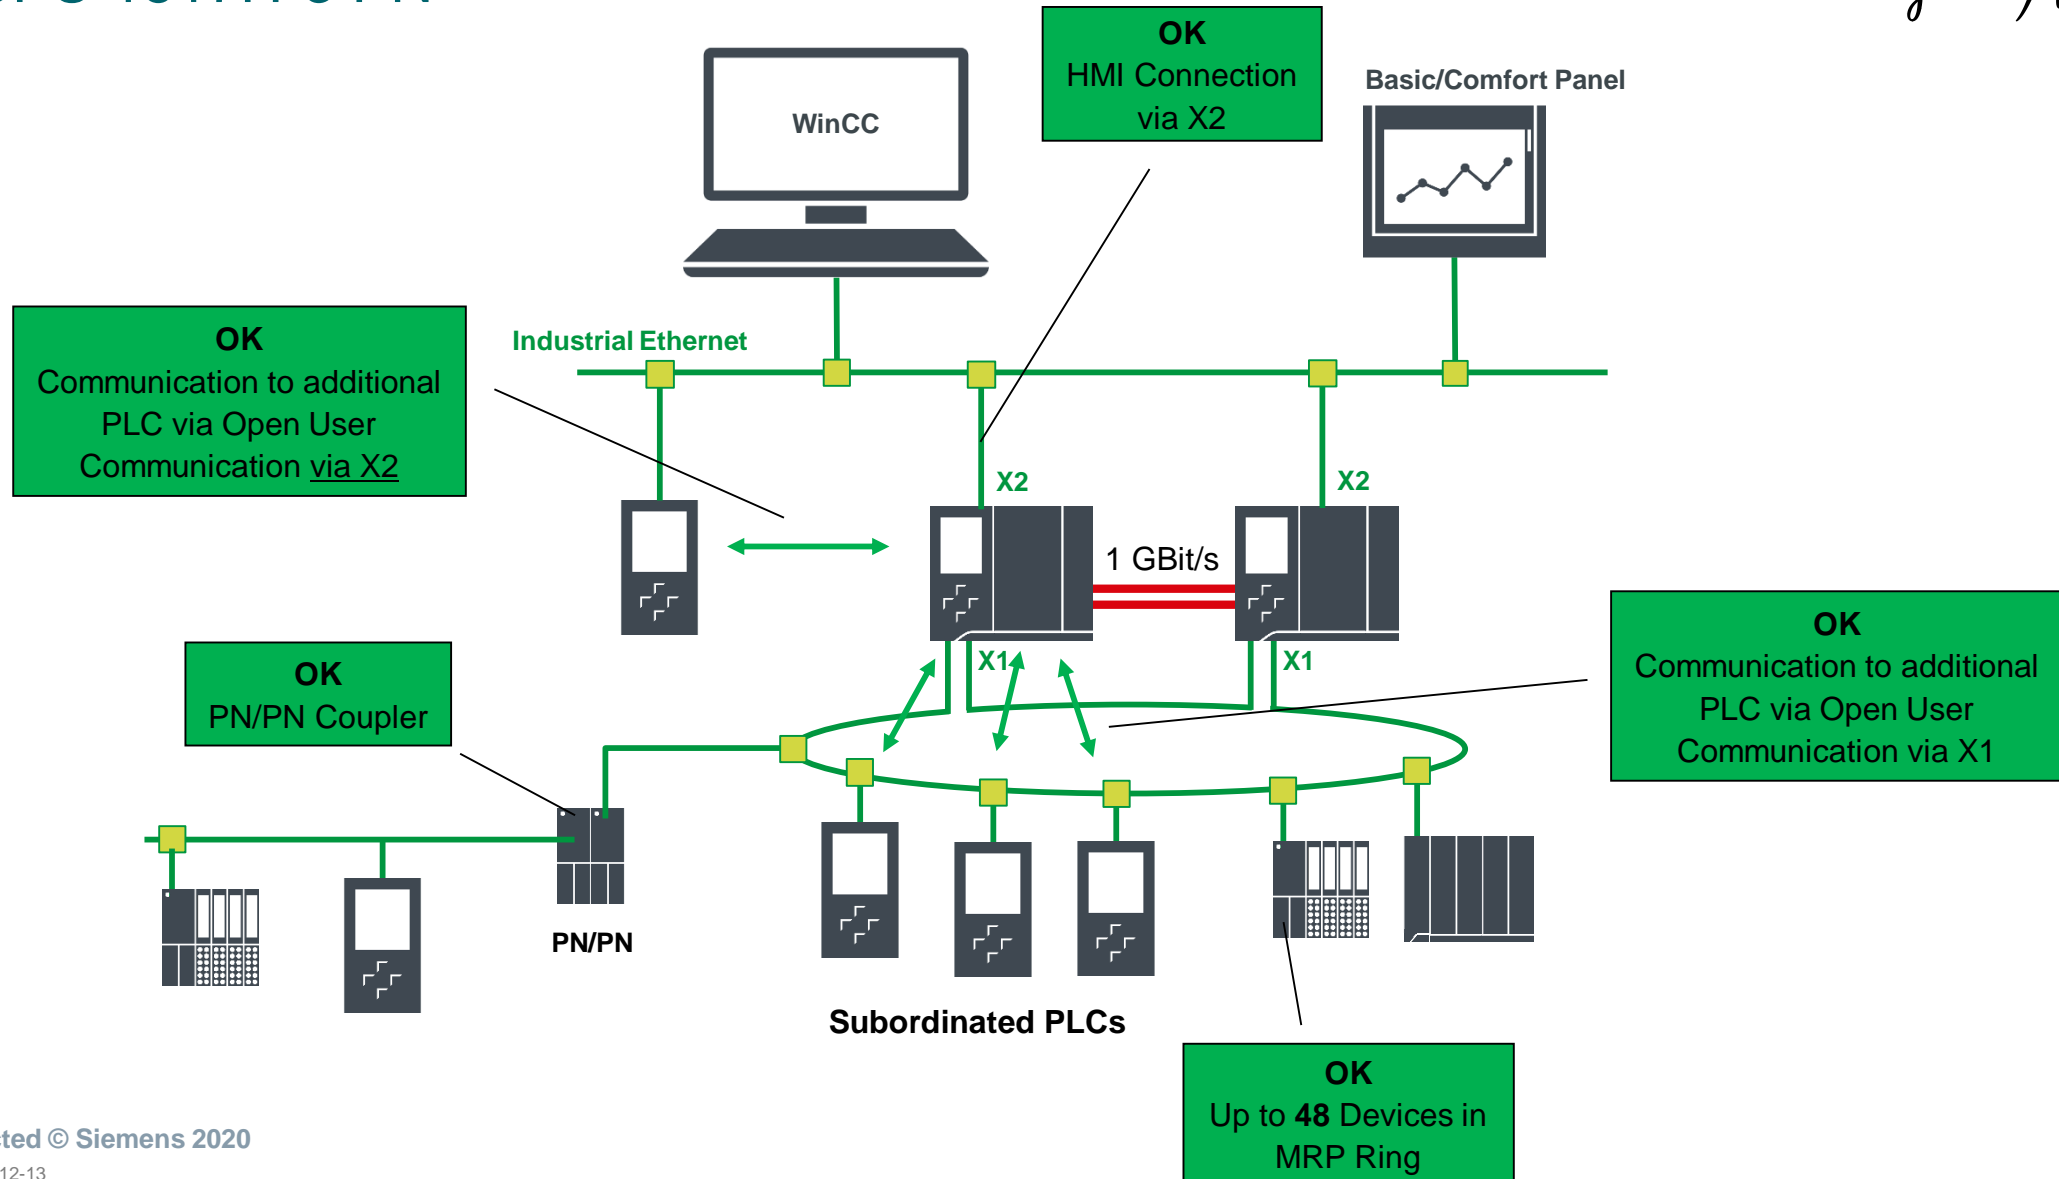

# SIMATIC S7-1500 Redundant Systems

- Motivation and Product Strategy
- System Overview
- Add In and System Redundancy and Network Configuration
- Communication
- S7-1500R/H and Safety
- HMI Connection
- Installation Recommendations
- **New Features with TIA Portal V16**
- **Remaining Restrictions**
- **Ordering Information**



# SIMATIC S7-1500 R/H

## New Features with V16 and Firmware Version 2.8



### New Features and improvements

**Connection of standard (non redundant) PN devices: Switched S1**

**Program Download in Run-Redundant Mode**

**IP Forwarding**

**Significantly reduced communication breakdown time during Sync-Up**

### Reduction of functional gaps compared with S7-1500

**Support of Alarm SFC's and Diagnosis SFC's**

**Support of ProDiag und S7-Graph**

**Support of PNIO SFB's**


**Support of Loop Control Blocks (PID)**

**S7-Routing**


# New in V16: Program Download in RUN-Redundant Mode

The Backup-PLC can remain in RUN redundant during program download

V15.1

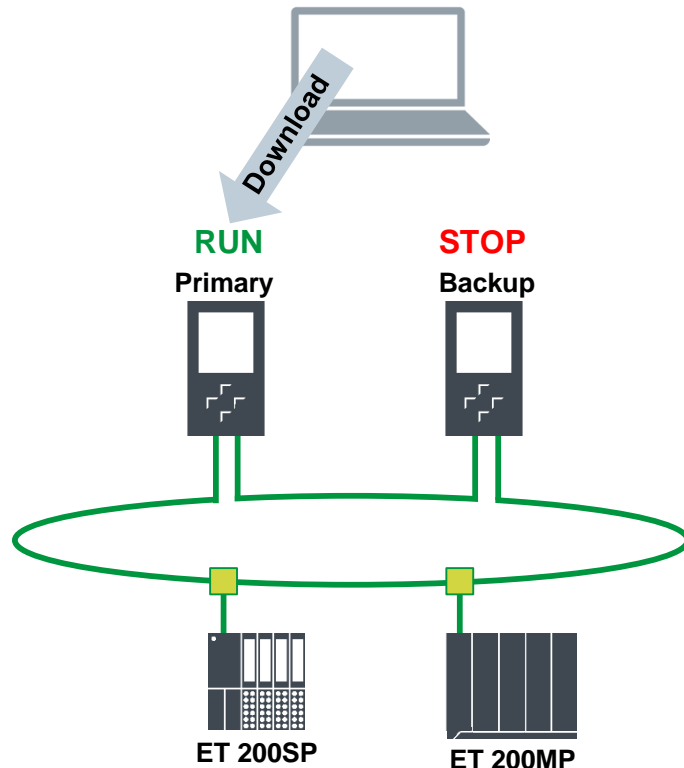

V16

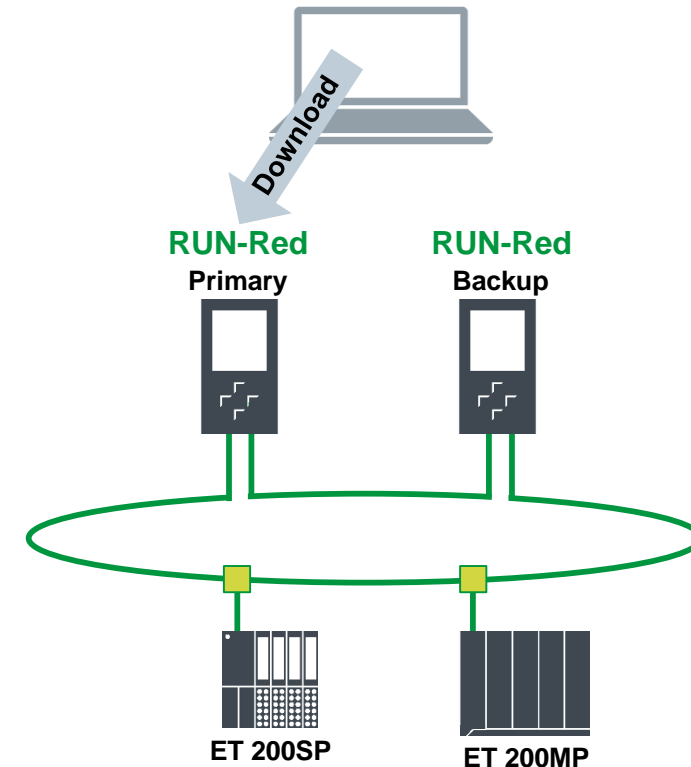


### Benefits:

- No RUN/STOP handling of Backup PLC required
- No SyncUp Phase (with temporary loss of communication)
- User Program is synchronized automatically


# New in V16: Mode „Switched S1 Device“

Also devices without System Redundancy Feature (S1) can be connected

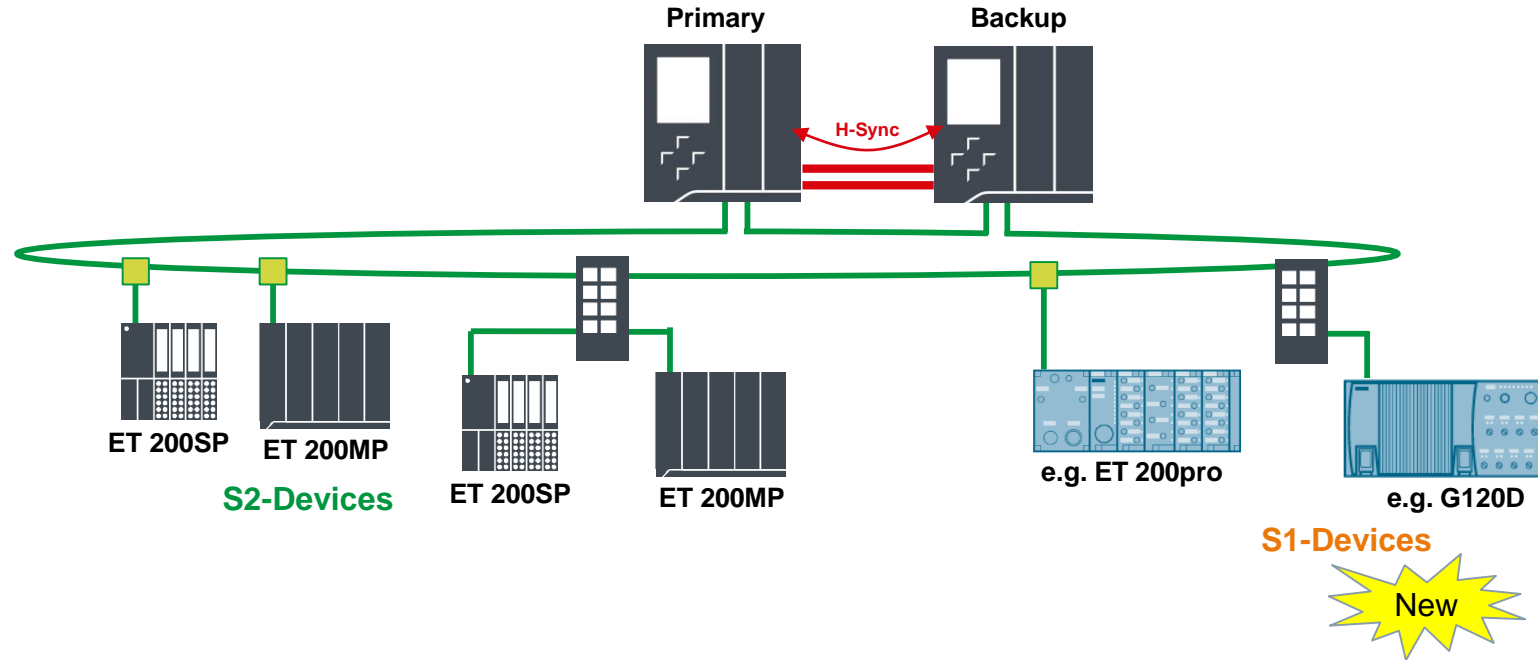

System Behavior when Primary-Backup switch occurs	S2-Devices (with System Redundancy)	S1-Devices (without System Redundancy)
<b>Activation time of device</b>	Very short (50ms +) because backup communication relation is already established	Some seconds (depended on the device itself) since device is restarted
<b>Behavior of Outputs</b>	Keeps last valid value during failover	If the device supports the function "Hold last value" → no difference to S2 Otherwise: Outputs switches to "0" during activation time.

# New in V16: Mode „Switched S1 Device“ Comparison with System Redundancy S2

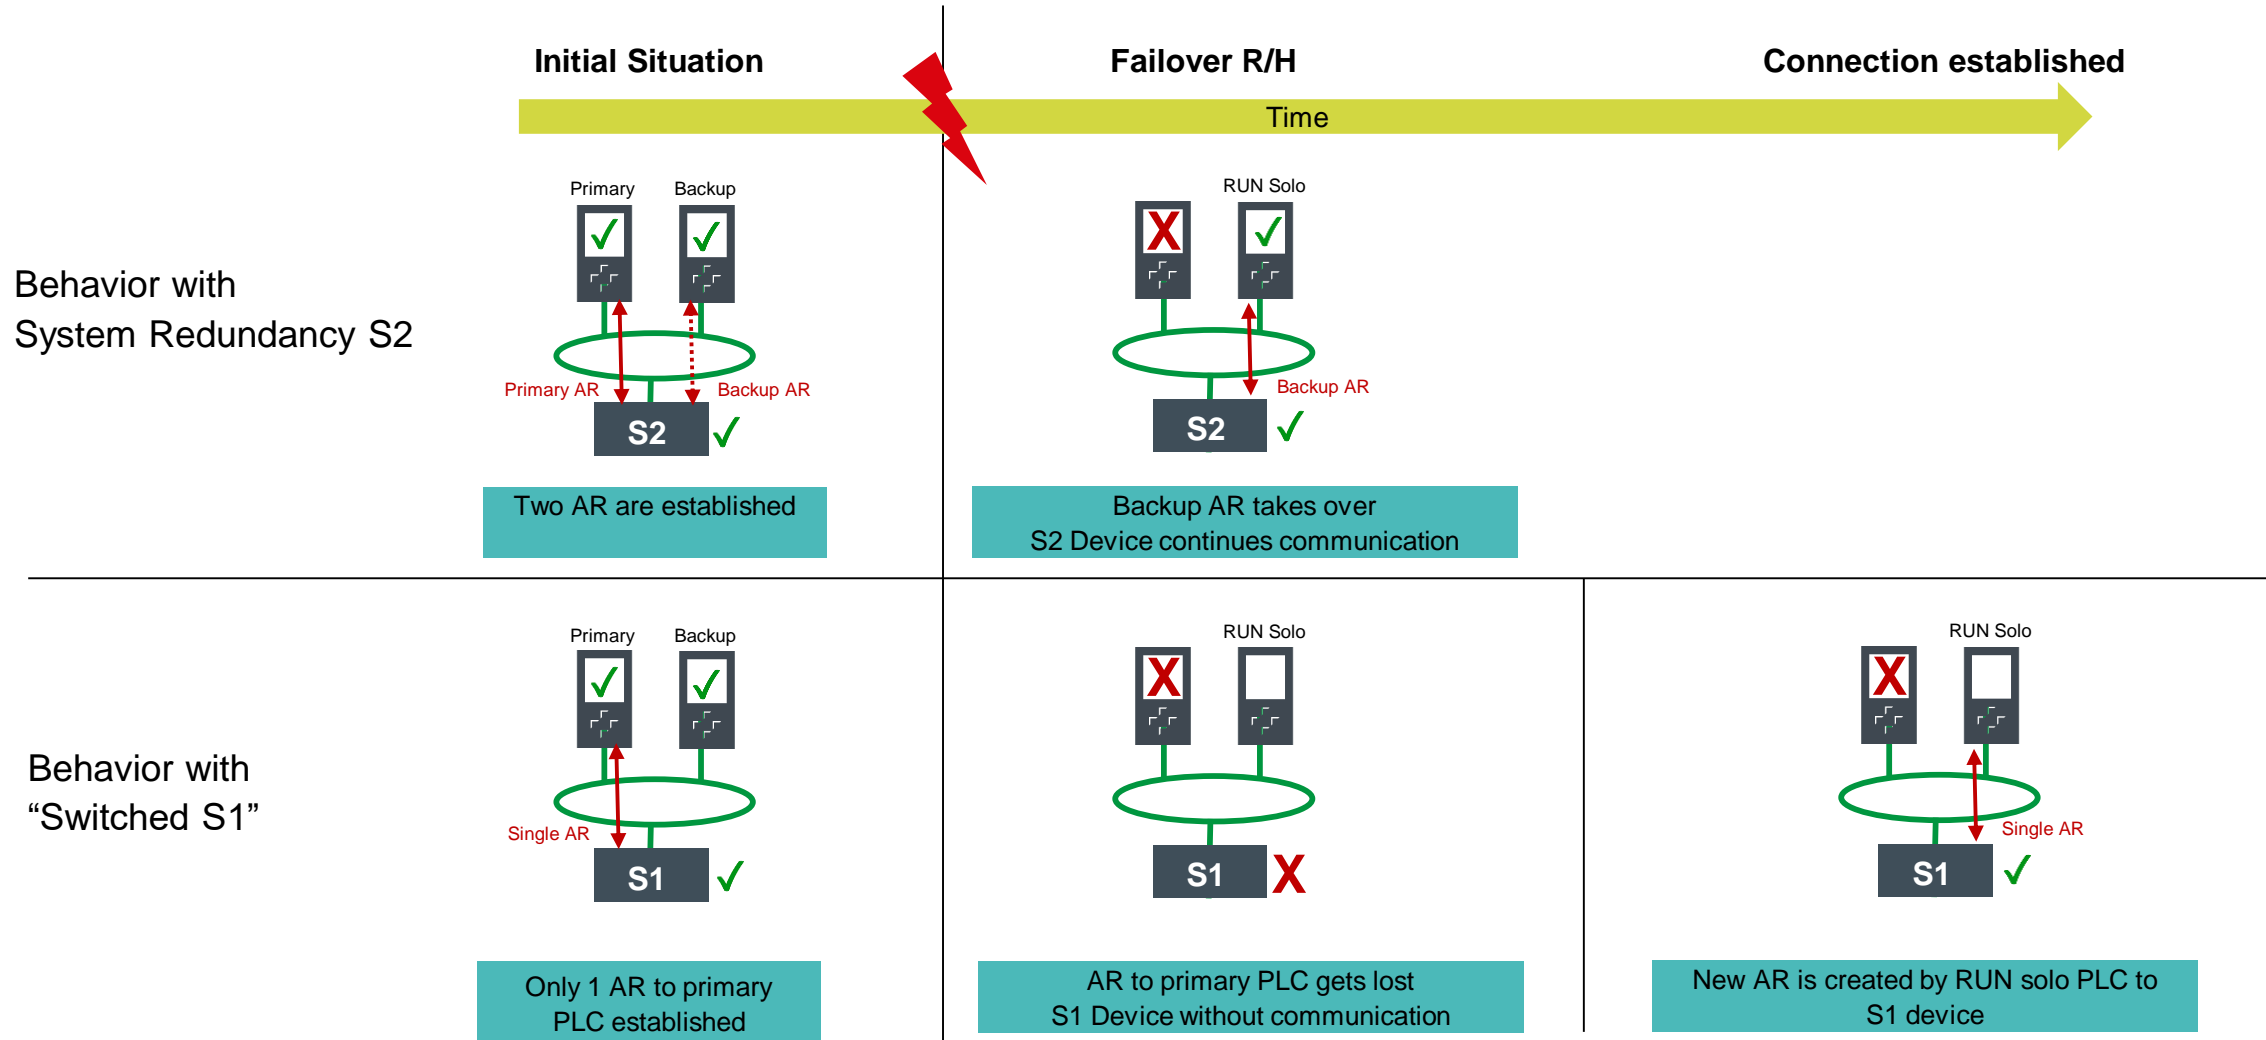



# New in V16: Mode „Switched S1 Device“

## Visualization of redundancy modes in TIA Portal

Partner 1	Partner 2	Interfa...	Mode	Optional...
1	▼ R-PLC_1			<input type="checkbox"/>
2	▼ PROFINET-S...			<input type="checkbox"/>
3	X1	↔ ET200SP-02	PROFIN... IO device(S2)	<input type="checkbox"/>
4	X1	↔ et200mp-01	PROFIN... IO device(S2)	<input type="checkbox"/>
5	X1	↔ ET200S-01	PROFIN... IO device(S1)	<input type="checkbox"/>
6	▼ R-PLC_2			<input type="checkbox"/>
7	▼ PROFINET-S...			<input type="checkbox"/>
8	X1	↔ ET200SP-02	PROFIN... IO device(S2)	<input type="checkbox"/>
9	X1	↔ et200mp-01	PROFIN... IO device(S2)	<input type="checkbox"/>
10	X1	↔ ET200S-01	PROFIN... IO device(S1)	<input type="checkbox"/>
11				<input type="checkbox"/>

In the network view S1 and S2 devices are marked as „Multi-assigned“

Differences are shown in the column „Mode“ of the I/O communication table. Here: ET 200MP is connected as S2 device


# New in V16: Support of STEP 7 Graph

## Function

- The graphical engineering language STEP 7 GRAPH is available for the S7-1500 R/ H Controller

## Benefit of the function

- Graphical programming language for creating of sequence controls and processes on S7-1500 R/H CPUs
- Identical behavior regarding used language and editor for S7-1500 R/H CPUs and „standard“ CPUs
- Depending on the application the user is free to choose the appropriate programming language within the engineering of S7-1500 R/H CPUs

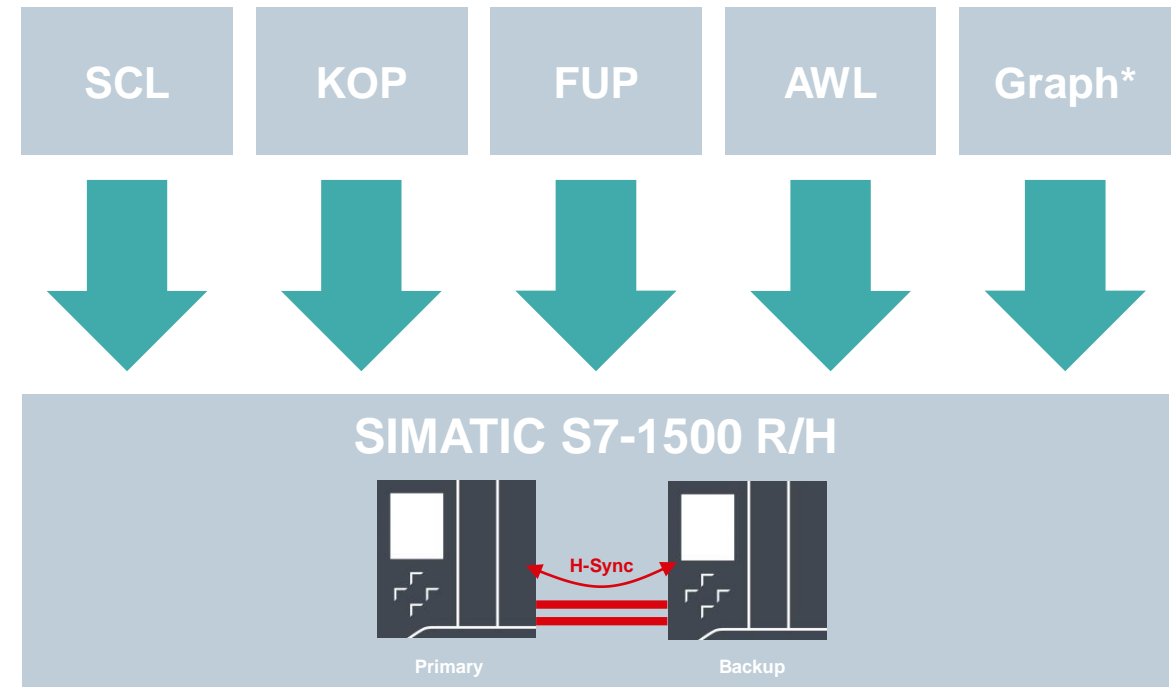

Identical engineering languages for Standard- and S7-1500R/H controllers

# New in V16: Support of additional blocks

Program Block	
<b>Program_Alarm</b>	Generate program alarm with associated values
<b>Get_AlarmState</b>	Output alarm state
<b>Gen_UsrMsg</b>	Generate user diagnostic messages
<b>Get_Alarm</b>	Read pending alarm
<b>Ack_Alarms</b>	Acknowledge alarms

Technology	
<b>PID_Compact</b>	Universal PID controller with integrated optimization
<b>PID_3Step</b>	PID controller with integrated optimization for valves
<b>PID_Temp</b>	PID controller for temperature

Advances Instructions	
<b>GETIO / GETIO_PART</b>	Read process image
<b>SETIO / SETIO_PART</b>	Transfer process image
<b>GetStationInfo</b>	Read information of an IO device
<b>DeviceStates</b>	Read module state information in an IO system
<b>GEN_DIAG</b>	Generate diagnostics information

# Restrictions for S7-1500R/H

## Restrictions of the configuration for S7-1500R/H

	S7-1500R/H	S7-1500	S7-400H
Single PLC projectable (H/R CPUs as redundant System only)	no	N/A	yes
Central periphery or central CPs / CMs projectable	no	yes	yes
Configure System-PS	no	yes	yes
Only MRP-Ring PN-Networks are supported (no „open Ring“ like in 400H)	yes	no	no
Operation as Shared Device or I-Device	no	yes	no

# Restrictions for S7-1500R/H

## Functional restrictions for S7-1500R/H

	S7-1500R/H	S7-1500	S7-400H
S7-Com, E-Mail, FDL, ISO, (OUC with dynamic connections is supported)	no <sup>1)</sup>	yes	yes
OPC UA	no	yes	no
System-supported H-communication (but the System IP-Address)	no	no	yes
Webserver	no	yes	no
System-supported redundant I/Os	no <sup>2)</sup>	no	yes
PROFIsafe	no	F-CPU	yes
Technology Objects	some <sup>3)</sup>	yes	no
Support for MRPD, clock synchrony and IRT	no	yes	no
CiR and firmware update in run is supported	no	no	yes
Direct migration through hardware replacement (Import of user programs via Copy/Paste)	no	n.a.	no
PLCsim and PLCsim advanced are supported	no	yes	yes

1) S7-Communication as server is supported  
2) Can be realized on application layer: See SIOS article [109767576](#)

3) TO Count, Measuring, PID are supported

# Ordering Information

## CPU S7-1500R

- CPU 1513R-1 PN                    6ES7 513-1RL00-0AB0
  - CPU 1515R-2 PN                    6ES7 515-2RM00-0AB0
- 

## CPU S7-1500H

- CPU 1517H-3 PN                    6ES7 517-3HP00-0AB0
- 

## Distance up to 10m between the S7-1500H PLCs

### Use of the Synchronization Modules for FO cables up to 10 m

- MLFB Module:                    6ES7960-1CB00-0AA5
- MLFB LWL-Cable 1m:            6ES7960-1BB00-5AA5
- MLFB LWL-Cable 2m:            6ES7960-1BC00-5AA5
- MLFB LWL-Cable 10m:          6ES7960-1CB00-5AA5

## Distance up to 10km between the PLCs

- MLFB Module:                    6ES7960-1FB00-0AA5
  - Monomode LWL-Cable LC/LC Duplex Crossed 9/125 $\mu$
- 

## S7-1500H Bundle (Consisting of 2 CPU 1517-3 PN, 4 Sync-Modules 10m and 2 Sync-Cables 1m)

- 6ES7500-0HP00-0AB0



**Thanks for listening**

**Steve Harris**

Applications Engineer Factory Automation

Siemens Australia

DI FA

185 Great Eastern Hwy

Belmont WA 6104

Mobile: +61 427 501 185

[steveharris@siemens.com](mailto:steveharris@siemens.com)

Restricted © Siemens 2020